

TRIPLEX DWELLING UNIT

OPTION #2

2-BEDROOMS / 2-BATH / COVERED GARAGE

COVERED PORCH AND PATIO



OWNER: _____
ADDRESS: _____
TEL. NO.: _____

PROJECT INFORMATION



PROJECT OF:
THE COUNTY OF FRESNO
DEPARTMENT OF PUBLIC WORKS AND PLANNING

Capital Projects Division
2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

SCOPE OF WORK:

PROPOSED ONE (1) STORY MULTI-FAMILY DWELLING UNIT
WITH THREE (3) UNITS TOTAL.

NUMBER OF BEDROOMS / UNIT : TWO (2)
NUMBER OF BATHROOMS: TWO (2)

	SQ.FT. / UNIT	TOTAL SQ.FT
FLOOR AREA (CONDITIONED SPACE)	966	2898
COVERED PORCH	76	228
COVERED PATIO	147	441
GARAGE	332	996
TOTAL	1521	4563

BUILDING DATA:

OCCUPANCY CLASSIFICATION: R2 / U
GROUP USE : (R-2) APARTMENT / (U) GARAGE
TYPE OF CONSTRUCTION: VB
SPRINKLERED: YES

STRUCTURAL DESIGN CRITERIA:

ROOF: DEAD LOAD = 20 PSF
LIVE LOAD = 20 PSF
WIND SPEED = 110 MPH (ALLOWABLE STRESS) / EXPOSURE C, LOW-
RISE BUILDING
SEISMIC DESIGN CATEGORY: D
SS = 0.557
SDS = 0.56*
Fa = 1.374
SNOW LOAD = NONE
ALLOWABLE SOIL PRESSURE: 1500 PSF PER CBC 2022
CONCRETE DESIGN STRENGTH OF 2500 PSI PER CBC TABLE 1808.8.1.

DEFERRED SUBMITTAL ITEMS

THE OWNER / APPLICANT IS RESPONSIBLE FOR
PREPARING DOCUMENTATION, APPLICATIONS,
PROCESSING THROUGH THE AUTHORITY HAVING
JURISDICTION AND PAYING ALL APPLICABLE FEES
FOR THE DEFERRED SUBMITTALS. REFER TO "RIGHTS
AND LIMITATIONS OF USING PRE-APPROVED PLANS"
FOR ADDITIONAL INFORMATION.

- ROOF TRUSSES
- FIRE SPRINKLERS
- SOLAR PV KW DC per TITLE 24
 - MINIMUM 2.64 kW DC (Option 2- Unit 1)
 - MINIMUM 2.64 kW DC (Option 2- Unit 2)
 - MINIMUM 2.66 kW DC (Option 2- Unit 3)
- HVAC - DUCTED MINI-SPLIT HEAT PUMP
HAVING HEATING EFF. 9 HSPF AND COOLING
EFF. 16.85 SEER 11.7 EER. (MODEL -
LH248HV4) WITH PERMANENTLY INSTALLED
WALL MOUNTED THERMOSTAT @ LIVING
ROOM.

REQUIREMENTS

FIRE DEPARTMENT APPROVAL MUST BE OBTAINED. PROVIDE
EVIDENCE OF FIRE PROTECTION DISTRICT APPROVAL TO MATTHEW
B. LOPEZ, PLANS EXAMINER AT (559) 600-4324 OR E-
MAIL, mattlopez@fresnocountyca.gov.

FOR QUESTIONS REGARDING ZONING REQUIREMENTS, CONTACT:
ZONING, AT (559) 600-4540 OR E-MAIL: zoningenforcement2@fresnocountyca.gov

FOR QUESTIONS REGARDING GRADING REQUIREMENTS, CONTACT:
DANA RITSCHER, AT (559) 600-4212 OR EMAIL:
dritschel@fresnocountyca.gov

FOR QUESTIONS REGARDING CODE ENFORCEMENT COMMENTS,
CONTACT: Elisania Harrison at (559) 600-2519 or e-mail,
eharrison@fresnocountyca.gov

DRAWING INDEX

A-100	COVER SHEET
G-101	GENERAL NOTES
G-102	GENERAL NOTES
A-201	PROPOSED FLOOR PLAN
A-202	TYPICAL FLOOR PLAN - ENLARGED VIEW
A-203	PROPOSED ROOF PLAN
A-301	ELEVATIONS
A-401	BUILDING SECTIONS
A-501	ENLARGED ADAPTABLE KITCHEN & DETAILS
A-502	ADAPTABLE BATHROOM DETAILS
A-601	OPENING SCHEDULES
A-801	ARCHITECTURAL DETAILS
A-802	ARCHITECTURAL DETAILS
A-803	ARCHITECTURAL DETAILS
A-804	WALL SIDING TYPICAL DETAILS
A-805	CLOTHES DRYER EXHAUST DETAILS
A-806	TYPICAL FIRESTOP DETAILS
A-807	TYPICAL FIRESTOP DETAILS
A-808	TYPICAL FIRESTOP DETAILS
A-809	TYPICAL FIRESTOP DETAILS
GBC-1	GREEN BUILDING MANDATORY MEASURES 1
GBC-2	GREEN BUILDING MANDATORY MEASURES 2
S-101	TYPICAL WOOD FRAMING DETAILS
S-102	TYPICAL STRUCTURAL DETAILS
S-103	FASTENING SCHEDULE (COMMERCIAL)
S-201	FOUNDATION PLAN
S-202	SHEAR WALL PLAN
S-203	ROOF FRAMING PLAN
S-301	STRUCTURAL DETAILS
M001	GN, LEGEND AND SCHEDULES
M002	MECHANICAL DETAILS
M100	MECHANICAL FLOOR PLAN
P001	PLUMBING GENERAL NOTES, LEGEND AND SCHEDULES
P002	PLUMBING DETAILS
P100	PLUMBING FLOOR PLAN
E-101	ELECTRICAL FLOOR PLAN
T24-1.1	TITLE 24 ENERGY COMPLIANCE
T24-1.2	TITLE 24 ENERGY COMPLIANCE
T24-2.1	TITLE 24 ENERGY COMPLIANCE
T24-2.2	TITLE 24 ENERGY COMPLIANCE
T24-3.1	TITLE 24 ENERGY COMPLIANCE
T24-3.2	TITLE 24 ENERGY COMPLIANCE
MM-1.1	TITLE 24 MANDATORY COMPLIANCE
MM-2.1	TITLE 24 MANDATORY COMPLIANCE
MM-3.1	TITLE 24 MANDATORY COMPLIANCE

8.5" x 11" ATTACHMENTS:
STRUCTURAL ANALYSIS
TITLE 24 DOCUMENTATION

ADDITIONAL REQUIREMENTS

- STATE LAW REQUIRES THIS PROJECT COMPLY WITH THE
CURRENT EDITION OF THE CALIFORNIA FIRE CODE. CONTACT
THE FOLLOWING FIRE PROTECTION DISTRICT AND OBTAIN
APPROVALS PRIOR TO OBTAINING THE PERMITS FROM THE
COUNTY OF FRESNO. VERIFY THE SITE ADDRESS WITH THE
CORRECT JURISDICTION BELOW:

FRESNO COUNTY FIRE PROTECTION DISTRICT
1700 JENSEN AVENUE SUITE 103
SANGER, CA. 93657
PHONE: (559) 319-0400

CITY OF FRESNO FIRE DEPARTMENT
911 H ST
FRESNO, CA. 93721
PHONE: (559) 621-4000

THE COUNTY OF FRESNO
DEPARTMENT OF PUBLIC WORKS AND PLANNING
DEVELOPMENT SERVICES
2220 TULARE ST. STREET LEVEL.
FRESNO, CA. 93721
PHONE (559) 600-4219

NORTH CENTRAL FIRE DEPARTMENT
15850 W. KEARNEY BLVD.
KERMAN, CA. 93630
PHONE (559) 275-5531

CSA 50 - AUBERRY VOLUNTEER FIRE DEPARTMENT
PO BOX 191
AUBERRY, CA. 93602
559-855-2777

SHAVER LAKE FIRE DISTRICT
41795 TOLLHOUSE
SHAVER LAKE, CA. 93664
559-841-8136

ORANGE COVE FIRE DEPARTMENT
550 CENTER STREET
ORANGE COVE, CA. 93646
559-626-7758

- PROVIDE A COMPLETE SITE PLAN AS PART OF THE PLANS,
DRAWN TO SCALE, ON A FULL-SIZE SHEET WITH THE
FOLLOWING INFORMATION:
 - PROVIDE PROPERTY LINE DIMENSIONS.
 - INDICATE A NORTH ARROW.
 - DIMENSION DISTANCES TO ALL PROPERTY LINES AND
ADJACENT BUILDINGS.
 - LOCATE THE FOLLOWING:
 - ALL STRUCTURES ON-SITE.
 - EASEMENTS AND SETBACKS.
 - MECHANICAL OR OTHER GROUND MOUNTED
EQUIPMENT.
 - LPG TANKS OR GAS METER.
 - WELLS OR WATER METERS.
 - SEPTIC SYSTEMS (INCLUDING 100% EXPANSION AREA
FOR LEACHING FIELD) OR SEWER CONNECTIONS.
 - DRIVEWAY (MATERIALS TO BE USED FOR THE
DRIVEWAY).
- PROVIDE A DRAINAGE PLAN FOR THE DEVELOPED PORTION OF
THE PROPERTY.
 - FOR VALLEY FLOOR ("FLAT" LAND) PARCELS, ADDRESS THE
FOLLOWING:
 - SHOW THE DRAINAGE AWAY FROM THE PROPOSED
CONSTRUCTION. "PROVIDE A TWO PERCENT SLOPE
AWAY FROM THE PROPOSED BUILDING FOR A
MINIMUM OF FIVE FEET." [FCOC 15.08.020 O].
 - SHOW DRAINAGE PATTERNS TO THE STREET OR AN
APPROVED DRAINAGE FACILITY.
 - PROVIDE ACTUAL/RELATIVE ELEVATIONS FOR THE
BUILDING PAD, LOT CORNERS AND CROWN OF
ADJACENT STREETS. "FINISH FLOOR ELEVATION IS TO
BE ABOVE THE CROWN OF THE STREET."
 - DELINEATE THE EXTENT OF THE BUILDING PAD WITH
DIMENSIONS FROM THE BUILDING TO THE EDGE OF
THE PAD.
 - FOR ALL FOOTHILL AND MOUNTAIN PARCELS WITH SLOPED
GRADES, ADDRESS THE FOLLOWING:
 - SHOW THE DRAINAGE AWAY FROM THE PROPOSED
CONSTRUCTION. "PROVIDE A TWO PERCENT SLOPE
AWAY FROM THE PROPOSED BUILDING FOR A
MINIMUM OF FIVE FEET." [FCOC 15.08.020 O].
 - SHOW DRAINAGE PATTERNS TO THE STREET OR AN
APPROVED DRAINAGE FACILITY (EXISTING AND
PROPOSED CONTOURS) INCLUDING:
 - TERRACING.
 - SWALES.
 - RETAINING WALLS.
 - ROOF RAINWATER RUNOFF. SHOW GUTTERS
AND DOWNSPOUT DISCHARGE LOCATIONS.
 - DELINEATE THE EXTENT OF THE BUILDING PAD WITH
DIMENSIONS FROM THE BUILDING TO THE EDGE OF THE
PAD.
 - CUT AND FILL AREAS (WITH QUANTITIES IN CUBIC YARDS)
ON BOTH PLAN AND SCHEMATIC (SECTION) VIEWS IN BOTH
DIRECTIONS.
 - DRIVEWAYS AND PRIVATE ROADS SHALL HAVE A MAXIMUM
SLOPE OF 12%. THE GRADE MAY BE INCREASED TO A
MAXIMUM OF 20% FOR PAVED SURFACES." [FCOC
15.60.505].

ADD THE FOLLOWING NOTES ON THE SITE OR DRAINAGE PLANS:
A. "FINISH FLOOR ELEVATION IS TO BE ABOVE THE CROWN OF
THE STREET."
B. "PROVIDE A TWO PERCENT SLOPE AWAY FROM THE
PROPOSED BUILDING FOR A MINIMUM OF FIVE FEET." [FCOC
15.08.020 O].
C. "DRIVEWAYS AND PRIVATE ROADS SHALL HAVE A
MAXIMUM SLOPE OF 12%. THE GRADE MAY BE INCREASED TO A
MAXIMUM OF 20% FOR PAVED SURFACES." [FCOC 15.60.505].

APPLICABLE CODE

2022 CALIFORNIA ADMINISTRATIVE CODE
2022 CALIFORNIA BUILDING CODE
2022 CALIFORNIA PLUMBING CODE
2022 CALIFORNIA MECHANICAL CODE
2022 CALIFORNIA ELECTRICAL CODE
2022 CALIFORNIA FIRE CODE
2022 CALIFORNIA RESIDENTIAL CODE
2022 CALIFORNIA ENERGY CODE
2022 CALIFORNIA GREEN BUILDING CODE
2022 CALIFORNIA REFERENCE STANDARDS CODE
FRESNO COUNTY ORDINANCE TITLE 15

REFER TO G-101 , G-102 FOR ADDITIONAL INFORMATION.

GENERAL NOTES:

- CONSTRUCTION WASTE MANAGEMENT PLAN MUST BE FINALIZED PRIOR TO OCCUPANCY.
- INSTALL STREET ADDRESS NUMERALS, AT LEAST FOUR INCHES HIGH WITH MINIMUM 1/2-INCH
STROKE, MOUNTED ON A CONTRASTING BACKGROUND CLEARLY VISIBLE FROM THE STREET.
- PRIOR TO PERMIT ISSUANCE, PROVIDE AN ADDITIONAL FLOOR PLAN AND SITE PLAN FOR USE BY THE
ASSESSOR'S OFFICE.

RIGHTS AND LIMITATIONS IN USING PRE-APPROVED PLANS


- RIGHTS OF THE OWNER / BUILDER:
 - THE OWNER / BUILDER HAS THE RIGHT TO UTILIZE THE PRE-APPROVED PLANS FOR THEIR
INTENDED CONSTRUCTION PROJECT, SUBJECT TO COMPLIANCE WITH APPLICABLE
REGULATIONS AND GUIDELINES.
- RESPONSIBILITY OF THE OWNER / BUILDER:
 - THE OWNER / BUILDER IS RESPONSIBLE FOR SUBMITTING ALL ITEMS LISTED UNDER THE
DEFERRED SUBMITTAL AS REQUIRED BY THE RELEVANT AUTHORITIES. THIS INCLUDES ANY
ADDITIONAL DOCUMENTS, PERMITS, OR INFORMATION THAT WERE NOT INCLUDED IN THE PRE-
APPROVED PLANS.
 - THE OWNER / BUILDER MUST ENSURE THAT THE CONSTRUCTION PROJECT ADHERES TO ALL
RELEVANT BUILDING CODES, ZONING REGULATIONS, AND OTHER APPLICABLE LAWS.
 - IT IS THE RESPONSIBILITY OF THE OWNER / BUILDER TO SECURE APPROVAL FROM THE ZONING
DEPARTMENT FOR SITE-SPECIFIC LOCATIONS. THE PRE-APPROVED PLANS DO NOT INCLUDE
SUCH SITE-SPECIFIC DETAILS, AND THE OWNER / BUILDER MUST OBTAIN NECESSARY PERMITS
OR VARIANCES AS REQUIRED.
- LIMITATIONS ON SITE-SPECIFIC LOCATIONS:
 - THE PRE-APPROVED PLANS DO NOT PROVIDE SITE-SPECIFIC INFORMATION OR DETAILS
REGARDING THE CONSTRUCTION SITE. THE OWNER / BUILDER MUST CONSULT WITH THE
APPROPRIATE AUTHORITIES, SUCH AS THE ZONING DEPARTMENT, TO OBTAIN THE NECESSARY
APPROVALS FOR THE SPECIFIC LOCATION OF THE CONSTRUCTION PROJECT.
 - THE OWNER / BUILDER MUST COMPLY WITH ALL ZONING REGULATIONS, SETBACK
REQUIREMENTS, ENVIRONMENTAL CONSIDERATIONS, AND ANY OTHER SITE-SPECIFIC
RESTRICTIONS IMPOSED BY THE RELEVANT AUTHORITIES.
- COMPLIANCE WITH BUILDING CODES AND REGULATIONS:
 - THE OWNER / BUILDER MUST ENSURE THAT THE CONSTRUCTION PROJECT COMPLIES WITH ALL
APPLICABLE BUILDING CODES, REGULATIONS, AND STANDARDS, EVEN IF THE PRE-APPROVED
PLANS WERE UTILIZED.
 - THE USE OF PRE-APPROVED PLANS DOES NOT EXEMPT THE OWNER / BUILDER FROM
FULFILLING THEIR OBLIGATIONS TO OBTAIN ALL NECESSARY PERMITS AND APPROVALS AS
REQUIRED BY LOCAL, STATE, AND FEDERAL REGULATIONS.
- LIABILITY AND INDEMNIFICATION:
 - THE OWNER / BUILDER ASSUMES ALL LIABILITY AND RESPONSIBILITY FOR THE CONSTRUCTION
PROJECT, INCLUDING ANY CONSEQUENCES ARISING FROM THE USE OF THE PRE-APPROVED
PLANS.
 - THE OWNER / BUILDER AGREES TO INDEMNIFY AND HOLD HARMLESS THE RELEVANT
AUTHORITIES, ARCHITECTS, ENGINEERS, AND ANY OTHER PARTIES INVOLVED IN THE
APPROVAL PROCESS, FROM ANY CLAIMS, DAMAGES, OR LIABILITIES ARISING OUT OF THE USE
OF THE PRE-APPROVED PLANS OR THE CONSTRUCTION PROJECT.
- GEOGRAPHIC LIMITATIONS:
 - THE PRE-APPROVED PLANS ARE NOT INTENDED FOR AREAS SUBJECT TO SNOW LOAD,
WILDFIRE RISK, FLOOD ZONES, OR OTHER SPECIFIC GEOGRAPHIC CONDITIONS.
 - THE OWNER / BUILDER ACKNOWLEDGES AND UNDERSTANDS THAT THE PRE-APPROVED PLANS
MAY NOT ACCOUNT FOR UNIQUE SITE CONDITIONS.
- SITE-SPECIFIC CONSIDERATIONS:
 - THE OWNER / BUILDER MUST ASSESS AND ADDRESS ANY SITE-SPECIFIC FACTORS THAT ARE
NOT COVERED BY THE PRE-APPROVED PLANS, INCLUDING BUT NOT LIMITED TO SOIL
CONDITIONS, TOPOGRAPHY, DRAINAGE, AND OTHER ENVIRONMENTAL CONSIDERATIONS.
 - IT IS THE RESPONSIBILITY OF THE OWNER / BUILDER TO ENGAGE THE NECESSARY
PROFESSIONALS, SUCH AS GEOTECHNICAL ENGINEERS OR ENVIRONMENTAL CONSULTANTS,
TO EVALUATE AND MITIGATE ANY SITE-SPECIFIC RISKS OR CHALLENGES.
- COMPLIANCE WITH LOCAL REGULATIONS:
 - THE OWNER / BUILDER MUST COMPLY WITH ALL LOCAL, STATE, AND FEDERAL REGULATIONS
THAT APPLY TO THEIR SPECIFIC GEOGRAPHIC AREA, INCLUDING BUT NOT LIMITED TO BUILDING
CODES, ZONING ORDINANCES, FIRE CODES, AND ENVIRONMENTAL REGULATIONS.
 - THE USE OF THE PRE-APPROVED PLANS DOES NOT EXEMPT THE OWNER / BUILDER FROM
FULFILLING THEIR OBLIGATIONS TO ADHERE TO THESE LOCAL REGULATIONS AND OBTAIN ANY
NECESSARY PERMITS OR APPROVALS.
- MODIFICATION RESTRICTIONS:
 - THE OWNER / BUILDER SHOULD BE AWARE THAT MODIFICATIONS TO THE PRE-APPROVED
PLANS MAY BE REQUIRED TO ADDRESS SPECIFIC SITE CONDITIONS OR MEET LOCAL
REGULATIONS. ANY SUCH MODIFICATIONS MUST BE CARRIED OUT IN COMPLIANCE WITH THE
APPLICABLE LAWS AND REGULATIONS.
 - THE OWNER / BUILDER MAY NEED TO ENGAGE DESIGN PROFESSIONALS, SUCH AS ARCHITECTS
OR ENGINEERS, TO REVIEW AND REVISE THE PRE-APPROVED PLANS AS NECESSARY TO
ENSURE COMPLIANCE WITH LOCAL REQUIREMENTS.
- RELIANCE AND VERIFICATION:
 - THE OWNER / BUILDER ACKNOWLEDGES THAT THE USE OF PRE-APPROVED PLANS IS BASED
ON THE ASSUMPTION THAT THEY ARE ACCURATE, COMPLETE, AND COMPLIANT WITH
RELEVANT REGULATIONS.
 - HOWEVER, THE OWNER / BUILDER ALSO UNDERSTANDS THAT IT IS THEIR RESPONSIBILITY TO
VERIFY THE SUITABILITY AND APPLICABILITY OF THE PRE-APPROVED PLANS FOR THEIR
SPECIFIC PROJECT AND SITE CONDITIONS. THEY SHOULD EXERCISE DUE DILIGENCE IN
CONFIRMING THE PLANS' ADEQUACY BEFORE PROCEEDING WITH CONSTRUCTION.

TRIPLEX DWELLING UNIT

OPTION #2

PROJECT

TRIPLEX
DWELLING UNIT

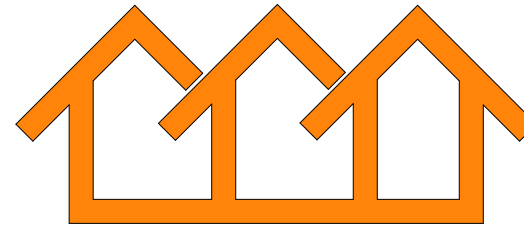

PWP23-005


DEPARTMENT OF PUBLIC
WORKS AND PLANNING



**CAPITAL PROJECTS
DIVISION**

2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

SEAL & SIGNATURE

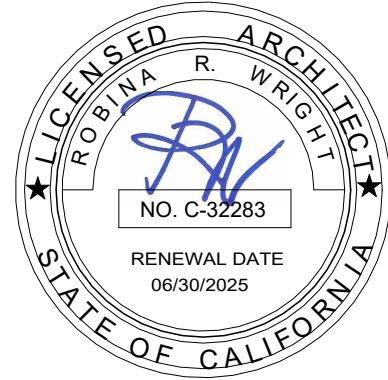

UPDATE

JANUARY 2, 2024

THESE DRAWINGS AND SPECIFICATIONS
ARE THE PROPERTY AND COPYRIGHT OF
THE ARCHITECT AND SHALL NOT BE
USED ON ANY OTHER PROJECT OR
LOCATIONS EXCEPT AS DESCRIBED ON
THE DRAWINGS WITHOUT WRITTEN
AGREEMENT WITH THE ARCHITECT.

TITLE

COVER SHEET

SCALE

As indicated

A-100

ISSUE DATE

JOB NUMBER

MARCH 7, 2023

2023_11

DRAWN BY

CHECKED BY

Author

Checker

GENERAL NOTES

1. SCOPE OF WORK SHALL BE CONSTRUCTED ACCORDING TO THESE WORKING DRAWINGS AS AGREED UPON BETWEEN OWNER AND CONTRACTOR. THE WORD "CONTRACTOR" REFERS TO THE GENERAL CONTRACTOR. "SUBCONTRACTOR" REFERS TO ONE HAVING DIRECT CONTACT WITH THE CONTRACTOR.
2. CONTRACTOR'S RESPONSIBILITIES:
- A. CONTRACTOR AND SUBCONTRACTORS SHALL VISIT THE JOB SITE BEFORE THEIR BID IS SUBMITTED TO FAMILIARIZE THEMSELVES WITH EXISTING CONDITIONS.
 - B. THE GENERAL CONTRACTOR SHALL READ, EXAMINE AND BE THOROUGHLY FAMILIAR WITH THESE DRAWINGS AND WITH THE EXISTING SITE CONDITIONS PRIOR TO THE START OF WORK. IN THE EVENT THERE ARE DISCREPANCIES OR OMISSIONS WITHIN THE DRAWINGS AND/OR SPECIFICATIONS, THE GENERAL CONTRACTOR SHALL NOTIFY THE ARCHITECT IMMEDIATELY.
 - C. CONTRACTOR SHALL INVESTIGATE SITE DURING CLEARING AND EARTHWORK OPERATIONS FOR FILLED EXCAVATIONS OR BURIED STRUCTURES SUCH AS CESSPOOLS, CISTERNS, FOUNDATION, ETC., AND BURIED ARTIFACTS SUCH AS INDIAN OR DINOSAUR BONES. IF ANY SUCH ITEMS ARE FOUND THE ARCHITECT, CIVIL ENGINEER, AND SOILS ENGINEER SHALL BE NOTIFIED IMMEDIATELY.
 - D. NO DRAWINGS, DETAILS, NOTES ETC., SHALL BE INTERPRETED TO ALLOW FOR A VIOLATION OF THE LOCAL BUILDING CODE, STATE BUILDING CODE AND OTHER APPLICABLE CODES AND GOOD CONSTRUCTION PRACTICES.
 - E. THE GENERAL CONTRACTOR SHALL REVIEW ALL GRADE ELEVATIONS PRIOR TO CONSTRUCTION.
 - F. CONTRACTORS SHALL VERIFY ALL DIMENSIONS, CONSTRUCTION METHODS, MATERIALS, SIZE OF MEMBERS, ETC., PRIOR TO ON-SITE DELIVERY.
 - G. CONTRACTOR SHALL TAKE ALL NECESSARY MEASURES TO FULLY PROTECT ADJACENT PROPERTIES. HIS JOB SHALL BE COMPLETED WITH AS MUCH SPEED AS POSSIBLE WHEN WORK BEGINS.
 - H. INSPECTIONS: THE CONTRACTOR SHALL OBTAIN ALL REQUIRED INSPECTIONS FOR HIS WORK AND GIVE THE OWNER THE RESULTS OF ALL INSPECTIONS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE GENERAL CONTRACTOR SHALL COORDINATE AND VERIFY WITH THE PLUMBING, MECHANICAL AND ELECTRICAL CONTRACTORS, THE SIZE AND LOCATION OF ALL PIPING, DUCTWORK, TRENCHES, SLEEVES, SPECIAL BOLTING FOR EQUIPMENT CONDUITS, ETC..
 - I. THE DESIGN, ADEQUACY AND SAFETY OF ERECTION, BRACING, SHORING, TEMPORARY SUPPORTS, ETC., IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR, AND HAS NOT BEEN CONSIDERED BY THE STRUCTURAL ENGINEER AND ARCHITECT.
 - J. THE CONTRACTOR SHALL PROVIDE ALL RISK INSURANCE. REFER TO PROJECT MANUAL FOR MINIMUM LIABILITY AND PROJECT DAMAGE COVERAGE.
 - K. THE GENERAL CONTRACTOR SHALL PROVIDE AND MAINTAIN TEMPORARY SANITARY FACILITY ENCLOSURES, LOCATE AS DIRECTED BY OWNER.
 - L. THE GENERAL CONTRACTOR AND ALL SUBCONTRACTORS SHALL COMPLY WITH ALL APPLICABLE LAWS AND CODE REGULATIONS.
 - M. CONTRACTOR SHALL TAKE FIELD MEASUREMENTS, VERIFY FIELD CONDITIONS, AND CAREFULLY COMPARE WITH THE CONSTRUCTION DOCUMENTS SUCH FIELD MEASUREMENTS, CONDITIONS, AND OTHER INFORMATION KNOWN TO CONTRACTOR BEFORE COMMENCING THE WORK. ERRORS, INCONSISTENCIES, OR OMISSIONS DISCOVERED AT ANY TIME SHALL BE PROMPTLY REPORTED IN WRITING TO THE OWNER / BUILDER.
 - N. CONTRACTOR SHALL PROMPTLY NOTIFY OWNER'S REPRESENTATIVE IF CONTRACTOR BECOMES AWARE DURING THE PERFORMANCE OF THE WORK THAT THE CONSTRUCTION DOCUMENTS ARE NOT IN COMPLIANCE WITH APPLICABLE CODE REQUIREMENTS.
 - O. BY SUBMITTAL OF BID, CONTRACTOR WARRANTS TO OWNER / BUILDER THAT ALL MATERIALS AND EQUIPMENT TO BE FURNISHED ARE NEW UNLESS NOTED OTHERWISE AND ALL WORK WILL BE OF GOOD QUALITY AND FREE FROM FAULTS AND DEFECTS.
 - P. SUBCONTRACTORS SHALL INSURE THAT ALL WORK IS DONE IN A PROFESSIONAL WORKMANLIKE MANNER BY SKILLED MECHANICS AND SHALL BE REPLACE ANY MATERIALS OR ITEMS DAMAGED BY SUB-CONTRACTOR'S PERFORMANCE. SUBCONTRACTORS AND SUPPLIERS ARE HEREBY NOTIFIED THAT THEY ARE TO BE CONSIDERED AS PART OF THE CONTRACTOR'S TEAM. THE CONTRACTOR SHALL BE RESPONSIBLE TO DETERMINE THE EXACT EXTENT AND OVERLAP OF EACH OTHER'S WORK AND TO SUCCESSFULLY COMPLETE THE EXECUTION OF THE WORK. ALL SUBCONTRACTOR WORKMANSHIP SHALL BE OF QUALITY TO PASS INSPECTIONS BY LOCAL AUTHORITIES, LENDING INSTITUTIONS, ARCHITECT OR BUILDER, ANY ONE OR ALL OF THE ABOVE MENTIONED INSPECTORS MAY INSPECT WORKMANSHIP AT ANY TIME, AND CORRECTIONS NEEDED TO ENHANCE THE QUALITY OF BUILDING WILL BE DONE IMMEDIATELY. EACH SUBCONTRACTOR, UNLESS SPECIFICALLY EXEMPTED BY THE TERMS OF HIS / HER'S SUBCONTRACT AGREEMENT, SHALL BE RESPONSIBLE FOR CLEANING UP AND REMOVING FROM THE JOB SITE ALL TRASH AND DEBRIS NOT LEFT BY OTHER SUBCONTRACTORS. OWNER / BUILDER WILL DETERMINE HOW SOON AFTER SUBCONTRACTOR COMPLETES EACH PHASE OF HIS / HER WORK THAT TRASH AND DEBRIS WILL BE REMOVED FROM THE SITE.
 - Q. APPROVAL BY THE BUILDING INSPECTOR DOES NOT MEAN APPROVAL OR ALLOWABLE FAILURE TO COMPLY WITH THE PLANS AND SPECIFICATIONS. ANY DESIGN WHICH FAILS TO BE CLEAR OR IS AMBIGUOUS MUST BE REFERRED TO THE ARCHITECT OR ENGINEER FOR INTERPRETATION OR CLARIFICATION.
 - R. ALL EQUIPMENT AND MATERIALS FURNISHED AND INSTALLED UNDER THESE PLANS SHALL BE GUARANTEED BY THE CONTRACTOR FOR A PERIOD OF ONE YEAR FROM THE DATE OF ACCEPTANCE OF THE WORK BY OWNER / BUILDER UNLESS STIPULATED OTHERWISE.
 - S. ALL TRADE NAMES AND BRAND NAMES CONTAINED HEREIN ESTABLISH QUALITY STANDARDS. SUBSTITUTIONS ARE PERMITTED, WITH PRIOR APPROVAL B. THE OWNER'S REPRESENTATIVE. THE CONTRACTOR SHALL SUBMIT FOR THE ARCHITECTS AND BUILDERS APPROVAL ALL MATERIALS OR EQUIPMENT WHICH IS CONSIDERED TO BE DIFFERENT TO THAT SPECIFIED.
 - T. CONSTRUCTION DOCUMENTS IDENTIFIED A "NOT FOR CONSTRUCTION" WATERMARK ON ANY OR ALL SHEETS MAY BE SUBJECT TO REVIEW. THIS REVIEW MAY RESULT IN CHANGES WHICH MAY BE MADE TO THE PLANS PRIOR TO THE ISSUANCE OF THE FINAL CONSTRUCTION SET WHICH WILL CONTAIN NO WATERMARK DESIGNATIONS. CONSTRUCTION DOCUMENTS IDENTIFIED WITH A WATERMARK ARE NOT TO BE CONSTRUCTED AS BEING THE COMPLETED OR FINAL DRAWINGS AND THEY SHOULD NOT IN ANY WAY BE USED AS SUCH.
 - U. ALL STANDARD NOTES CONTAINED HEREIN ARE TYPICAL UNLESS NOTED OTHERWISE.
 - V. TYPICAL DETAILS AND SPECIFICATIONS ARE MINIMUM REQUIREMENTS TO BE USED WHEN CONDITIONS ARE NOT SHOWN OTHERWISE.
 - W. SPECIFIC NOTES AND DETAILS ON DRAWINGS SHALL TAKE PRECEDENCE OVER GENERAL NOTES AND TYPICAL DETAILS, WHERE NO DETAILS ARE SHOWN CONSTRUCTION SHALL CONFORM TO SIMILAR WORK ON THE PROJECT.
 - X. THE CONSTRUCTION DOCUMENTS AND ALL COPIES THEREOF FURNISHED TO CONTRACTOR ARE THE PROPERTY OF THE COUNTY AND ARE NOT TO BE USED ON OTHER WORK.
 - Y. ERRORS AND OMISSION: IF ANY ERRORS OR OMISSIONS APPEAR IN THESE DRAWINGS, OR OTHER CONTRACT DOCUMENTS, THE GENERAL CONTRACTOR AND SUBCONTRACTORS AFFECTED SHALL NOTIFY THE OWNER / BUILDER IN WRITING OF SUCH ERROR OR OMISSION. IN THE EVENT OF FAILING TO DO SO, THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE CORRECTION OF THE WORK. HE WILL BE HELD RESPONSIBLE FOR THE RESULT OF THE ANY SUCH ERRORS OR OMISSIONS AND THE COST FOR RECTIFYING THE SAME.
 - Z. GUARANTEES: CONTRACTOR SHALL GUARANTEE THE WORK IN GENERAL FOR ONE YEAR AGAINST DEFECTS IN MATERIALS AND WORKMANSHIP. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR LEAVING THE BUILDING FREE FROM DEFECTS OF MATERIALS AND POOR WORKMANSHIP FROM DATE OF COMPLETION. THE CONTRACTOR SHALL FURNISH AND MAINTAIN GUARANTEEING THAT ALL WORK EXECUTED BY HIM WILL BE FREE FROM DEFECTS OF THE MATERIALS AND WORKMANSHIP FOR A PERIOD OF ONE YEAR (UNLESS OTHERWISE SPECIFIED) FROM DATE OF ACCEPTANCE OF HIS WORK, THAT HE WILL REPAIR AND REPLACE ALL SUCH DEFECTIVE WORK AND ALL OTHER WORK DAMAGE WITHOUT COST TO THE OWNER.
 - AA. ASSURING THAT PLANS ARE BEING FOLLOWED, IT DOES NOT RELIEVE THE CONTRACTOR OR ANY SUBCONTRACTORS FROM ANY RESPONSIBILITY FOR WORK WHICH MAY PROVE FAULTY.
 - AB. JOB CONDITIONS:
 - A. DUST CONTROL: USE ALL MEANS NECESSARY TO PREVENT THE SPREAD OF DUST DURING THE PERFORMANCE OF THIS WORK. THOROUGHLY MOISTEN ALL EXTERIOR SURFACES AS REQUIRED TO PREVENT DUST FROM BEING A NUISANCE TO THE PUBLIC, NEIGHBORS AND CONCURRENT PERFORMANCE OF OTHER WORK ON THE SITE.
 - B. PROTECTION: USE ALL MEANS NECESSARY TO PROTECT EXISTING OBJECTS TO REMAIN AND IN THE EVENT OF DAMAGE, IMMEDIATELY MAKE ALL REPAIRS AND REPLACEMENTS NECESSARY TO THE SATISFACTION OF THE ARCHITECT AND AT NO ADDITIONAL COST TO THE OWNER.
 - AC. PREPARATION:
 - A. CONTRACTOR SHALL INVESTIGATE SITE DURING CLEARING AND EARTHWORK OPERATIONS FOR FILLED EXCAVATIONS OR BURIED STRUCTURES SUCH AS CESSPOOLS, CISTERNS, FOUNDATION, ETC., AND BURIED ARTIFACTS SUCH AS INDIAN OR DINOSAUR BONES. IF ANY SUCH ITEMS ARE FOUND THE ARCHITECT, CIVIL ENGINEER, AND SOILS ENGINEER SHALL BE NOTIFIED IMMEDIATELY.
 - B. NOTIFICATION: THE CONTRACTOR SHALL INFORM THE OWNER AND ARCHITECT OF THE DATE FOR START OF SITE WORK. THE DATE SHALL BE ACCEPTABLE TO ALL PARTIES.
 - C. SITE INSPECTION:
 - 1. PRIOR TO ANY DEMOLITION, CAREFULLY INSPECT THE ENTIRE SITE & ALL OBJECTS DESIGNATED TO BE REMOVED & TO REMAIN.
 - 2. LOCATE ALL EXISTING UTILITY LINES AND EQUIPMENT. DETERMINE WHICH UTILITIES MUST BE REMOVED AND WHICH ARE TO REMAIN AS WELL AS ALL REQUIREMENTS FOR DISCONNECTING OR CAPPING.
 - D. PROTECTIVE WORKS:
 - 1. DEMOLITION SHALL NOT PROCEED UNTIL SUCH PROTECTIVE WORKS ARE PLACED AS ARE REQUIRED TO PROTECT THE PROPERTY AND PERSONNEL FROM THAT HAZARDS OF THE WORK.
 - 2. LOCATE ALL EXISTING UTILITY LINES AND EQUIPMENT. DETERMINE WHICH UTILITIES MUST BE REMOVED AND WHICH ARE TO REMAIN AS WELL AS ALL REQUIREMENTS FOR DISCONNECTING OR CAPPING.
 - E. DAMAGE TO EXISTING WORK: EXISTING WORK DAMAGE IN THAT EXECUTION OF THIS WORK SHALL BE REPAIRED OR RESTORED TO THE ORIGINAL CONDITION AT THE CONTRACTOR'S EXPENSE.
 - AD. DISCONNECTION OF UTILITIES: BEFORE STARTING JOB OPERATIONS, DISCONNECT OR ARRANGE FOR THE DISCONNECTION OF ALL UTILITIES TO BE WORK IN ACCORDANCE WITH THE REQUIREMENTS OF THE BUILDING FOUNDATION OF THE UTILITY COMPANY OR AGENCY INVOLVED, AND WITH OWNER.
 - AE. PROTECTION OF UTILITIES: PRESERVE IN OPERATING CONDITION ALL ACTIVE UTILITIES REMAINING.
 - AF. USE OF THE PREMISES: THE CONTRACTOR SHALL CONFINES HIS WORKMEN, AND THE PARKING OF WORKMEN'S VEHICLES TO LIMITS INDICATED BY LAW, ORDINANCE, PERMITS OR DIRECTION OF THE OWNER. MATERIALS AND EMPLOYEES: UNLESS OTHERWISE DIRECTED BY THE OWNER, THE CONTRACTOR AND/OR SUB CONTRACTOR SHALL PROVIDE AND PAY FOR ALL MATERIALS, LABOR, TOOLS, EQUIPMENT, TELEPHONE, AND GAS TRANSPORTATION. MATERIALS SHALL BE OF GOOD QUALITY.
 - AG. CLEANING UP: THE CONTRACTOR AND SUBCONTRACTORS SHALL AT ALL TIMES KEEP THE PREMISES FREE OF ACCUMULATIONS OF WASTE MATERIALS AND RUBBISH CAUSED BY HIS EMPLOYEES AND WORK, AT THE

13. COMPLETION OF THE WORK, HE SHALL REMOVE ALL HIS RUBBISH, ALL OF HIS TOOLS, SCAFFOLDING AND SURPLUS MATERIALS FROM AND ABOUT THE BUILDING AND SHALL LEAVE HIS WORK IN A BROOM CLEAN CONDITION. THE SITE AND BUILDING AREA SHALL BE KEPT CLEAN AND PICKED UP OF DEBRIS AND SCRAPS AT ALL TIMES DURING CONSTRUCTION, PARTICULARLY AT THE END OF EACH WORK WEEK. THE CONTRACTOR SHALL INSURE THAT ALL GLASSES, TILES, TOILET FIXTURES, EQUIPMENT, PAINTED SURFACES, FLOORS, ETC., ARE THOROUGHLY PROTECTED DURING ALL CONDITIONS FOR ACCEPTANCE BY THE OWNER.
14. INTENT OF DRAWINGS: PLANS ARE INTENDED TO SHOW DETAILS FOR A COMPLETE PROJECT. PARTS AND DETAILS NOT SHOWN SHALL BE DETAILS NOT FULLY SHOWN SHALL BE DETAILS NOT SHOWN. FIRST CLASS PRACTICE AND IN SIMILAR MANNER AND SPIRIT OF DETAILS WHICH ARE SHOWN. IF THE CONTRACTOR FINDS DETAILS WHICH IN HIS OPINION ARE UNSOUND OR NOT STANDARDS, IT IS HIS DUTY TO NOTIFY THE ARCHITECT OF THIS FACT. IF HE PERFORMS THE WORK AS DETAILED WITHOUT SAID NOTIFICATIONS, THEN IT SHALL BE ASSUMED THAT HE DOES NOT OBJECT TO DETAIL. REFER TO RELEVANT NOTED NOTE FOR CORRECTIONS OR ERRORS AND OMISSION.
15. CLARIFICATION ON DRAWINGS: NOTE THAT DRAWINGS DO NOT SUPPORT TO SHOW ALL OBJECTS EXISTING ON THE JOB. BEFORE COMMENCING ANY DEMOLITION, VERIFY ALL OBJECTS TO BE REMOVED AND ALL OBJECTS TO BE PRESERVED.
16. DIMENSIONS: FIGURED DIMENSIONS SHALL BE FOLLOWED IN PREFERENCE TO SMALL SCALE DRAWINGS. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS IN THE FIELD BEFORE ANY WORK IS CONSTRUCTED AND/OR FABRICATED. THE SPECIFICATION AND/OR SCHEDULES ON THE DRAWINGS SHALL HAVE WRITTEN NOTES AND OR BE FOLLOWED IN PREFERENCE TO INFORMATION FURNISHED IN THE FORM OF LINES ON DRAWINGS. DETAILED CLARIFICATION DRAWINGS FURNISHED DURING CONSTRUCTION OR APPROVED BY THE ARCHITECT ARE TO BE CONSIDERED EXPLANATORY AND NOT AS MODIFICATION OF THESE PLANS AS SHALL BE CALLED CLARIFICATION DRAWINGS. ALL NOTES, FIGURES AND DETAIL DRAWINGS SHALL BE FOLLOWED AND EXECUTED AS PART OF THESE NOTES.
17. ALL WRITTEN DIMENSIONS SHALL TAKE PRECEDENCE OVER SCALED DIMENSIONS. DIMENSION LINES ARE TO FACE OF STUD UNLESS NOTED OTHERWISE (U.N.O.)

NOTE: PLEASE NOTE THAT ALL SPECIFIED MATERIALS ARE SUBJECT TO CHANGE UPON APPROVAL BY ALL PARTIES WITH AN EQUAL AND COMPARABLE ALTERNATE.

03 -CONCRETE WORK

1. REFER TO STRUCTURAL ENGINEERING CALCULATIONS AND THE MOST CURRENT SOILS REPORT FOR THE PERFORMANCE REQUIREMENTS FOR CONCRETE FOUNDATIONS.
2. CONCRETE STRENGTH SHALL BE PER CBC SECTION 1808.8 AND TABLE TABLE 1808.8.1 REFER TO STRUCTURAL ENGINEERING CALCULATIONS FOR ADDITIONAL INFORMATION.
3. CONCRETE SHALL BE MIXED IN ACCORDANCE WITH CBC SECTION SECTION 1901.2.
4. CONCRETE PROPORTION SHALL BE PLACED IN ACCORDANCE WITH CBC SECTION 1808.8.
5. CONCRETE SHALL BE CURED IN ACCORDANCE WITH CBC CHAPTER 1908.1.
6. ALL FORM WORK SHALL BE DESIGNED, CONSTRUCTED, UTILIZED, AND REMOVED PER CBC SECTION 1808A.8.5.
7. CONDUIT, PIPES, OR SLEEVES MAY PENETRATE OR BE EMBEDDED IN CONCRETE ONLY IN ACCORDANCE WITH PER A.C.I. 318-14.
8. CONSTRUCTION JOINTS SHALL BE CONSTRUCTED IN ACCORDANCE WITH CBC SECTION 1904.1.
9. ALL STEEL REINFORCING OF CONCRETE SHALL BE DONE IN ACCORDANCE WITH CBC SECTION 1904.1.
10. TOP OF CONCRETE SLABS TO BE MINIMUM 6" (8" HUD) ABOVE FINISH GRADE. CBC SECTION 1805.4.2.
11. FOUNDATION WIDTHS, DEPTHS, AND REINFORCING, AS SHOWN ON PLANS, ARE SUPERCEDED BY ANY LOCAL CODES OR ORDINANCES WHICH REQUIRES INCREASES OF THE SAME.
12. ALL REINFORCING, CONDUITS, ANCHORS, SLEEVES, BOLTS OR OTHER EMBEDDED MATERIALS AND ITEMS MUST BE SECURED AND APPROPRIATELY FASTENED IN THEIR PROPER LOCATIONS PRIOR TO THE PLACEMENT OF CONCRETE. SUB-CONTRACTOR SHALL VERIFY INSTALLATION OF HOLD-DOWNS, ANCHOR BOLTS, PA STRAPS, AND OTHER ANCHORAGE MATERIALS AND ITEMS PRIOR TO PLACEMENT OF CONCRETE.

04 -MASONRY

1. ANY AND ALL MATERIALS USED FOR THE CONSTRUCTION AND / OR INSTALLATION OF STONE OR MASONRY VENEER SHALL MEET THE QUALITY STANDARDS AS SET FORTH IN CBC SECTION 1404.7.
2. ALL MORTAR AND GROUT USED FOR THE CONSTRUCTION AND/OR INSTALLATION OF STONE OR MASONRY VENEER SHALL MEET THE REQUIREMENTS OF CBC SECTION 2103.2 & 2104A.1.3.
3. WATER USED IN MORTAR OR GROUT SHALL BE CLEAN AND FREE OF DELETERIOUS AMOUNTS OF ACID, ALKALIS, OR ORGANIC MATERIAL OR OTHER HARMFUL SUBSTANCES.
4. MORTAR FOR MASONRY CONSTRUCTION SHALL COMPLY WITH SECTION 2103A.2.1, 2103A.2.2, 2103A.2.3 OR 2103A.2.4.
5. GROUT SHALL COMPLY WITH ARTICLE 2.2 OF TMS 602. COARSE GROUT SHALL BE USED IN GROUT SPACES BETWEEN WYTHES OF 2 INCHES (51 MM) OR MORE IN WIDTH AS DETERMINED IN ACCORDANCE WITH TMS 602. TABLE 6, FOOTNOTE 3, AND IN ALL GROUTED CELLS OF HOLLOW UNIT MASONRY CONSTRUCTION. (CBC SEC 2103.3).
6. CEMENT SHALL BE PORTLAND CEMENT CONFORMING TO ASTM C150-12.
7. ALL BRICK SHALL CONFORM TO ASTM C1088-13 FOR SOLID UNITS OF THIN VENEER BRICK.
8. UNLESS SPECIFICALLY SHOWN OTHERWISE ALL BRICK SHALL BE LAID IN A RUNNING BOND PATTERN.
9. MASONRY VENEER SHALL BE ANCHORED TO THE SUPPORTING WALL STUDS WITH CORROSION-RESISTANT METAL TIES EMBEDDED IN MORTAR OR GROUT AND EXTENDING INTO THE VENEER A MINIMUM OF 1 1/2 INCHES, WITH NOT LESS THAN 5/8 INCH MORTAR OR GROUT COVER TO OUTSIDE FACE. MASONRY VENEER SHALL CONFORM (CBC SECTION 1404.6) AS AN ALTERNATIVE TO THE AIRSPACE REQUIRED BY TABLE 1404.6, GROUT SHALL BE PERMITTED TO FILL THE AIRSPACE.
10. WHERE THE AIRSPACE IS FILLED WITH GROUT, A WATER-RESISTIVE BARRIER IS REQUIRED OVER STUDS OR SHEATHING, WHERE THE AIRSPACE IS FILLED, REPLACING THE SHEATHING AND WATER-RESISTIVE BARRIER WITH WIRE MESH AND APPROVED WATER RESISTIVE BARRIER-BACKED REINFORCEMENT ATTACHED DIRECTLY TO STUD IS PERMITTED. (CBC SECTION 1404.6).
11. MORTAR FOR USE WITH ADHERED MASONRY VENEER SHALL CONFORM TO ASTM C270 FOR TYPE N MORTAR. (CBC SECTION 1404.6). THE LATEST EDITION OF THE BUILDING CODE SHALL BE USED. (CBC SEC 2103.2.4 AND THE REQUIREMENTS IN SECTION 12.1 AND 12.3 OF TMS 402.10).
12. MASONRY VENEER SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. MASONRY VENEER SHALL COMPLY WITH THE PROVISIONS OF CHAPTER 14. (CBC 2101.2.1).
13. FLASHING AND WEEP HOLES IN ANCHORED VENEER DESIGNED IN ACCORDANCE WITH SECTION 1404.6 SHALL BE LOCATED MORE THAN 10 INCHES ABOVE FINISH GROUND LEVEL ABOVE THE FOUNDATION WALL OR SLAB. AT OTHER POINTS OF SUPPORT INCLUDING STRUCTURAL FLOORS, SHELF ANGLES AND LINTELS, FLASHING AND WEEP HOLES SHALL BE LOCATED IN THE FIRST COURSE OF MASONRY ABOVE THE SUPPORT. (CBC 1404.4.2).

05 -METALS

1. REFER TO STRUCTURAL NOTES AND SPECIFICATIONS FOR STRUCTURAL STEEL AND METAL AND REINFORCING STEEL SPECIFICATIONS.
2. ALL STRUCTURAL STEEL SHALL CONFORM TO: 2022 CBC; ANSI S100, AISI S200 AND ASTM C955 SEC. 8, AISI S220 AND ASTM C645. SEC. 10 AND AISI S230.
3. JOINTS SHALL BE WELDED OR BOLTED. WOOD WALLS SUPPORTED DIRECTLY ON CONTINUOUS FOUNDATION SHALL BE ANCHORED TO THE FOUNDATION IN ACCORDANCE TO CBC SECTION 2308.6.7.3.
4. FASTENERS FOR ALL PRESERVATIVE TREATED WOOD INCLUDING NUTS AND WASHERS SHALL BE OF HOT-DIPPED ZINC COATED GALVANIZED STEEL, STAINLESS STEEL, SILICON BRONZE OR COPPER.

06 -WOOD, PLASTIC & COMPOSITES

LUMBER

1. THE DESIGN OF STRUCTURAL ELEMENTS OR SYSTEMS, CONSTRUCTED PARTIALLY OR WHOLLY OF WOOD OR WOOD-BASED PRODUCTS, SHALL BE IN ACCORDANCE WITH ONE OF THE FOLLOWING METHODS:
- A. ALLOWABLE STRESS DESIGN IN ACCORDANCE WITH SECTIONS 2304, 2305 AND 2306.
 - B. LOAD AND RESISTANCE FACTOR DESIGN IN ACCORDANCE WITH SECTIONS 2304, 2305 AND 2307.
 - C. CONVENTIONAL LIGHT-FRAME CONSTRUCTION IN ACCORDANCE WITH SECTIONS 2304 AND 2308.
 - D. AWC WFCM IN ACCORDANCE WITH SECTION 2309.
 - E. THE DESIGN AND CONSTRUCTION OF LOG STRUCTURES IN ACCORDANCE WITH THE PROVISIONS OF ICC 400.
2. ALL PRESERVATIVE TREATED WOOD REQUIRED TO BE TREATED UNDER CBC SECTION 2303.1.9.1 SHALL BEAR THE QUALITY MARK OF AN INSPECTION AGENCY WHICH HAS BEEN ACCREDITED BY AN ACCREDITATION BODY THAT COMPLIES WITH THE REQUIREMENTS OF THE AMERICAN LUMBER STANDARDS TREATMENT ASSOCIATION (ALTA). THE QUALITY MARK SHALL BE ON A STAMPED OR LABEL AFFIXED TO THE PRESERVATIVE-TREATED WOOD. CBC SECTION 2303.1.9.1.
3. ALL LUMBER SIZES NOTED AND SPECIFIED ON PLANS ARE NOMINAL SIZES UNLESS SPECIFICALLY INDICATED AS NET SIZE.

GLUE LAMINATED LUMBER

1. QUALITY LAMINATED TIMBERS SHALL BE MANUFACTURED AND IDENTIFIED AS REQUIRED IN ANSI/APA 190.1 AND ASTM D3737, AND THE CURRENT EDITION OF THE TIMBER CONSTRUCTION MANUAL BY THE AMERICAN INSTITUTE OF TIMBER CONSTRUCTION.
2. REFER TO THE STRUCTURAL ENGINEER'S CURRENT NOTES, CALCULATIONS AND SPECIFICATIONS.

PROTECTION AGAINST DECAY & TERMITES

1. WOOD SHALL BE PROTECTED FROM DECAY AND TERMITES IN ACCORDANCE WITH THE APPLICABLE PROVISIONS OF SECTIONS 2304.12.1 THROUGH 2304.12.4.
2. WOOD USED ABOVE GROUND IN THE LOCATIONS SPECIFIED IN SECTIONS 2304.12.1 THROUGH 2304.12.1.5 SH, BE NATURALLY DURABLE WOOD OR PRESERVATIVE-TREATED WOOD USING WATERBORNE PRESERVATIVES, IN ACCORDANCE WITH AWPA U1 FOR ABOVE-GROUND USE. (CBC 2304.12).
3. WOOD JOISTS OR WOOD STRUCTURAL FLOORS THAT ARE CLOSER THAN 18 INCHES OR WOOD GIRDERS THAT ARE CLOSER THAN 12 INCHES TO THE EXPOSED GROUND IN CRAWL SPACES OR UNEXCAVATED AREAS LOCATED WITHIN THE PERIMETER OF THE BUILDING FOUNDATION SHALL BE OF NATURALLY DURABLE WOOD OR PRESERVATIVE-TREATED WOOD. (CBC 2304.12.1.1).
4. WOOD FRAMING MEMBERS, INCLUDING WOOD SHEATHING, THAT ARE IN CONTACT WITH EXTERIOR FOUNDATION WALLS AND ARE LESS THAN 8 INCHES FROM EXPOSED EARTH SHALL BE OF NATURALLY DURABLE OR PRESERVATIVE-TREATED WOOD. (CBC 2304.12.1.2).
5. SLEEPERS AND SILLS ON A CONCRETE OR MASONRY SLAB THAT IS IN DIRECT CONTACT WITH EARTH SHALL BE OF NATURALLY DURABLE OR PRESERVATIVE-TREATED WOOD. (CBC 2304.12.1.3).
6. WOOD USED IN THE LOCATIONS SPECIFIED IN SECTIONS 2304.12.2.1 THROUGH 2304.12.2.8 SHALL BE NATURALLY DURABLE WOOD OR PRESERVATIVE-TREATED WOOD IN ACCORDANCE WITH AWPA U1.

- PRESERVATIVE-TREATED WOOD USED IN INTERIOR LOCATIONS SHALL BE PROTECTED WITH TWO COATS OF URETHANE, SHELLAC, LATEX EPOXY OR VARNISH UNLESS WATERBORNE PRESERVATIVES ARE USED. PRIOR TO APPLICATION OF THE PROTECTIVE FINISH, THE WOOD SHALL BE DRIED IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS. (CBC 2304.12.2).
7. POSTS OR COLUMNS SUPPORTING PERMANENT STRUCTURES AND SUPPORTED BY A CONCRETE OR MASONRY SLAB OR FOOTING THAT IS IN DIRECT CONTACT WITH THE EARTH SHALL BE OF NATURALLY DURABLE OR PRESERVATIVE-TREATED WOOD.
- EXCEPTION: POSTS OR COLUMNS THAT MEET ALL OF THE FOLLOWING: (CBC 2304.12.2.2)
- A. ARE NOT EXPOSED TO EARTH AND ARE PROTECTED BY A ROOF, EAVE, OVERHANG, OR OTHER COVERING IF EXPOSED TO THE WEATHER.
 - B. ARE SUPPORTED BY CONCRETE PIERS OR METAL PEDESTALS PROJECTED NOT LESS THAN 1 INCH ABOVE THE SLAB OR DECK AND ARE SEPARATED FROM THE CONCRETE PIER BY AN IMPERVIOUS MOISTURE BARRIER.
 - C. ARE LOCATED NOT LESS THAN 8 INCHES ABOVE EXPOSED EARTH.
8. NATURALLY DURABLE OR PRESERVATIVE-TREATED WOOD SHALL BE UTILIZED FOR THOSE PORTIONS OF WOOD MEMBERS THAT FORM THE STRUCTURAL SUPPORTS OF BUILDINGS, BALCONIES, PORCHES OR SIMILAR PERMANENT BUILDING APPURTENANCES WHERE SUCH MEMBERS ARE EXPOSED TO THE WEATHER WITHOUT ADEQUATE PROTECTION FROM A ROOF, EAVE, OVERHANG OR OTHER COVERING TO PREVENT MOISTURE OR WATER ACCUMULATION ON THE SURFACE OR AT JOINTS BETWEEN MEMBERS. (CBC 2304.12.2.3).
9. WOOD STRUCTURAL MEMBERS THAT SUPPORT MOISTURE-PERMEABLE FLOORS OR ROOFS THAT ARE EXPOSED TO THE WEATHER, SUCH AS CONCRETE OR MASONRY SLABS, SHALL BE OF NATURALLY DURABLE OR PRESERVATIVE-TREATED WOOD UNLESS SEPARATED FROM SUCH FLOORS OR ROOFS BY AN IMPERVIOUS MOISTURE BARRIER. THE IMPERVIOUS MOISTURE BARRIER SYSTEM PROTECTING THE STRUCTURE SUPPORTING FLOORS SHALL PROVIDE POSITIVE DRAINAGE OF WATER THAT INFILTRATES THE MOISTURE-PERMEABLE FLOOR TOPPING. (CBC 2304.12.2.4).
10. ENCLOSED FRAMING IN EXTERIOR BALCONIES AND ELEVATED WALKING SURFACES THAT HAVE WEATHEREXPOSED SURFACES SHALL BE PROVIDED WITH OPENINGS THAT PROVIDE A NET FREE CROSS-VENTILATION AREA NOT LESS THAN 1/150 OF THE AREA OF EACH SEPARATE SPACE. (CBC 2304.12.2.5).
11. WOOD USED IN CONTACT WITH EXPOSED EARTH SHALL BE NATURALLY DURABLE FOR BOTH DECK AND TERMITE RESISTANCE OR PRESERVATIVE TREATED IN ACCORDANCE WITH AWPA U1 FOR SOIL OR FRESH WATER USE. EXCEPTION: UNTREATED WOOD IS PERMITTED WHERE SUCH WOOD IS CONTINUOUSLY AND ENTIRELY BELOW THE GROUND-WATER LEVEL OR SUBMERGED IN FRESH WATER. (CBC 2304.12.2.6).

SHEATHING

1. WOOD STRUCTURAL PANEL WALL SHEATHING SHALL CONFORM TO DOS PS 1 OR DOC PS 2 OR ANSI/APA PRP 210 CSA 0437 OR CSA 0325. PANELS SHALL BE IDENTIFIED BY A GRADE MARK OR CERTIFICATE OF INSPECTION ISSUED BY THE APPROVED OFFICE OF THE BUILDING DEPARTMENT. (CBC 1908.1).
2. WOOD STRUCTURAL PANEL USED AS ROOF SHEATHING SHALL CONFORM TO REQUIREMENTS OF CBC SECTION 2304.8.
3. REFER TO THE STRUCTURAL ENGINEER'S CURRENT SPECIFICATIONS CALCULATIONS AND PLANS FOR REQUIRED STRENGTH, GRADE, AND THICKNESS FOR WOOD STRUCTURAL PANEL ROOF SHEATHING AND FOR DIAPHRAGM NAILING.
4. REFER TO THE STRUCTURAL ENGINEER'S CURRENT SPECIFICATIONS, CALCULATIONS AND PLANS FOR REQUIRED STRENGTH, GRADE, AND THICKNESS FOR THICKNESS FOR PLYWOOD FLOOR SHEATHING PANELS AND FOR DIAPHRAGM NAILING AND ADHESIVE REQUIREMENTS.
5. WHERE APPLICABLE, REFER TO THE SHEAR WALL SCHEDULE FOR REQUIRED STRENGTH, GRADE, AND THICKNESS OF PLYWOOD SHEAR PANELS AND FOR REQUIRED SHEAR WALL NAILING SCHEDULE.

FLOOR FRAMING

1. REFER TO THE STRUCTURAL ENGINEER'S CURRENT PLAN & CALCULATIONS FOR SIZE, SPACING AND ANCHORAGE OF ALL FLOOR JOISTS, SIZE, LOCATION, AND ANCHORAGE OF ALL FLOOR BEAMS AND HEADERS, AND ALL RELATED FRAMING ISSUES.
2. THE PLACEMENT OF HOLES IN FLOOR JOIST WEBS SHALL BE PER MANUFACTURER'S SPECIFICATIONS. THE NOTCHING OR CUTTING OF FLOOR JOIST FLANGES IS NOT ALLOWED.

ROOF FRAMING

1. ROOF FRAMING SHALL BE PRE-MANUFACTURED ROOF TRUSSES SPACED AT 24 INCHES ON CENTER UNLESS NOTED OTHERWISE.
2. THE MANUFACTURER SHALL SUPPLY TO THE ARCHITECT AND BUILDER CALCULATIONS AND SHOP DRAWINGS FOR APPROVAL OF DESIGN LOADS CONFIGURATION (2 OR 3 POINT BEARING), VOLUME CEILING OPTIONS, AND SHEAR TRANSFER, PRIOR TO FABRICATION.
3. ALL CALCULATIONS AND SHOP DRAWINGS SHALL BE SIGNED BY PROFESSIONAL ENGINEER REGISTERED IN THE STATE WHEREIN THE PROJECT IS TO BE BUILT.
4. MANUFACTURER IS TO SECURE BUILDING DEPARTMENT APPROVAL OF CALCULATIONS AND SHOP DRAWINGS PROPER TO FABRICATION.
5. TRUSSES SHALL BE DESIGNED IN ACCORDANCE WITH THE LATEST BUILDING CODE FOR ALL LOADS IMPOSED, INCLUDING LATERAL LOADS AND MECHANICAL EQUIPMENT LOADS.
6. ALL CONNECTORS SHALL BE ICC APPROVED AND OF ADEQUATE STRENGTH TO RESIST ALL DESIGN LOADS.
7. AN ATTIC ACCESS MINIMUM OPENING ALLOWED IS 22" X 30", PROVIDED THE LARGEST PIECE OF EQUIPMENT CAN BE REMOVED THROUGH THE OPENING. (2022 CALIFORNIA MECHANICAL CODE - SECTION 904.10) ATTIC ACCESS BE PROVIDED AND LOCATED IN A CORRIDOR, HALLWAY OR OTHER READILY ACCESSIBLE LOCATION. THIRTY-INCH-MINIMUM UNOBSSTRUCTED HEADROOM IN THE ATTIC SPACE SHALL BE PROVIDED ABOVE THE ACCESS MEASURED VERTICALLY FROM THE BOTTOM OF CEILING FRAMING MEMBERS (CBC SEC 1209.2).

WALL FRAMING

1. ROOF FRAMING SHALL BE PRE-MANUFACTURED ROOF TRUSSES SPACED AT 24 INCHES ON CENTER UNLESS NOTED OTHERWISE.
2. THE MANUFACTURER SHALL SUPPLY TO THE ARCHITECT AND BUILDER CALCULATIONS AND SHOP DRAWINGS FOR APPROVAL OF DESIGN LOADS CONFIGURATION (2 OR 3 POINT BEARING), VOLUME CEILING OPTIONS, AND SHEAR TRANSFER, PRIOR TO FABRICATION.
3. ALL CALCULATIONS AND SHOP DRAWINGS SHALL BE SIGNED BY PROFESSIONAL ENGINEER REGISTERED IN THE STATE WHEREIN THE PROJECT IS TO BE BUILT.
4. MANUFACTURER IS TO SECURE BUILDING DEPARTMENT APPROVAL OF CALCULATIONS AND SHOP DRAWINGS PROPER TO FABRICATION.
5. TRUSSES SHALL BE DESIGNED IN ACCORDANCE WITH THE LATEST BUILDING CODE FOR ALL LOADS IMPOSED, INCLUDING LATERAL LOADS AND MECHANICAL EQUIPMENT LOADS.
6. ALL CONNECTORS SHALL BE ICC APPROVED AND OF ADEQUATE STRENGTH TO RESIST ALL DESIGN LOADS.
7. AN ATTIC ACCESS MINIMUM OPENING ALLOWED IS 22" X 30", PROVIDED THE LARGEST PIECE OF EQUIPMENT CAN BE REMOVED THROUGH THE OPENING. (2022 CALIFORNIA MECHANICAL CODE - SECTION 904.10) ATTIC ACCESS BE PROVIDED AND LOCATED IN A CORRIDOR, HALLWAY OR OTHER READILY ACCESSIBLE LOCATION. THIRTY-INCH-MINIMUM UNOBSSTRUCTED HEADROOM IN THE ATTIC SPACE SHALL BE PROVIDED ABOVE THE ACCESS MEASURED VERTICALLY FROM THE BOTTOM OF CEILING FRAMING MEMBERS (CBC SEC 1209.2).


FIRE BLOCKING (CBC 718.2)

1. IN COMBUSTIBLE CONSTRUCTION, FIRE BLOCKING SHALL BE PROVIDED TO CUT OFF BOTH VERTICAL AND HORIZONTAL CONVEYANCE OF FIRE AND SMOKE THROUGH OPENINGS BETWEEN STORIES, AND BETWEEN A TOP STORY AND THE ROOF SPACE. FIREBLOCKING SHALL BE PROVIDED IN A WOOD-FRAMED CONSTRUCTIONS IN THE LOCATIONS SPECIFIED IN CBC SECTION 718.2.
2. FIREBLOCKING SHALL BE PROVIDED IN THE FOLLOWING LOCATIONS:
- A. IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS, INCLUDING FURRED SPACES, AND PARALLEL ROWS AND STAGGERED STUDS, AS FOLLOWS:
 - a. VERTICALLY AT THE CEILING AND FLOOR LEVELS.
 - b. HORIZONTALLY AT INTERVALS NOT EXCEEDING 10 FEET
 - B. AT INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES SUCH AS OCCUR AT SOFFITS, DROP CEILINGS AND COVE CEILINGS.
 - C. FIREBLOCKING SHALL BE PROVIDED IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN. ENCLOSED SPACES UNDER STAIRWAYS SHALL COMPLY WITH SECTION 1011.7.3.
 - D. AT OPENINGS AROUND VENTS, PIPES, DUCTS, CABLES, AND WIRES AT CEILING & FLOOR LEVELS, WITH AN APPROVED MATERIAL TO RESIST FIRE PASSAGE OF FLAME AND PRODUCTS OF COMBUSTION. THE MATERIALS PROVIDING THIS ANNUAL SPACE SHALL NOT BE REQUIRED TO MEET THE ASTM E 136 REQUIREMENTS.
 - E. FOR THE FIREBLOCKING AT CHIMNEYS AND FIREPLACES, SEE CBC SECTION 2113.11.
3. FIREBLOCKING OF CORNICES OF A TWO-FAMILY DWELLING IS REQUIRED AT THE LINE OF DWELLING UNIT SEPARATION. (CBC SECTION 2113.20).
4. FIRE BLOCKING SHALL BE PROVIDED AT 2 INCHES NOMINAL LUMBER OR TWO THICKNESS OF 1-INCH NOMINAL LUMBER WITH BROKEN LAP JOINTS OR ONE THICKNESS OF 28/32-INCH WOOD STRUCTURAL PANELS WITH JOINTS BACKED BY 23/32-INCH WOOD STRUCTURAL PANELS OR ONE THICKNESS OF 3/4 -INCH PARTICLEBOARD WITH JOINTS BACKED BY 3/4-INCH PARTICLEBOARD OR ONE-HALF-INCH GYPSUM BOARD OR ONE-QUARTER-INCH CEMENT-BASED MILLBOARD OR BATTS OR BLANKETS OF MINERAL WOOL OR GLASS FIBER OR OTHER APPROVED MATERIALS INSTALLED IN SUCH A MANNER AS TO BE SECURELY RETAINED IN PLACE OR CEILING INSULATION INSTALLED AS TESTED IN ACCORDANCE WITH ASTM E 119 OR UL 263 FOR SPECIFIED APPLICATIONS. (CBC SEC 718.2.1).
5. WALLS CONSTRUCTED USING PARALLEL OR STAGGERED STUDS FOR SOUND TRANSMISSION CONTROL SHALL HAVE FIRE BLOCKS OF BATTS OR BLANKETS OF MINERAL OR GLASS FIBER OR OTHER APPROVED NONRIGID MATERIALS SHALL BE PERMITTED FOR COMPLIANCE WITH 10-FOOT HORIZONTAL FIREBLOCKING. (CBC SEC 718.2.2).
6. IN COMBUSTIBLE CONSTRUCTION WHERE THERE IS USABLE SPACE BOTH ABOVE AND BELOW THE CONCEALED SPACE OF FLOOR-CEILING ASSEMBLY, DRAFTSTOPS SHALL BE INSTALLED SO THAT THE AREA OF THE CONCEALED SPACE DOES NOT EXCEED 1000 SQUARE FEET. DRAFT-STOPPING SHALL DIVIDE THE CONCEALED SPACE INTO APPROXIMATELY EQUAL AREAS WHERE THE ASSEMBLY IS ENCLOSED BY A FLOOR-MEMBRANE ABOVE AND A CEILING-MEMBRANE BELOW. DRAFT-STOPPING SHALL BE PROVIDED IN FLOOR-CEILING ASSEMBLIES UNDER THE FOLLOWING CIRCUMSTANCES:
- A. CEILING IS SUSPENDED UNDER THE FLOOR FRAMING
 - B. FLOOR FRAMING IS CONSTRUCTED OF TRUSS-TYPE OPEN-WEB OR PERFORATED MEMBERS (CBC SECTION 718.3 & 718.4).
7. DRAFT-STOPPING MATERIALS SHALL NOT BE LESS THAN 1/2-INCH GYPSUM BOARD, 3/8-INCH WOOD STRUCTURAL PANELS OR OTHER APPROVED MATERIALS ADEQUATELY SUPPORTED. DRAFTSTOPPING SHALL BE INSTALLED PARALLEL TO THE FLOOR FRAMING MEMBERS UNLESS OTHERWISE APPROVED BY THE BUILDING OFFICIAL. INTEGRITY OF THE DRAFTSTOPS SHALL BE MAINTAINED. (CBC SEC 718.3.1 & 718.4.1).

07 -THERMAL & MOISTURE PROTECTION

1. PROVIDE ALL FLASHING, COUNTER-FLASHING, BITUMEN, MEMBRANE WATERPROOFING, SHEET METAL, CAULKING, SEALANTS, ELECTROMERIAL WALKING SURFACES, AND RAIN GUTTERS AND/OR DIVERTERS WHERE REQUIRED, TO PREVENT WATER INTRUSION INTO THE BUILDING. (CBC SECTION 1402.2).
2. THE TERMS "CORROSION RESISTANT" OR "NON-CORROSIVE" THE ABILITY OF A MATERIAL TO WITHSTAND DETERIORATION OF ITS SURFACE OR ITS PROPERTIES WHEN EXPOSED TO ITS ENVIRONMENT. (CBC SEC 202). WHEN AN ELEMENT IS REQUIRED TO BE CORROSION RESISTANT OR NON-CORROSIVE, ALL OF ITS PARTS, SUCH AS SCREWS, NAILS, WIRE, DOWELS, BOLTS, NUTS, WASHERS, SHIMS, AND TIES AND ATTACHMENTS, SHALL BE OF CORROSION RESISTANT MATERIALS USED FOR CONSTRUCTION OF EXTERIOR WALLS SHALL COMPLY WITH THE PROVISIONS OF SECTION 1406.2. THE EXTERIOR WALL ENVELOPE SHALL BE DESIGNED AND CONSTRUCTED IN A MANNER THAT PREVENTS THE ACCUMULATION OF WATER WITHIN THE WALL ASSEMBLY BY PROVIDING WATER RESISTIVE BARRIER WHICH IS A MINIMUM OF ONE LAYER OF NO. 15 ASPHALT FELT COMPLYING WITH ASTM D226 FOR TYPE I FELT OR OTHER APPROVED WATER-RESISTIVE BARRIER SHALL BE PROVIDED OVER STUDS OR SHEATHING OF ALL EXTERIOR WALLS DESCRIBED IN SEC 1402.2.
3. PROTECTION AGAINST CONDENSATION IN THE EXTERIOR WALL ASSEMBLY SHALL BE PROVIDED IN ACCORDANCE WITH THE CALIFORNIA ENERGY CODE (CBC SECTION 1402.2).
4. EXTERIOR WALLS SHALL PROVIDE THE BUILDING WITH WEATHER RESISTANT EXTERIOR WALL ENVELOPE. THE EXTERIOR WALL ENVELOPE SHALL INCLUDE FLASHING AS DESCRIBED IN SECTION 1404.4 (CBC SECTION 1404.4).
5. APPROVED CORROSION RESISTANT FLASHING SHALL BE APPLIED SHINGLE FASHION IN A MANNER TO PREVENT ENTRY OF WATER INTO THE WALL CAVITY OR PENETRATION OF WATER TO BUILDING STRUCTURAL FRAMING COMPONENTS SELF-ADHERED MEMBRANES USED AS FLASHING SHALL AAMA 711 FLUID-APPLIED MEMBRANES USED AS FLASHING IN EXTERIOR WALLS SHALL COMPLY WITH AAMA 714. THE FLASHING SHALL BE APPLIED OVER THE EXTERIOR WALL FINISH. APPROVED CORROSION RESISTANT FLASHING SHALL BE INSTALLED AT THE FOLLOWING LOCATIONS:
- A. FLASHING AT EXTERIOR WINDOW AND DOOR OPENINGS SHALL EXTEND TO THE SURFACE OF THE EXTERIOR WALL FINISH OR TO THE WATER RESISTIVE BARRIER FOR SUBSEQUENT DRAINAGE
 - B. AT THE INTERSECTION OF CHIMNEYS OR OTHER MASONRY CONSTRUCTION WITH FRAME OR STRUCTURAL WALL, FLASHING SHALL BE INSTALLED OVER THE EXTERIOR WALL FINISH AND COPINGS.
 - C. UNDER AND THE ENDS OF MASONRY, WOOD, OR METAL COPINGS AND SILLS
 - D. CONTINUOUSLY ABOVE ALL PROJECTING WOOD TRIMS
 - E. WHERE EXTERIOR PORCHES, DECKS OR STAIRS ATTACH TO A WALL OR FLOOR ASSEMBLY OF WOOD-FRAME CONSTRUCTION
 - F. AT WALL AND ROOF INTERSECTIONS
 - G. AT BUILT-IN GUTTERS
6. BALCONIES LANDINGS, EXTERIOR STAIRWAYS, OCCUPIED ROOFS AND SIMILAR SURFACES EXPOSED TO THE WEATHER AND SEALED UNDERNEATH SHALL BE AND SLOPED A MINIMUM OF 1/4 UNIT VERTICAL IN 12 UNITS HORIZONTALLY (2% SLOPE) FOR DRAINAGE (CBC 1012.6.1).
7. EXTERIOR WALLS HAVING WINDOWS OPENING ON OPPOSITE SIDES SHALL BE NOT LESS THAN 6 FEET IN WIDTH. COURTS SHALL BE NOT LESS THAN 10 FEET IN LENGTH UNLESS BOUNDED ON ONE END BY A PUBLIC WAY OR YARD. THE BOTTOM OF EVERY COURT SHALL BE PROPERLY GRADED AND DRAINED TO A PUBLIC SEWER OR OTHER APPROVED DISPOSAL SYSTEM COMPLYING WITH THE CALIFORNIA PLUMBING CODE. (CBC 1205.3).
8. ELASTOMERIC OR MEMBRANE DECK COATINGS SHALL BE INSTALLED PER MANUFACTURER'S SPECIFICATIONS AT DECKS AS WELL AS BALCONIES, COLOR FINISH AND DETAILING SHALL BE APPROVED BY OWNER / BUILDER AND ARCHITECT.
9. UNLESS DESIGNED TO DRAIN OVER DECK EDGES, DRAINS, AND OVER-FLOWS ADEQUATE SIZE SHALL BE INSTALLED AT THE LOW POINTS OF DECK OR BALCONY.
10. ALL SHEET METAL WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE RECOMMENDATIONS AND STANDARDS OF THE NATIONAL ASSOCIATION OF SHEET METAL AND AIR CONDITIONING CONTRACTORS (N.A.S.M.A.C.N.A.), THE ARCHITECTURAL SHEET METAL MANUAL, AND SEALANT, WATERPROOFING AND RESTORATION INSTITUTE'S (S.W.R.I.) GUIDE - "SEALANTS: THE PROFESSIONAL'S GUIDE".
11. SHEET METAL SHALL BE STEEL, HOT-DIPPED, TIGHT COATED IN GALVANIZED, CONFORMING TO ASTM A525 AND SHALL BE A NUMBER 24 SHEET METAL GAGE UNLESS OTHERWISE NOTED IN THESE NOTES.
12. PLANS, OR MANUFACTURER'S SPECIFICATIONS SHALL BE USED TO DETERMINE THE SIZE OF THE SHEET METAL.
13. SHEET ALUMINUM SHALL CONFORM WITH FEDERAL SPECIFICATIONS QQ-A-359 AND ASTM B209 ALLOY 3003.
14. FLASHING FOR ASPHALT SHINGLES SHALL COMPLY WITH SECTION 1507.2.8. FABRICATE SHEET METAL WITH FLAT LOCK SEAMS AND SOLDER WITH TYPE AND FLUX RECOMMENDED BY MANUFACTURER. SEAL ALUMINUM SEAMS WITH EPOXY METAL SEAM CEMENT. WHERE REQUIRED FOR STRENGTH, RIVET, SEAMS, AND JOINTS.
15. SHOP FABRICATE TO THE GREATEST EXTENT POSSIBLE IN ACCORDANCE WITH APPLICABLE STANDARDS TO PROVIDE A PERMANENTLY WATER-PROOF, WEATHER RESISTANT INSTALLATION.
16. BASE AND CAP FLASHING SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTALLATION INSTRUCTIONS. BASE FLASHING SHALL BE HEAVY CORROSION RESISTANT METAL OF MINIMUM NOMINAL 0.019-INCH THICKNESS OR MINERAL SURFACE ROLL ROOFING WEIGHING A MINIMUM OF 77 POUNDS PER 100 SQUARE FEET. CAP FLASHING SHALL BE CORROSION-RESISTANT METAL OF MINIMUM NOMINAL 0.019-INCH THICKNESS. (CBC SECTION 1507.2.8.1).
17. ROOF VALLEY LININGS SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS BEFORE APPLYING SHINGLES. VALLEY LINING OF THE FOLLOWING TYPES SHALL BE PERMITTED:
- A. FOR OPEN VALLEYS (VALLEY LINING EXPOSED) LINED WITH METAL, THE VALLEY LINING SHALL BE NOT LESS THAN 24 INCHES WIDE AND OF ANY OF THE CORROSION-RESISTANT METALS IN TABLE 1507.2.8.2.
 - B. FOR OPEN VALLEYS, VALLEY LINING OF TWO PILES OF MINERAL-SURFACED ROLL ROOFING COMPLYING WITH ASTM D 3890 OR ASTM D 3890 CLASS M, SHALL BE PERMITTED. THE BOTTOM LAYER SHALL BE 18 INCHES AND THE TOP LAYER A MINIMUM OF 36 INCHES WIDE.
 - C. FOR CLOSED VALLEYS (VALLEYS COVERED WITH SHINGLES), VALLEY LINING OF ONE PLY OF SMOOTH ROLL ROOFING COMPLYING WITH ASTM

1/4/2024 8:06:54 AM
24" X 36"

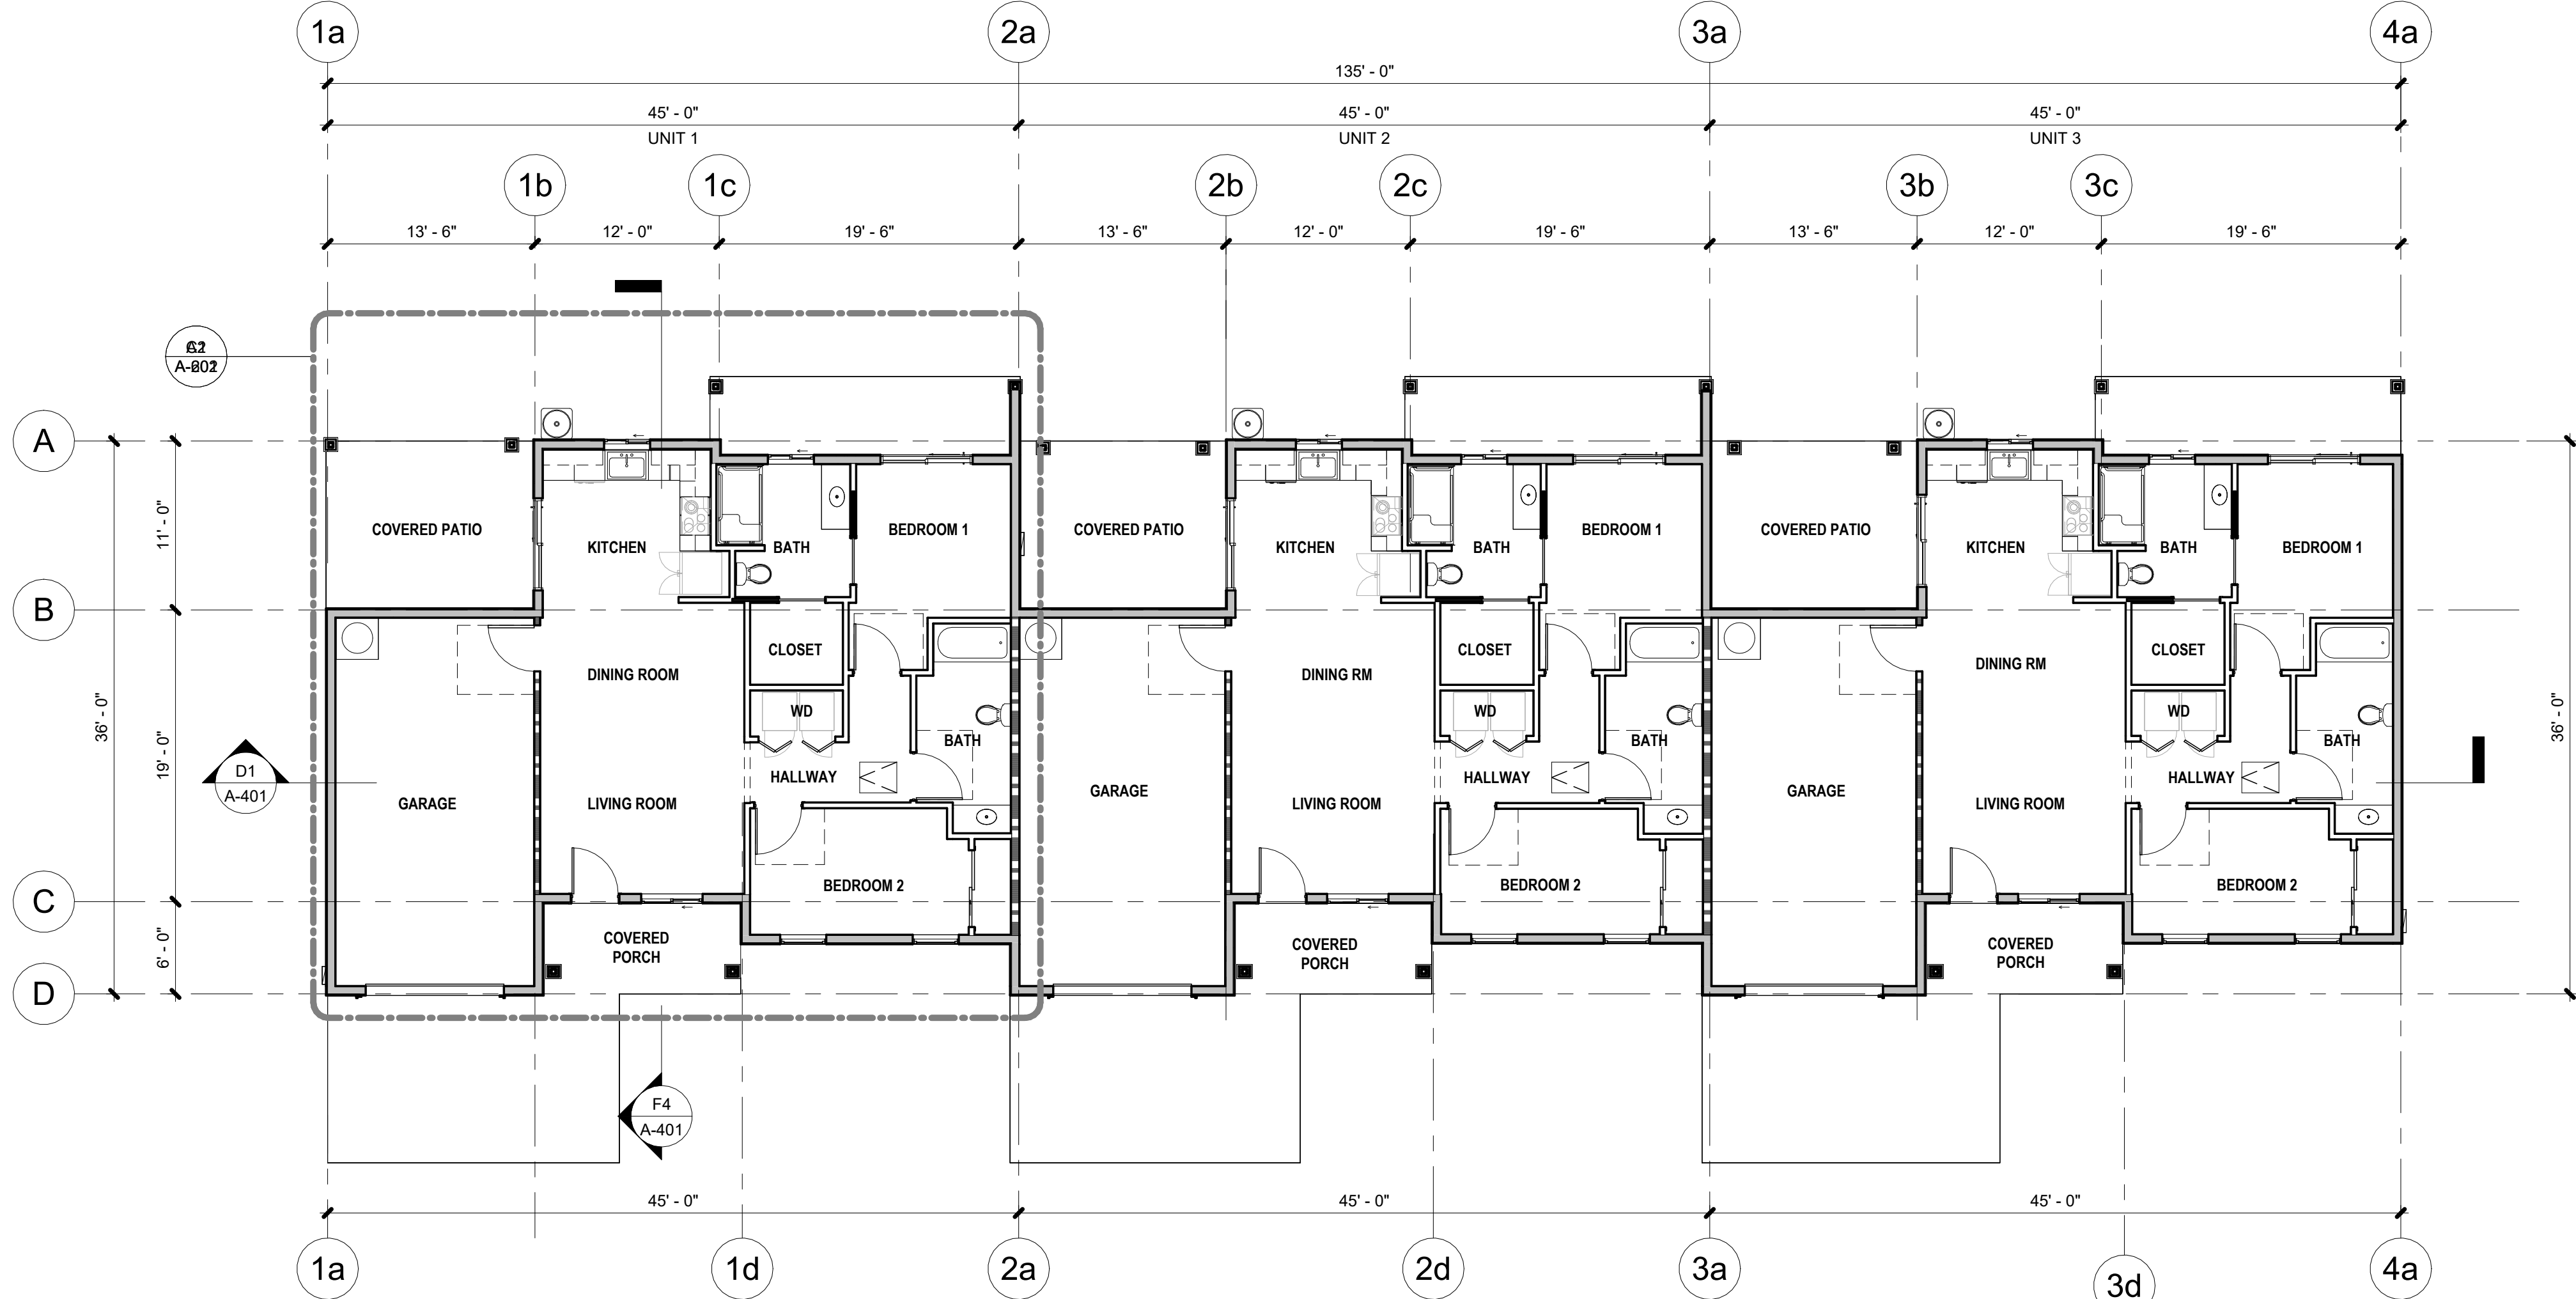

CONDITIONED SPACE (UNIT 1)	966 SF
COVERED PATIO (UNIT 1)	147 SF
GARAGE (UNIT 1)	332 SF
COVERED PORCH (UNIT 1)	76 SF
TOTAL	1521 SF

CONDITIONED SPACE (UNIT 2)	966 SF
COVERED PATIO (UNIT 2)	147 SF
GARAGE (UNIT 2)	332 SF
COVERED PORCH (UNIT 2)	76 SF
TOTAL	1521 SF

CONDITIONED SPACE (UNIT 3)	979 SF
COVERED PATIO (UNIT 3)	147 SF
GARAGE (UNIT 3)	332 SF
COVERED PORCH (UNIT 3)	76 SF
TOTAL	1534 SF

PROPOSED FLOOR PLAN
1/8" = 1'-0"

A2

FLOOR PLAN GENERAL NOTES:

- VERIFY ALL DIMENSIONS, GRADES, AND OTHER CONDITIONS AT JOB SITE BEFORE COMMENCING WORK. DIMENSIONS SHOWN ON THESE PLANS ARE FROM FACE OF FINISH, UNLESS OTHERWISE NOTED.
- WEATHER-STRIP ALL EXTERIOR DOORS AND WINDOWS CERTIFIED ACCORDING TO SECTION 2-555 OF STANDARD FOR DOORS AND WINDOWS.
- ALL OPENINGS AROUND DUCTING, GAS VENTS, PIPES, CHIMNEYS AT THE CEILING SHALL BE FIRE BLOCKED PER CBC. ALL WINDOWS AND DOORS SHALL MEET THE AIR INFILTRATION STANDARDS OF THE 2022 CALIFORNIA BUILDING AND ENERGY CODES. SHALL BE CERTIFIED AND LABELED.
- INTERIOR WALL COVERING TO BE 1/2" THK. GYP. BRD., UNLESS OTHERWISE NOTED. (FLAME SPREAD CLASS 111)
- ALL WINDOW GLAZING ARE TO BE DUAL-GLAZED AND PROVIDE SOLAR SCREENS.
- GLASS DOORS AND WINDOWS IMMEDIATELY TO OR LESS THAN 18" FROM FLOOR OR IN DOOR SHALL BE TEMPERED.
- THE FOLLOWING SHALL BE CAULKED OR OTHERWISE SEALED TO LIMIT AIR INFILTRATION:
 - EXTERIOR JOINTS AROUND WINDOWS AND DOOR FRAMES, BETWEEN WALLS SOLE PLATES AND FLOORS AND BETWEEN WALL PANELS.
 - OPENING FOR PLUMBING, ELECTRICITY, AND GAS LINES IN WALLS, CEILINGS AND FLOORS.
 - OPENINGS IN THE ATTIC FLOOR (SUCH AS WHERE CEILING PANELS MEET INTERIOR AND EXTERIOR WALLS AND MASONRY FIREPLACES.)
- PROVIDE 2x SOLID BLOCKING BEHIND ALL TOILET FIXTURES, CABINETS, WATER HEATER, CEILING LIGHT FIXTURES (FUTURE FAN LOCATION) AND WHEREVER DIRECTED BY THE OWNER, INSPECTOR OR ARCHITECT.
- DUCT CONSTRUCTED, INSTALLED AND INSULATED PER CURRENT CODE AND TITLE 24.
- MECHANICAL VENTILATION SYSTEMS MUST SUPPLY 5 CHANGES PER HOUR IN BATHROOMS AND LAUNDRY ROOMS: 2 AIR CHANGES PER HOUR IN OTHER HABITABLE ROOMS.
- PROVIDE 1-1/2" DUCT INSULATION (TYPICAL).
- VERIFY ALL APPLIANCE SPECIFICATIONS, SIZES AND OWNER'S REQUIREMENT FOR BUILT-IN ASSEMBLY PRIOR TO PRODUCTION OF CASEWORKS. ADJUST DIMENSIONS OF BUILT IN CASEWORK WITH APPLIANCE DIMENSION.
- CONSTRUCT PATIO SLABS WITH 4" THK. CONCRETE X 12" DP SHOVEL (1 #4 BAR) FOOTING AT PERIMETER. SLABS ARE TO BE BROOM FINISH. PROVIDE 6x6x10 /10 WWM IN MIDDLE OF SLABS.
- THE ENERGY CERTIFICATION OF COMPLIANCE MUST BE SUBMITTED AFTER INSTALLATION OF THE REQUIRED EQUIPMENT AND MATERIAL AND PRIOR TO REQUEST OF FINAL INSPECTION.
- PROVIDE 115V OUTLET (W.P., GFI) WITHIN 25 FEET OF ROOF MOUNTED EQUIPMENT.
- AFTER INSTALLING INSULATION, THE INSTALLER SHALL POST IN A CONSPICUOUS LOCATION THE CERTIFICATE OF INSTALLATION SIGNED BY THE INSTALLER AND THE BUILDER STATING THAT THE INSTALLATION CONFORM WITH THE REQUIREMENTS FOR TITLE 24 PART 2, CHAPTER 2-53 AND THAT THE MATERIALS INSTALLED CONFORM WITH THE REQUIREMENTS OF TITLE 20, CHAPTER 2 SUB-CHAPTER 4, ARTICLE 3. THE CERTIFICATE SHALL STATE THE MANUFACTURER'S NAME AND MATERIAL IDENTIFICATION, THE INSTALLED "R" VALUE, AND (IN APPLICATIONS OF LOOSE FILL INSULATION) THE MINIMUM INSTALLED WEIGHT PER SQUARE FOOT CONSISTENT WITH THE MANUFACTURER'S LABEL DENSITY FOR THE DESIRED "R" VALUE TO BE INSTALLED IN CEILING AND IN WALLS.
- WALL AND CEILING FINISHES SHALL HAVE A FLAME SPREAD INDEX OF NOT GREATER THAN 200. CBC 803.1.2
- WALL AND CEILING FINISHES SHALL HAVE A SMOKE-DEVELOPED INDEX OF NOT GREATER THAN 450. CBC 803.1.2
- PROVIDE DOOR CHIME / BELL ON EACH UNIT AT 48" MAX. AFF. REFER TO ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION

DOOR LANDING NOTES

- LANDING SHALL HAVE A WIDTH NOT LESS THAN THE WIDTH OF THE DOOR AND 36" MIN. IN THE DIRECTION OF TRAVEL. (CBC 1008.1.5)
- PER CBC 1008.1.6 BELOW:

*1008.1.6 THRESHOLDS. THRESHOLDS AT DOORWAYS SHALL NOT EXCEED 0.75 INCH IN HEIGHT FOR SLIDING DOORS SERVING DWELLING UNITS OR 0.5 INCH FOR OTHER DOORS. RAISED THRESHOLDS AND FLOOR LEVEL CHANGES GREATER THAN 0.25 INCH AT DOORWAYS SHALL BE BEVELED WITH A SLOPE NOT GREATER THAN ONE UNIT VERTICAL IN TWO UNITS HORIZONTAL (50-PERCENT SLOPE). EXCEPTION: THE THRESHOLD HEIGHT SHALL BE LIMITED TO 7.75 INCHES WHERE THE OCCUPANCY IS GROUP R-2 OR R-3. THE DOOR IS AN EXTERIOR DOOR THAT IS NOT A COMPONENT OF THE REQUIRED MEANS OF EGRESS; THE DOOR, OTHER THAN AN EXTERIOR STORM OR SCREEN DOOR DOES NOT SWING OVER THE LANDING OR STEP; AND THE DOORWAY IS NOT ON AN ACCESSIBLE ROUTE AS REQUIRED BY CHAPTER 11A OR 11B AND IS NOT PART OF AN ADAPTABLE OR ACCESSIBLE DWELLING UNIT.

LEGEND


- 2x6 EXTERIOR WALL ASSEMBLY. REFER TO A1/A-803 AND A-401 FOR ADDITIONAL INFORMATION.
- TYP. INTERIOR PARTITION WALL. 1/2" GYP. BOARD EACH SIDE OF 2x4 STUDS @ 16" O.C. TYPICAL INTERIOR WALL PARTITION. U.N.O. REFER TO A5/A-903 FOR ADDITIONAL INFORMATION.
- * FOR BATHROOM WALLS: FIBER-CEMENT, FIBER-MAT REINFORCED CEMENT, GLASS MAT GYPSUM BACKERS OR FIBER-REINFORCED GYPSUM BACKERS IN COMPLIANCE WITH ASTM C 1288, C1325, C 1178 OR C 1278, RESPECTIVELY, AND INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS SHALL BE USED AS BACKERS FOR WALL TILE IN TUB AND SHOWER AREAS AND WALL PANELS IN SHOWER AREAS.
- 2x6 INTERIOR STUD WALL (60 MINUTES FIRE RESISTANCE RATING) REFER TO G1/A-803 FOR ADDITIONAL INFORMATION.
- 2x4 INTERIOR STUD WALL (60 MINUTES FIRE RESISTANCE RATING) REFER TO G5/A-803 FOR ADDITIONAL INFORMATION.
- DOOR
REFER TO A-601. FOR ADDITIONAL INFORMATION.
- WINDOW
REFER TO A-601. FOR ADDITIONAL INFORMATION.

TRIPLEX DWELLING UNIT

OPTION
#2

PROJECT

TRIPLEX
DWELLING UNIT

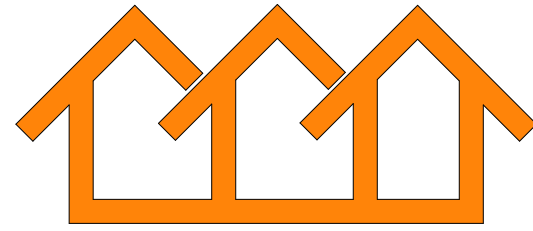

PWP23-005


DEPARTMENT OF PUBLIC
WORKS AND PLANNING



CAPITAL PROJECTS
DIVISION

2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

SEAL & SIGNATURE

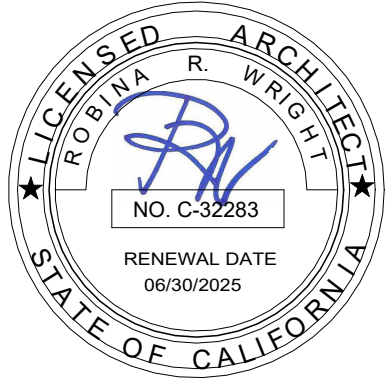

UPDATE

JANUARY 2, 2024

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY AND COPYRIGHT OF THE ARCHITECT AND SHALL NOT BE USED ON ANY OTHER PROJECT OR LOCATIONS EXCEPT AS DESCRIBED ON THE DRAWINGS WITHOUT WRITTEN AGREEMENT WITH THE ARCHITECT.

TITLE


PROPOSED FLOOR
PLAN

SCALE

As indicated

A-201

ISSUE DATE	JOB NUMBER
MARCH 7, 2023	2023_11
DRAWN BY	CHECKED BY
Author	Checker

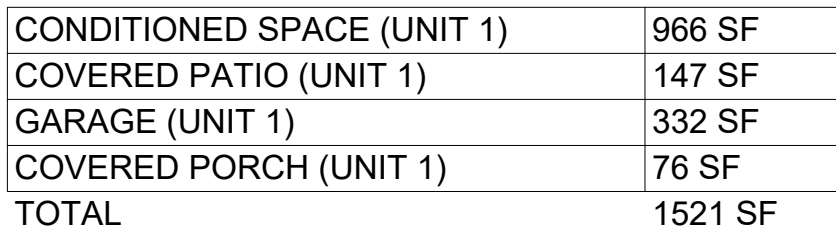

1. ADAPTABLE ROLL-IN SHOWER, MAINTAIN A 2% MAXIMUM SLOPE IN ALL DIRECTIONS. TYPICAL ON ALL SHOWER AND BATH ROOMS, REFER TO A6/A-502 FOR ADDITIONAL INFORMATION.
2. BUILT-IN CLOSET/DRAWERS WITH CLOTHES ROD. PROVIDE 50% OF STORAGE AT 48" HIGH MAX. FROM FINISH FLOOR.
3. ALIGN WITH EDGE OF WALL FOR A SMOOTH AND FLUSHED FINISHED.
4. PROVIDE PEEP HOLE OR VISION PANEL AT 1" PEEPHOLE AT 43" MAX. (OPTIONS PEEPHOLE @ MAX. 60" O.C. AFF). PROVIDE STEEL PLATE AT THE DEAD BOLT STRIKER. SOLID SHIM #6 ABOVE & BELOW WITH 2/8 BY 2" SCREWS.
5. WASHING MACHINES AND CLOTHES DRYERS, DRYER SHALL PROVIDE 4" VENT DUCT TO EXTERIOR WITH MAXIMUM RUN OF 14' INCLUDING 2-90° ELBOWS. TWO FEET SHALL BE DEDUCTED FOR EACH 90 DEGREE ELBOW IN EXCESS OF TWO. REFER TO E5/A-100 FOR ADDITIONAL DETAIL.
6. LAUNDRY MACHINES AND CLOTHES DRYERS SHALL BE FRONT LOADING. THE BOTTOM OF THE OPENING TO THE WASHING COMPARTMENT SHALL BE LOCATED 15 INCHES MINIMUM AND 36 INCHES MAXIMUM ABOVE THE FINISH FLOOR. 2022 CBC 1127A.10.4
7. 50 GAL. HEAT PUMP WATER HEATER. (MINIMUM OF 3.2 UFE PER TITL 24). INSTALL PER MANUFACTURER'S INSTALLATION INSTRUCTIONS.
8. NEW SERVICE PANEL. COORDINATE WITH POWER AND GAS COMPANY PROVIDER PRIOR TO COMMENCING WORK. REFER TO ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION.
9. MIN 24" X 36" ATTIC ACCESS PANEL. "ATTIC ACCESS DOORS SHALL HAVE PERMANENTLY ATTACHED INSULATION USING ADHESIVE OR MECHANICAL FASTENERS. THE ATTIC ACCESS DOORS SHALL BE GASKETED TO PREVENT AIR LEAKS AND WHEN LOOSE-FIT INSULATION IS INSTALLED, THE MINIMUM INSTALLED WEIGHT PER SQUARE FOOT SHALL CONFORM WITH THE INSULATION MANUFACTURER'S INSTALLED DESIGN WEIGHT PER SQUARE FOOT AT THE MANUFACTURER'S LABELED R-VALUE." 2022 CBC 1127A.10.4
10. CONCRETE PATIO SLAB SHALL BE SLOPED AT 2% MAXIMUM AWAY FROM THE BUILDING. REFER TO A11/A-801 FOR ADDITIONAL INFORMATION.

2x6 EXTERIOR WALL ASSEMBLY. REFER TO A1/A-803 AND A-401 FOR ADDITIONAL INFORMATION.

TYP. INTERIOR PARTITION WALL, 1/2" GYP. BOARD EACH SIDE OF 2X4 STUDS @ 16" O.C. TYPICAL INTERIOR WALL PARTITION, U.N.O. REFER TO A5/A-803 FOR ADDITIONAL INFORMATION.

* FOR BATHROOM WALLS:
FIBER-CEMENT, FIBER-MAT REINFORCED CEMENT, GLASS MAT GYPSUM BACKERS OR FIBER-REINFORCED GYPSUM BACKERS IN COMPLIANCE WITH ASTM C 1288, C1325, C 1178 OR C 1278, RESPECTIVELY, AND INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS SHALL BE USED AS BACKERS FOR WALL TILE IN TUB AND SHOWER AREAS AND WALL PANELS IN SHOWER AREAS.


FLOOR FINISHES (FF)	
F1	LUXURY VINYL TILES
F2	CERAMIC TILES OPTION: FLOOR FINISH WITH NON-ABSORBENT SURFACE FROM FINISH FLOOR TO MINIMUM OF 6' A.F.F.

THESE DRAWINGS AND SPECIFICATIONS
ARE THE PROPERTY AND COPYRIGHT OF
THE ARCHITECT AND SHALL NOT BE
USED ON ANY OTHER PROJECT OR
LOCATIONS EXCEPT AS DESCRIBED ON
THE DRAWINGS WITHOUT WRITTEN
AGREEMENT WITH THE ARCHITECT.

ISSUE DATE MARCH 7, 2023	JOB NUMBER 2023_11
DRAWN BY Author	CHECKED BY Checke



©

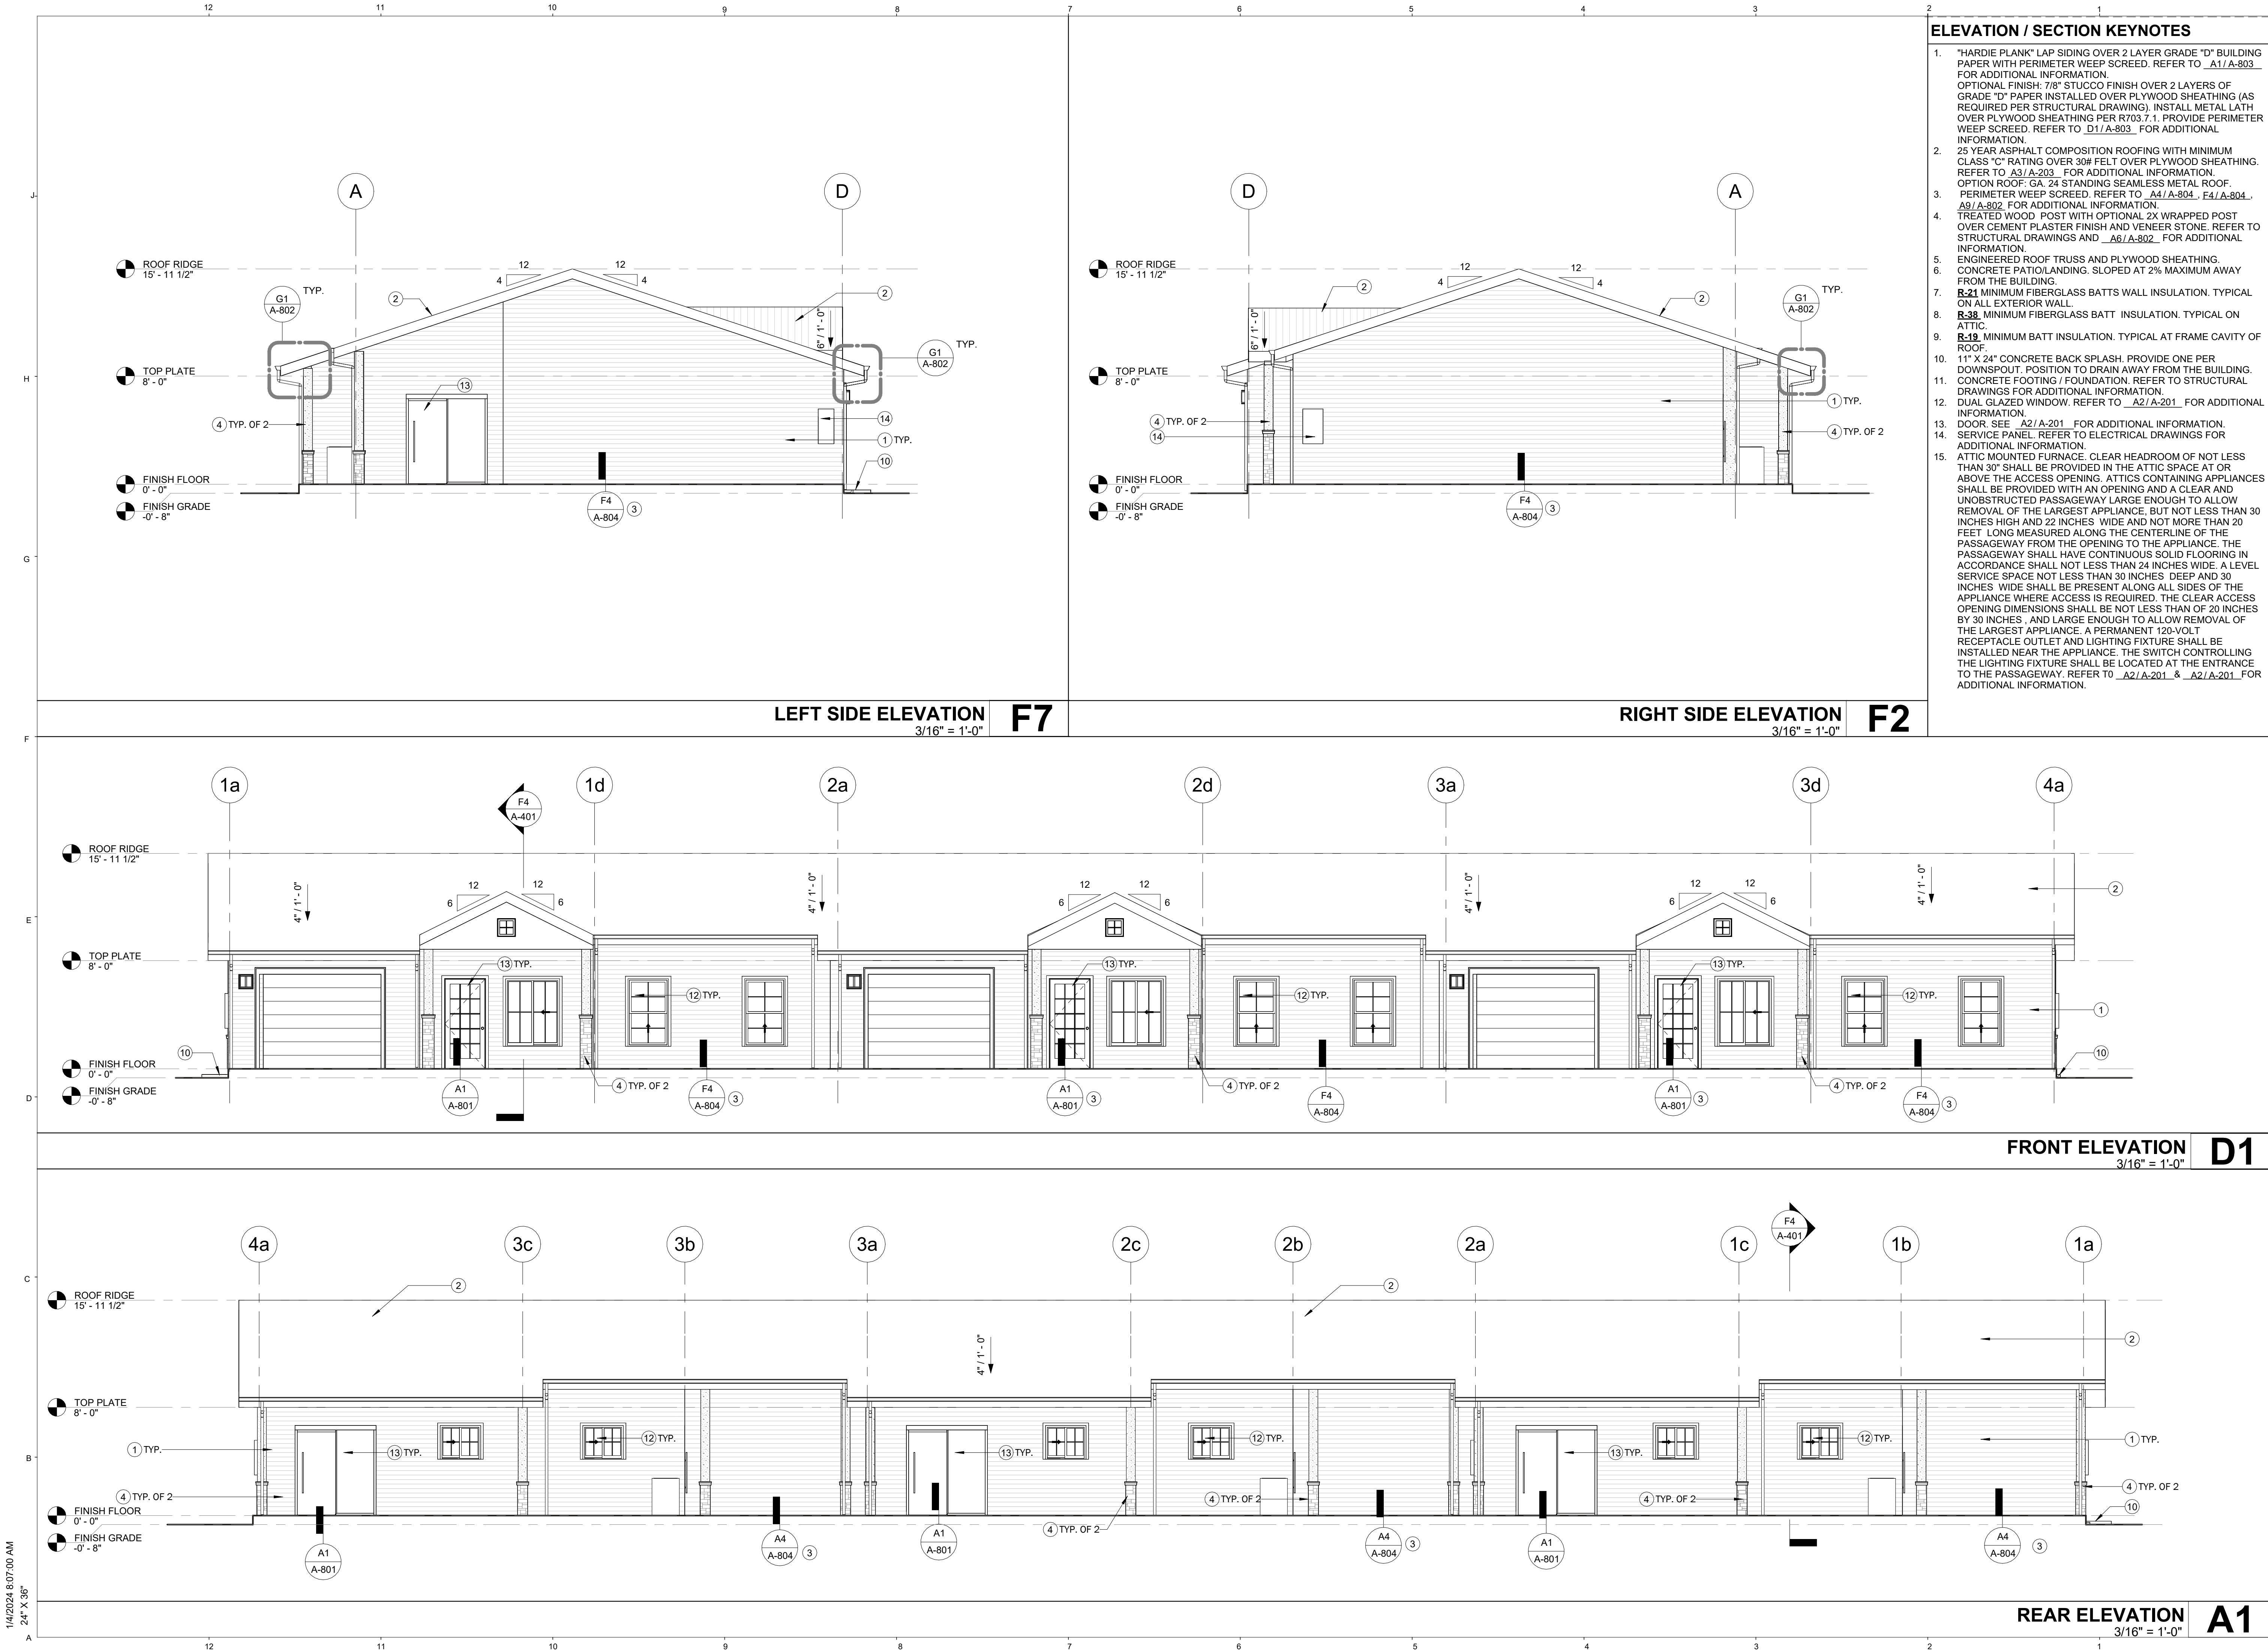


ELEVATION / SECTION KEYNOTES

- "HARDIE PLANK" LAP SIDING OVER 2 LAYER GRADE "D" BUILDING PAPER WITH PERIMETER WEEP SCREED. REFER TO A1/A-803 FOR ADDITIONAL INFORMATION.
OPTIONAL FINISH: 7/8" STUCCO FINISH OVER 2 LAYERS OF GRADE "D" PAPER INSTALLED OVER PLYWOOD SHEATHING (AS REQUIRED PER STRUCTURAL DRAWING). INSTALL METAL LATH OVER PLYWOOD SHEATHING PER R703.7.1. PROVIDE PERIMETER WEEP SCREED. REFER TO D1/A-803 FOR ADDITIONAL INFORMATION.
- 25 YEAR ASPHALT COMPOSITION ROOFING WITH MINIMUM CLASS "C" RATING OVER 30# FELT OVER PLYWOOD SHEATHING. REFER TO A3/A-203 FOR ADDITIONAL INFORMATION.
OPTION ROOF: GA. 24 STANDING SEAMLESS METAL ROOF. PERIMETER WEEP SCREED. REFER TO A4/A-804 & F4/A-804 & A9/A-802 FOR ADDITIONAL INFORMATION.
- TREATED WOOD POST WITH OPTIONAL 2X WRAPPED POST OVER CEMENT PLASTER FINISH AND VENEER STONE. REFER TO STRUCTURAL DRAWINGS AND A6/A-802 FOR ADDITIONAL INFORMATION.
- ENGINEERED ROOF TRUSS AND PLYWOOD SHEATHING.
- CONCRETE PATIO/LANDING. SLOPED AT 2% MAXIMUM AWAY FROM THE BUILDING.
- R-21 MINIMUM FIBERGLASS BATTS WALL INSULATION. TYPICAL ON ALL EXTERIOR WALL.
- R-38 MINIMUM FIBERGLASS BATT INSULATION. TYPICAL ON ATTIC.
- R-19 MINIMUM BATT INSULATION. TYPICAL AT FRAME CAVITY OF ROOF.
- 11" X 24" CONCRETE BACK SPLASH. PROVIDE ONE PER DOWNSPOUT. POSITION TO DRAIN AWAY FROM THE BUILDING.
- CONCRETE FOOTING / FOUNDATION. REFER TO STRUCTURAL DRAWINGS FOR ADDITIONAL INFORMATION.
- DUAL GLAZED WINDOW. REFER TO A2/A-201 FOR ADDITIONAL INFORMATION.
- DOOR. SEE A2/A-201 FOR ADDITIONAL INFORMATION.
- SERVICE PANEL. REFER TO ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION.
- ATTIC MOUNTED FURNACE. CLEAR HEADROOM OF NOT LESS THAN 30" SHALL BE PROVIDED IN THE ATTIC SPACE AT OR ABOVE THE ACCESS OPENING. ATTICS CONTAINING APPLIANCES SHALL BE PROVIDED WITH AN OPENING AND A CLEAR AND UNOBSTRUCTED PASSAGEWAY LARGE ENOUGH TO ALLOW REMOVAL OF THE LARGEST APPLIANCE, BUT NOT LESS THAN 30 INCHES HIGH AND 22 INCHES WIDE AND NOT MORE THAN 20 FEET LONG MEASURED ALONG THE CENTERLINE OF THE PASSAGEWAY FROM THE OPENING TO THE APPLIANCE. THE PASSAGEWAY SHALL HAVE CONTINUOUS SOLID FLOORING IN ACCORDANCE SHALL NOT LESS THAN 24 INCHES WIDE. A LEVEL SERVICE SPACE NOT LESS THAN 30 INCHES DEEP AND 30 INCHES WIDE SHALL BE PRESENT ALONG ALL SIDES OF THE APPLIANCE WHERE ACCESS IS REQUIRED. THE CLEAR ACCESS OPENING DIMENSIONS SHALL BE NOT LESS THAN OF 20 INCHES BY 30 INCHES, AND LARGE ENOUGH TO ALLOW REMOVAL OF THE LARGEST APPLIANCE. A PERMANENT 120-VOLT RECEPTACLE OUTLET AND LIGHTING FIXTURE SHALL BE INSTALLED NEAR THE APPLIANCE. THE SWITCH CONTROLLING THE LIGHTING FIXTURE SHALL BE LOCATED AT THE ENTRANCE TO THE PASSAGEWAY. REFER TO A2/A-201 & A2/A-201 FOR ADDITIONAL INFORMATION.

TRIPLEX DWELLING UNIT

OPTION #2

PROJECT
TRIPLEX DWELLING UNIT

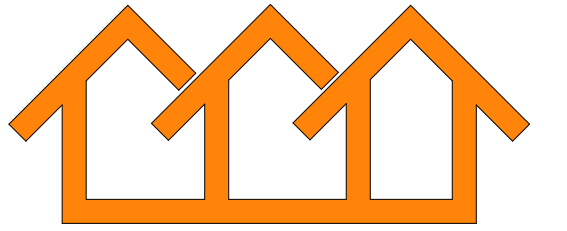

PWP23-005


DEPARTMENT OF PUBLIC WORKS AND PLANNING



CAPITAL PROJECTS DIVISION

2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

SEAL & SIGNATURE

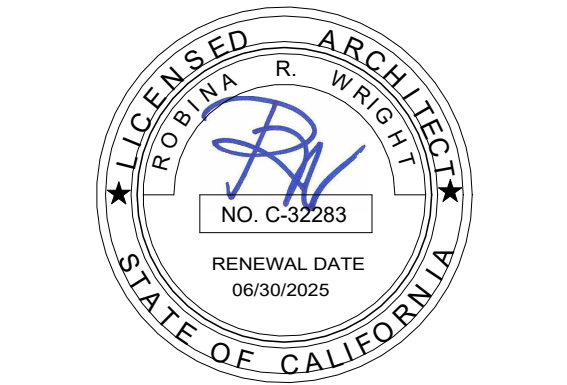

UPDATE

JANUARY 2, 2024

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY AND COPYRIGHT OF THE ARCHITECT AND SHALL NOT BE USED ON ANY OTHER PROJECT OR LOCATIONS EXCEPT AS DESCRIBED ON THE DRAWINGS WITHOUT WRITTEN AGREEMENT WITH THE ARCHITECT.

TITLE

ELEVATIONS

SCALE

As indicated


A-301

ISSUE DATE MARCH 7, 2023 JOB NUMBER 2023_11

DRAWN BY Author CHECKED BY Checker

1/4/2024 8:07:00 AM
24" X 36"

1/4/2024 5:07:01 AM
24" X 36"

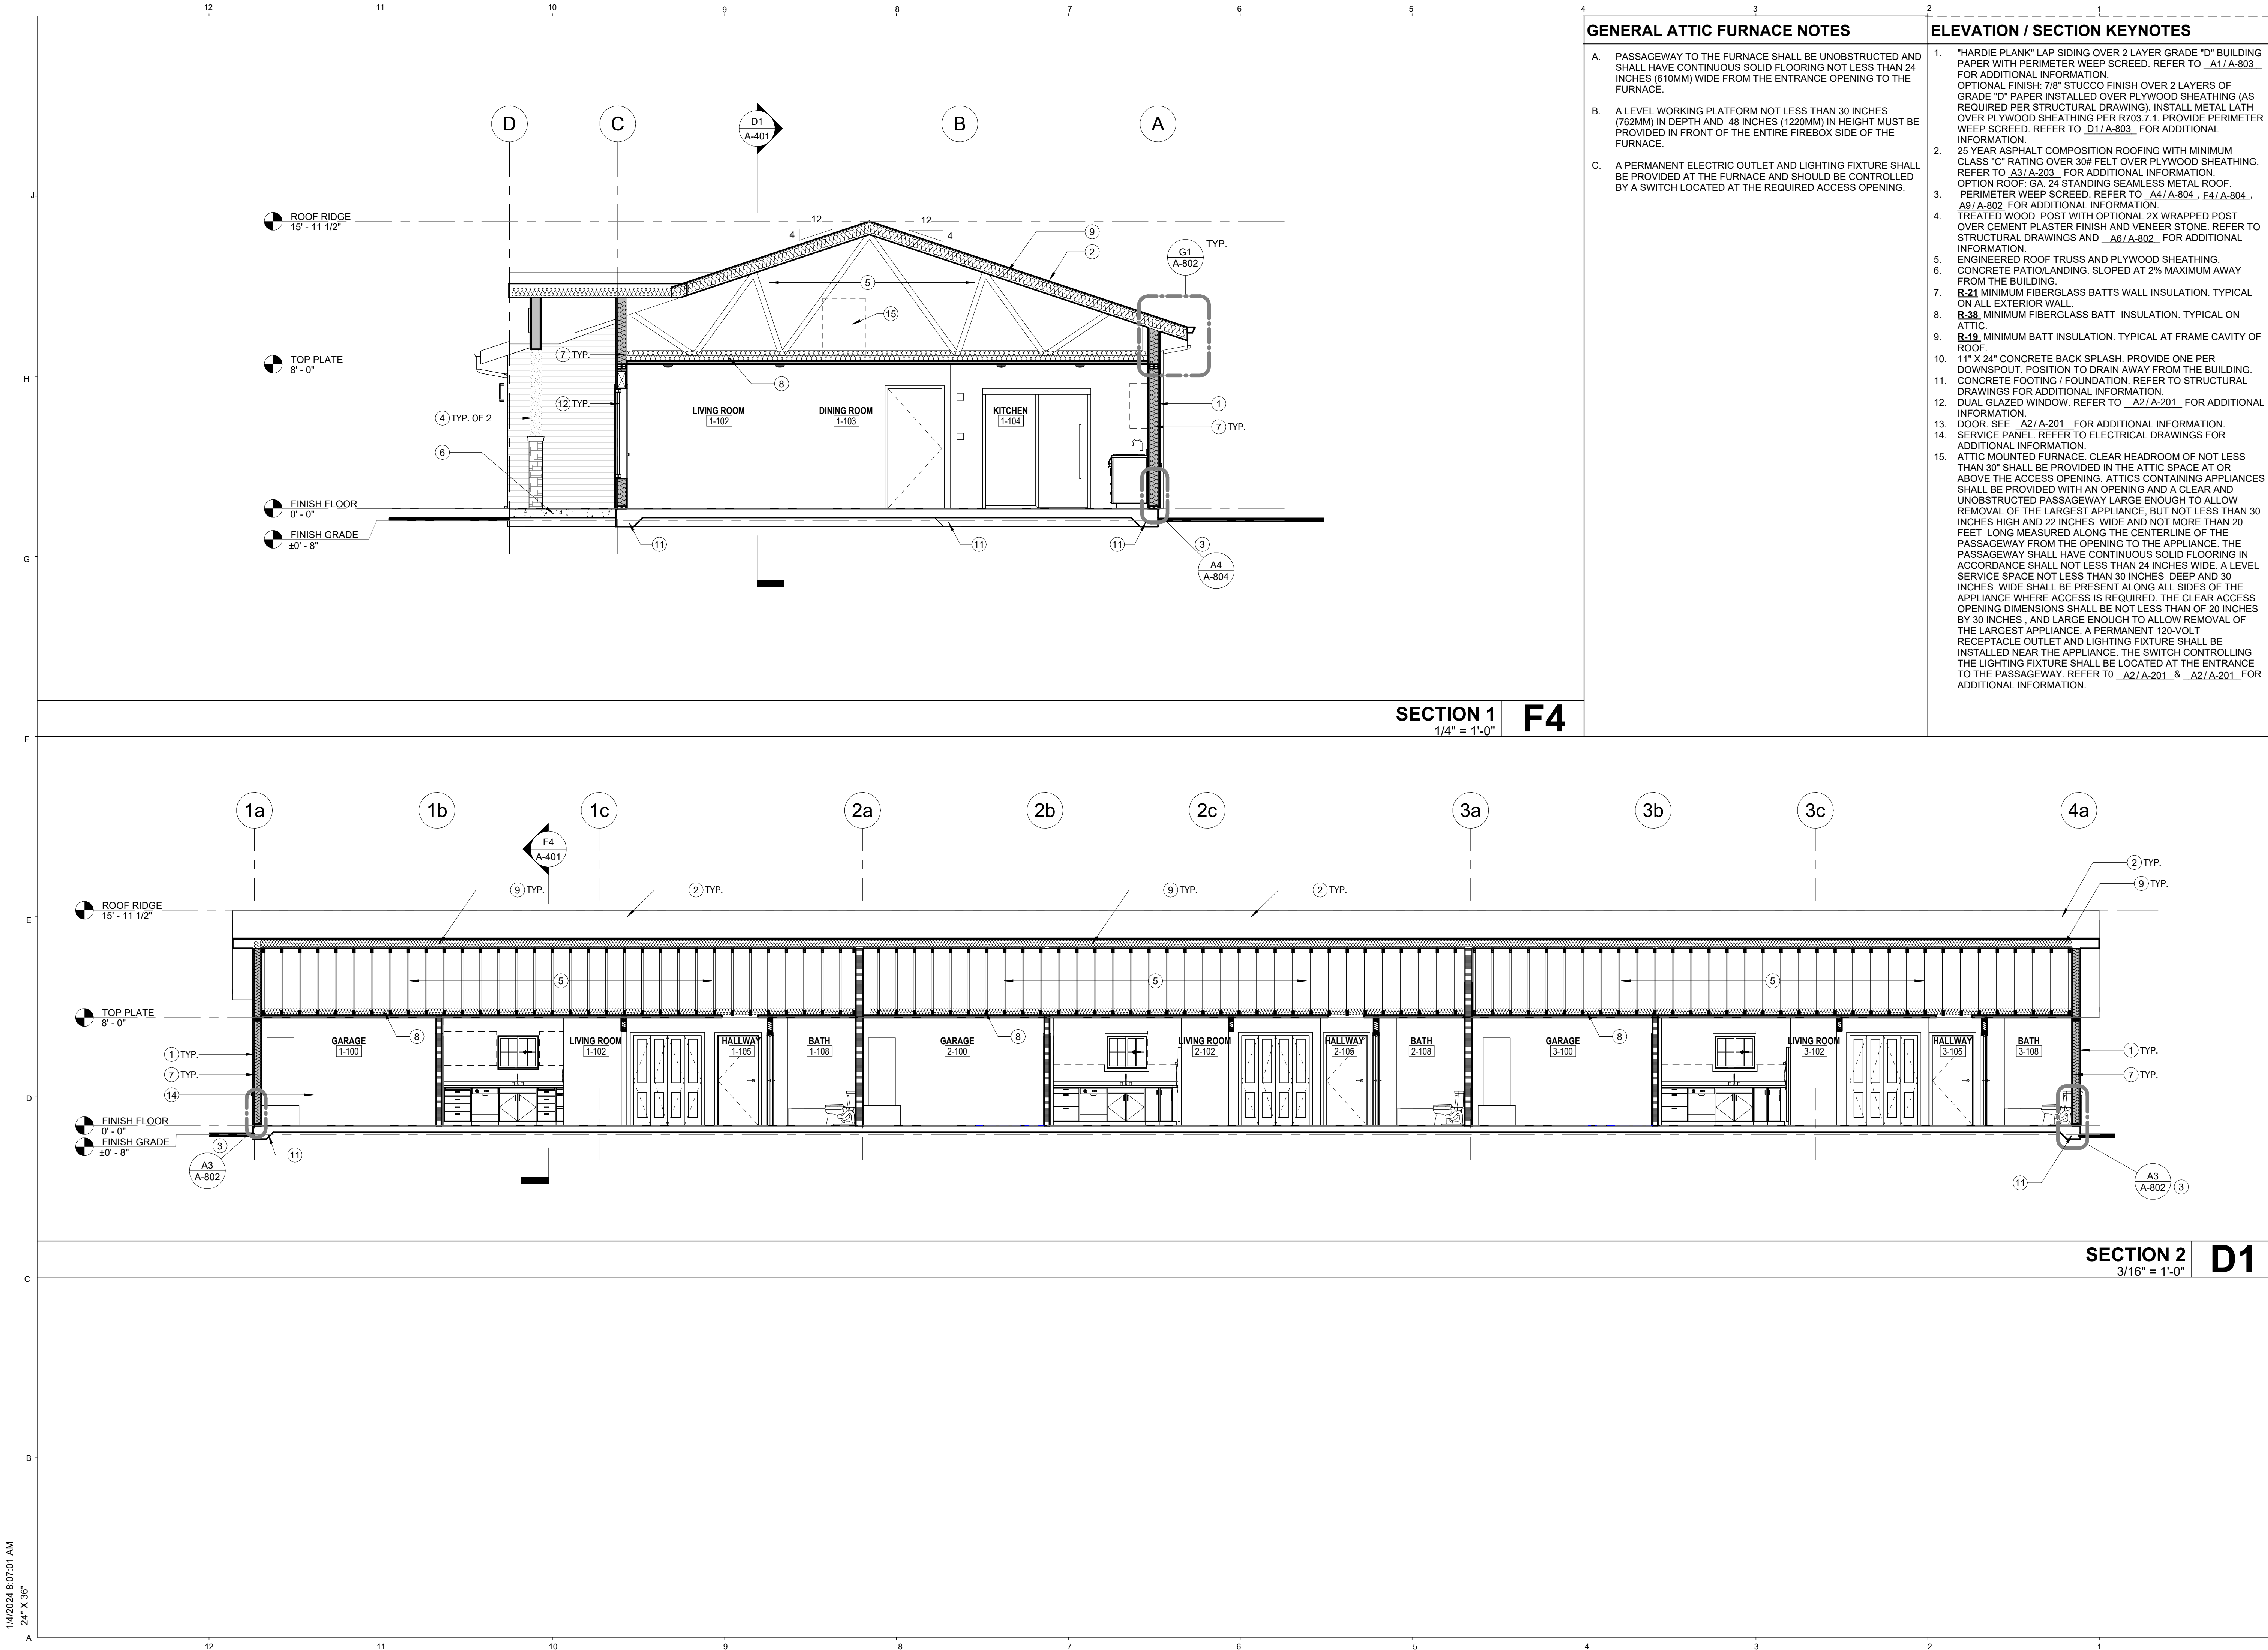

GENERAL ATTIC FURNACE NOTES

- A. PASSAGEWAY TO THE FURNACE SHALL BE UNOBSTRUCTED AND SHALL HAVE CONTINUOUS SOLID FLOORING NOT LESS THAN 24 INCHES (610MM) WIDE FROM THE ENTRANCE OPENING TO THE FURNACE.
- B. A LEVEL WORKING PLATFORM NOT LESS THAN 30 INCHES (762MM) IN DEPTH AND 48 INCHES (1220MM) IN HEIGHT MUST BE PROVIDED IN FRONT OF THE ENTIRE FIREBOX SIDE OF THE FURNACE.
- C. A PERMANENT ELECTRIC OUTLET AND LIGHTING FIXTURE SHALL BE PROVIDED AT THE FURNACE AND SHOULD BE CONTROLLED BY A SWITCH LOCATED AT THE REQUIRED ACCESS OPENING.

ELEVATION / SECTION KEYNOTES


- "HARDIE PLANK" LAP SIDING OVER 2 LAYER GRADE "D" BUILDING PAPER WITH PERIMETER WEEP SCREED. REFER TO A1/A-803 FOR ADDITIONAL INFORMATION.
- OPTIONAL FINISH: 7/8" STUCCO FINISH OVER 2 LAYERS OF GRADE "D" PAPER INSTALLED OVER PLYWOOD SHEATHING (AS REQUIRED PER STRUCTURAL DRAWING). INSTALL METAL LATH OVER PLYWOOD SHEATHING PER R703.7.1. PROVIDE PERIMETER WEEP SCREED. REFER TO D1/A-803 FOR ADDITIONAL INFORMATION.
- 25 YEAR ASPHALT COMPOSITION ROOFING WITH MINIMUM CLASS "C" RATING OVER 30# FELT OVER PLYWOOD SHEATHING. REFER TO A3/A-203 FOR ADDITIONAL INFORMATION.
- OPTION ROOF: GA. 24 STANDING SEAMLESS METAL ROOF. PERIMETER WEEP SCREED. REFER TO A4/A-804, F4/A-804, A9/A-802 FOR ADDITIONAL INFORMATION.
- TREATED WOOD POST WITH OPTIONAL 2X WRAPPED POST OVER CEMENT PLASTER FINISH AND VENEER STONE. REFER TO STRUCTURAL DRAWINGS AND A6/A-802 FOR ADDITIONAL INFORMATION.
- ENGINEERED ROOF TRUSS AND PLYWOOD SHEATHING.
- CONCRETE PATIO/LANDING. SLOPED AT 2% MAXIMUM AWAY FROM THE BUILDING.
- R-21** MINIMUM FIBERGLASS BATTS WALL INSULATION. TYPICAL ON ALL EXTERIOR WALL.
- R-38** MINIMUM FIBERGLASS BATT INSULATION. TYPICAL ON ATTIC.
- R-19** MINIMUM BATT INSULATION. TYPICAL AT FRAME CAVITY OF ROOF.
- 11" X 24" CONCRETE BACK SPLASH. PROVIDE ONE PER DOWNSPOUT. POSITION TO DRAIN AWAY FROM THE BUILDING.
- CONCRETE FOOTING / FOUNDATION. REFER TO STRUCTURAL DRAWINGS FOR ADDITIONAL INFORMATION.
- DUAL GLAZED WINDOW. REFER TO A2/A-201 FOR ADDITIONAL INFORMATION.
- DOOR. SEE A2/A-201 FOR ADDITIONAL INFORMATION.
- SERVICE PANEL. REFER TO ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION.
- ATTIC MOUNTED FURNACE. CLEAR HEADROOM OF NOT LESS THAN 30" SHALL BE PROVIDED IN THE ATTIC SPACE AT OR ABOVE THE ACCESS OPENING. ATTICS CONTAINING APPLIANCES SHALL BE PROVIDED WITH AN OPENING AND A CLEAR AND UNOBSTRUCTED PASSAGEWAY LARGE ENOUGH TO ALLOW REMOVAL OF THE LARGEST APPLIANCE, BUT NOT LESS THAN 30 INCHES HIGH AND 22 INCHES WIDE AND NOT MORE THAN 20 FEET LONG MEASURED ALONG THE CENTERLINE OF THE PASSAGEWAY FROM THE OPENING TO THE APPLIANCE. THE PASSAGEWAY SHALL HAVE CONTINUOUS SOLID FLOORING IN ACCORDANCE SHALL NOT LESS THAN 24 INCHES WIDE. A LEVEL SERVICE SPACE NOT LESS THAN 30 INCHES DEEP AND 30 INCHES WIDE SHALL BE PRESENT ALONG ALL SIDES OF THE APPLIANCE WHERE ACCESS IS REQUIRED. THE CLEAR ACCESS OPENING DIMENSIONS SHALL BE NOT LESS THAN OF 20 INCHES BY 30 INCHES, AND LARGE ENOUGH TO ALLOW REMOVAL OF THE LARGEST APPLIANCE. A PERMANENT 120-VOLT RECEPTACLE OUTLET AND LIGHTING FIXTURE SHALL BE INSTALLED NEAR THE APPLIANCE. THE SWITCH CONTROLLING THE LIGHTING FIXTURE SHALL BE LOCATED AT THE ENTRANCE TO THE PASSAGEWAY. REFER TO A2/A-201 & A2/A-201 FOR ADDITIONAL INFORMATION.

TRIPLEX DWELLING UNIT

OPTION #2

PROJECT

TRIPLEX
DWELLING UNIT

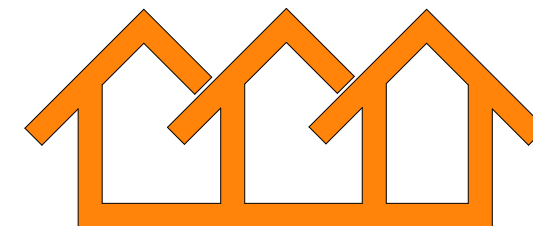

PWP23-005


DEPARTMENT OF PUBLIC
WORKS AND PLANNING



CAPITAL PROJECTS
DIVISION

2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

SEAL & SIGNATURE

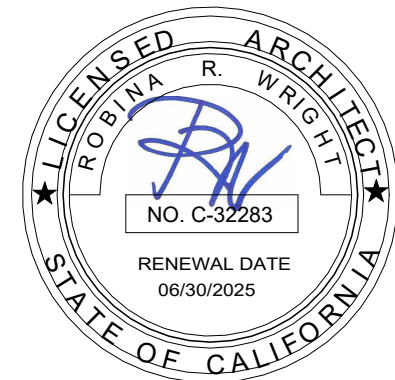

UPDATE

JANUARY 2, 2024

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY AND COPYRIGHT OF THE ARCHITECT AND SHALL NOT BE USED ON ANY OTHER PROJECT OR LOCATIONS EXCEPT AS DESCRIBED ON THE DRAWINGS WITHOUT WRITTEN AGREEMENT WITH THE ARCHITECT.

TITLE

BUILDING SECTIONS

SCALE

As indicated

A-401


ISSUE DATE	JOB NUMBER
MARCH 7, 2023	2023_11
DRAWN BY	CHECKED BY
Author	Checker

©


1/4/2024 8:07:05 AM

1/4/2024 5:07:06 AM
24" X 36"


- 1134A.7 WATER CLOSETS.** WATER CLOSETS IN BATHROOMS OR POWDER ROOMS REQUIRED TO BE ACCESSIBLE SHALL COMPLY WITH THIS SECTION.
1. **FLOOR SPACE AND LOCATION.** THE MINIMUM FLOOR SPACE PROVIDED AT A WATER CLOSET SHALL BE 48 INCHES IN CLEAR WIDTH. THE CLEAR FLOOR SPACE SHALL EXTEND PAST THE FRONT EDGE OF THE WATER CLOSET AT LEAST 36 INCHES. SEE **FIGURE 11A-9M.**
- EXCEPTION:** THE 48-INCH MINIMUM CLEAR WIDTH MAY BE REDUCED TO 36 INCHES FOR LAVATORIES, CABINETS, WING WALLS OR PRIVACY WALLS LOCATED IMMEDIATELY ADJACENT TO A WATER CLOSET WHICH EXTEND NO MORE THAN 24 INCHES IN DEPTH.
- WATER CLOSETS SHALL BE LOCATED WITHIN BATHROOMS IN A MANNER THAT PERMITS A GRAB BAR TO BE INSTALLED ON AT LEAST ONE SIDE OF THE FIXTURE. THE CENTERLINE OF THE WATER CLOSET SHALL BE 17 INCHES MINIMUM TO 18 INCHES MAXIMUM FROM A GRAB BAR WALL OR PARTITION. IN LOCATIONS WHERE WATER CLOSETS ARE ADJACENT TO NON-GRAB BAR WALLS, VANITIES, LAVATORIES OR BATHTUBS, THE CENTERLINE OF THE FIXTURE SHALL BE A MINIMUM OF 18 INCHES FROM THE OBSTACLE.
2. **REINFORCED WALLS FOR GRAB BARS.** WHERE THE WATER CLOSET IS NOT PLACED ADJACENT TO A SIDE WALL CAPABLE OF ACCOMMODATING A GRAB BAR, THE BATHROOM SHALL HAVE PROVISIONS FOR INSTALLATION OF FLOOR-MOUNTED, FOLDAWAY OR SIMILAR ALTERNATIVE GRAB BARS. WHERE THE WATER CLOSET IS PLACED ADJACENT TO A SIDE WALL, REINFORCEMENT SHALL BE INSTALLED ON BOTH SIDES OR ONE SIDE AND THE BACK. IF REINFORCEMENT IS INSTALLED AT THE BACK, IT SHALL BE INSTALLED BETWEEN 32 INCHES AND 38 INCHES ABOVE THE FLOOR. THE GRAB BAR REINFORCEMENT SHALL BE A MINIMUM OF 6 INCHES NOMINAL IN HEIGHT. THE BACKING SHALL BE A MINIMUM OF 40 INCHES IN LENGTH. REINFORCEMENT INSTALLED AT THE SIDE OF THE WATER CLOSET SHALL BE INSTALLED 32 INCHES TO 38 INCHES ABOVE THE FLOOR. THE REINFORCEMENT SHALL BE INSTALLED A MAXIMUM OF 12 INCHES FROM THE REAR WALL AND SHALL EXTEND A MINIMUM OF 28 INCHES IN FRONT OF THE WATER CLOSET. THE GRAB BAR REINFORCEMENT SHALL BE A MINIMUM OF 6 INCHES NOMINAL IN HEIGHT.
3. **SEAT HEIGHT.** THE MINIMUM HEIGHT OF WATER CLOSET SEATS SHALL BE 15 INCHES ABOVE THE FLOOR.
4. **WATER CLOSET CONTROLS.** WATER CLOSET CONTROLS SHALL BE MOUNTED NO MORE THAN 44 INCHES ABOVE THE FLOOR. THE FORCE REQUIRED TO ACTIVATE CONTROLS SHALL BE NO GREATER THAN 5 POUNDS.

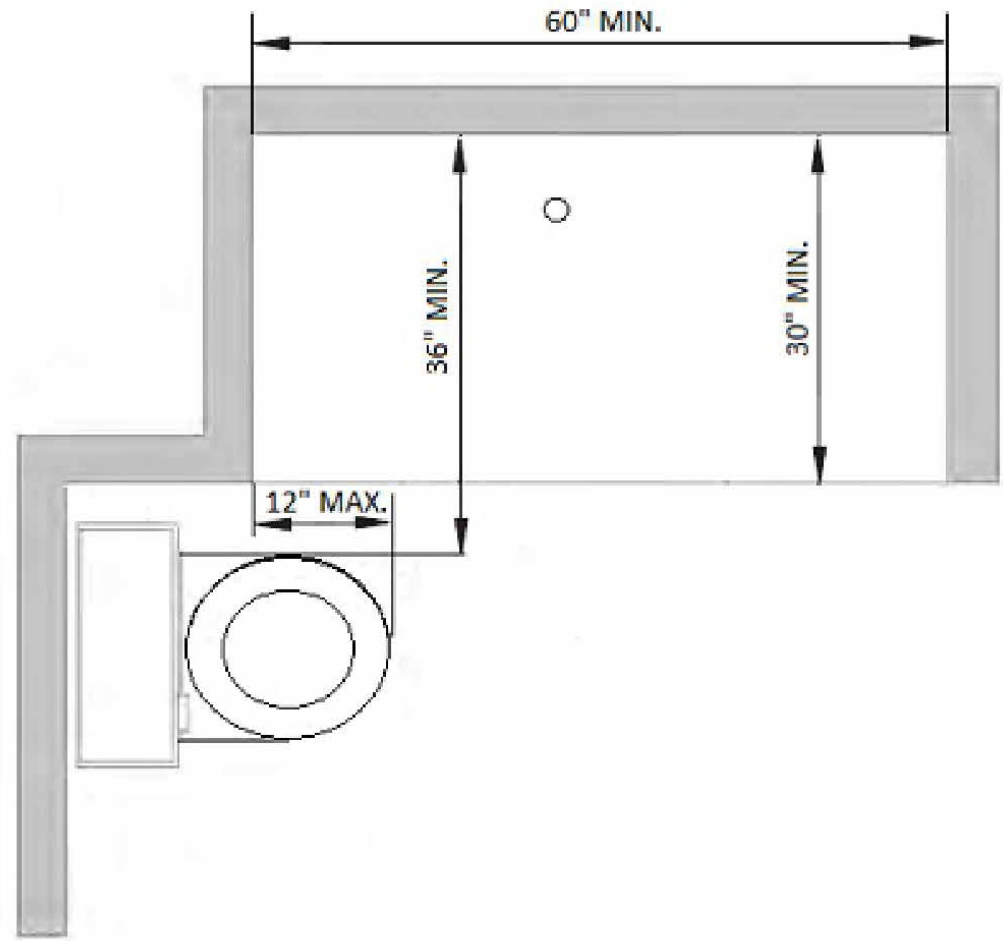

**FIGURE 11A-9L
SHOWER WITH WATER CLOSET**

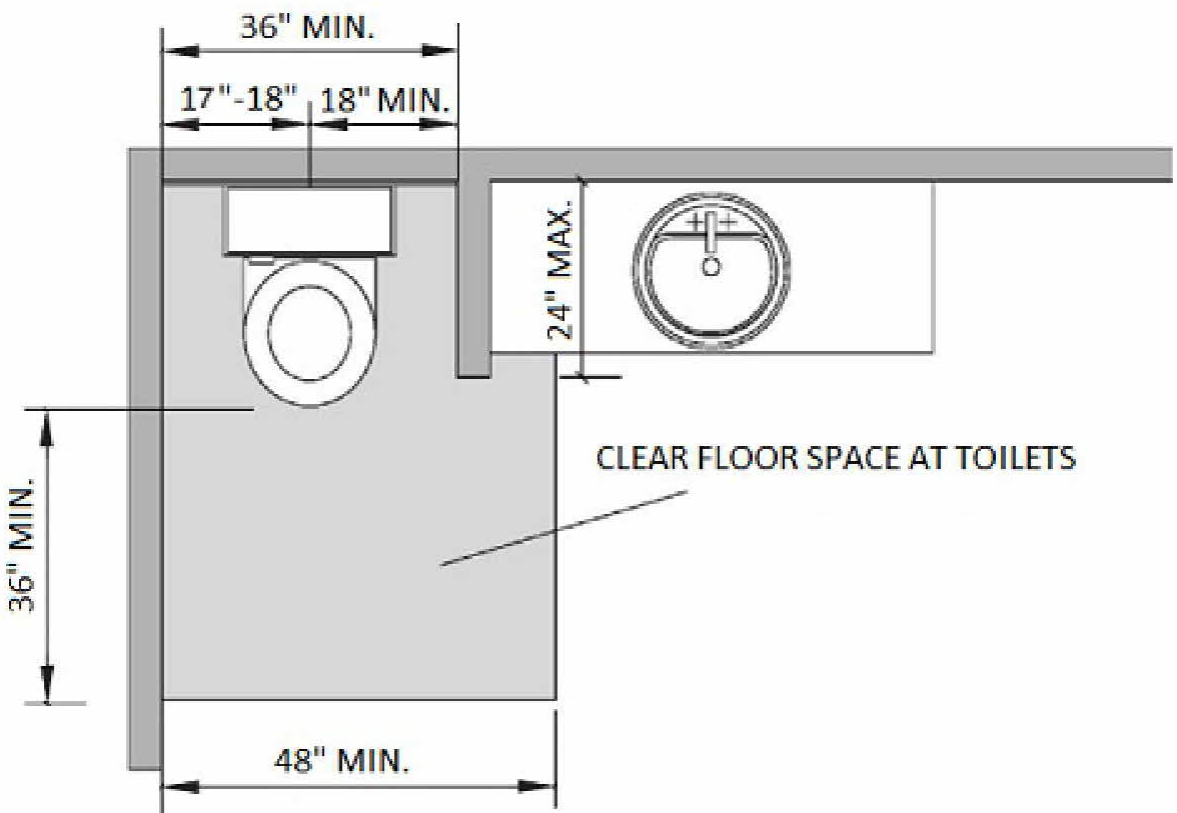

**FIGURE 11A-9M
WING WALL OR CABINET AT WATER CLOSET**

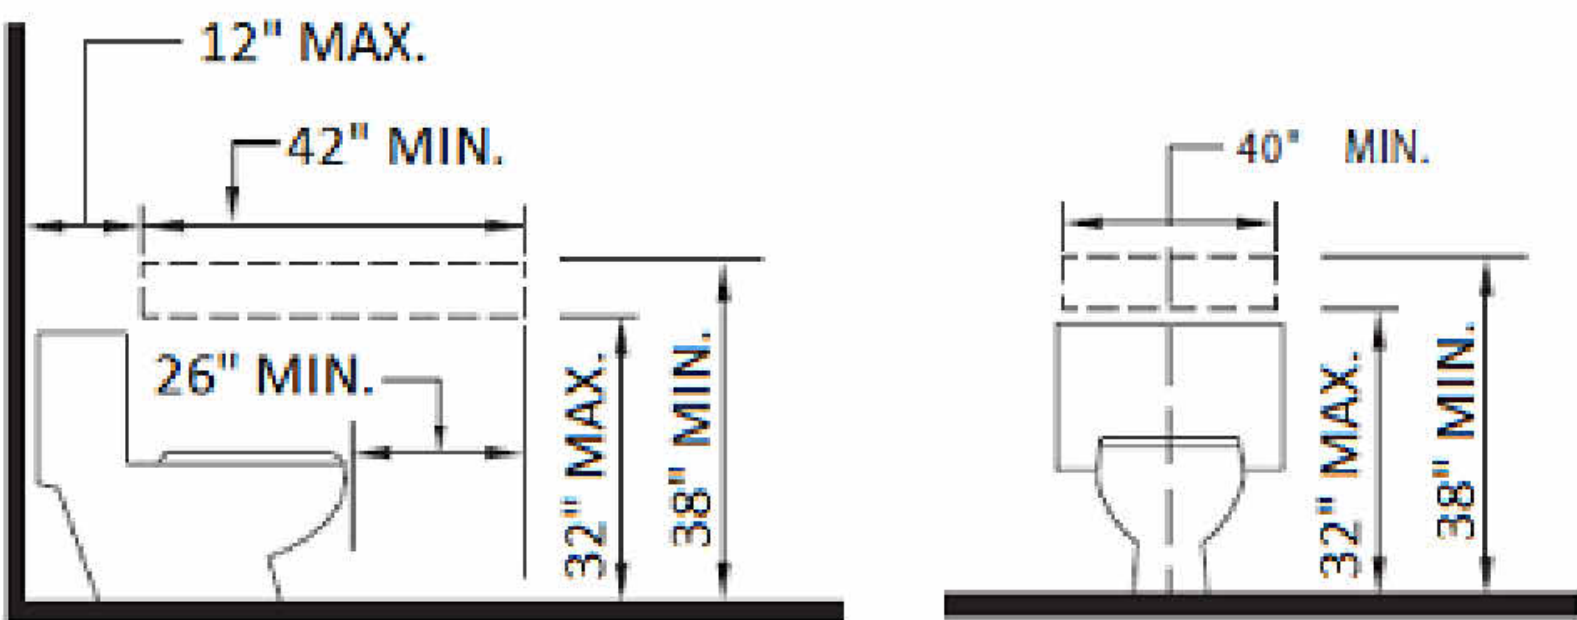

GRAB BAR REINFORCEMENT FOR ADAPTABLE WATER CLOSETS

ADAPTABLE WATER CLOSET
12" = 1'-0"

A9


**SECTION 1134A
BATHING AND TOILET FACILITIES 9
(APPLIES TO COVERED MULTI-FAMILY DWELLING UNITS)**

- OPTION 2. ONLY ONE BATHROOM WITHIN THE DWELLING UNIT SHALL BE DESIGNED TO COMPLY WITH THE FOLLOWING:
1. TOILET, BATHING AND SHOWER FACILITIES SHALL COMPLY WITH SECTION 1134A.4.
 2. BATHTUBS SHALL COMPLY WITH SECTION 1134A.5.
 3. SHOWERS SHALL COMPLY WITH SECTION 1134A.6.
 4. WATER CLOSETS SHALL COMPLY WITH SECTION 1134A.7.
 5. LAVATORIES, VANITIES, MIRRORS AND TOWEL FIXTURES SHALL COMPLY WITH SECTION 1134A.8.
 6. WHERE BOTH A TUB AND SHOWER ARE PROVIDED IN THE BATHROOM, AT LEAST ONE SHALL BE MADE ACCESSIBLE. ADDITIONAL REQUIREMENTS APPLY TO DWELLINGS UNITS CONTAINING TWO OR MORE BATHROOMS WHEN A BATHTUB IS PROVIDED AS THE ACCESSIBLE BATHING FIXTURE. WHERE TWO OR MORE BATHROOMS ARE PROVIDED WITHIN THE SAME DWELLING UNIT AND A BATHTUB IS INSTALLED TO COMPLY WITH OPTION 2, ITEM 6 IN ONE BATHROOM AND A SHOWER STALL IS PROVIDED IN A SUBSEQUENT BATHROOM, BOTH THE BATHTUB SELECTED TO COMPLY WITH OPTION 2, ITEM 6 AND AT LEAST ONE SHOWER STALL WITHIN THE DWELLING UNIT SHALL MEET ALL THE APPLICABLE ACCESSIBILITY REQUIREMENTS PROVIDED IN SECTION 1134A. (SEE SECTION 1134A.5 FOR BATHTUBS, OR SECTION 1134A.6 FOR SHOWERS.)
 7. BATHROOMS SHALL BE PROVIDED WITH AN ACCESSIBLE ROUTE INTO AND THROUGH THE BATHROOM.
 8. WHEN TWO OR MORE LAVATORIES ARE PROVIDED, AT LEAST ONE SHALL BE MADE ACCESSIBLE AND COMPLY WITH SECTION 1134A.8.
 9. IF A DOOR IS PROVIDED, IT SHALL COMPLY WITH THE REQUIREMENTS OF SECTION 1132A.5.
 10. A MINIMUM 18-INCH CLEAR MANEUVERING SPACE SHALL BE PROVIDED ON THE SWING SIDE OF THE DOOR AT THE STRIKE EDGE OF THE DOOR.
 11. SWITCHES, OUTLETS AND CONTROLS SHALL COMPLY WITH SECTION 1142A.
 12. REINFORCED WALLS TO ALLOW FOR THE FUTURE INSTALLATION OF GRAB BARS AROUND THE TOILET, TUB AND SHOWER SHALL COMPLY WITH SECTIONS 1134A.5 FOR BATHTUBS, 1134A.6 FOR SHOWERS AND 1134A.7 FOR WATER CLOSETS. GRAB BARS SHALL COMPLY WITH SECTIONS 1127A.4 AND 1127A.2.2, ITEM 4.


WHEN OPTION 2 IS USED, ALL ADDITIONAL BATHROOMS MUST COMPLY WITH ITEMS 8 THROUGH 12 ABOVE

1134A.4 SUFFICIENT MANEUVERING SPACE. BATHING AND TOILET FACILITIES REQUIRED TO BE ADAPTABLE SHALL PROVIDE SUFFICIENT MANEUVERING SPACE FOR A PERSON USING A WHEELCHAIR OR OTHER MOBILITY AID TO ENTER AND CLOSE THE DOOR, USE THE FIXTURES, REOPEN THE DOOR AND EXIT, WHERE THE DOOR SWINGS INTO THE BATHROOM OR POWDER ROOM, THERE SHALL BE A CLEAR MANEUVERING SPACE OUTSIDE THE SWING OF THE DOOR OF AT LEAST 30 INCHES BY 48 INCHES WITHIN THE ROOM. THE CLEAR MANEUVERING SPACE SHALL ALLOW THE USER TO POSITION A WHEELCHAIR OR OTHER MOBILITY AID CLEAR OF THE PATH OF THE DOOR AS IT IS CLOSED AND TO PERMIT USE OF FIXTURES. DOORS MAY SWING INTO THE REQUIRED CLEAR SPACE AT ANY FIXTURE WHEN A CLEAR MANEUVERING SPACE IS PROVIDED OUTSIDE THE SWING ARC OF THE DOOR SO IT CAN BE CLOSED. MANEUVERING SPACES MAY INCLUDE ANY KNEE SPACE OR TOE SPACE AVAILABLE BELOW BATHROOM FIXTURES.

- 1134A.5 BATHTUBS.** BATHTUBS REQUIRED TO BE ACCESSIBLE SHALL COMPLY WITH THIS SECTION.
1. **FLOOR SPACE.** THERE SHALL BE A MINIMUM CLEAR FLOOR SPACE 48 INCHES PARALLEL BY 30 INCHES PERPENDICULAR TO THE SIDE OF A BATHTUB OR BATHTUB-SHOWER COMBINATION TO PROVIDE FOR THE MANEUVERING OF A WHEELCHAIR AND TRANSFER TO AND FROM THE BATHING FACILITIES. THE CONTROLS SHALL BE ON THE WALL AT THE FOOT OF THE BATHTUB. THE EDGE OF THE CLEAR FLOOR SPACE SHALL BE FLUSH WITH THE CONTROL WALL SURFACE. THE AREA UNDER A LAVATORY, LOCATED AT THE CONTROL END OF THE TUB, MAY BE INCLUDED IN THE CLEAR FLOOR SPACE PROVIDED THE LAVATORY IS 19 INCHES MAXIMUM DEEP, AND THE KNEE AND TOE SPACE COMPLY WITH **SECTION 1134A.8**. CABINETS UNDER LAVATORIES AND TOILETS SHALL NOT ENCROACH INTO THE CLEAR FLOOR SPACE.
 2. **REINFORCED WALLS FOR GRAB BARS.** A BATHTUB INSTALLED WITHOUT SURROUNDING WALLS SHALL PROVIDE REINFORCED AREAS FOR THE INSTALLATION OF FLOOR-MOUNTED GRAB BARS. WHERE A BATHTUB IS INSTALLED WITH SURROUNDING WALLS, GRAB BAR REINFORCEMENT SHALL BE LOCATED ON EACH END OF THE BATHTUB, 32 INCHES TO 38 INCHES ABOVE THE FLOOR, EXTENDING A MINIMUM OF 24 INCHES FROM THE FRONT EDGE OF THE BATHTUB TOWARD THE BACK WALL OF THE BATHTUB. THE GRAB BAR REINFORCEMENT SHALL BE A MINIMUM OF 6 INCHES NOMINAL IN HEIGHT. (SEE FIGURE 11A-9G.) GRAB BAR REINFORCEMENT SHALL BE INSTALLED ON THE BACK WALL OF THE BATHTUB A MAXIMUM OF 6 INCHES ABOVE THE BATHTUB RIM EXTENDING UPWARD TO AT LEAST 38 INCHES ABOVE THE FLOOR. GRAB BAR BACKING SHALL BE INSTALLED HORIZONTALLY TO PERMIT THE INSTALLATION OF A 48-INCH GRAB BAR WITH EACH END A MAXIMUM OF 6 INCHES FROM THE END WALLS OF THE BATHTUB. THE GRAB BAR REINFORCEMENT SHALL BE A MINIMUM OF 6 INCHES NOMINAL IN HEIGHT.
 3. **BATHTUB CONTROLS.** FAUCET CONTROLS AND OPERATION MECHANISMS SHALL BE OPERABLE WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING, PINCHING OR TWISTING OF THE WRIST. THE FORCE REQUIRED TO ACTIVATE CONTROLS SHALL BE NO GREATER THAN 5 POUNDS. LEVER OPERATED, PUSH TYPE AND ELECTRONICALLY CONTROLLED MECHANISMS ARE EXAMPLES OF ACCEPTABLE DESIGNS.
 4. **SHOWER UNIT.** A SHOWER SPRAY UNIT IS NOT REQUIRED IN BATHTUBS.
 5. **BATHTUB ENCLOSURES.** DOORS AND PANELS OF BATHTUB ENCLOSURES SHALL BE SUBSTANTIALLY CONSTRUCTED FROM APPROVED, SHATTER-RESISTANT MATERIALS. HINGED DOORS SHALL OPEN OUTWARD. GLAZING USED IN DOORS AND PANELS OF BATHTUB ENCLOSURES SHALL BE FULLY TEMPERED, LAMINATED SAFETY GLASS OR APPROVED PLASTIC. WHEN GLASS IS USED, IT SHALL HAVE A MINIMUM THICKNESS OF NOT LESS THAN 1/8 INCH WHEN FULLY TEMPERED, OR 1/4 INCH WHEN LAMINATED, AND SHALL PASS THE TEST REQUIREMENTS OF THIS PART, CHAPTER 24, GLASS AND GLAZING. PLASTICS USED IN DOORS AND PANELS OF BATHTUB ENCLOSURES SHALL BE OF A SHATTER-RESISTANT TYPE.

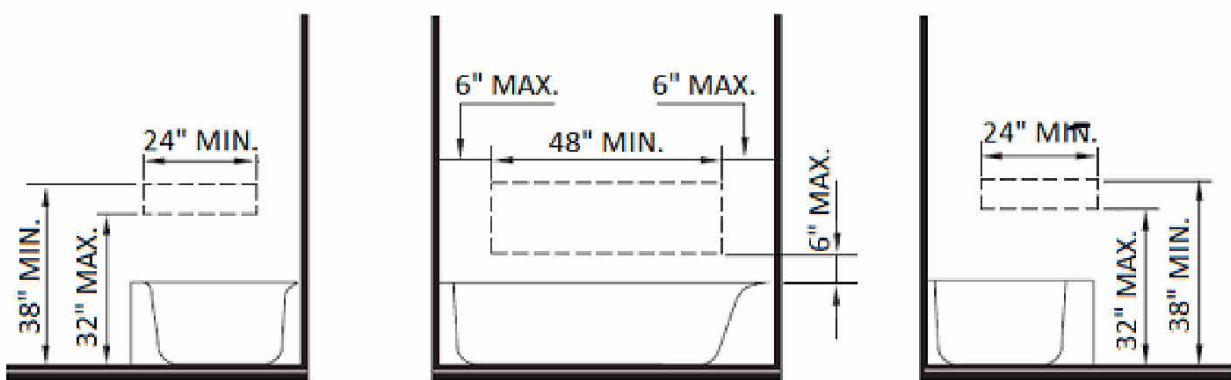

(b) GRAB BAR REINFORCEMENT FOR ADAPTABLE BATHTUBS

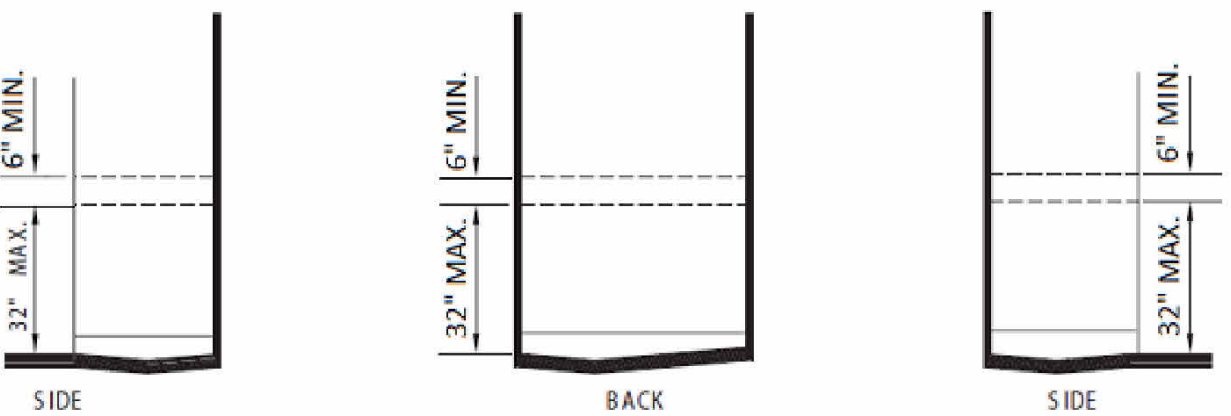


(c) GRAB BAR REINFORCEMENT FOR ADAPTABLE SHOWERS

AREAS OUTLINED IN DASHED LINES REPRESENT LOCATION FOR FUTURE INSTALLATION OF GRAB BARS

**FIGURE 11A-9G
REINFORCEMENT FOR GRAB BARS**

GRAB BAR REINFORCEMENT
12" = 1'-0"

A6

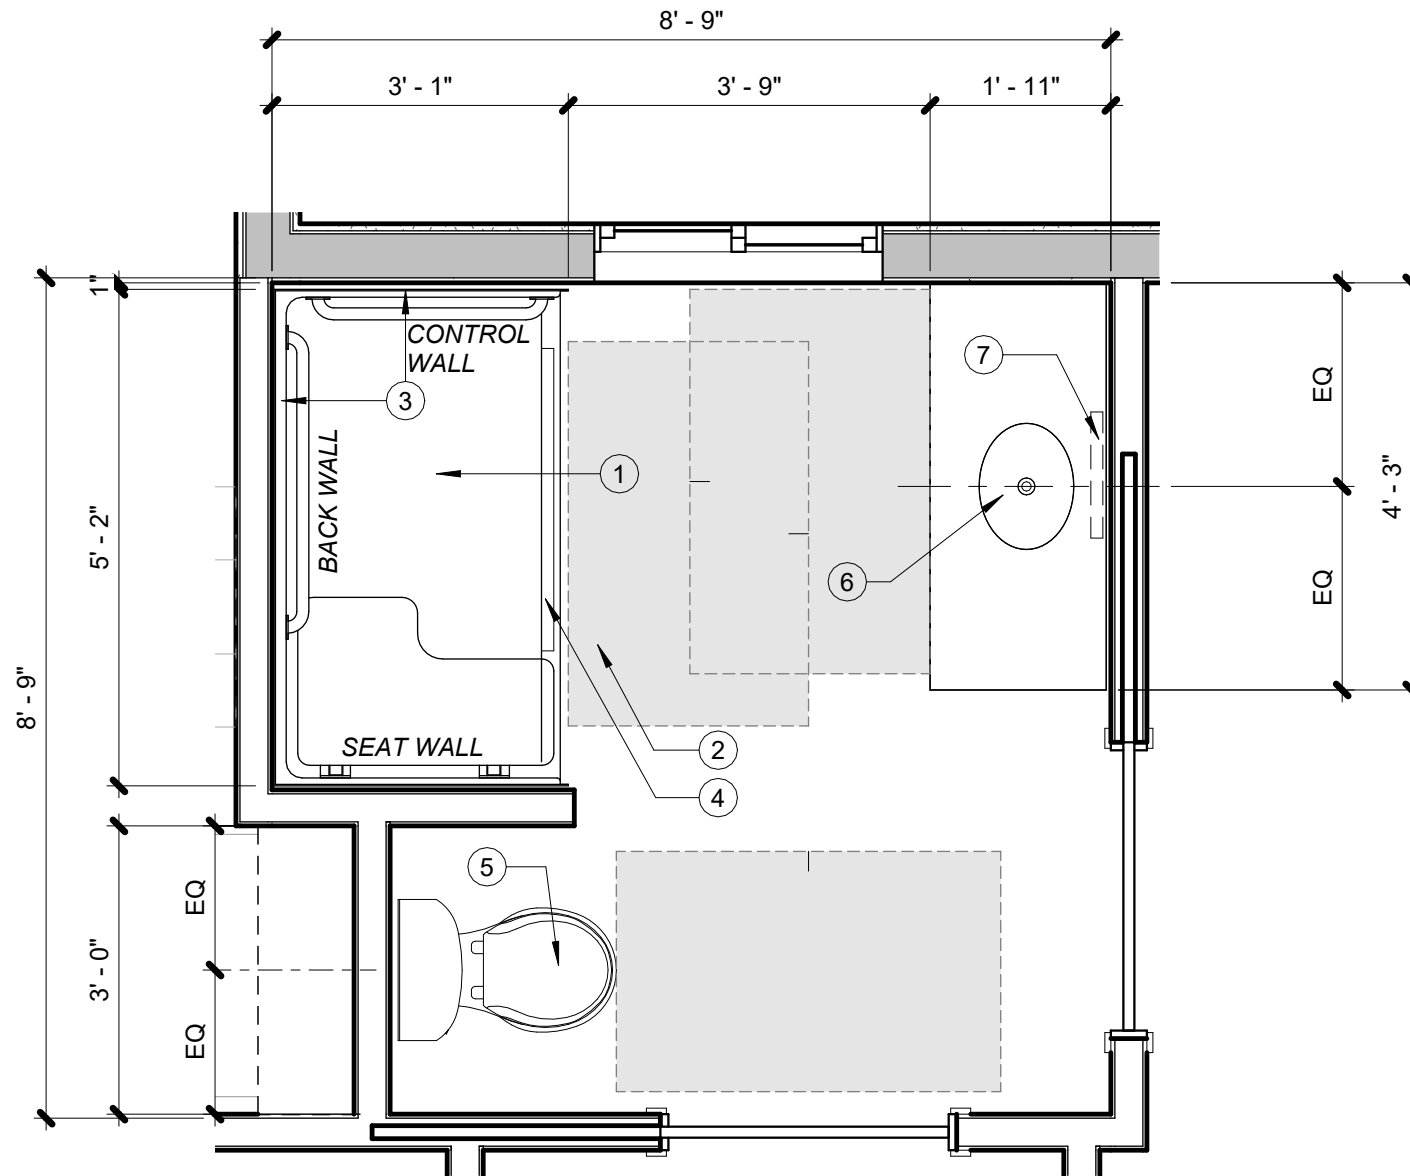

KEYNOTES

1. ADAPTABLE ROLL-IN SHOWER. MAINTAIN A 2% MAXIMUM SLOPE IN ALL DIRECTIONS. TYPICAL ON ALL SHOWER AND BATHROOMS. REFER TO **A6/A-502** FOR ADDITIONAL INFORMATION.
2. 30" MIN. X 48" MIN. CLEAR MANEUVERING SPACE. LOCATE OUTSIDE THE SHOWER, FLUSH AND PARALLEL TO THE CONTROL WALL.
3. REINFORCED WALLS FOR GRAB BARS. GRAB BAR REINFORCEMENT SHALL BE INSTALLED CONTINUOUSLY IN THE WALLS OF SHOWERS 32 INCHES TO 38 INCHES ABOVE THE FLOOR. THE GRAB BAR REINFORCEMENT SHALL BE A MINIMUM OF 6 INCHES NOMINAL IN HEIGHT. INSTALLATION OF ACTUAL GRAB BAR IS OPTIONAL. REFER TO **A6/A-502** FOR ADDITIONAL INFORMATION.
4. SHOWER THRESHOLD SHALL BE A MAXIMUM OF 2 INCHES IN HEIGHT AND HAVE A BEVELED OR SLOPED ANGLE NOT EXCEEDING 1 UNIT VERTICAL IN 2 UNITS HORIZONTAL. THRESHOLDS 1/2 INCH OR LESS IN HEIGHT MAY HAVE A BEVELED OR SLOPED ANGLE NOT EXCEEDING 1 UNIT VERTICAL IN 1 UNIT HORIZONTAL.
5. WATER CLOSET. PROVIDE MANEUVERING CLEARANCE. REFER TO **A9/A-502** FOR ADDITIONAL INFORMATION.
6. LAVATORIES SHALL BE INSTALLED WITH THE CENTERLINE OF THE FIXTURE A MINIMUM OF 18 INCHES HORIZONTALLY FROM AN ADJOINING WALL OR FIXTURE TO ALLOW FOR FORWARD APPROACH. WHEN PARALLEL APPROACH IS PROVIDED, LAVATORIES SHALL BE INSTALLED WITH THE CENTERLINE OF THE FIXTURE A MINIMUM OF 24 INCHES HORIZONTALLY FROM AN ADJOINING WALL OR FIXTURE. THE TOP OF THE FIXTURE RIM SHALL BE A MAXIMUM OF 34 INCHES ABOVE THE FINISHED FLOOR. WATER SUPPLY AND DRAIN PIPES UNDER LAVATORIES SHALL BE INSULATED OR OTHERWISE COVERED TO PROTECT AGAINST CONTACT. THERE SHALL BE NO SHARP OR ABRASIVE SURFACES UNDER LAVATORIES. FAUCET CONTROLS AND OPERATION MECHANISMS SHALL BE OPERABLE WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING, PINCHING OR TWISTING OF THE WRIST.
7. MIRRORS OR TOWEL FIXTURES SHALL BE MOUNTED WITH THE BOTTOM EDGE NO HIGHER THAN 40 INCHES FROM THE FLOOR.
8. DOOR MANEUVERING CLEARANCE. REFER TO **A1/A-502** FOR ADDITIONAL INFORMATION.

ENLARGED BATHROOM DETAIL
1/2" = 1'-0"

G1


SECTION R327 AGING-IN-PLACE DESIGN AND FALL PREVENTION

R327.1.2 ELECTRICAL RECEPTACLE OUTLET, SWITCH AND CONTROL HEIGHTS. ELECTRICAL RECEPTACLE OUTLETS, SWITCHES AND CONTROLS (INCLUDING CONTROLS FOR HEATING, VENTILATION AND AIR CONDITIONING) INTENDED TO BE USED BY OCCUPANTS SHALL BE LOCATED NO MORE THAN 48 INCHES MEASURED FROM THE TOP OF THE OUTLET BOX AND NOT LESS THAN 15 INCHES MEASURED FROM THE BOTTOM OF THE OUTLET BOX ABOVE THE FINISH FLOOR.

- EXCEPTIONS:
1. DEDICATED RECEPTACLE OUTLETS; FLOOR RECEPTACLE OUTLETS; CONTROLS MOUNTED ON CEILING FANS AND CEILING LIGHTS; AND CONTROLS LOCATED ON APPLIANCES.
 2. RECEPTACLE OUTLETS REQUIRED BY THE CALIFORNIA ELECTRICAL CODE ON A WALL SPACE WHERE THE DISTANCE BETWEEN THE FINISHED FLOOR AND A BUILT-IN FEATURE ABOVE THE FINISH FLOOR, SUCH AS A WINDOW, IS LESS THAN 15 INCHES.


R327.1.3 INTERIOR DOORS. AT LEAST ONE BATHROOM AND ONE BEDROOM ON THE ENTRY LEVEL SHALL PROVIDE A DOORWAY WITH A NET CLEAR OPENING OF NOT LESS THAN 32 INCHES, MEASURED WITH THE DOOR POSITIONED AT AN ANGLE OF 90 DEGREES FROM THE CLOSED POSITION. OR, IN THE CASE OF A TWO- OR THREE-STORY SINGLE FAMILY DWELLING, ON THE SECOND OR THIRD FLOOR OF THE DWELLING IF A BATHROOM OR BEDROOM IS NOT LOCATED ON THE ENTRY LEVEL.

R327.1.4 DOORBELL BUTTONS. DOORBELL BUTTONS OR CONTROLS, WHEN INSTALLED, SHALL NOT EXCEED 48 INCHES ABOVE EXTERIOR FLOOR OR LANDING, MEASURED FROM THE TOP OF THE DOORBELL BUTTON ASSEMBLY. WHERE DOORBELL BUTTONS INTEGRATED WITH OTHER FEATURES ARE REQUIRED TO BE INSTALLED ABOVE 48 INCHES MEASURED FROM THE EXTERIOR FLOOR OR LANDING, A STANDARD DOORBELL BUTTON OR CONTROL SHALL ALSO BE PROVIDED AT A HEIGHT NOT EXCEEDING 48 INCHES ABOVE EXTERIOR FLOOR OR LANDING, MEASURED FROM THE TOP OF THE DOORBELL BUTTON OR CONTROL.

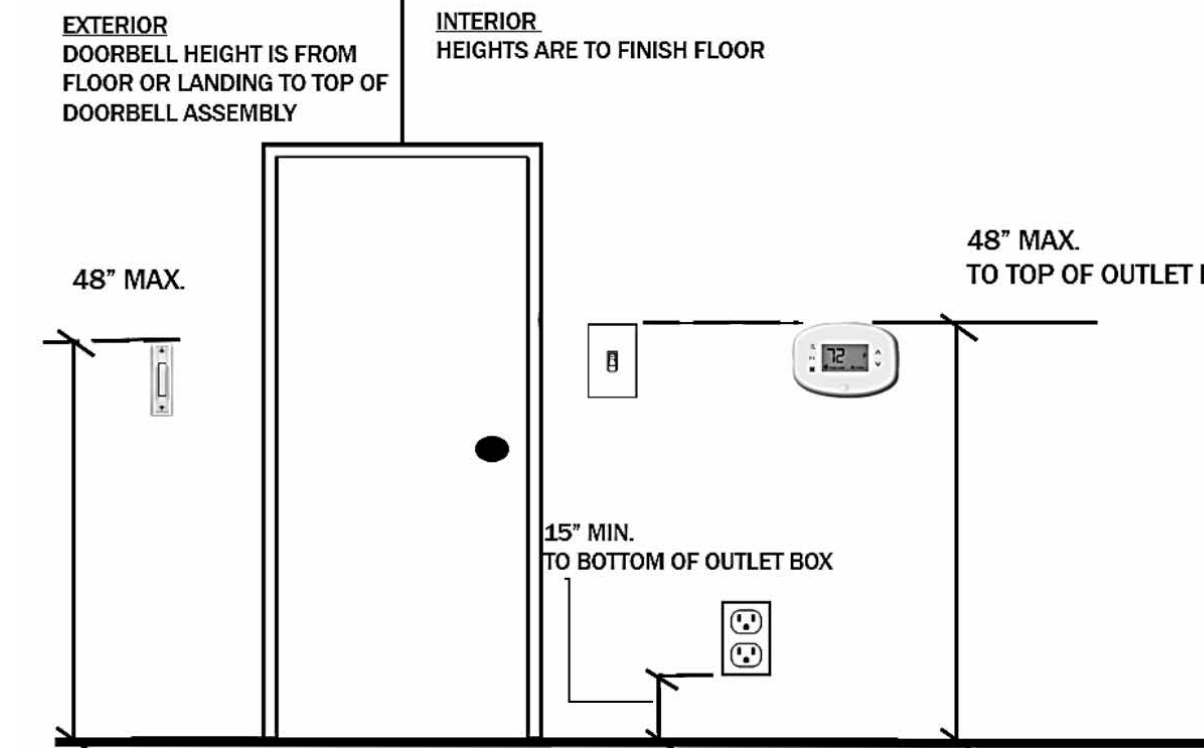

HEIGHTS FOR ELECTRICAL RECEPTACLE OUTLETS, SWITCHES, DOORBELL BUTTONS, INCLUDING HVAC CONTROLS

1132A.5.1 GENERAL. THE FLOOR OR LANDING ON THE DWELLING UNIT SIDE OF THE PRIMARY ENTRY DOOR AND ANY REQUIRED EXIT DOOR SHALL HAVE A MINIMUM LENGTH OF NOT LESS THAN 44 INCHES. SECTION 1126A.3 SHALL APPLY TO MANEUVERING CLEARANCES AT THE SIDE OF THE DOOR EXPOSED TO COMMON OR PUBLIC USE SPACES. MANEUVERING CLEARANCES AT INTERIOR DOORS SHALL PROVIDE A MINIMUM LENGTH ON BOTH SIDES OF THE DOOR OF AT LEAST 42 INCHES MEASURED AT A RIGHT ANGLE TO THE PLANE OF THE DOOR IN ITS CLOSED POSITION. EXCEPTION: A 39-INCH LENGTH IS ACCEPTABLE AT INTERIOR DOORS WHEN A MINIMUM CLEAR OPENING WIDTH OF 34 INCHES IS PROVIDED.

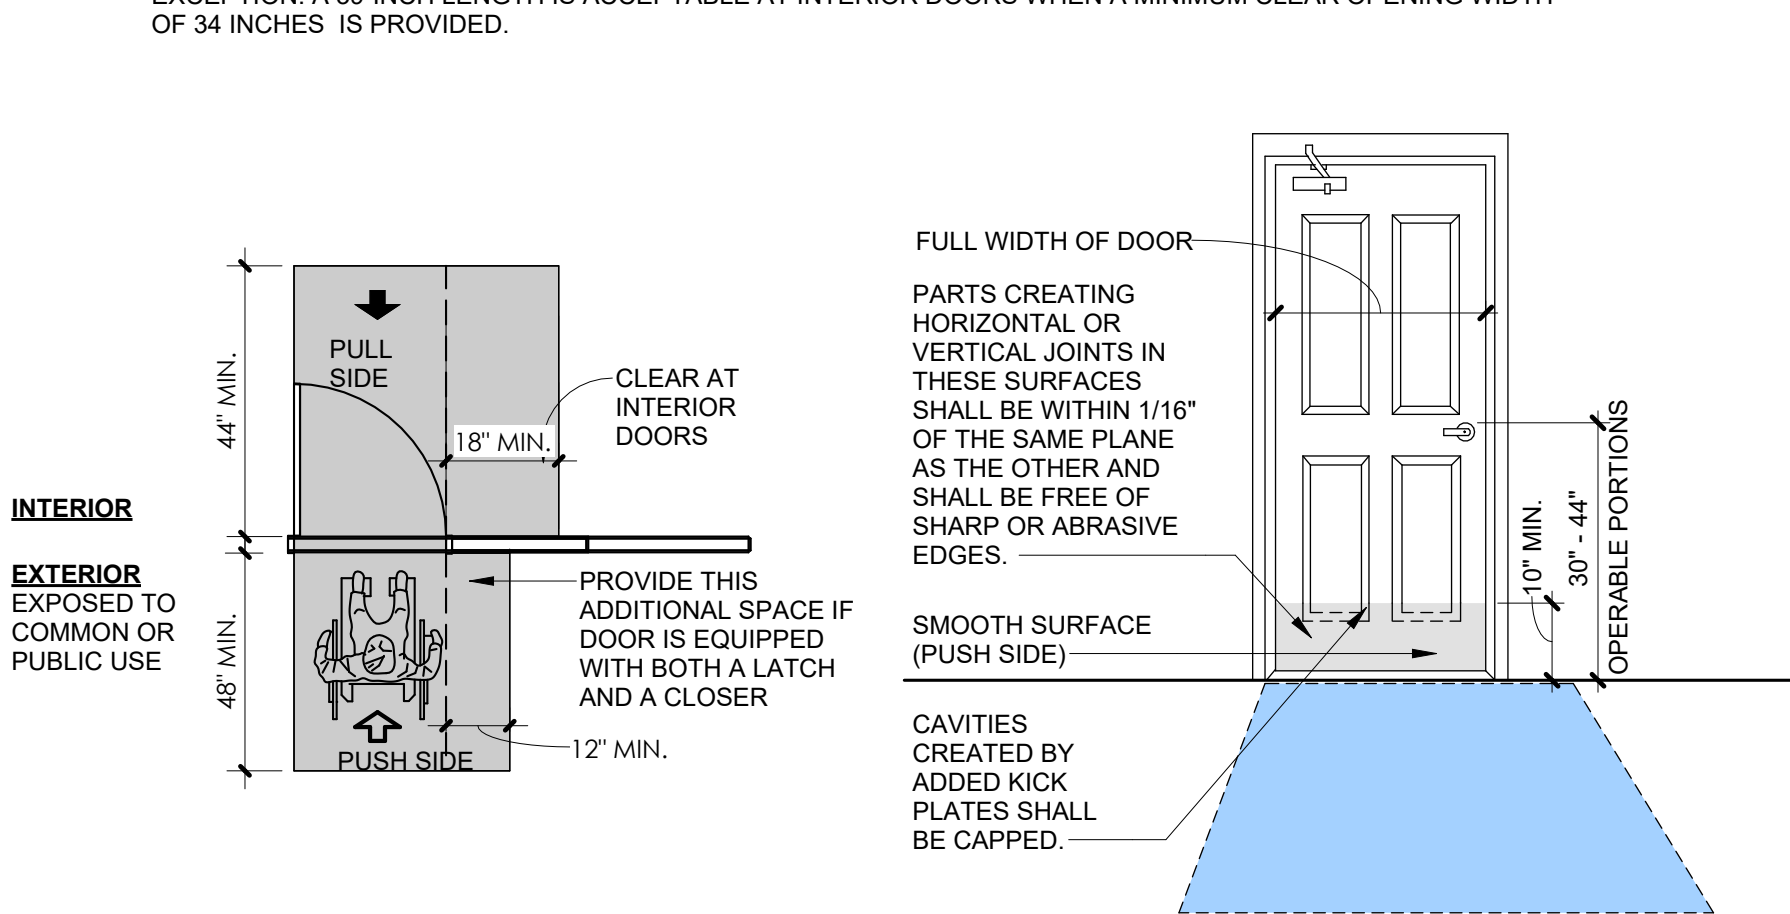


PRIMARY DOOR MANEUVERING CLEARANCE
3/16" = 1'-0"

A2

OUTLETS, DOORS & CONTROLS
12" = 1'-0"

D1

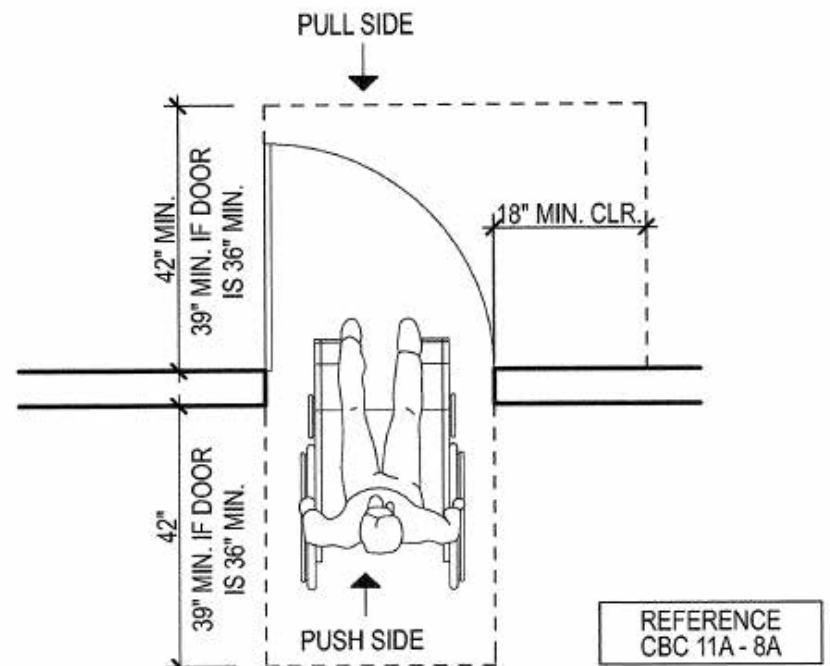

DOOR MANUEVERING - INT.
12" = 1'-0"


A1

TRIPLEX DWELLING UNIT

**OPTION
#2**

PROJECT

**TRIPLEX
DWELLING UNIT**

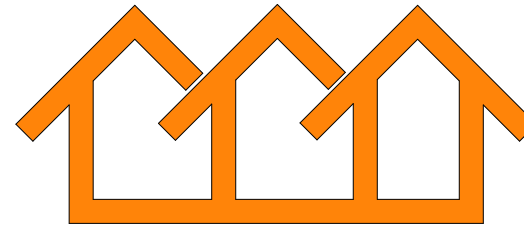

PWP23-005


**DEPARTMENT OF PUBLIC
WORKS AND PLANNING**



**CAPITAL PROJECTS
DIVISION**

2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

SEAL & SIGNATURE

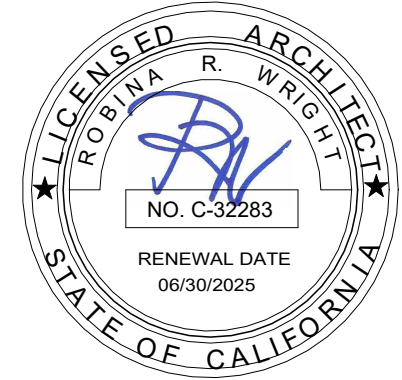

UPDATE

JANUARY 2, 2024

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY AND COPYRIGHT OF THE ARCHITECT AND SHALL NOT BE USED ON ANY OTHER PROJECT OR LOCATIONS EXCEPT AS DESCRIBED ON THE DRAWINGS WITHOUT WRITTEN AGREEMENT WITH THE ARCHITECT.

TITLE

**ADAPTABLE
BATHROOM DETAILS**

SCALE

As indicated

A-502

ISSUE DATE

MARCH 7, 2023

JOB NUMBER

2023_11



DRAWN BY

Author

CHECKED BY

Checker

1/4/2024 8:07:08 AM
24" X 36"

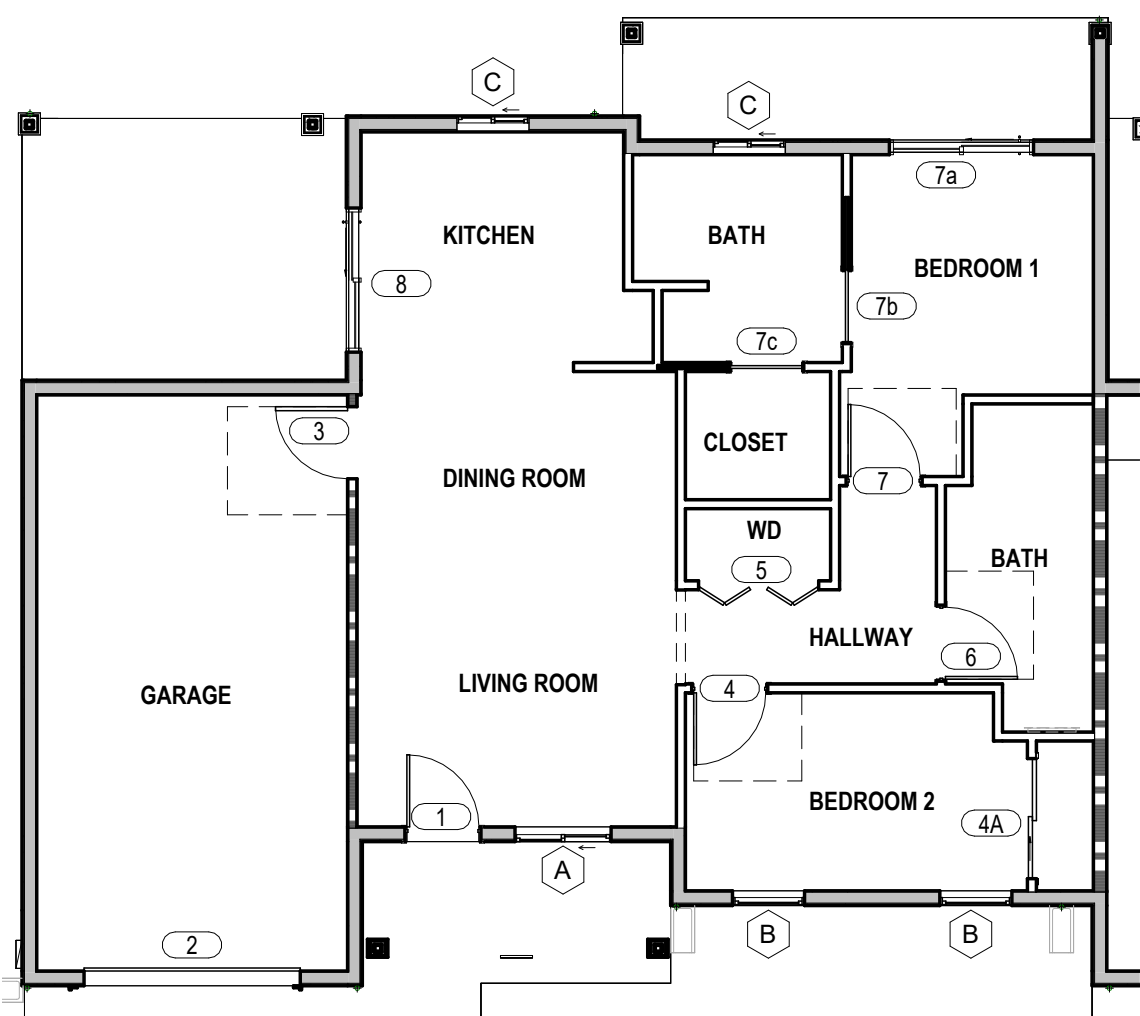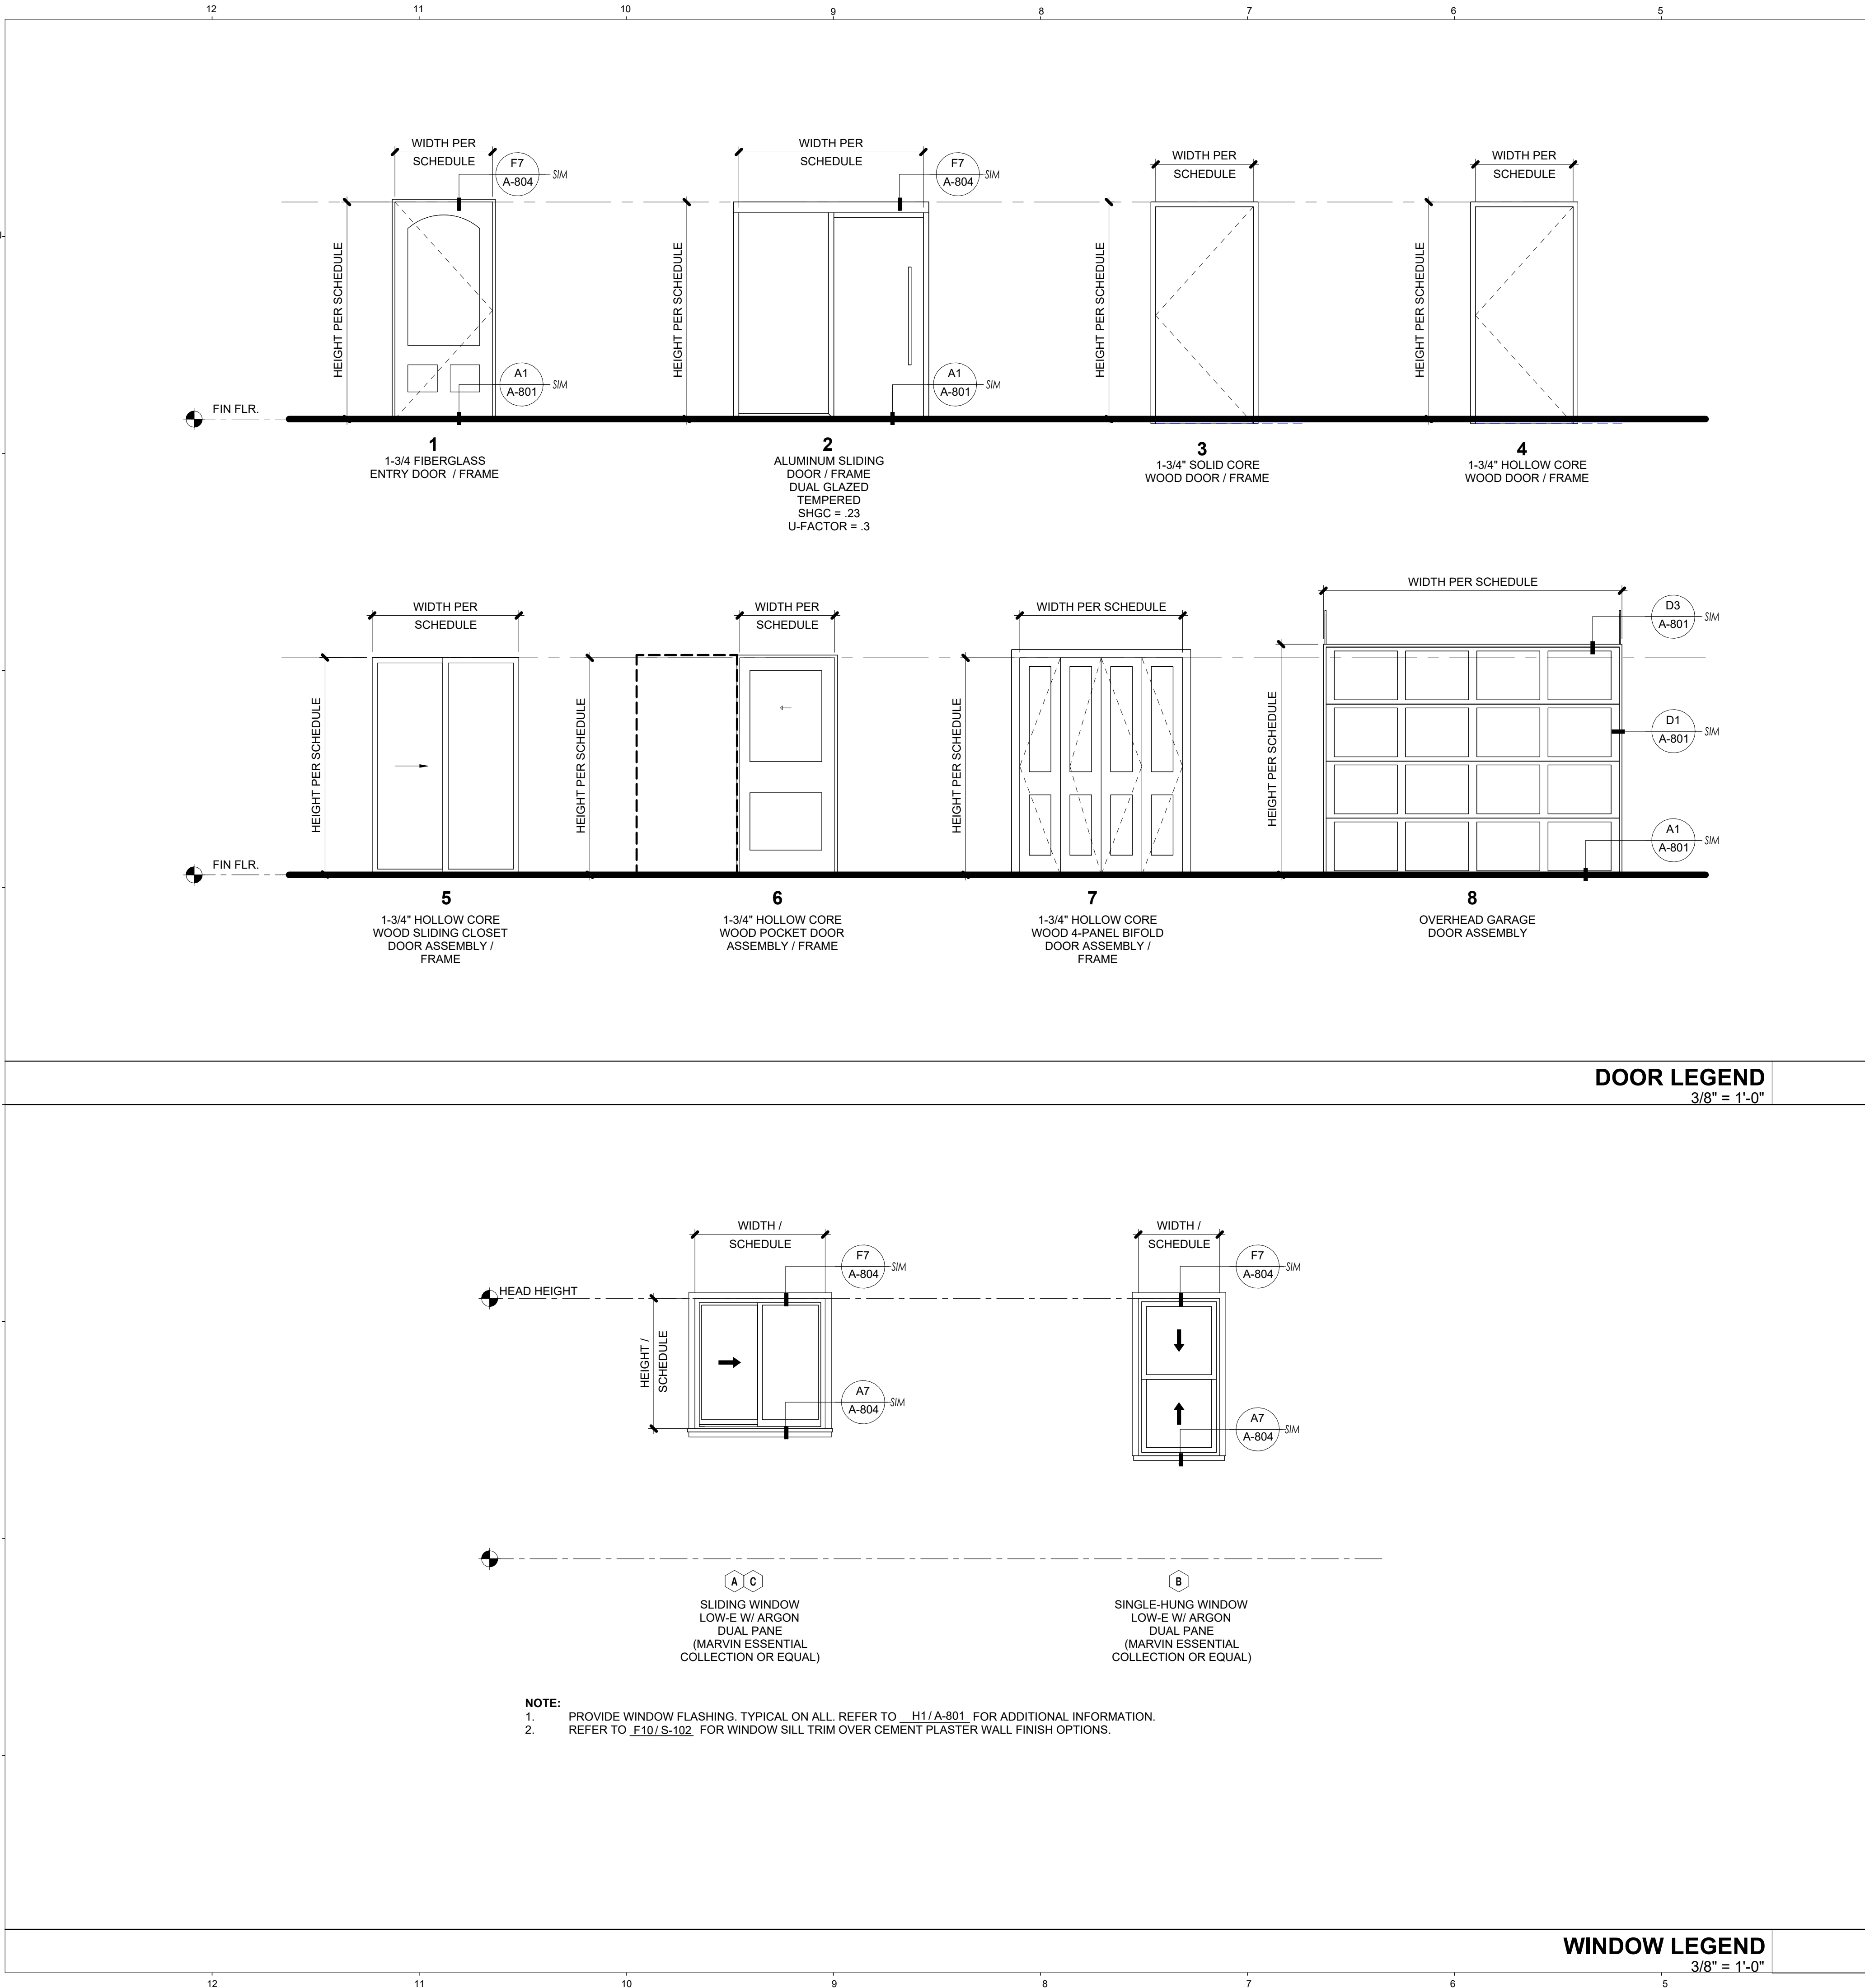

DOOR SCHEDULE						
TAG #	ROOM	TYPE	WIDTH	HEIGHT	COMMENTS	
1	LIVING ROOM	1	3' - 0"	6' - 8"		
2	GARAGE	7	9' - 0"	7' - 0"	SELF CLOSING & SELF-LATCHING	
3	GARAGE	3	3' - 0"	6' - 8"		
4	BEDROOM 2	4	3' - 0"	6' - 8"		
4A	BEDROOM 2	5	5' - 0"	6' - 8"		
5	W/D	6	5' - 0"	6' - 8"		
6	BATH	4	3' - 0"	6' - 8"		
7	BEDROOM 1	4	3' - 0"	6' - 8"		
7a	BEDROOM 1	2	6' - 0"	6' - 8"		
7b	BATH	6	3' - 0"	6' - 8"		
7c	CLOSET	6	3' - 0"	6' - 8"		
8	KITCHEN	2	6' - 0"	6' - 8"		


WINDOW SCHEDULE							
TYPE MARK	WIDTH	HEIGHT	HEAD HEIGHT	SILL HEIGHT	SHGCS	U-FACTOR	COMMENTS
A	4' - 0"	5' - 0"	6' - 8"	1' - 8"	0.23	0.3	
B	3' - 0"	5' - 0"	6' - 8"	1' - 8"	0.23	0.3	
C	3' - 0"	2' - 6"	6' - 8"	4' - 2"	0.23	0.3	

KEYPLAN - OPENING SCHEDULE
1/8" = 1'-0" **C1**

TRIPLEX DWELLING UNIT

OPTION #2

PROJECT
TRIPLEX
DWELLING UNIT

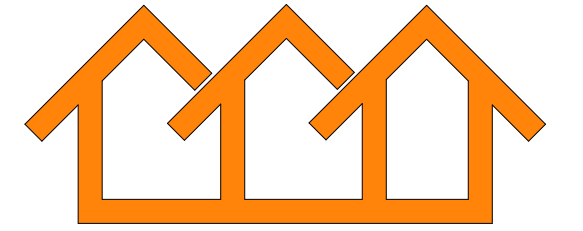

PWP23-005


DEPARTMENT OF PUBLIC
WORKS AND PLANNING



CAPITAL PROJECTS
DIVISION

2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

SEAL & SIGNATURE

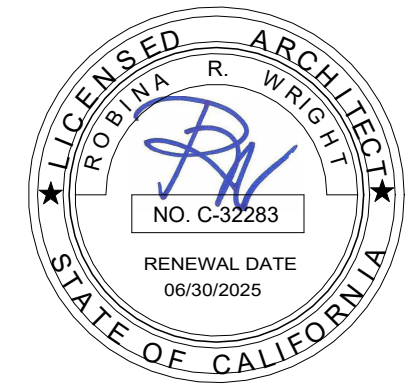

UPDATE

JANUARY 2, 2024

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY AND COPYRIGHT OF THE ARCHITECT AND SHALL NOT BE USED ON ANY OTHER PROJECT OR LOCATIONS EXCEPT AS DESCRIBED ON THE DRAWINGS WITHOUT WRITTEN AGREEMENT WITH THE ARCHITECT.

TITLE

OPENING
SCHEDULES

SCALE


As indicated

A-601

ISSUE DATE	JOB NUMBER
MARCH 7, 2023	2023_11
DRAWN BY	CHECKED BY
Author	Checker


1/4/2024 8:07:09 AM
24" X 36"

STEP 1

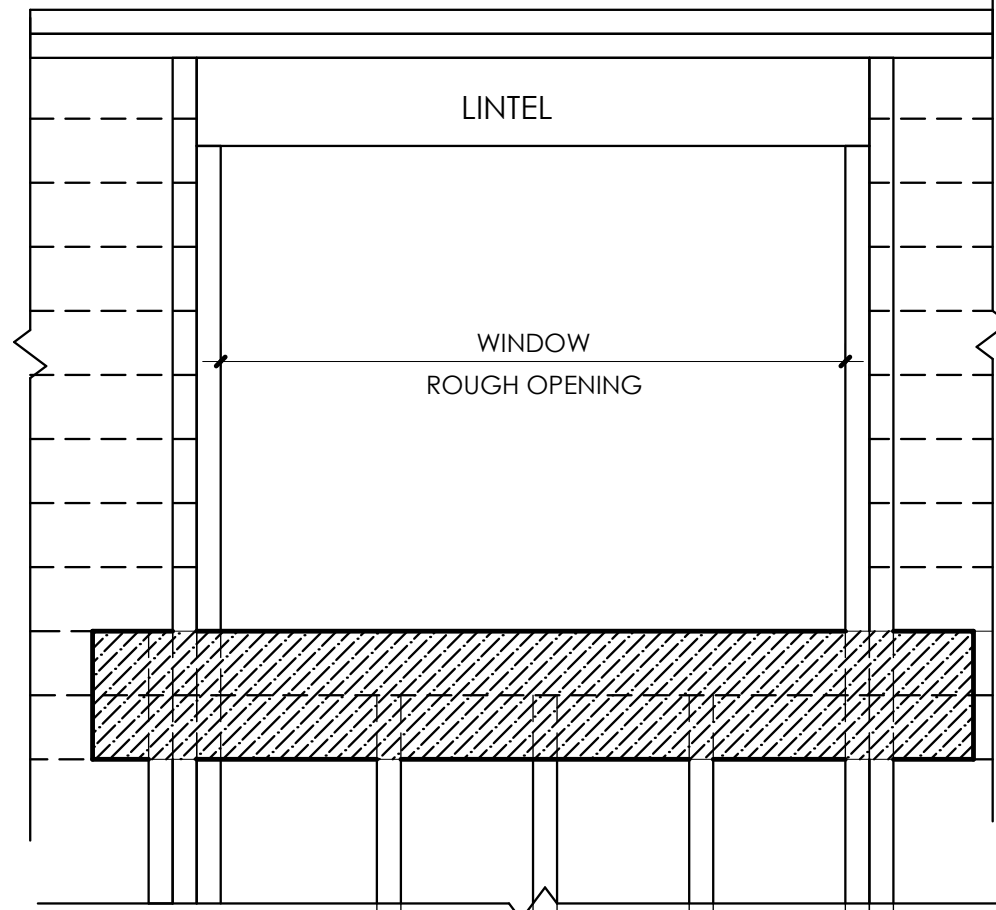


ATTACH A SILL STRIP OF ASPHALT-SATURATED ROOFING FELT PAPER, OR APPROVED FLASHING MATERIAL AT LEAST 8" WIDE WITH THE TOP EDGE EVEN WITH THE TOP EDGE OF THE ROUGH SILL. EXTEND THIS SILL STRIP AT LEAST 8" BEYOND THE EDGE OF THE ROUGH OPENING OF THE WINDOW.

STEP 2

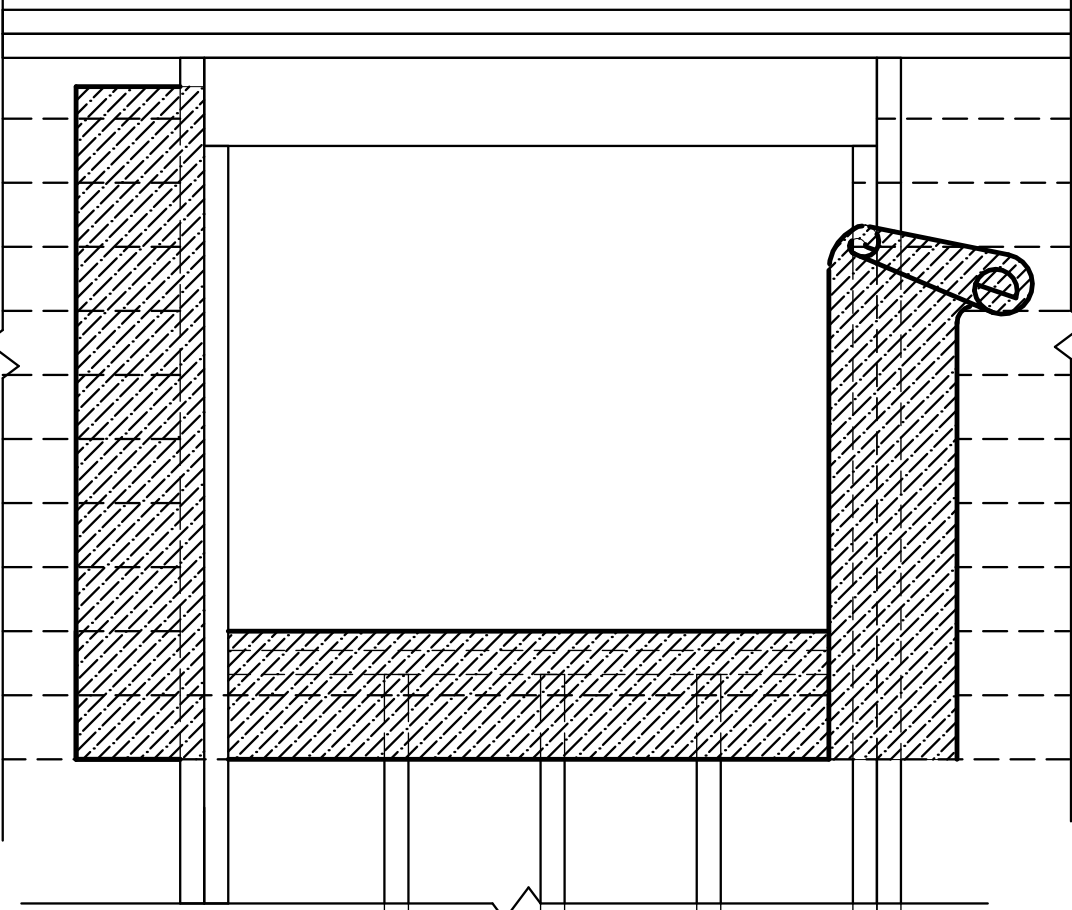


AFTER SILL STRIP IS IN PLACE, ATTACH JAMB STRIP (SIDE OF OPENING) AT LEAST 8" WIDE WITH INSIDE EDGE EVEN WITH EDGE OF WINDOW OPENING. EXTEND JAMB STRIP 4" ABOVE THE TOP OF WINDOW OPENING.

STEP 3

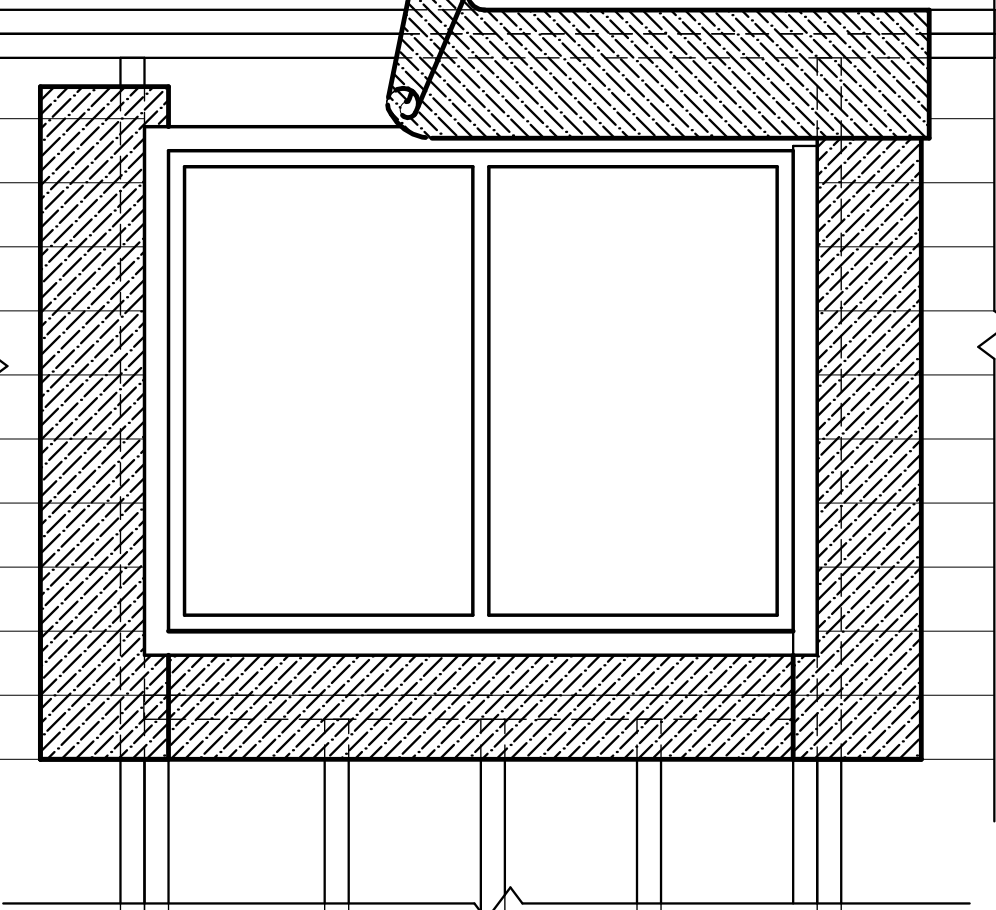

APPLY A BEAD OF CAULKING TO THE BACK SURFACES OF THE WINDOW, THEN PLACE THE WINDOW INTO THE ROUGH OPENING. WITH FLANGES OVER THE INSTALLED FLASHING FELT STRIP. AFTER WINDOW IS PLACED, INSTALL THE HEAD FLASHING OVER THE WINDOW FLANGE. THIS IS ANOTHER STRIP OF FELT AT LEAST 4" WIDE.

STEP 4

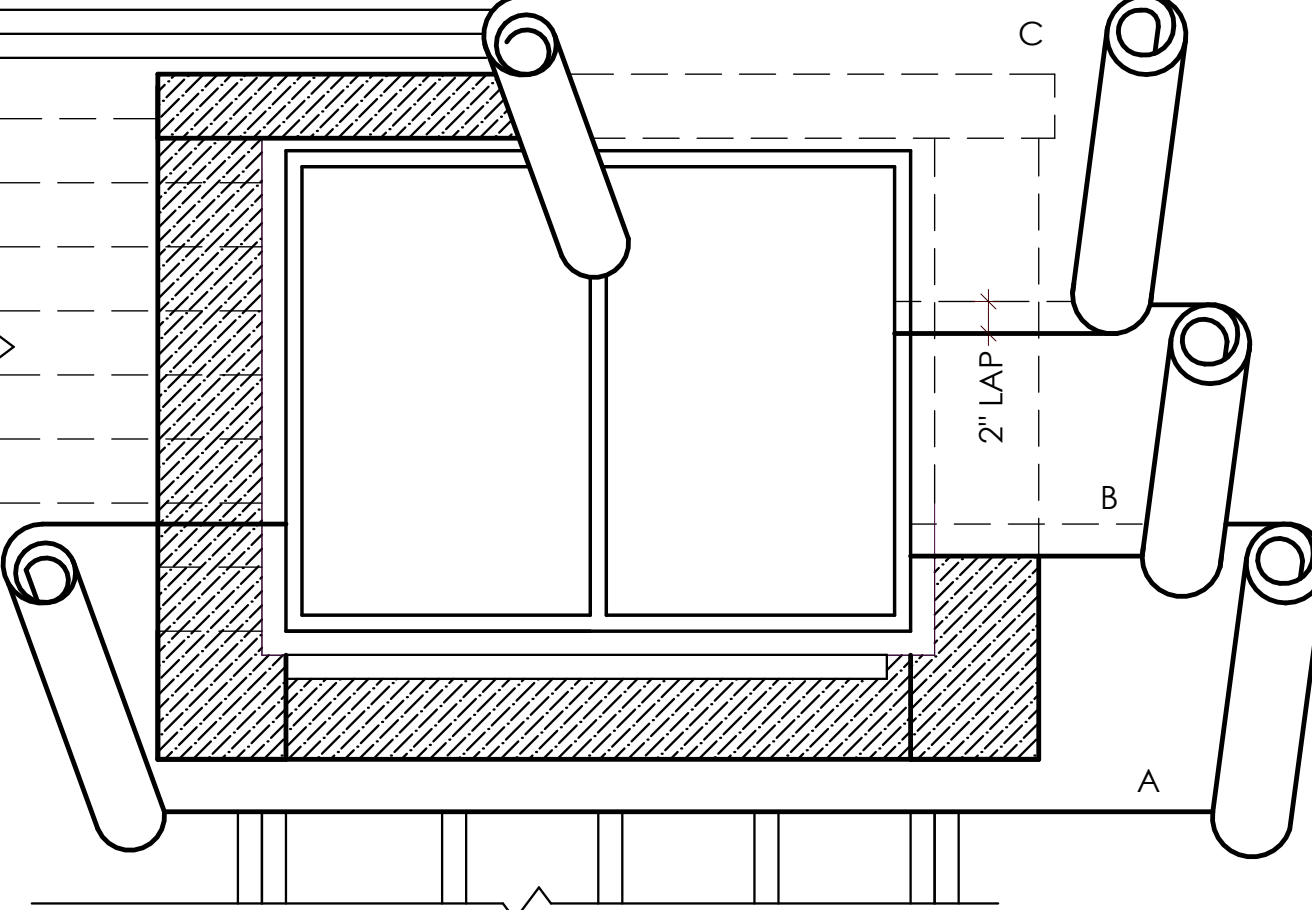


STARTING AT THE BOTTOM OF THE WALL (SOLE PLATE), LAY WATER RESISTANT PAPER UNDER THE SILL STRIP AND CUT TO FIT (A) INSTALL SUCCEEDING COURSES OF WATER RESISTANT PAPER (B,C, ETC.) OVER JAMB AND HEAD FLANGES IN SHINGLE BOARD FASHION.

WINDOW FLASHING DETAIL

1" = 1'-0"


H1

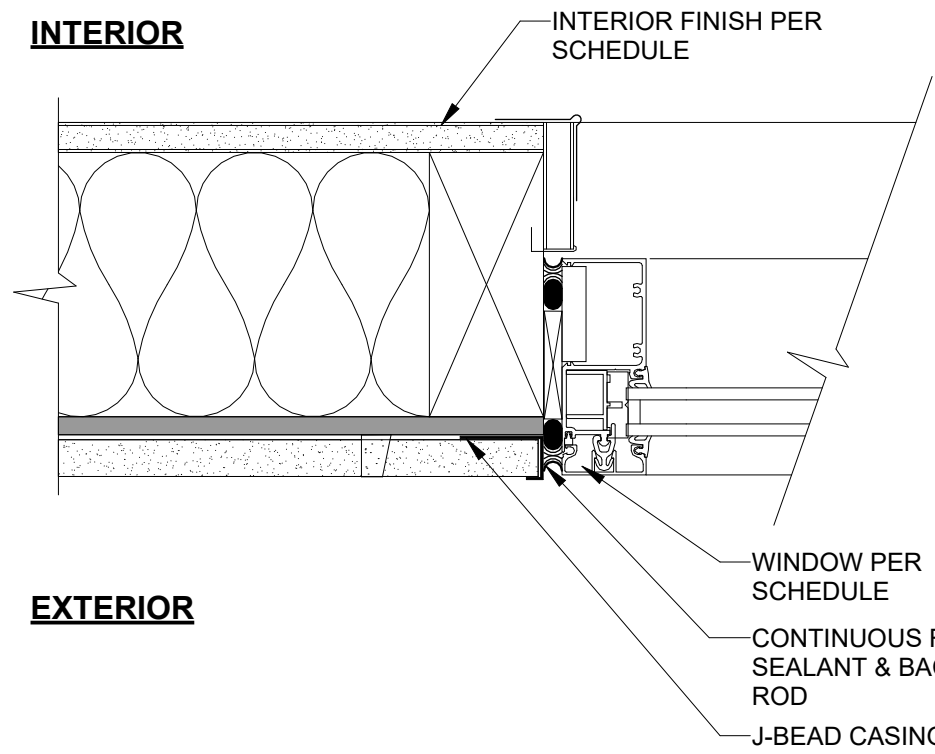

WINDOW DETAIL - EXTERIOR JAMB

3" = 1'-0"


E10

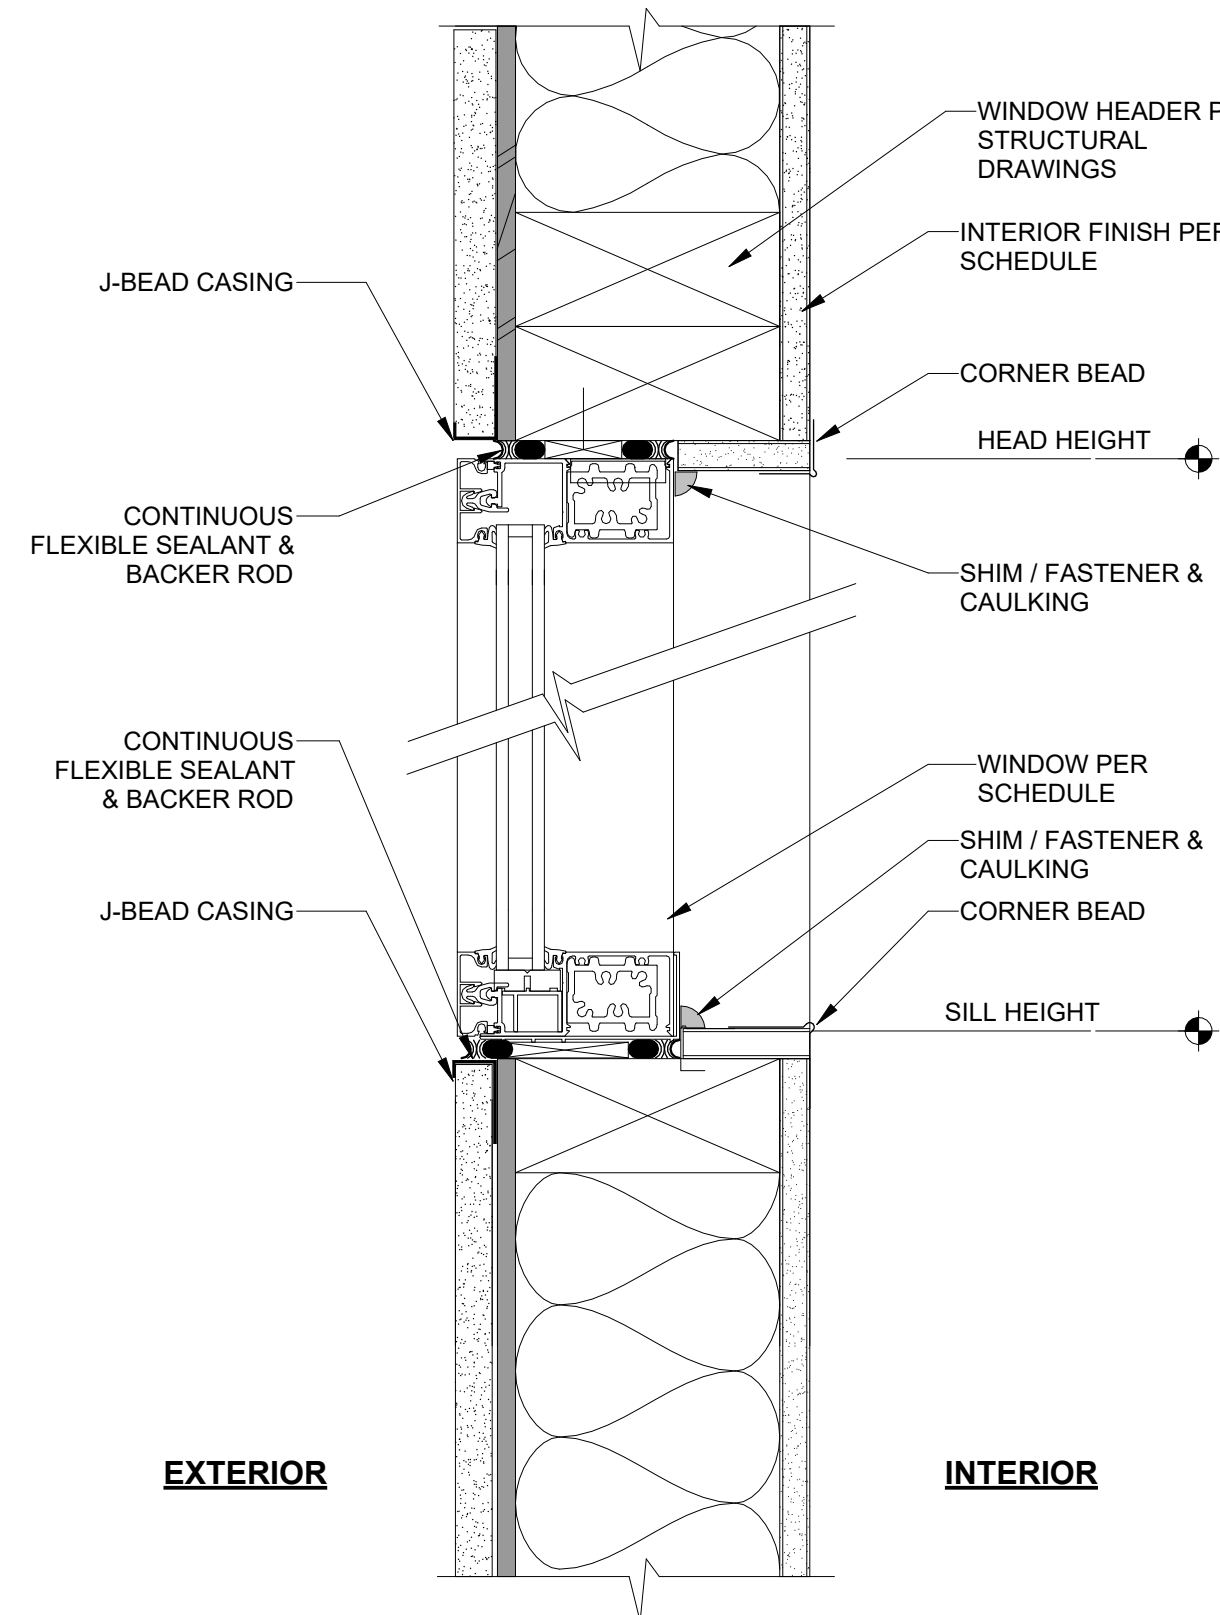

WINDOW DETAIL - VERTICAL SECTION

3" = 1'-0"


A10

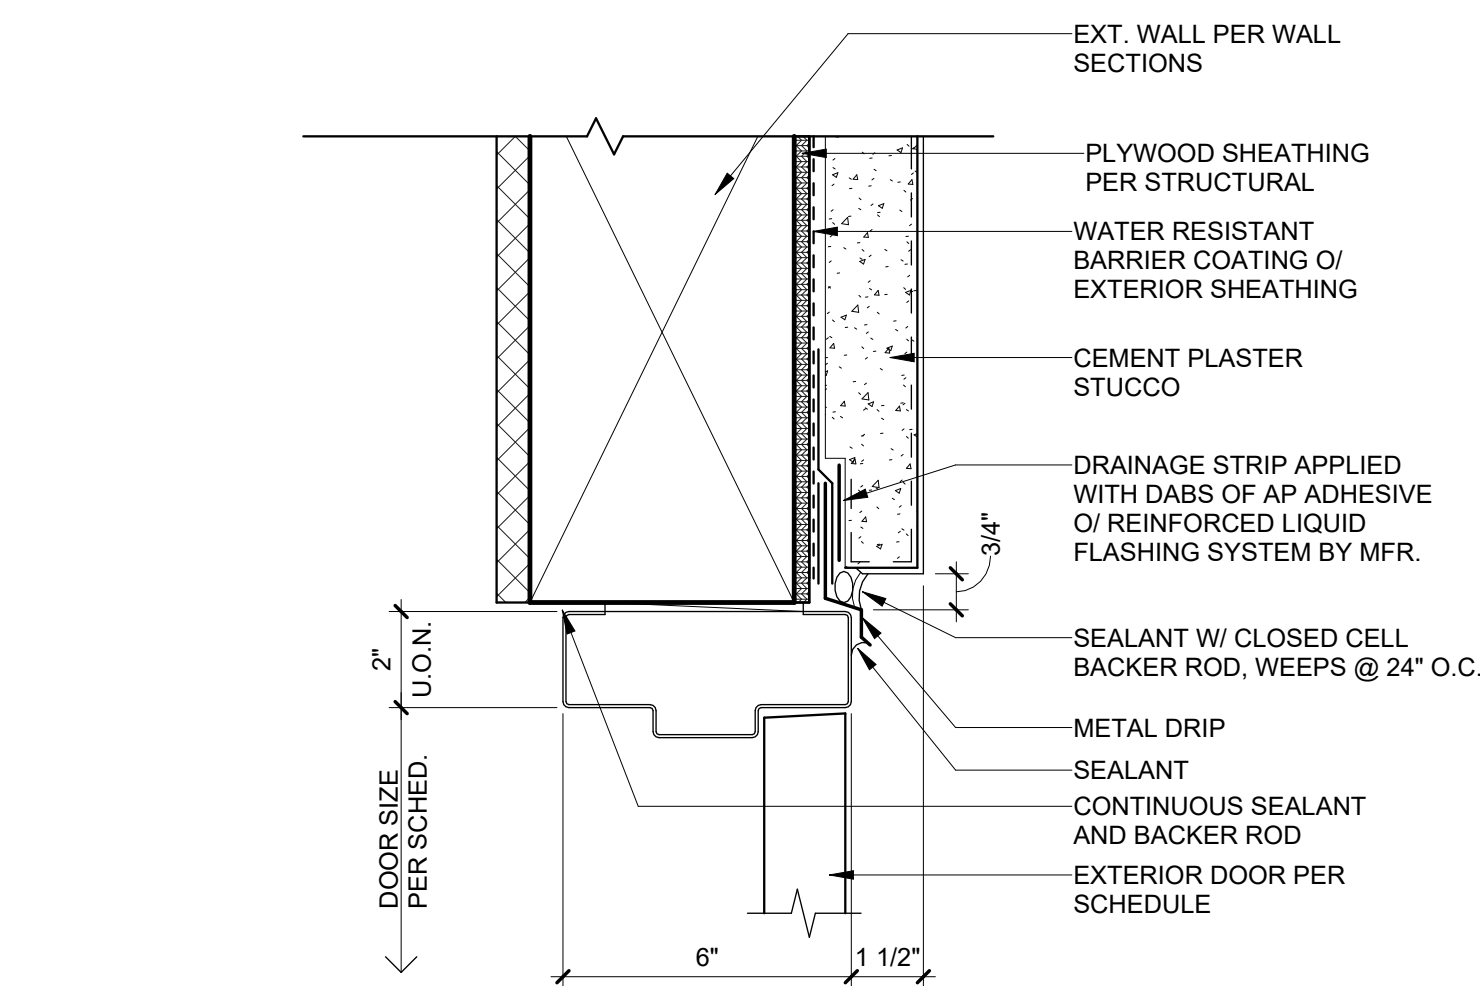

DOOR HEAD - EXTERIOR

3" = 1'-0"


D6

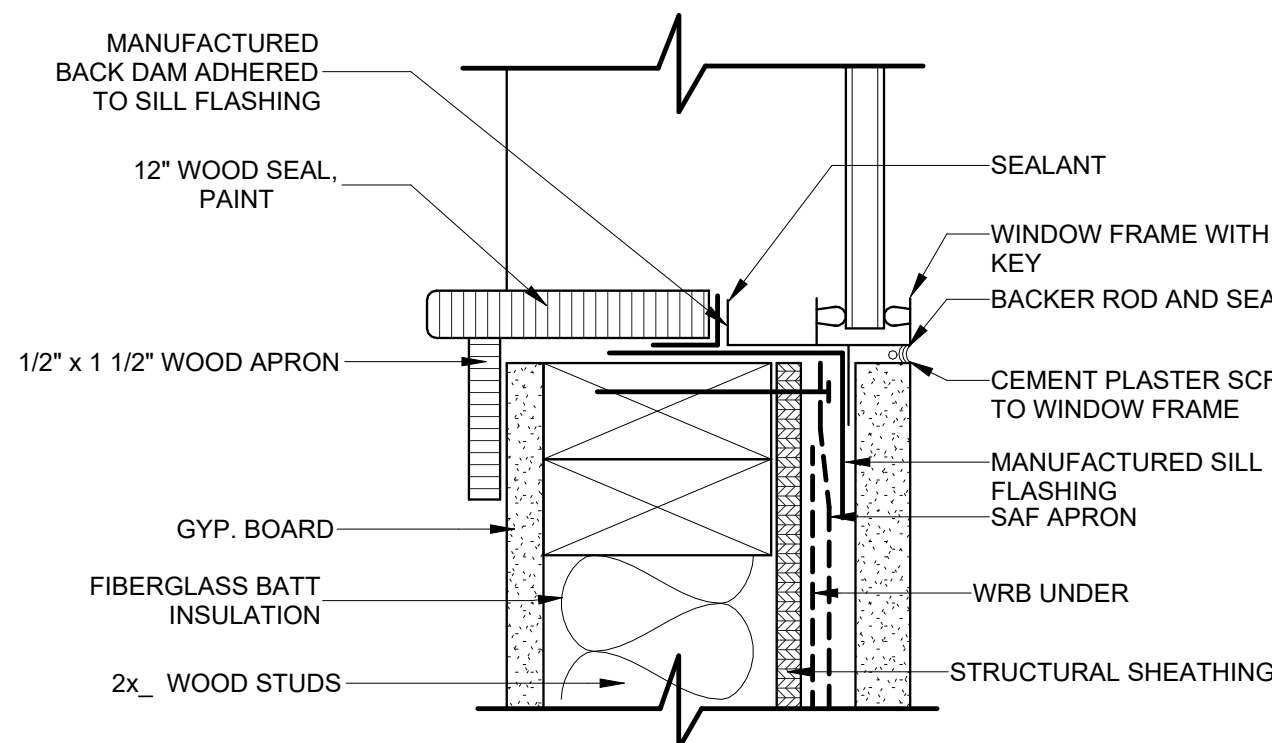

WINDOW SILL AND FLASHING

3" = 1'-0"


A6

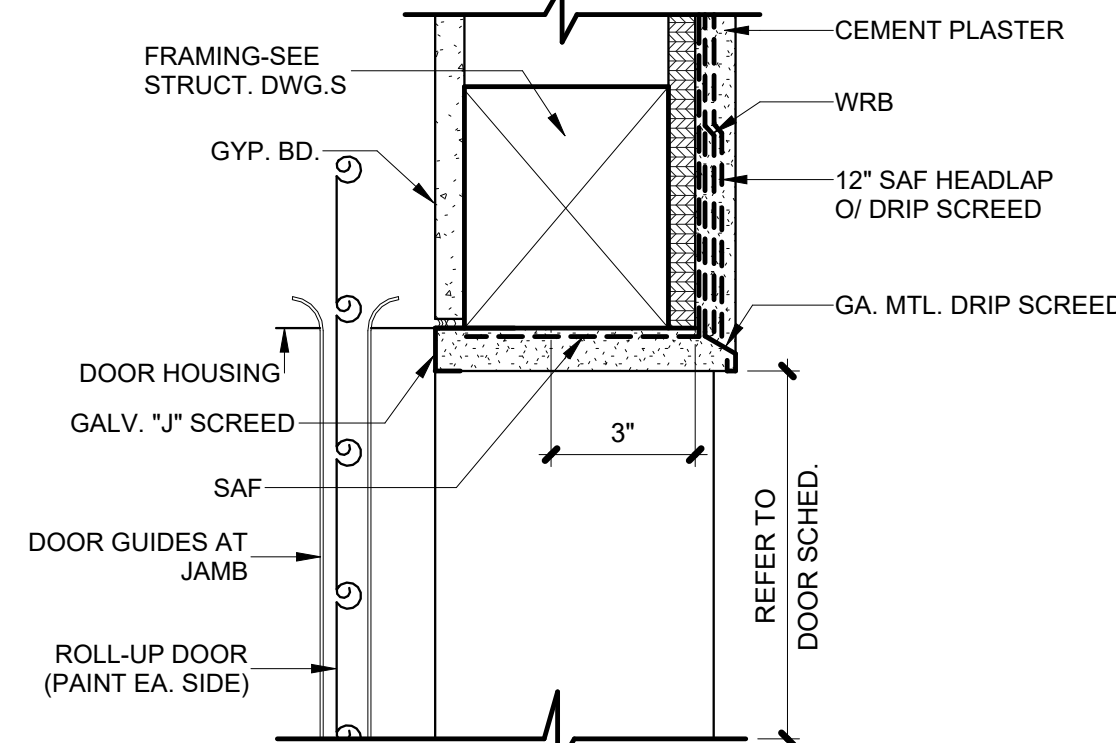

ROLL-UP DOOR HEAD (STUD WALL)

3" = 1'-0"


D3

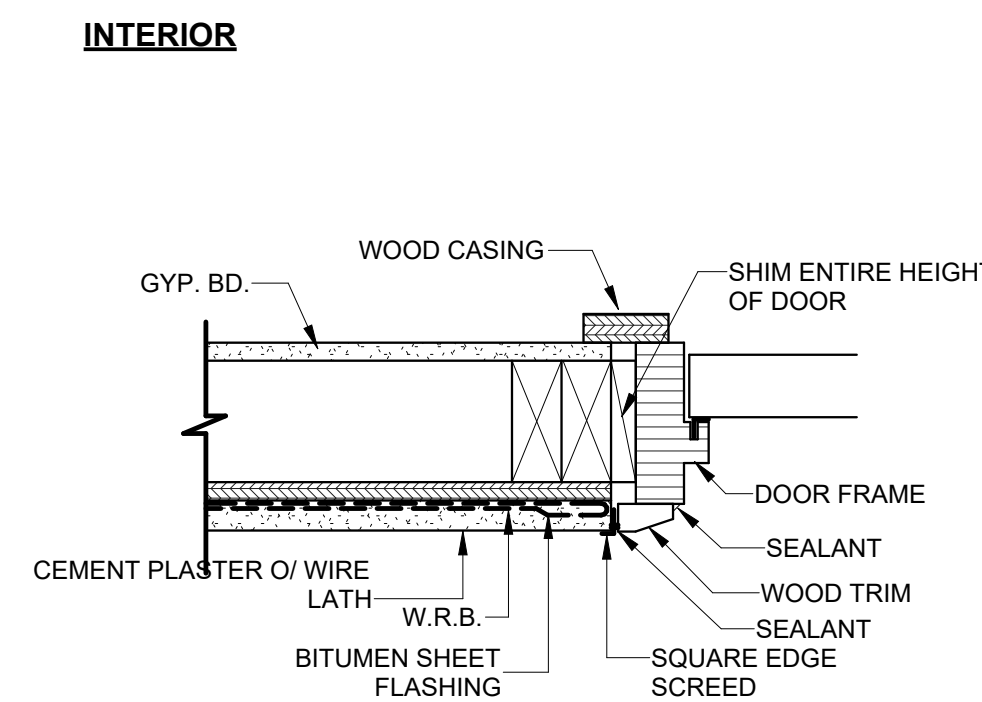

EXTERIOR DOOR JAMB @ STUCCO

3" = 1'-0"


A3

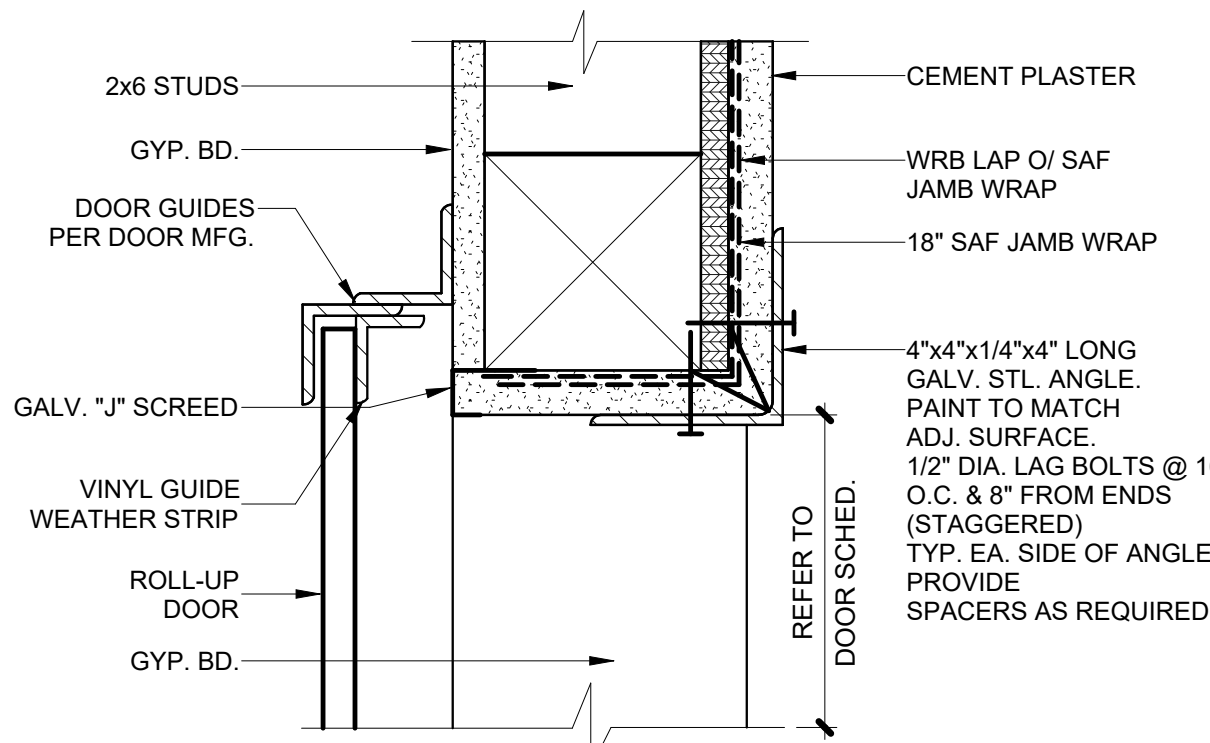

ROLL-UP DOOR JAMB (STUD WALL)

3" = 1'-0"

D1

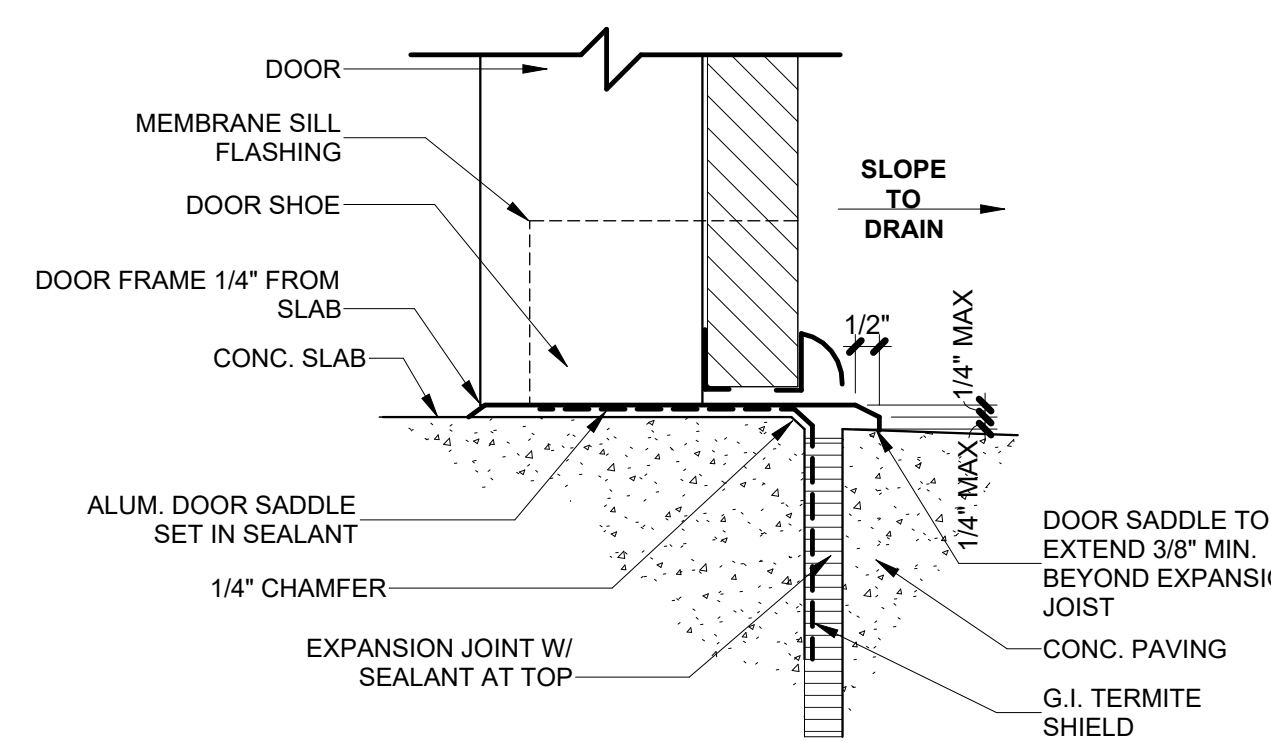

EXTERIOR DOOR SILL

3" = 1'-0"


A1

TRIPLEX DWELLING UNIT

OPTION
#2

PROJECT

TRIPLEX
DWELLING UNIT

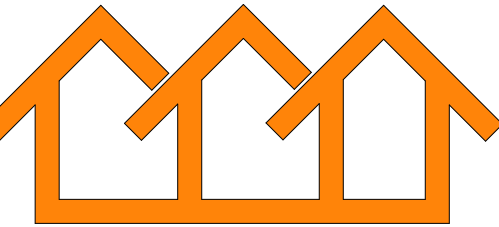

PWP23-005


DEPARTMENT OF PUBLIC
WORKS AND PLANNING



CAPITAL PROJECTS
DIVISION

2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

SEAL & SIGNATURE

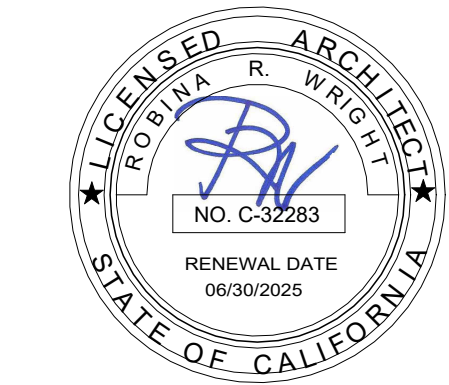

UPDATE

JANUARY 2, 2024

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY AND COPYRIGHT OF THE ARCHITECT AND SHALL NOT BE USED ON ANY OTHER PROJECT OR LOCATIONS EXCEPT AS DESCRIBED ON THE DRAWINGS WITHOUT WRITTEN AGREEMENT WITH THE ARCHITECT.

TITLE

ARCHITECTURAL
DETAILS

SCALE As indicated

A-801


ISSUE DATE JOB NUMBER

MARCH 7, 2023 2023_11




DRAWN BY CHECKED BY

Author Checker

©




1/4/2024 8:07:10 AM

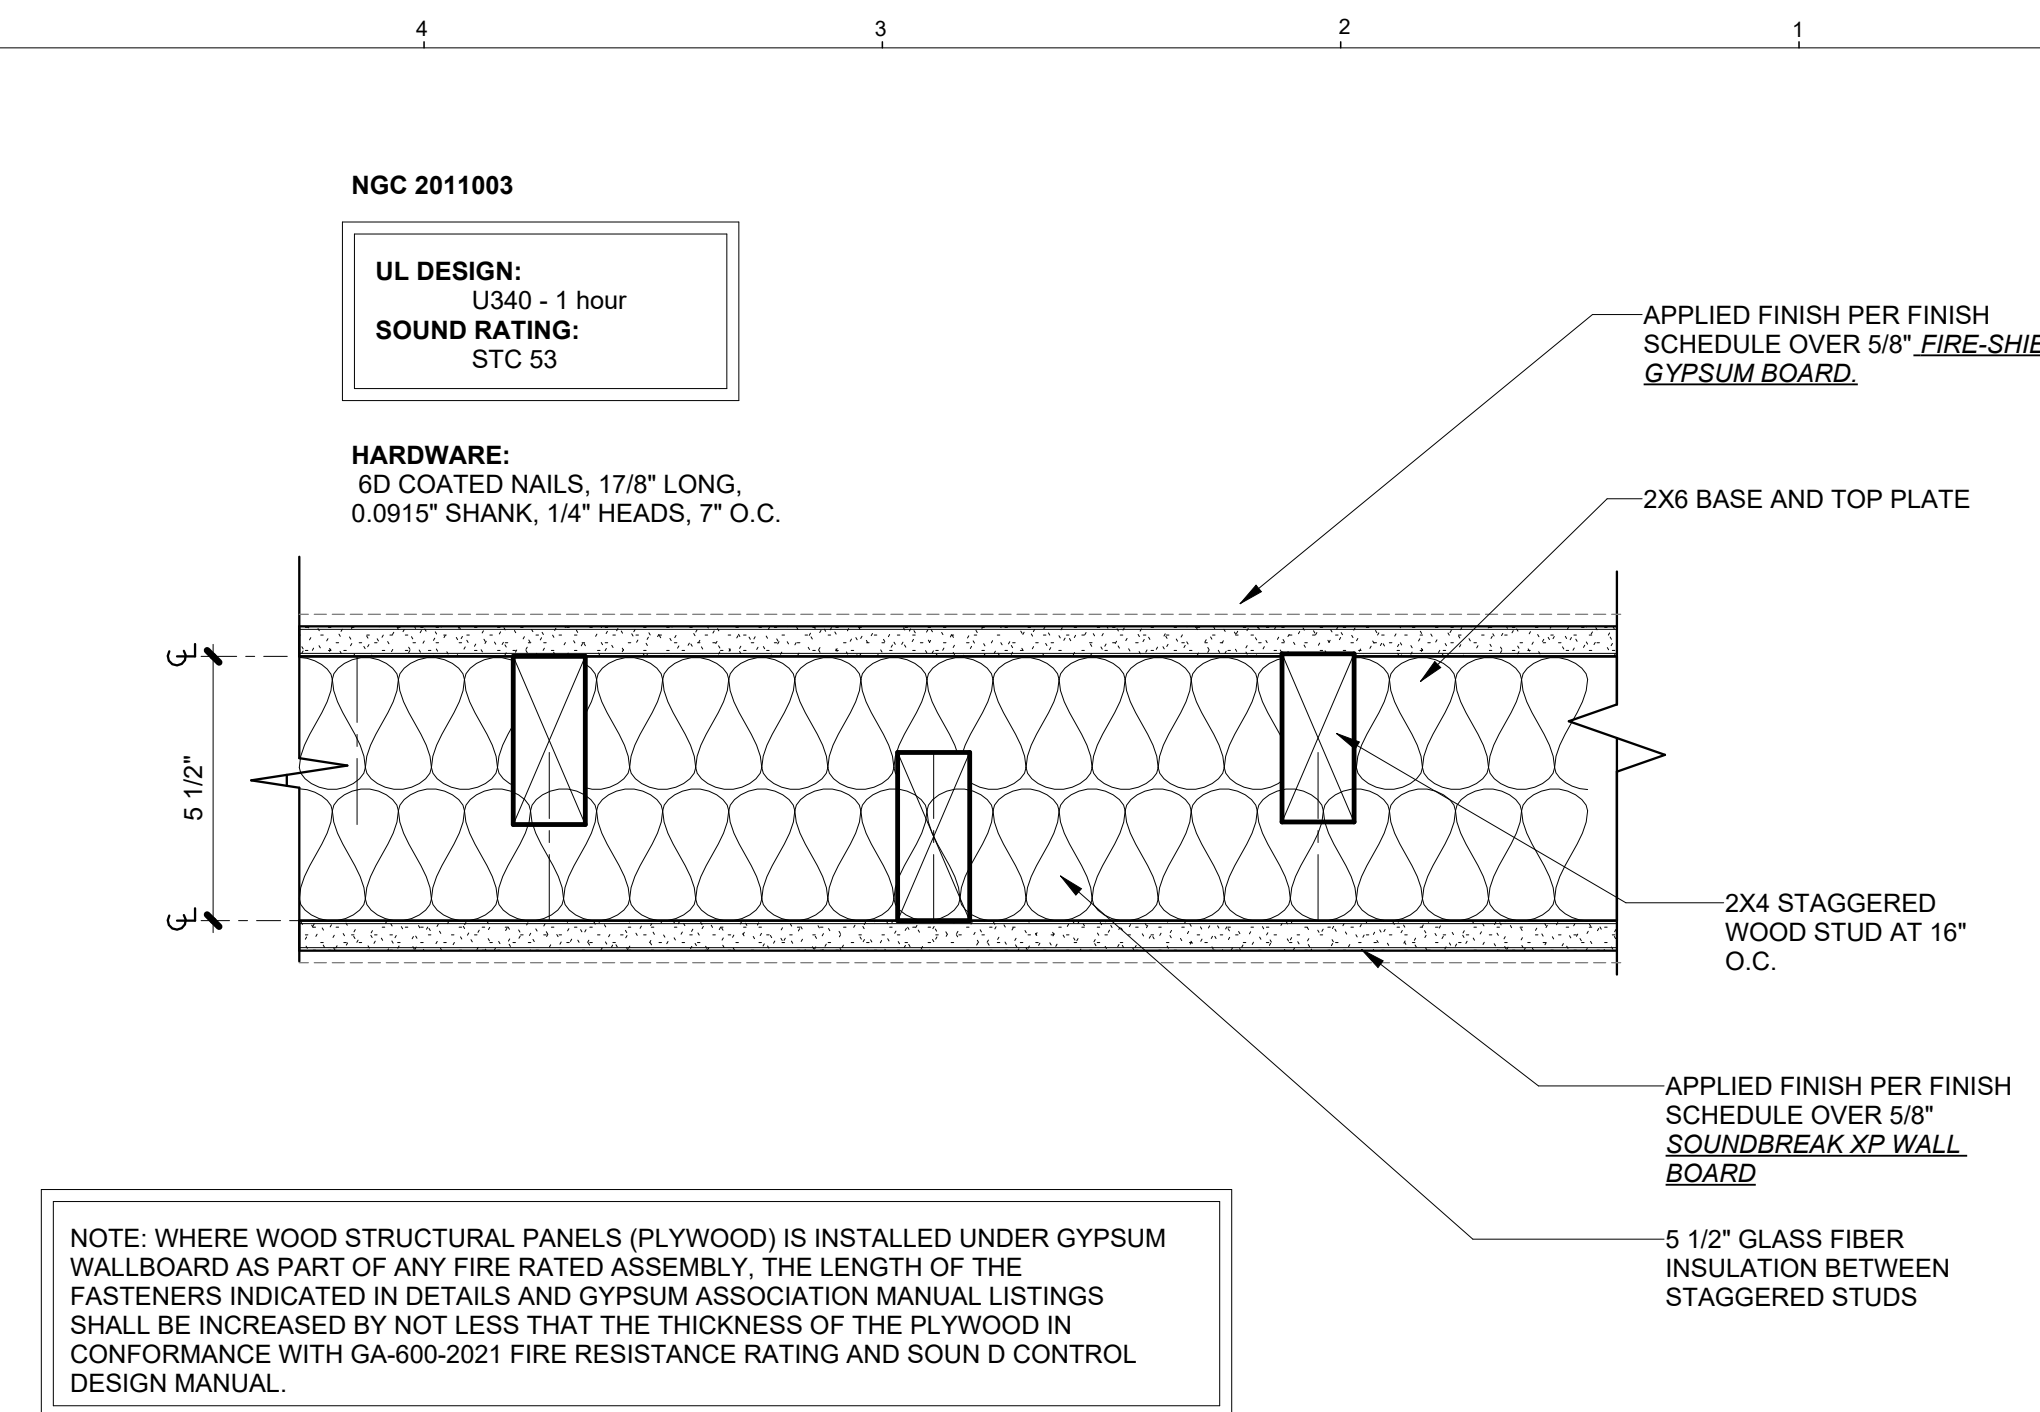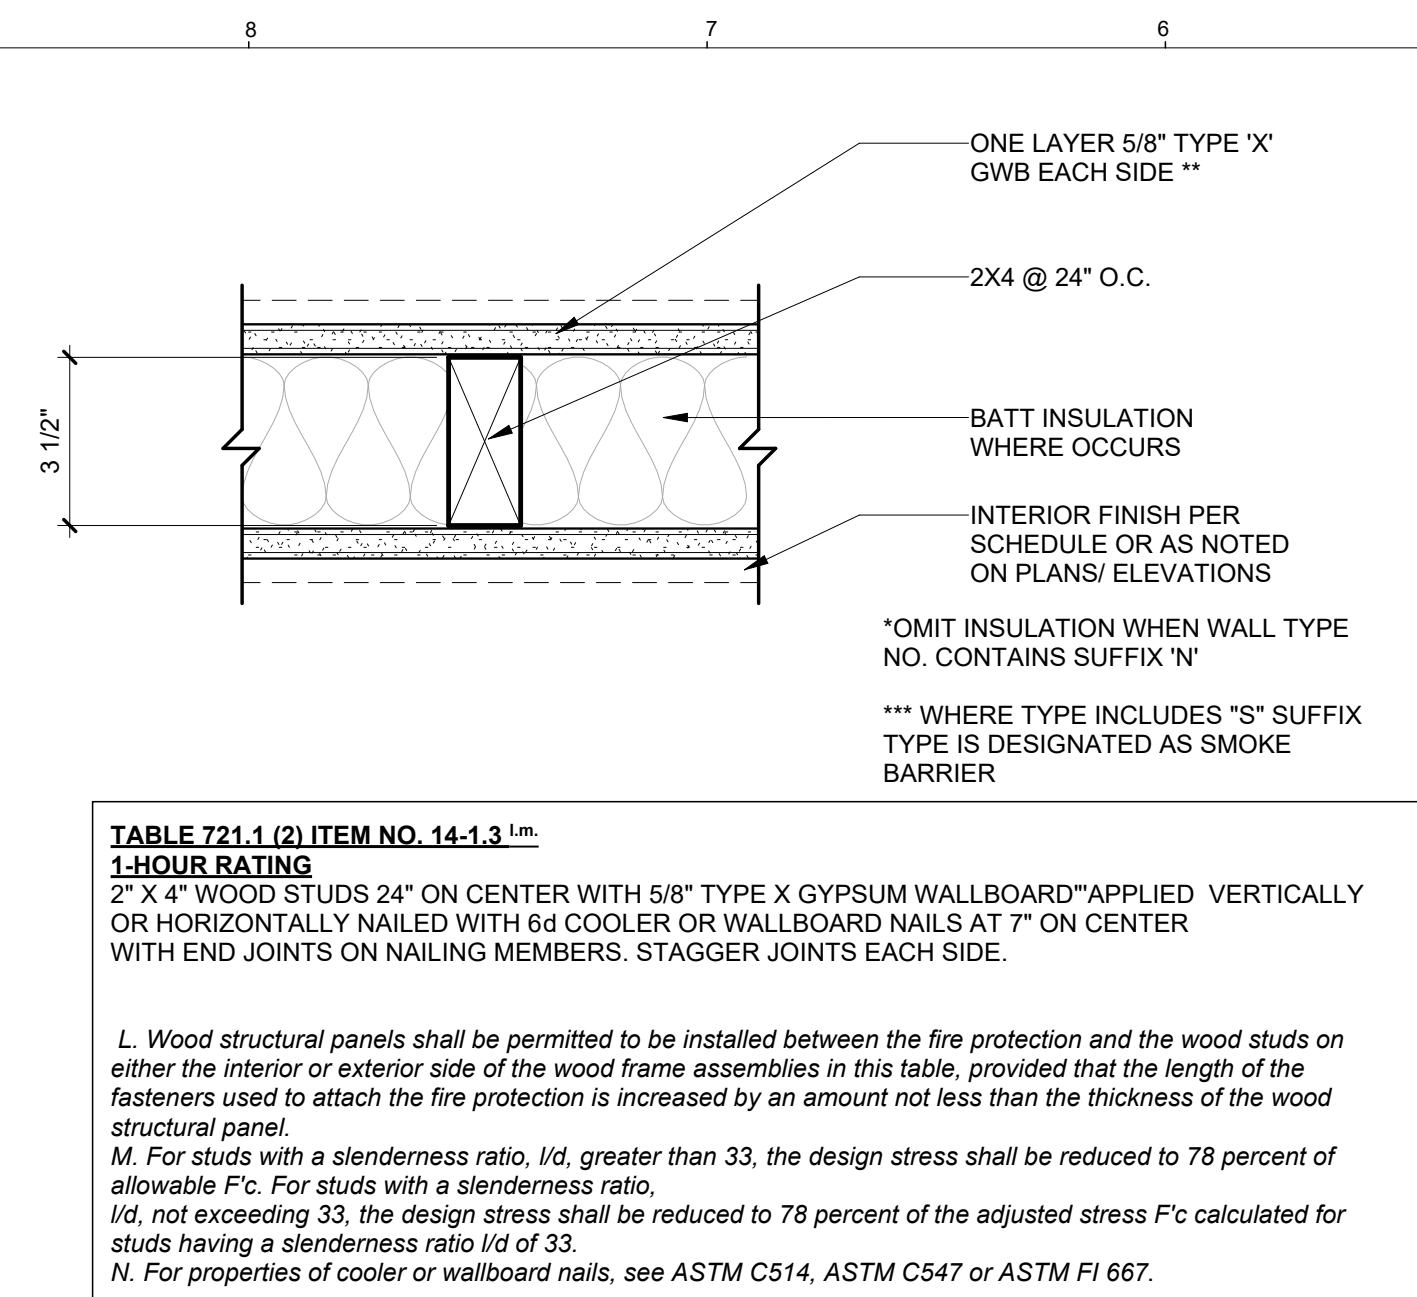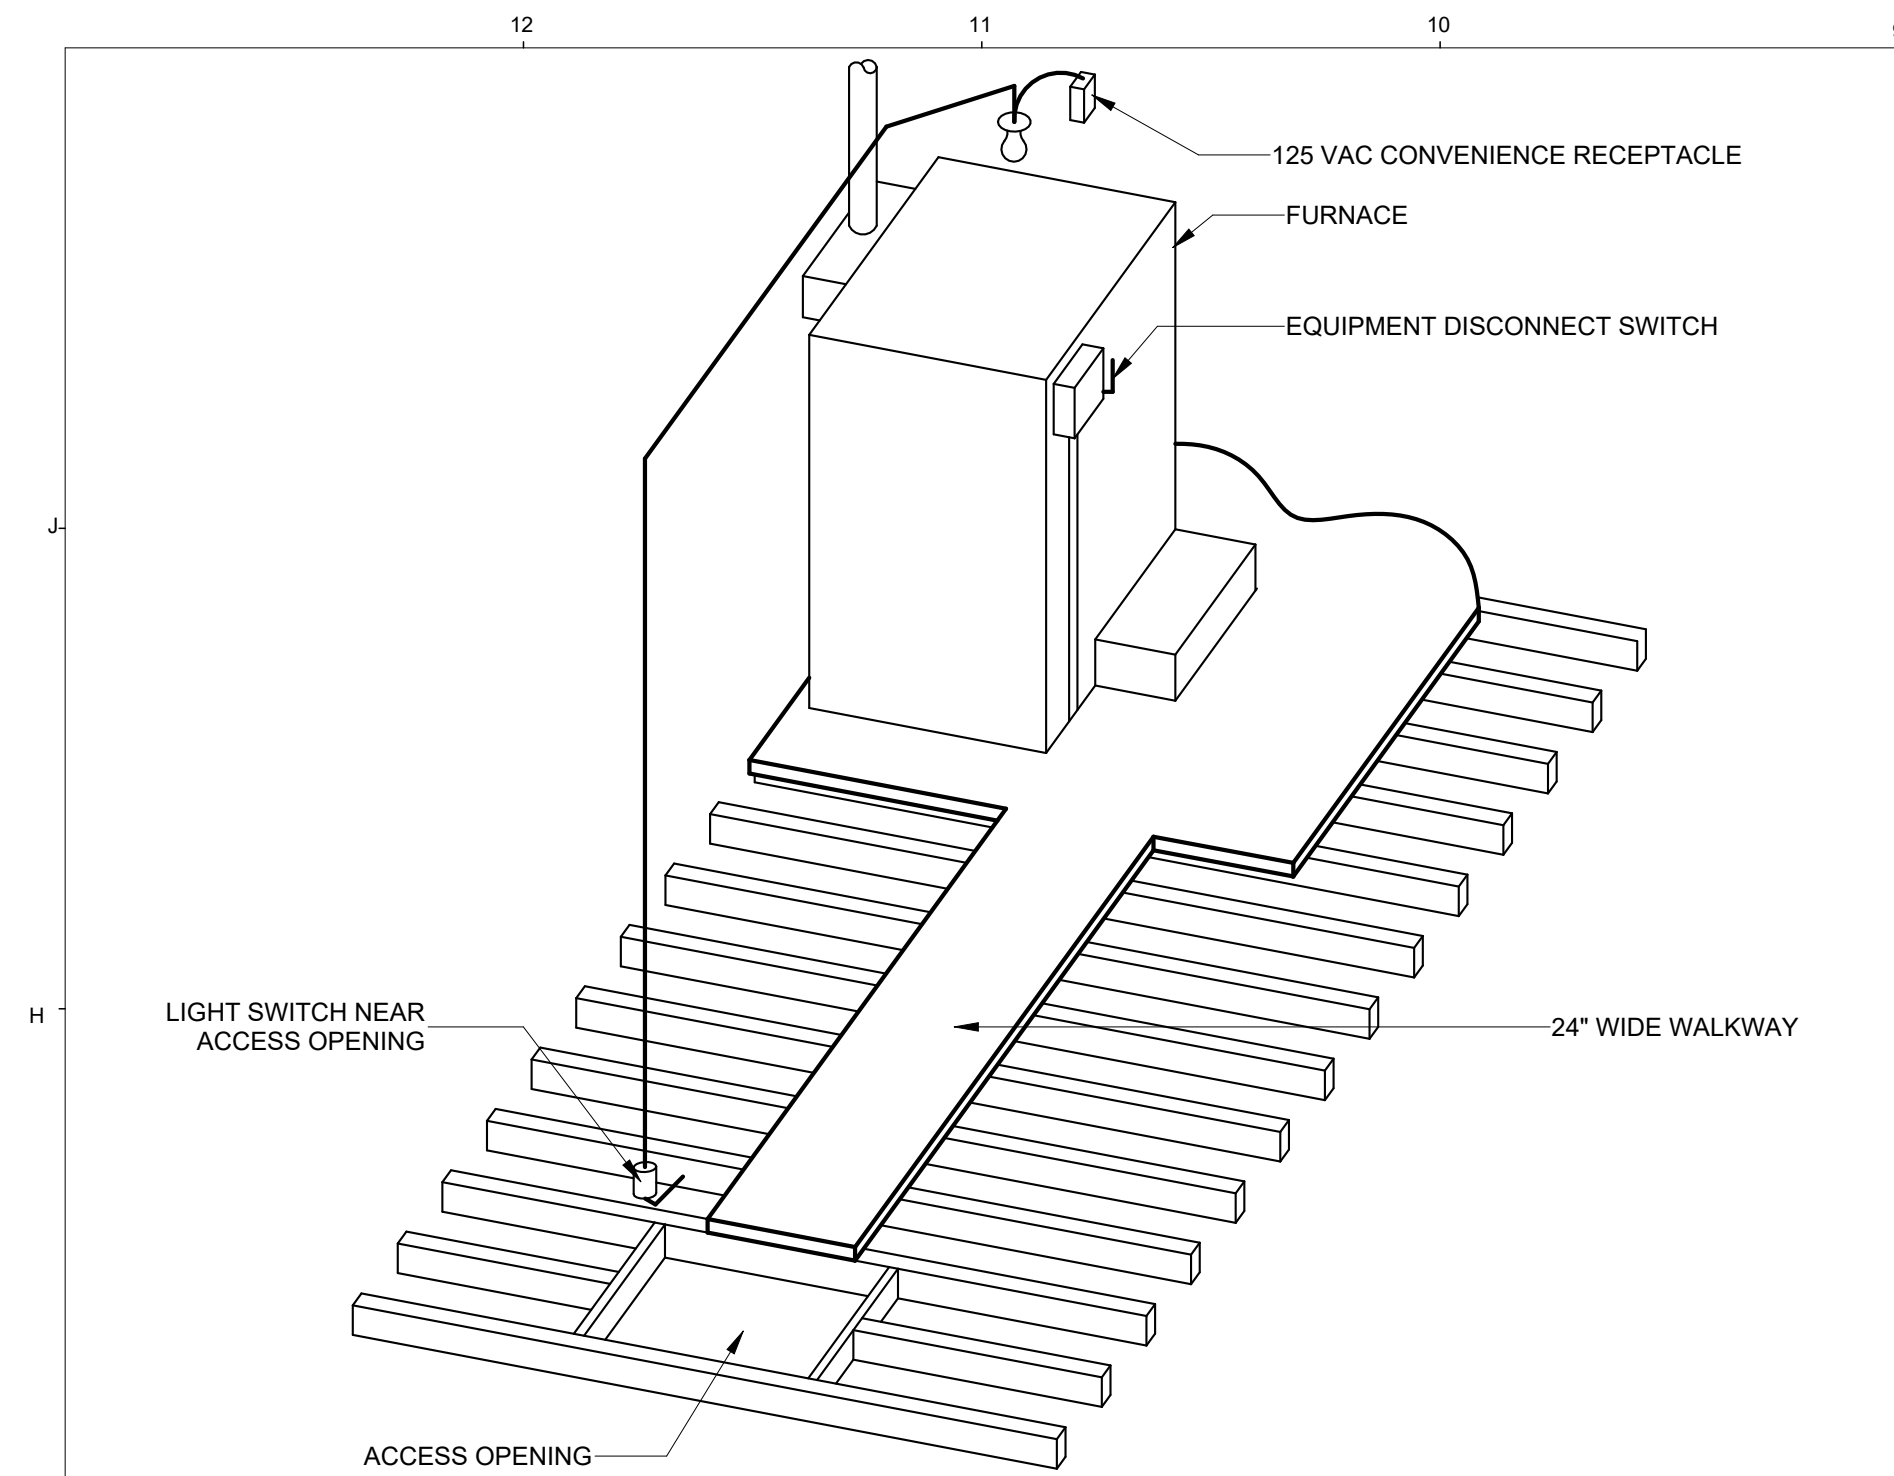


ATTIC FURNACE ISOMETRIC DETAIL G9

1 HR RATED INTERIOR WALL 3" = 1'-0"	G5
--	-----------


1- HR WALL ASSEMBLY (STAGGERED) G1

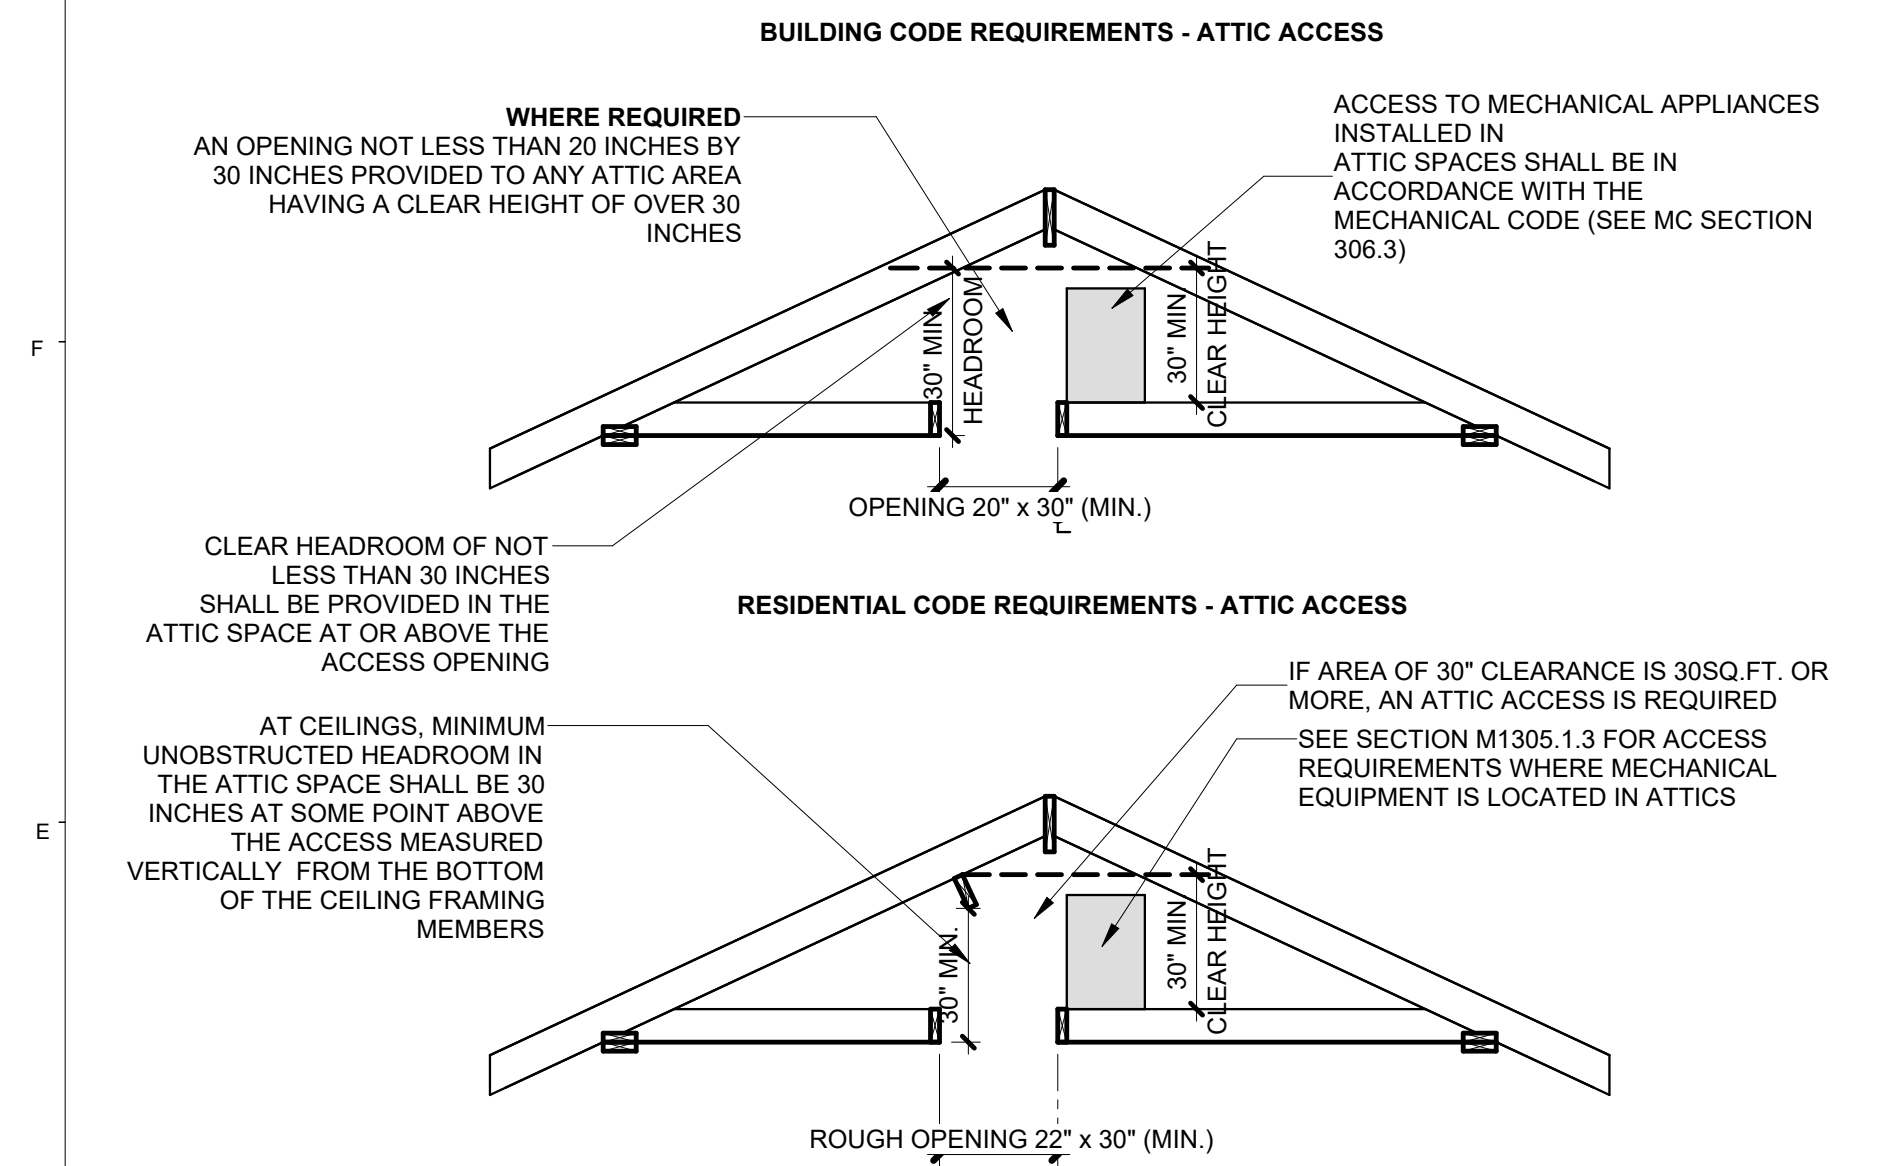


ATTIC ACCESS 3/8" = 1'-0"	D9
------------------------------	----

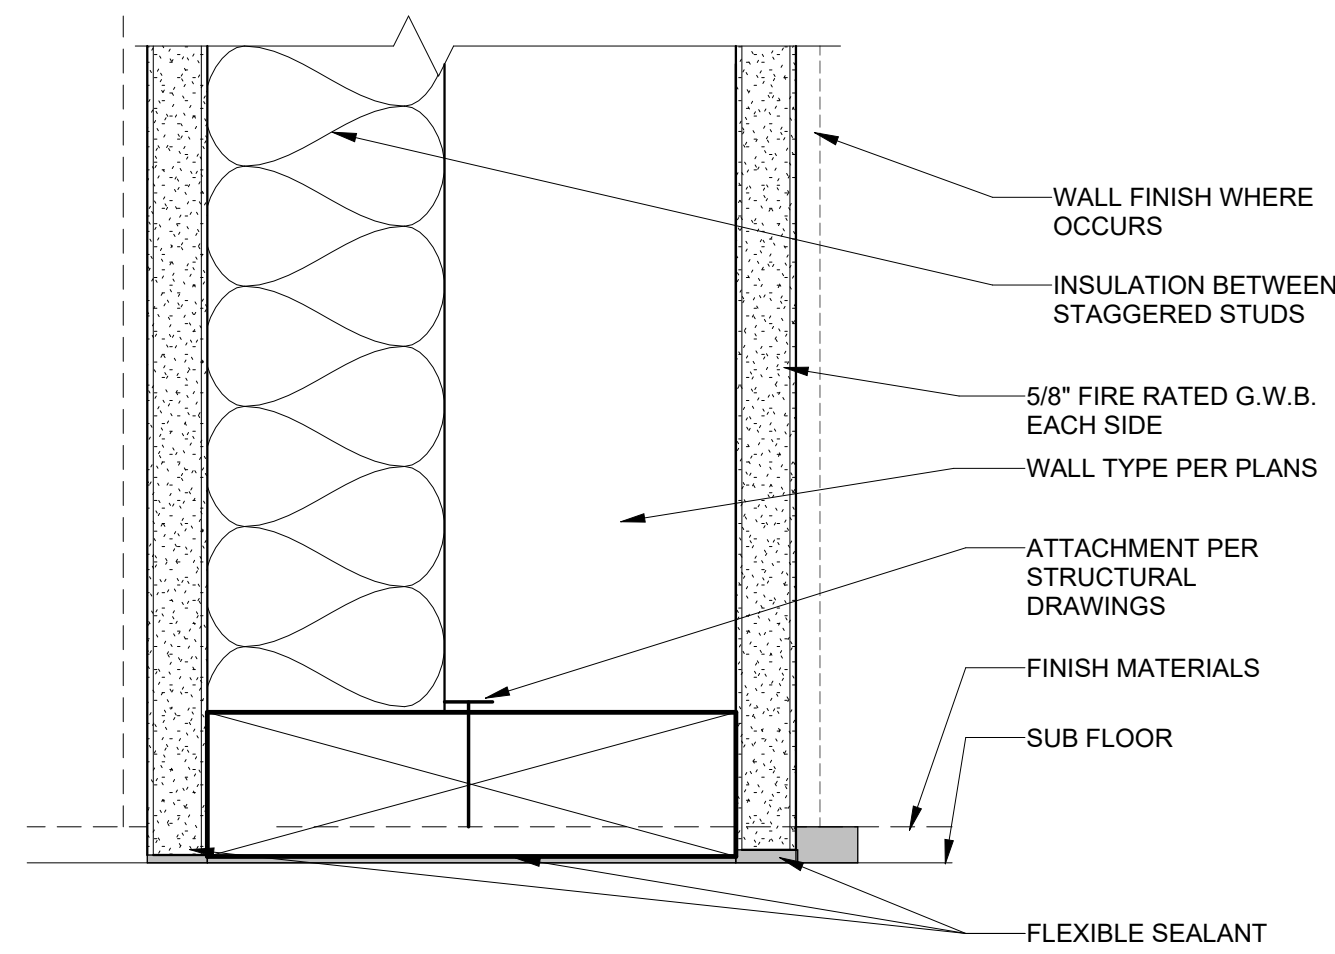


1 HR RATED WALL BASE 6" = 1'-0"	D5
------------------------------------	----

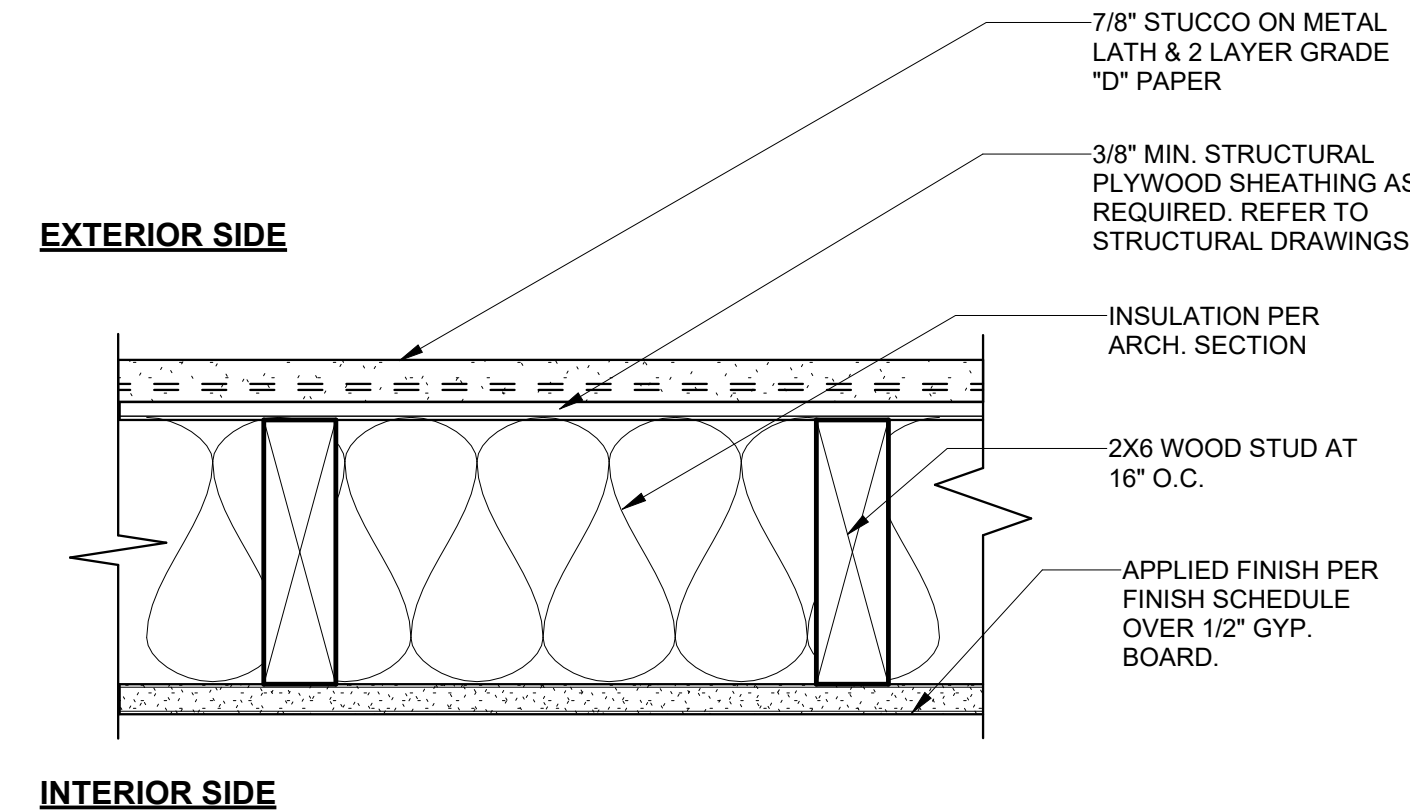


EXTERIOR WALL ASSEMBLY - CEMENT PLASTER D1

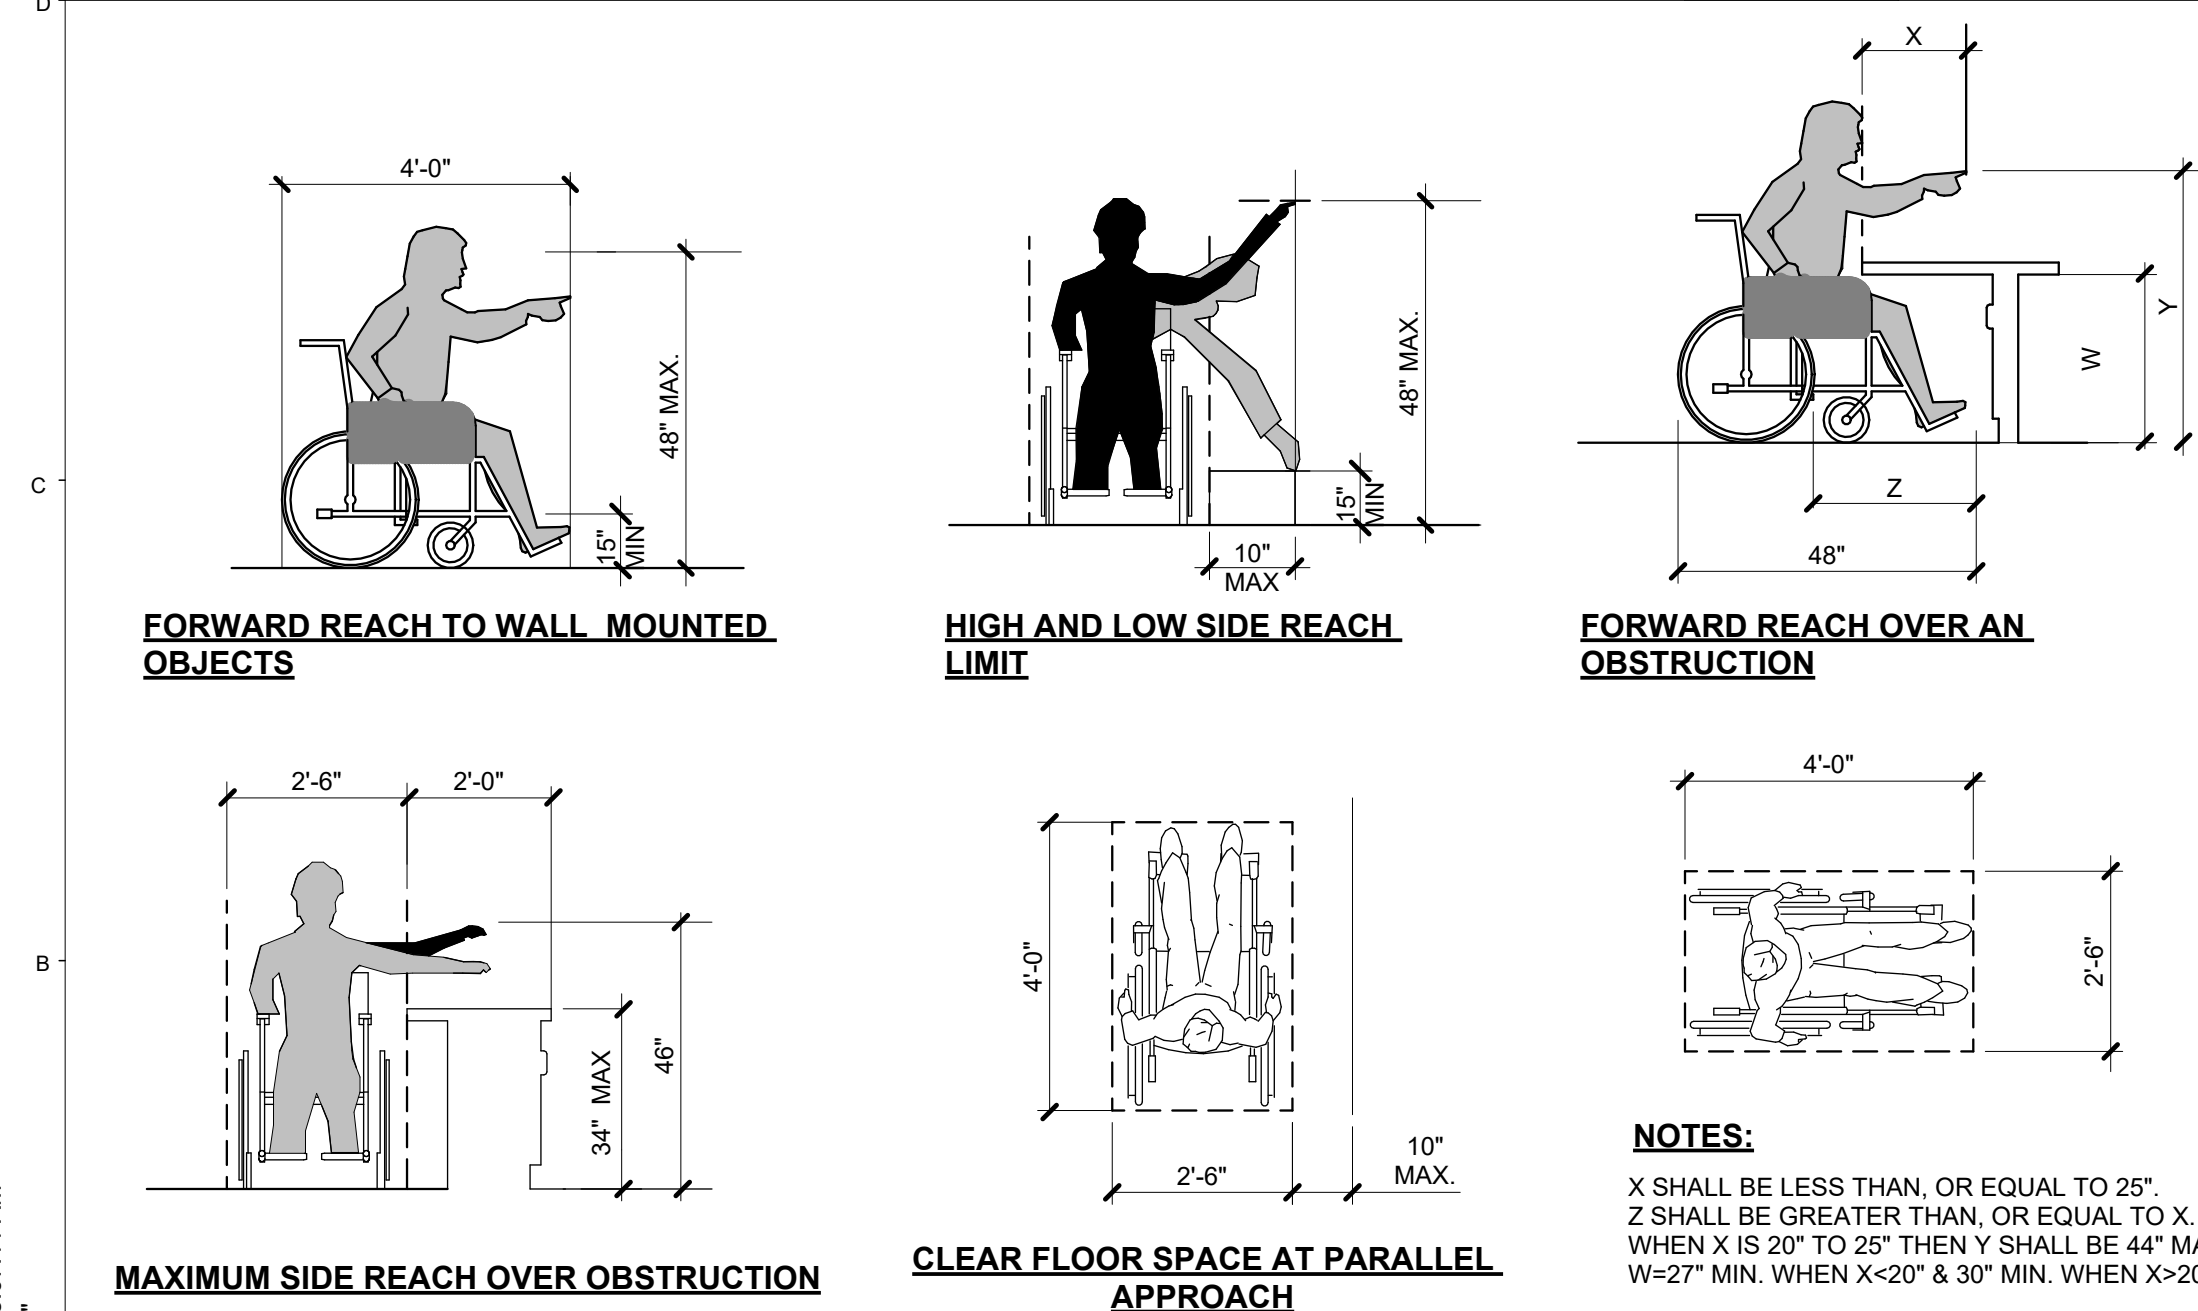

TYPICAL REACH RANGES

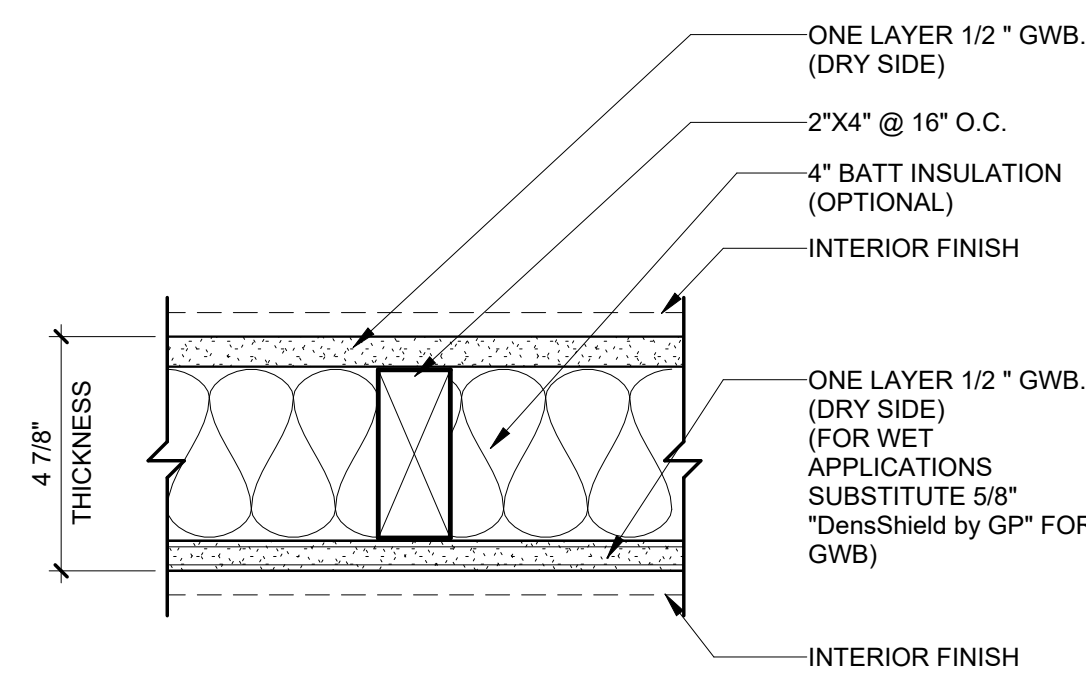

INTERIOR NON- RATED WALL 3" = 1'-0"	A5
--	-----------

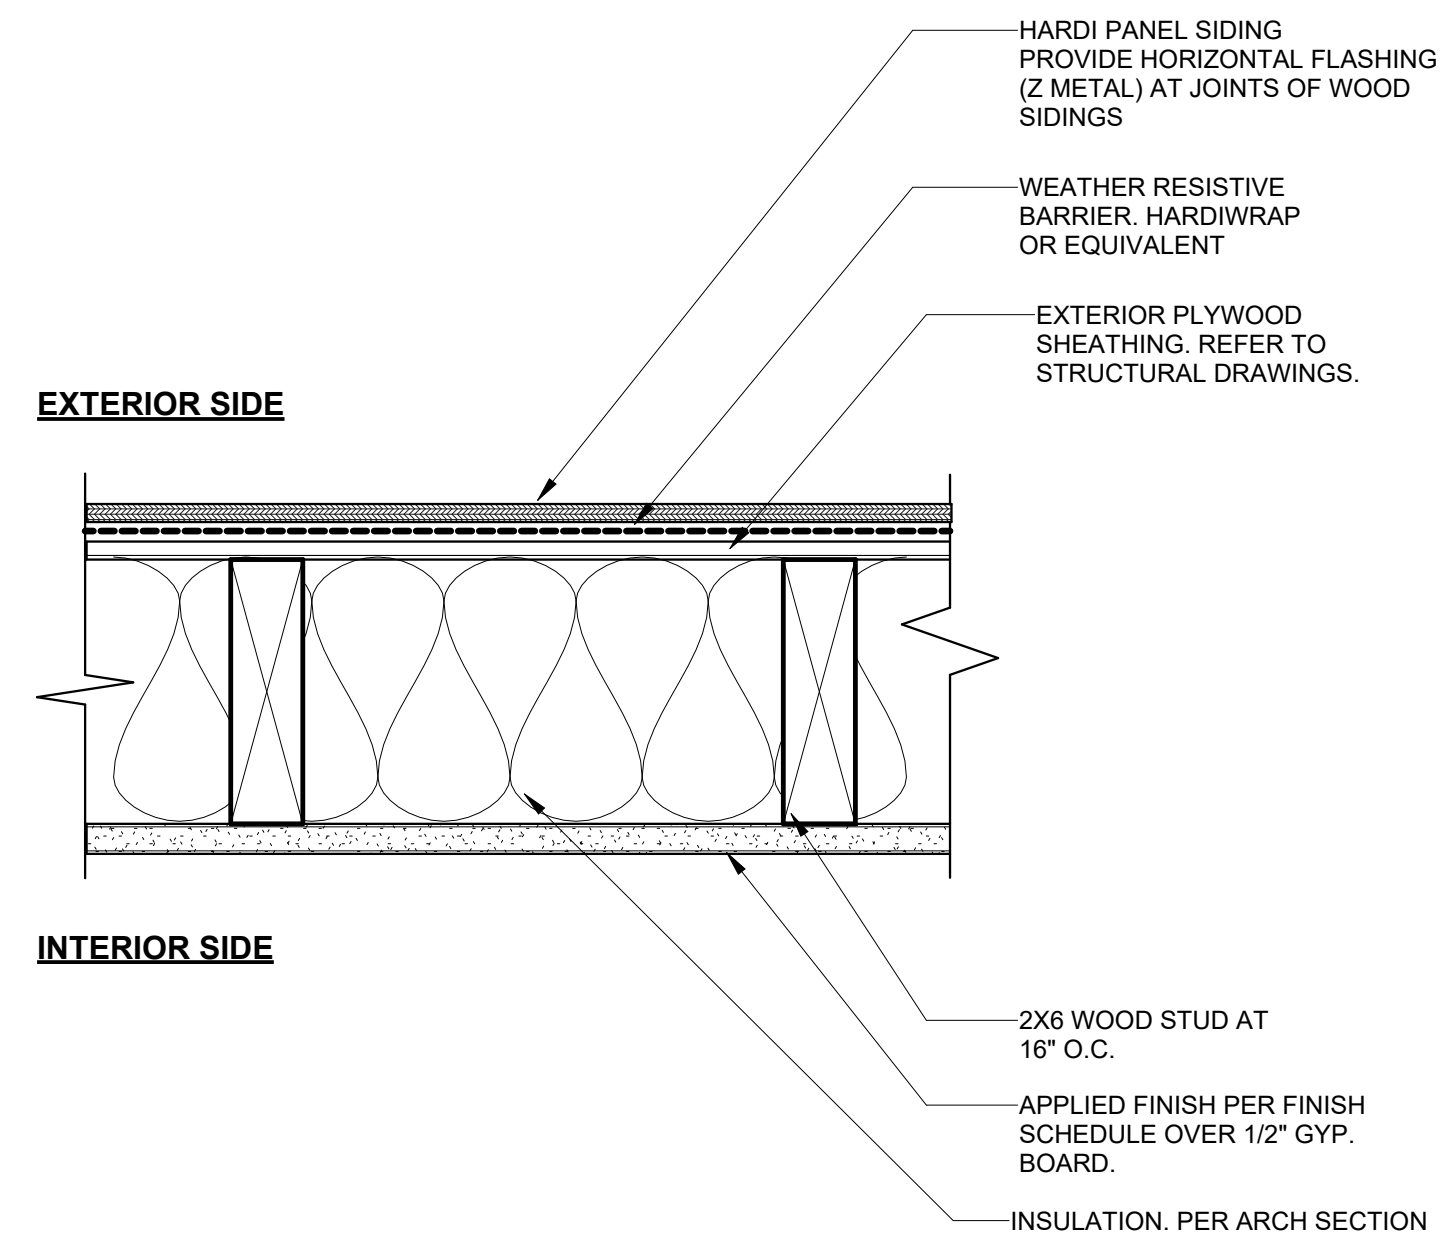


EXTERIOR WALL ASSEMBLY - HARDIPANEL SIDING A1

TRIPLEX DWELLING UNIT

OPTION #2

PROJECT

TRIPLEX DWELLING UNIT

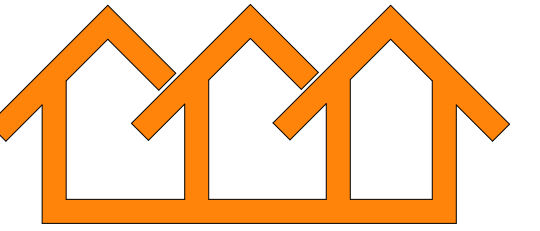


PWP23-005

DEPARTMENT OF PUBLIC
WORKS AND PLANNINGCAPITAL PROJECTS
DIVISION

220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

REAL & SIGNATURE

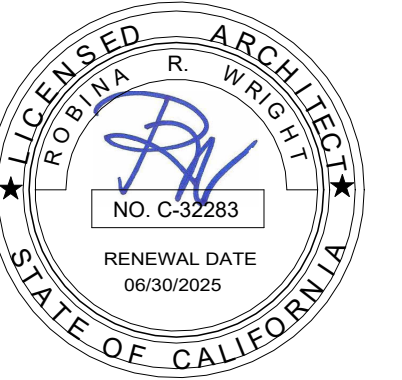

UPDATE

ANUARY 2, 2024

THESE DRAWINGS AND SPECIFICATIONS
ARE THE PROPERTY AND COPYRIGHT OF
THE ARCHITECT AND SHALL NOT BE
USED ON ANY OTHER PROJECT OR
LOCATIONS EXCEPT AS DESCRIBED ON
THE DRAWINGS WITHOUT WRITTEN
AGREEMENT WITH THE ARCHITECT.

ARCHITECTURAL DETAILS

SCALE	As indicated
-------	--------------


A-803

ISSUE DATE	JOB NUMBER
MARCH 7, 2023	2023_11


RAWN BY	CHECKED BY
Author	Checker

1/4/2024 8:07:11 AM


1/4/2024 5:07:12 AM
24" X 36"

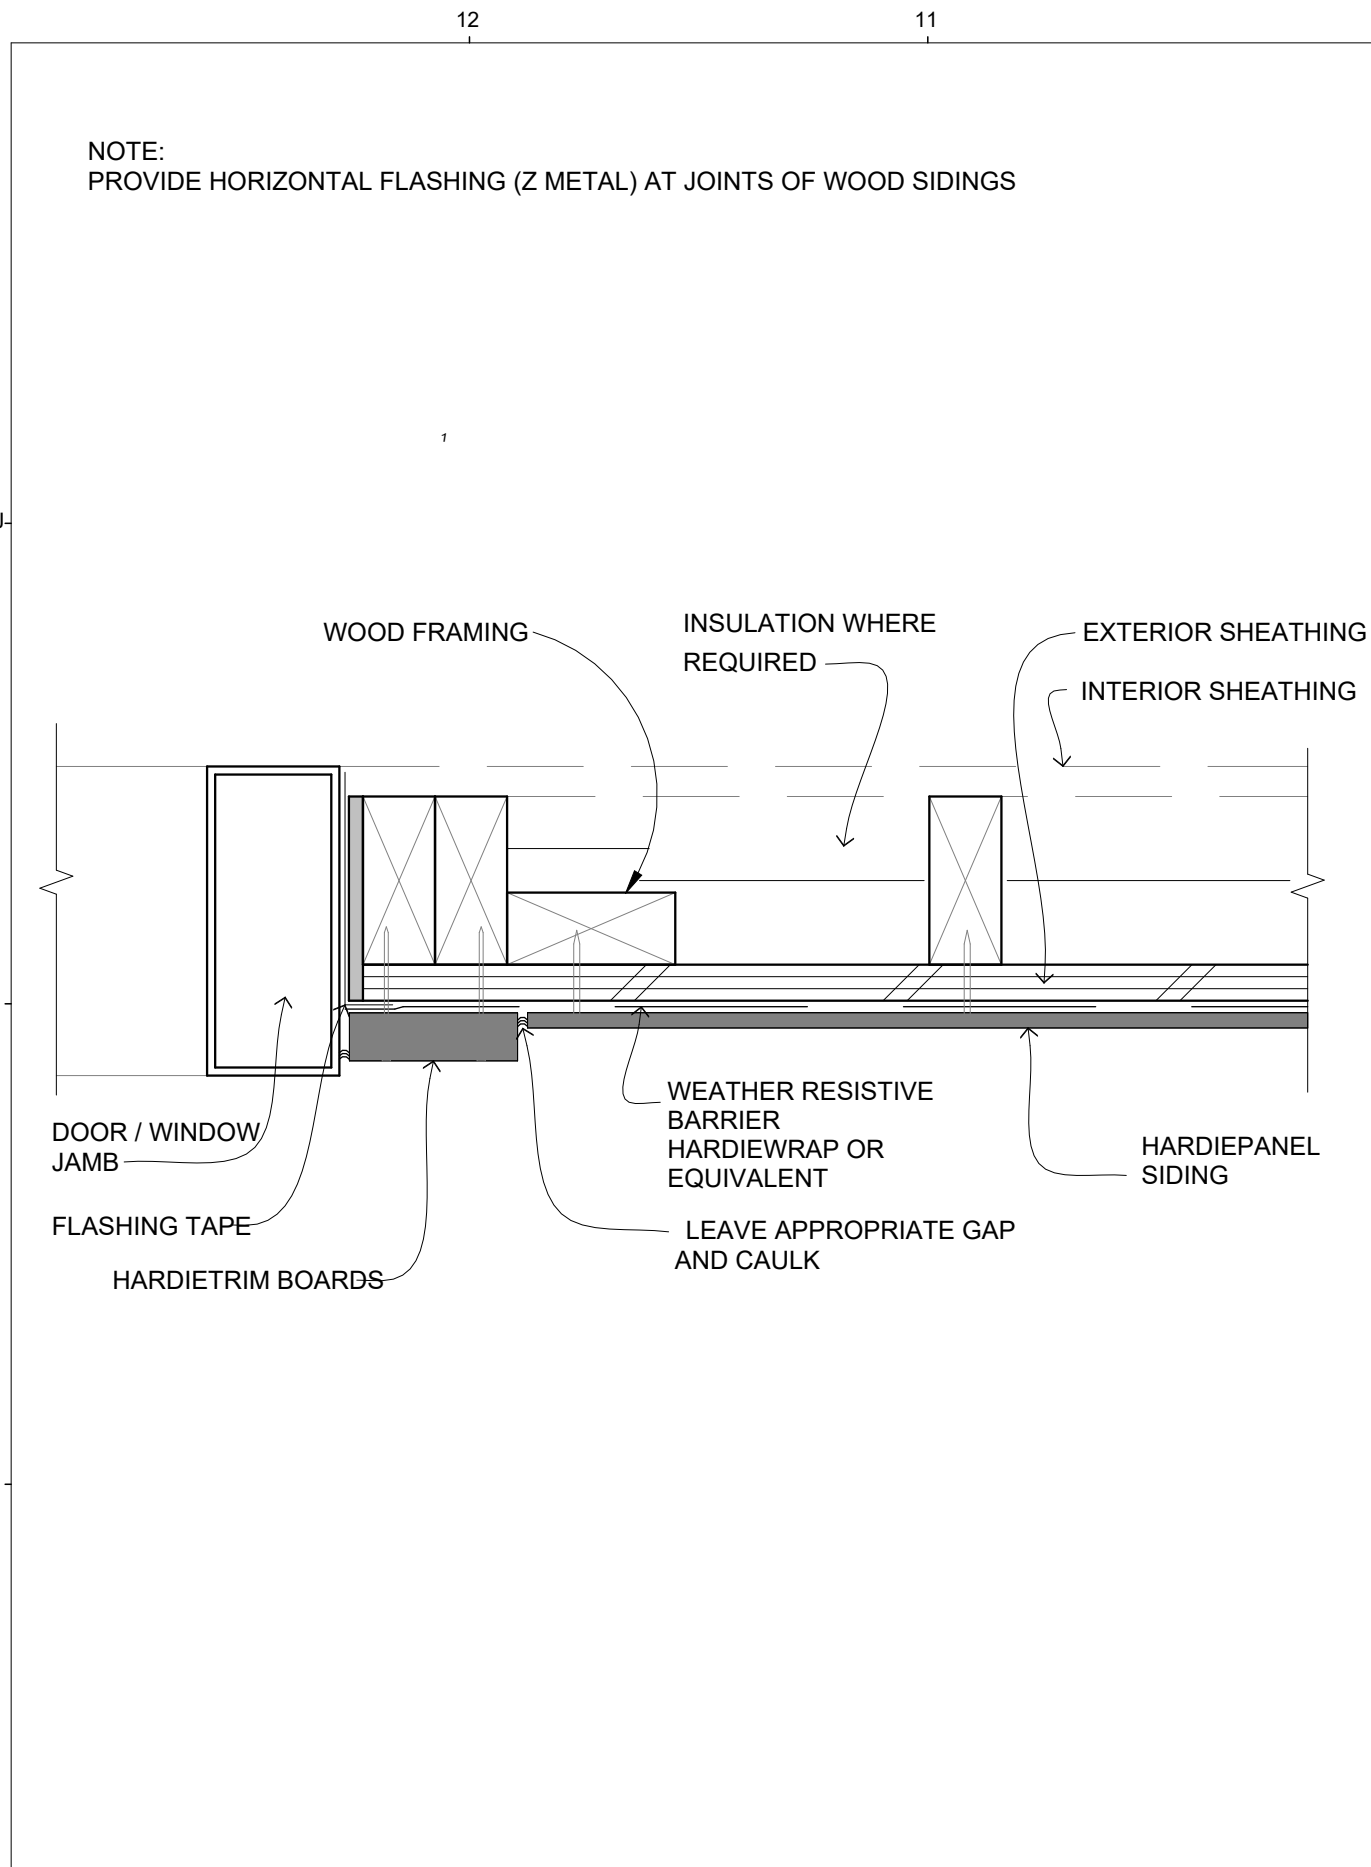


DOOR / WINDOW JAMB DETAIL **F10**
3" = 1'-0"

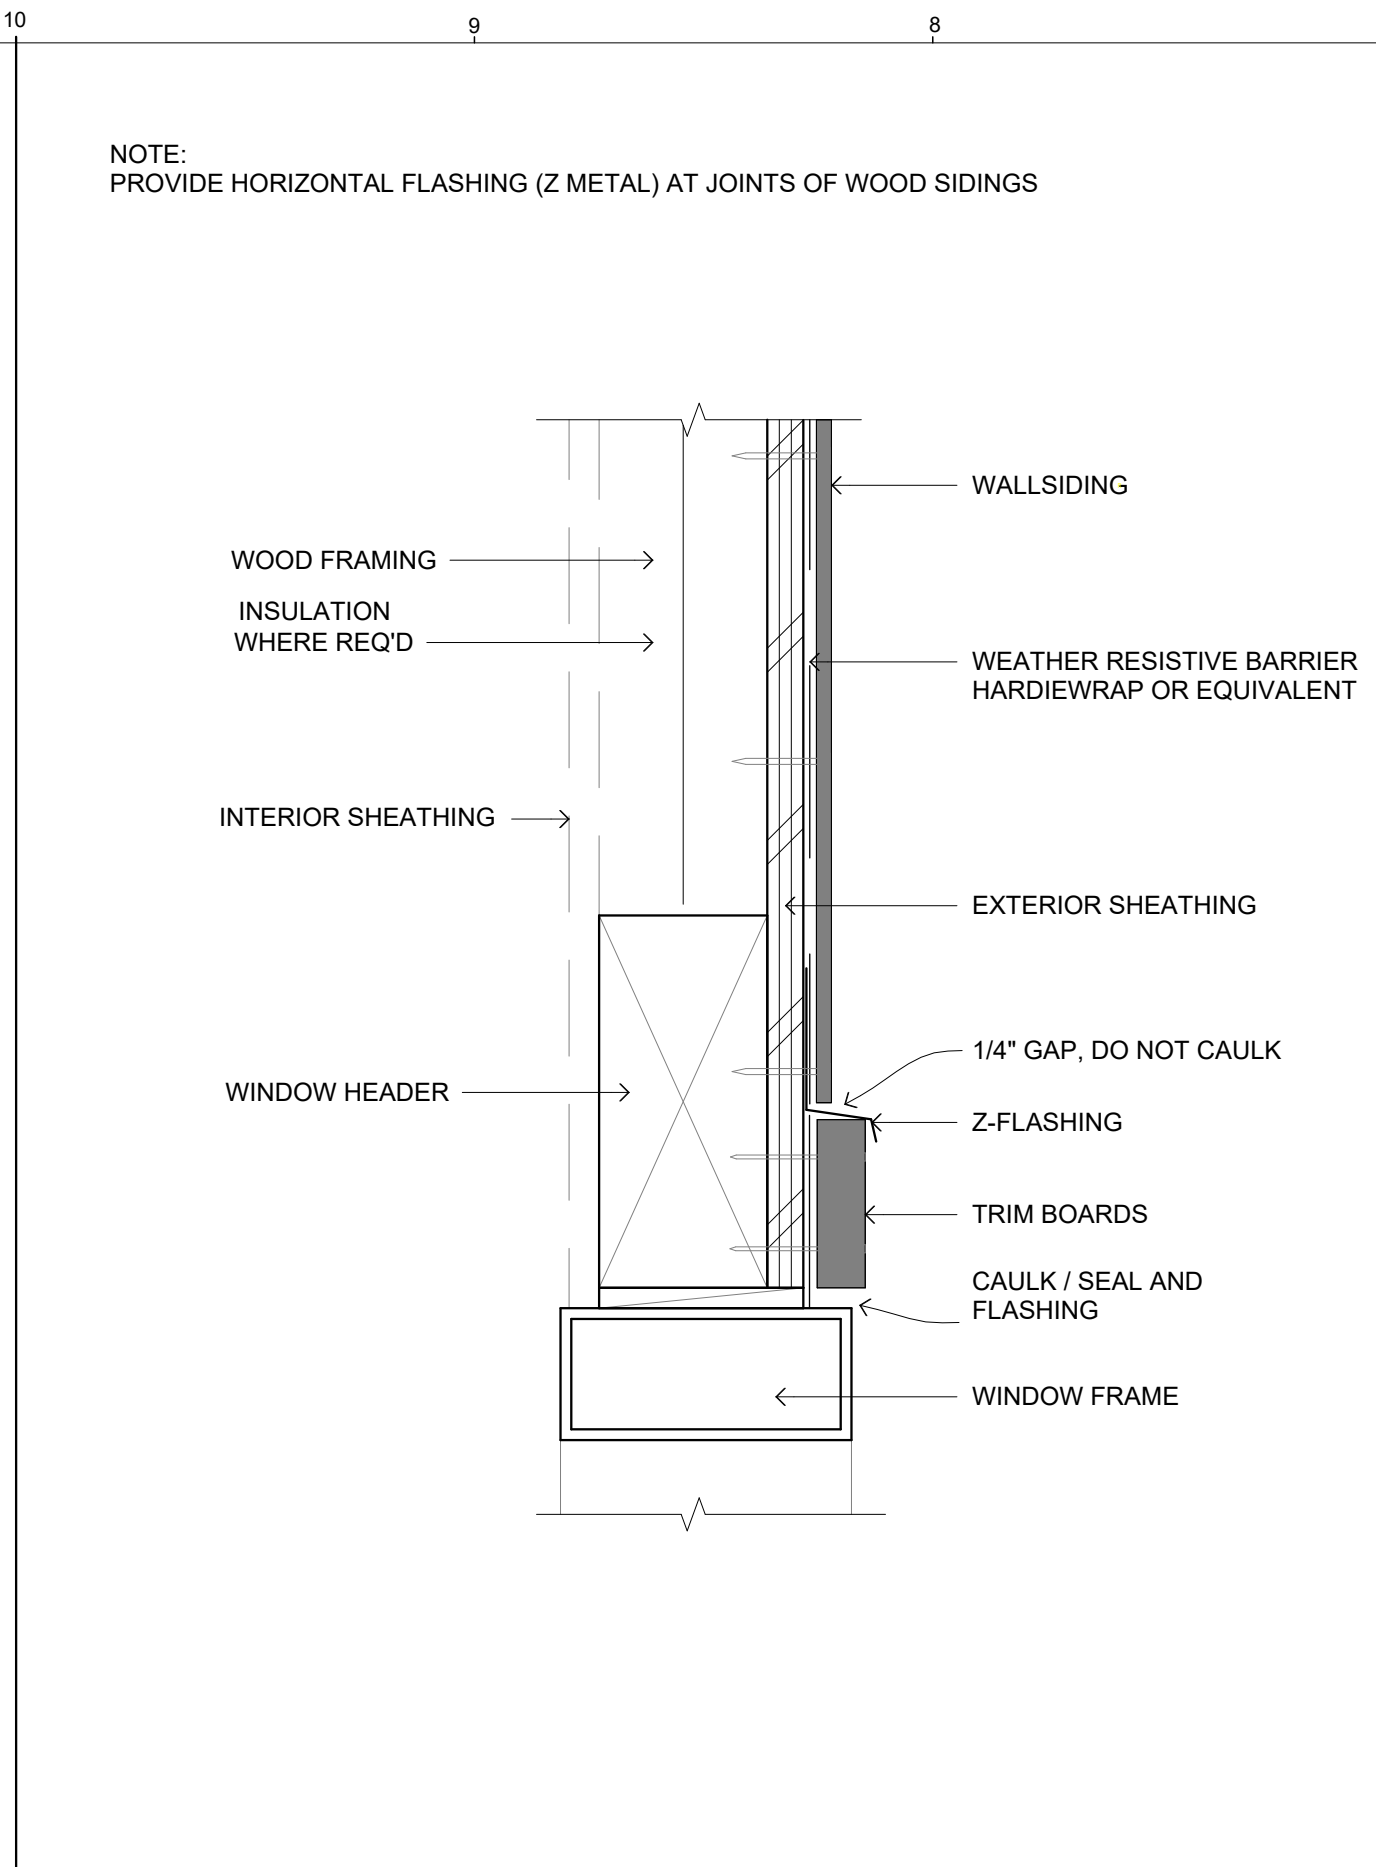


DOOR / WINDOW HEAD **F7**
3" = 1'-0"

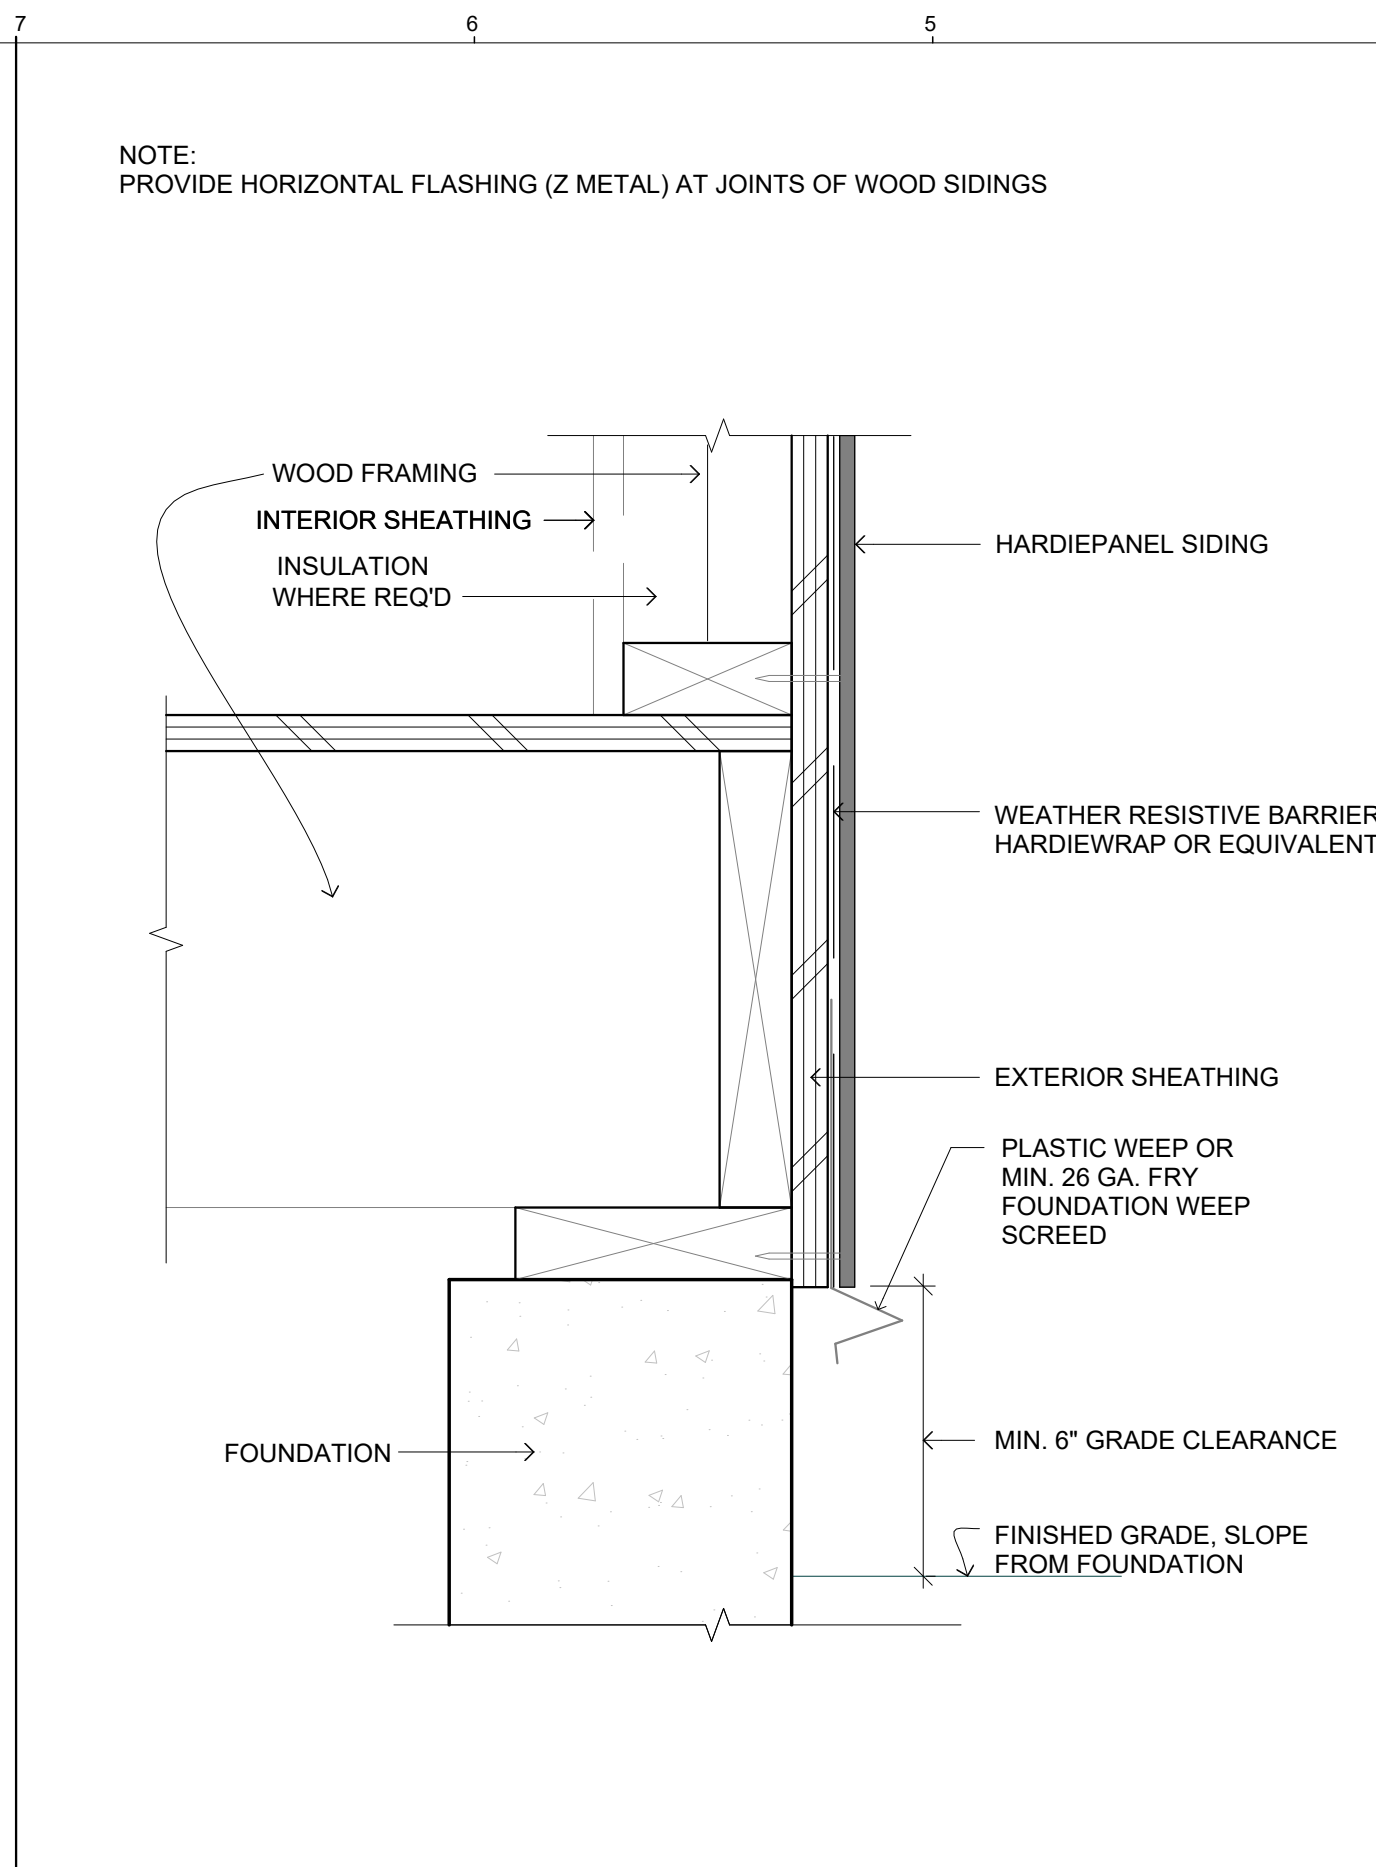


WEEP SCREED AT GRADE (HARDI WALL) **F4**
3" = 1'-0"

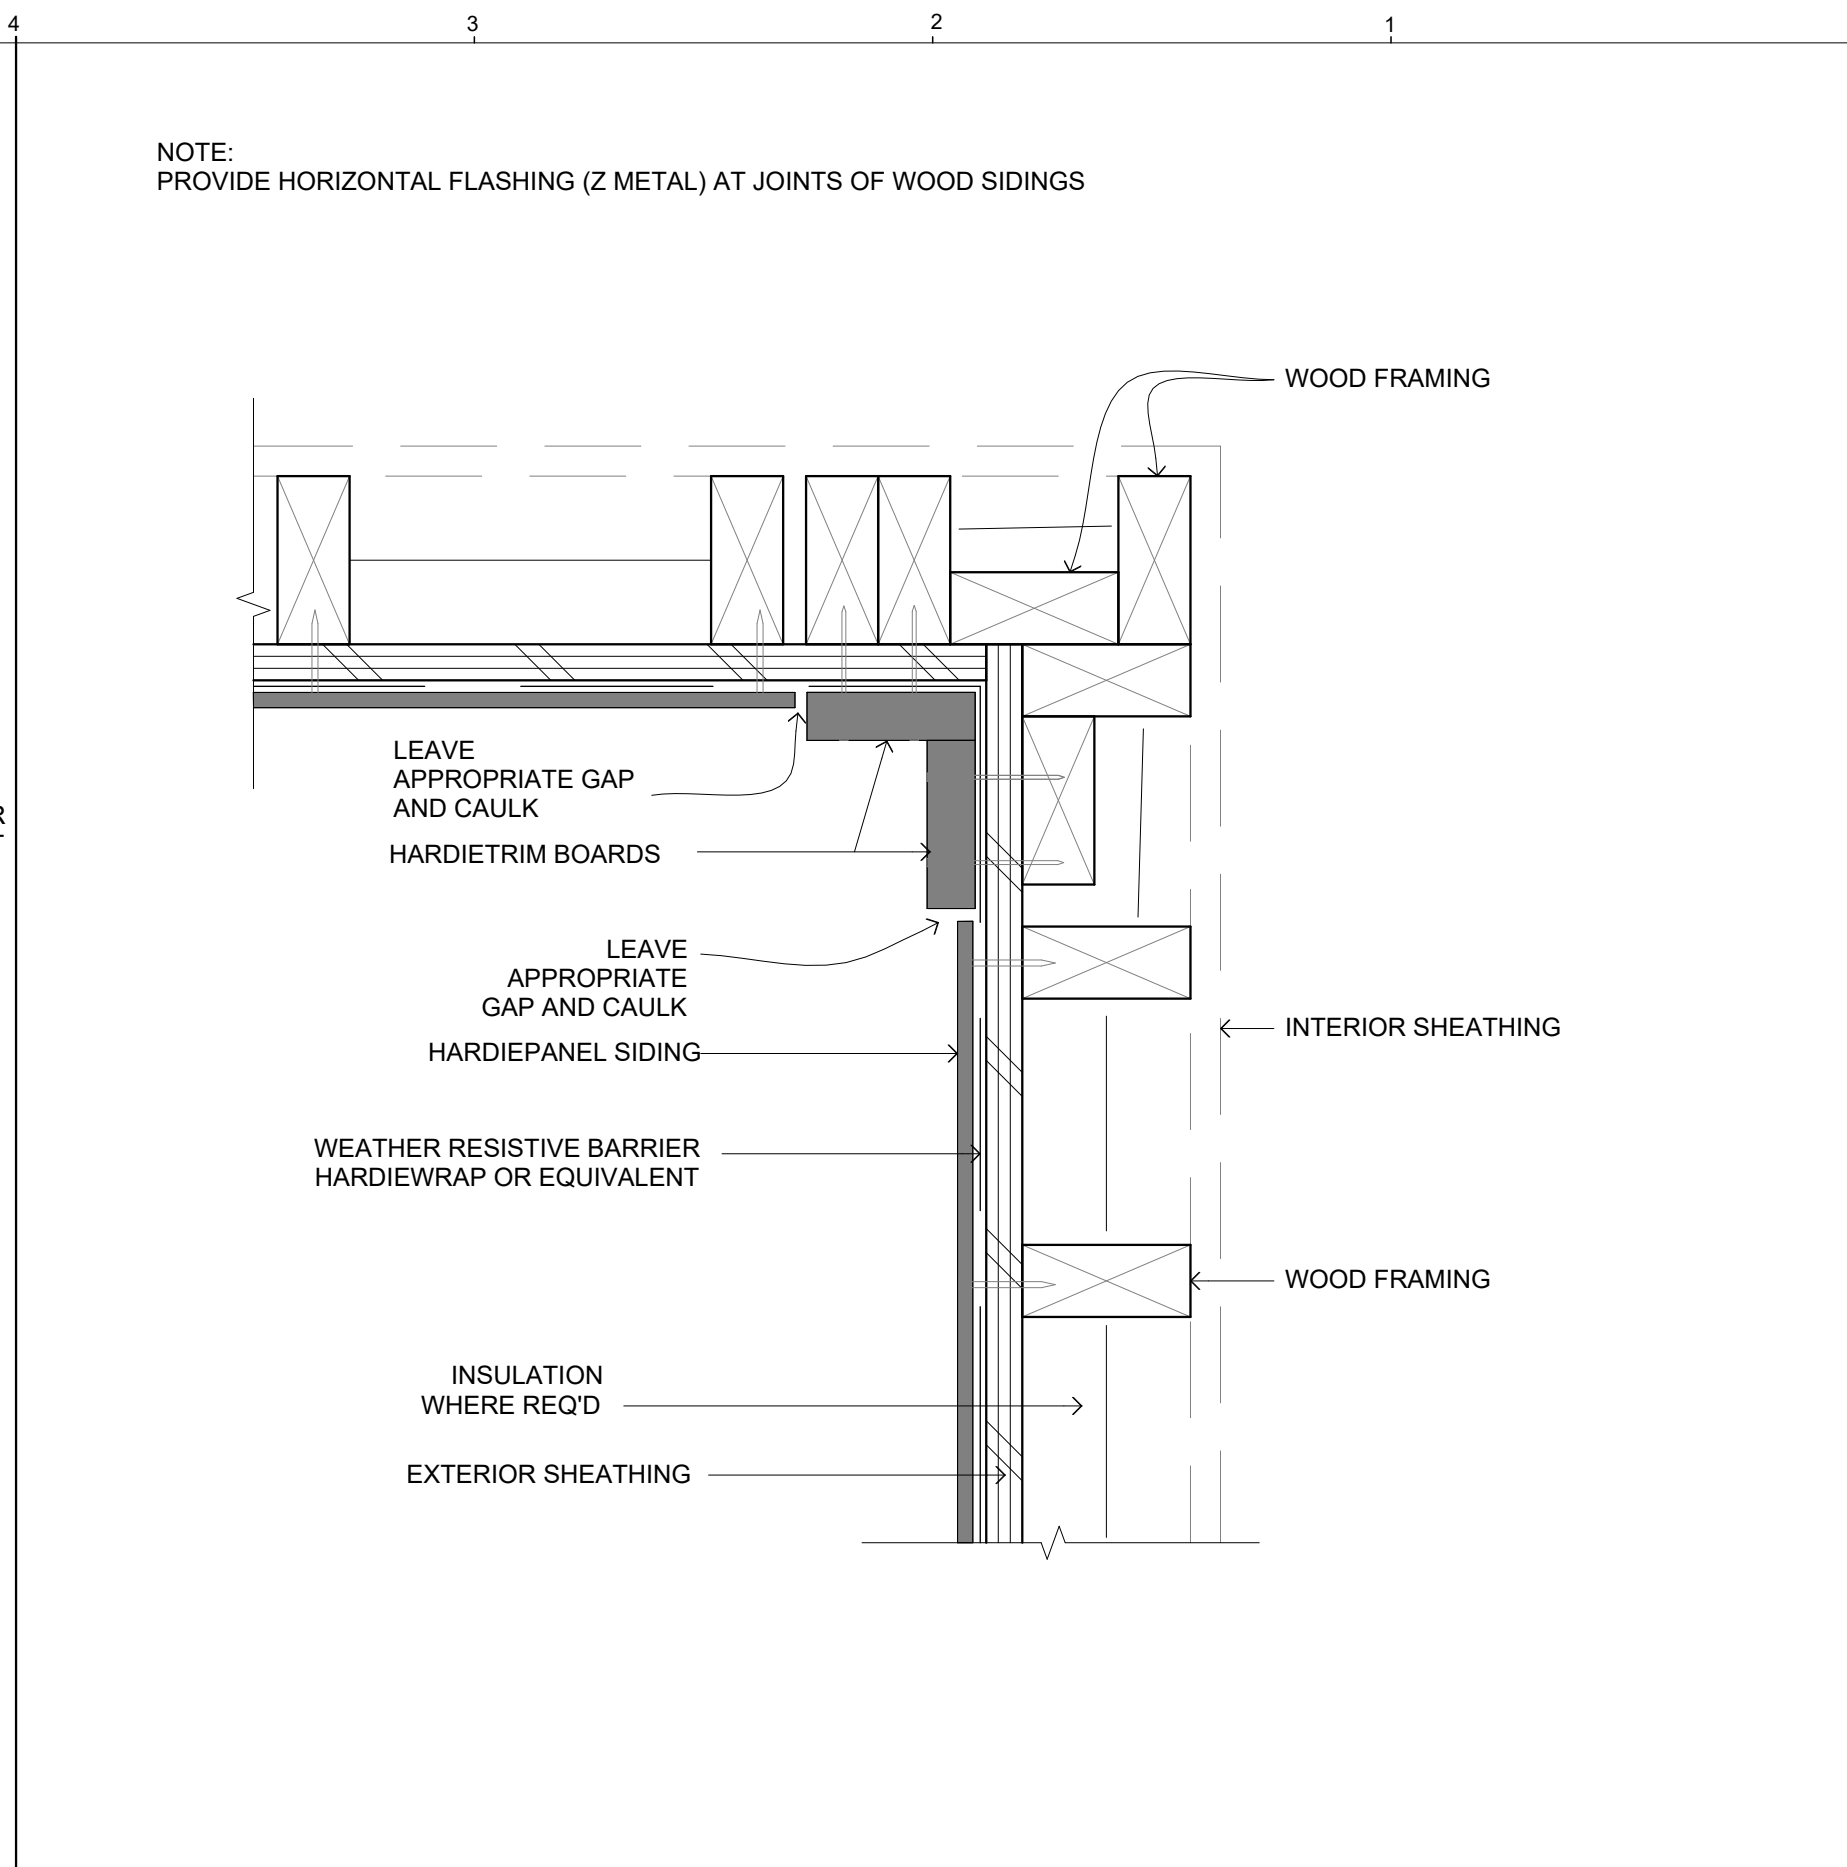


INSIDE CORNER CONDITION AT HARDI WALL **F1**
3" = 1'-0"

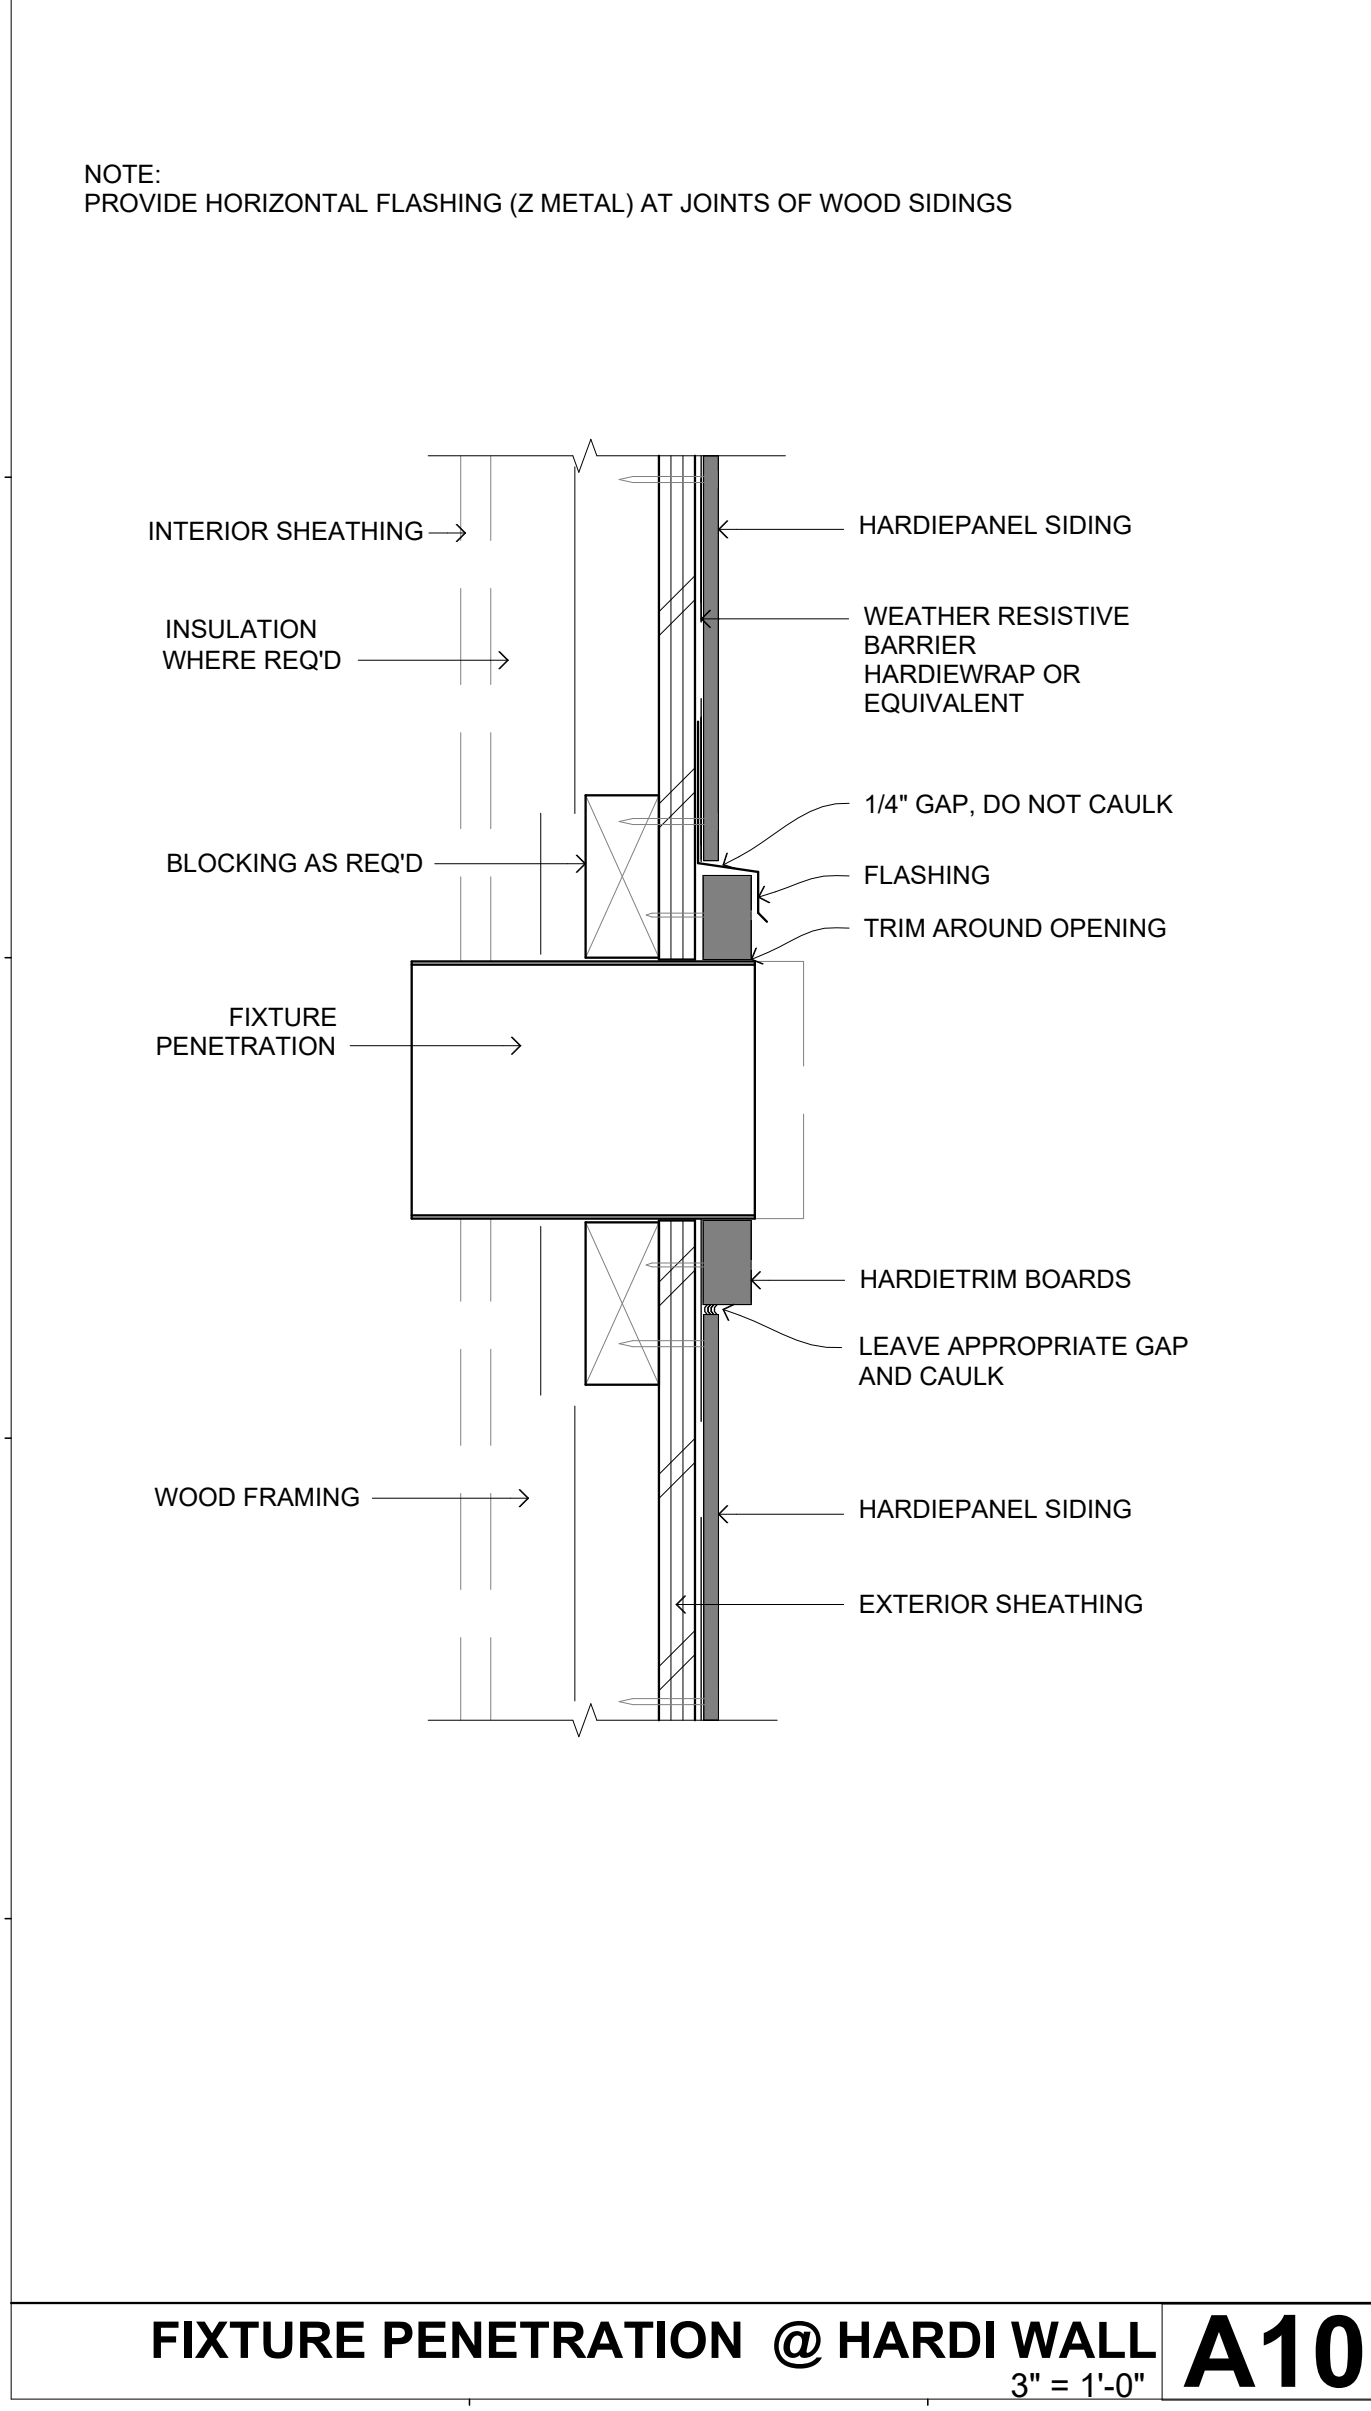


FIXTURE PENETRATION @ HARDI WALL **A10**
3" = 1'-0"

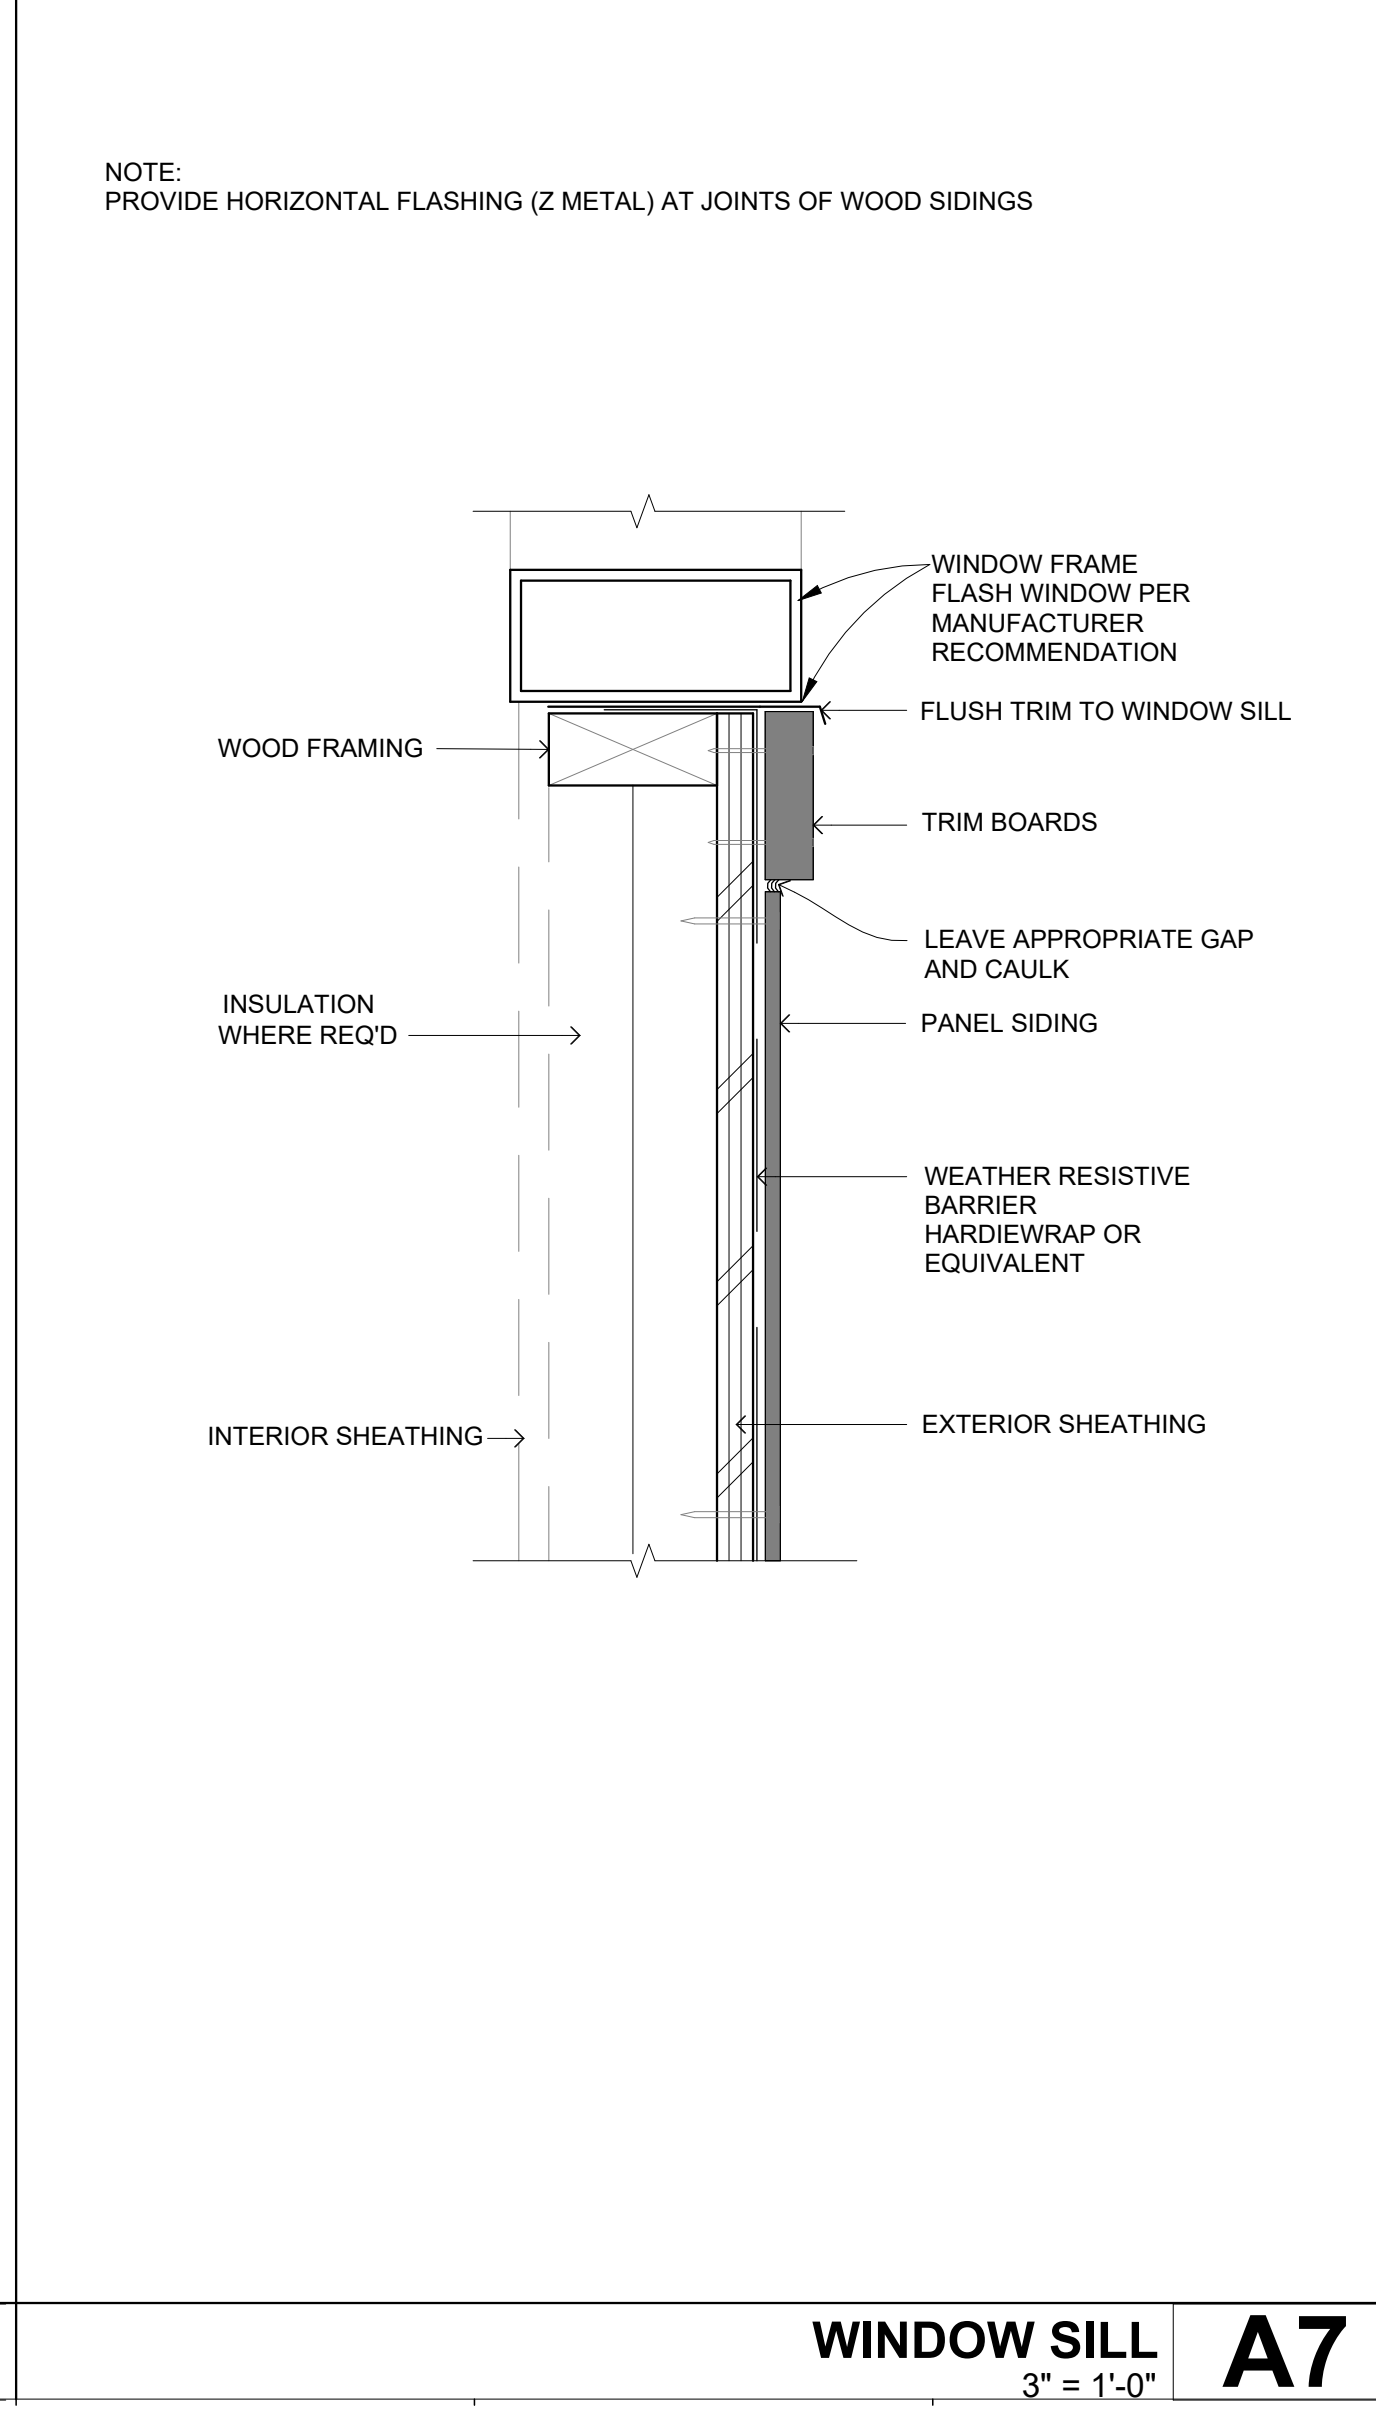

WINDOW SILL **A7**
3" = 1'-0"

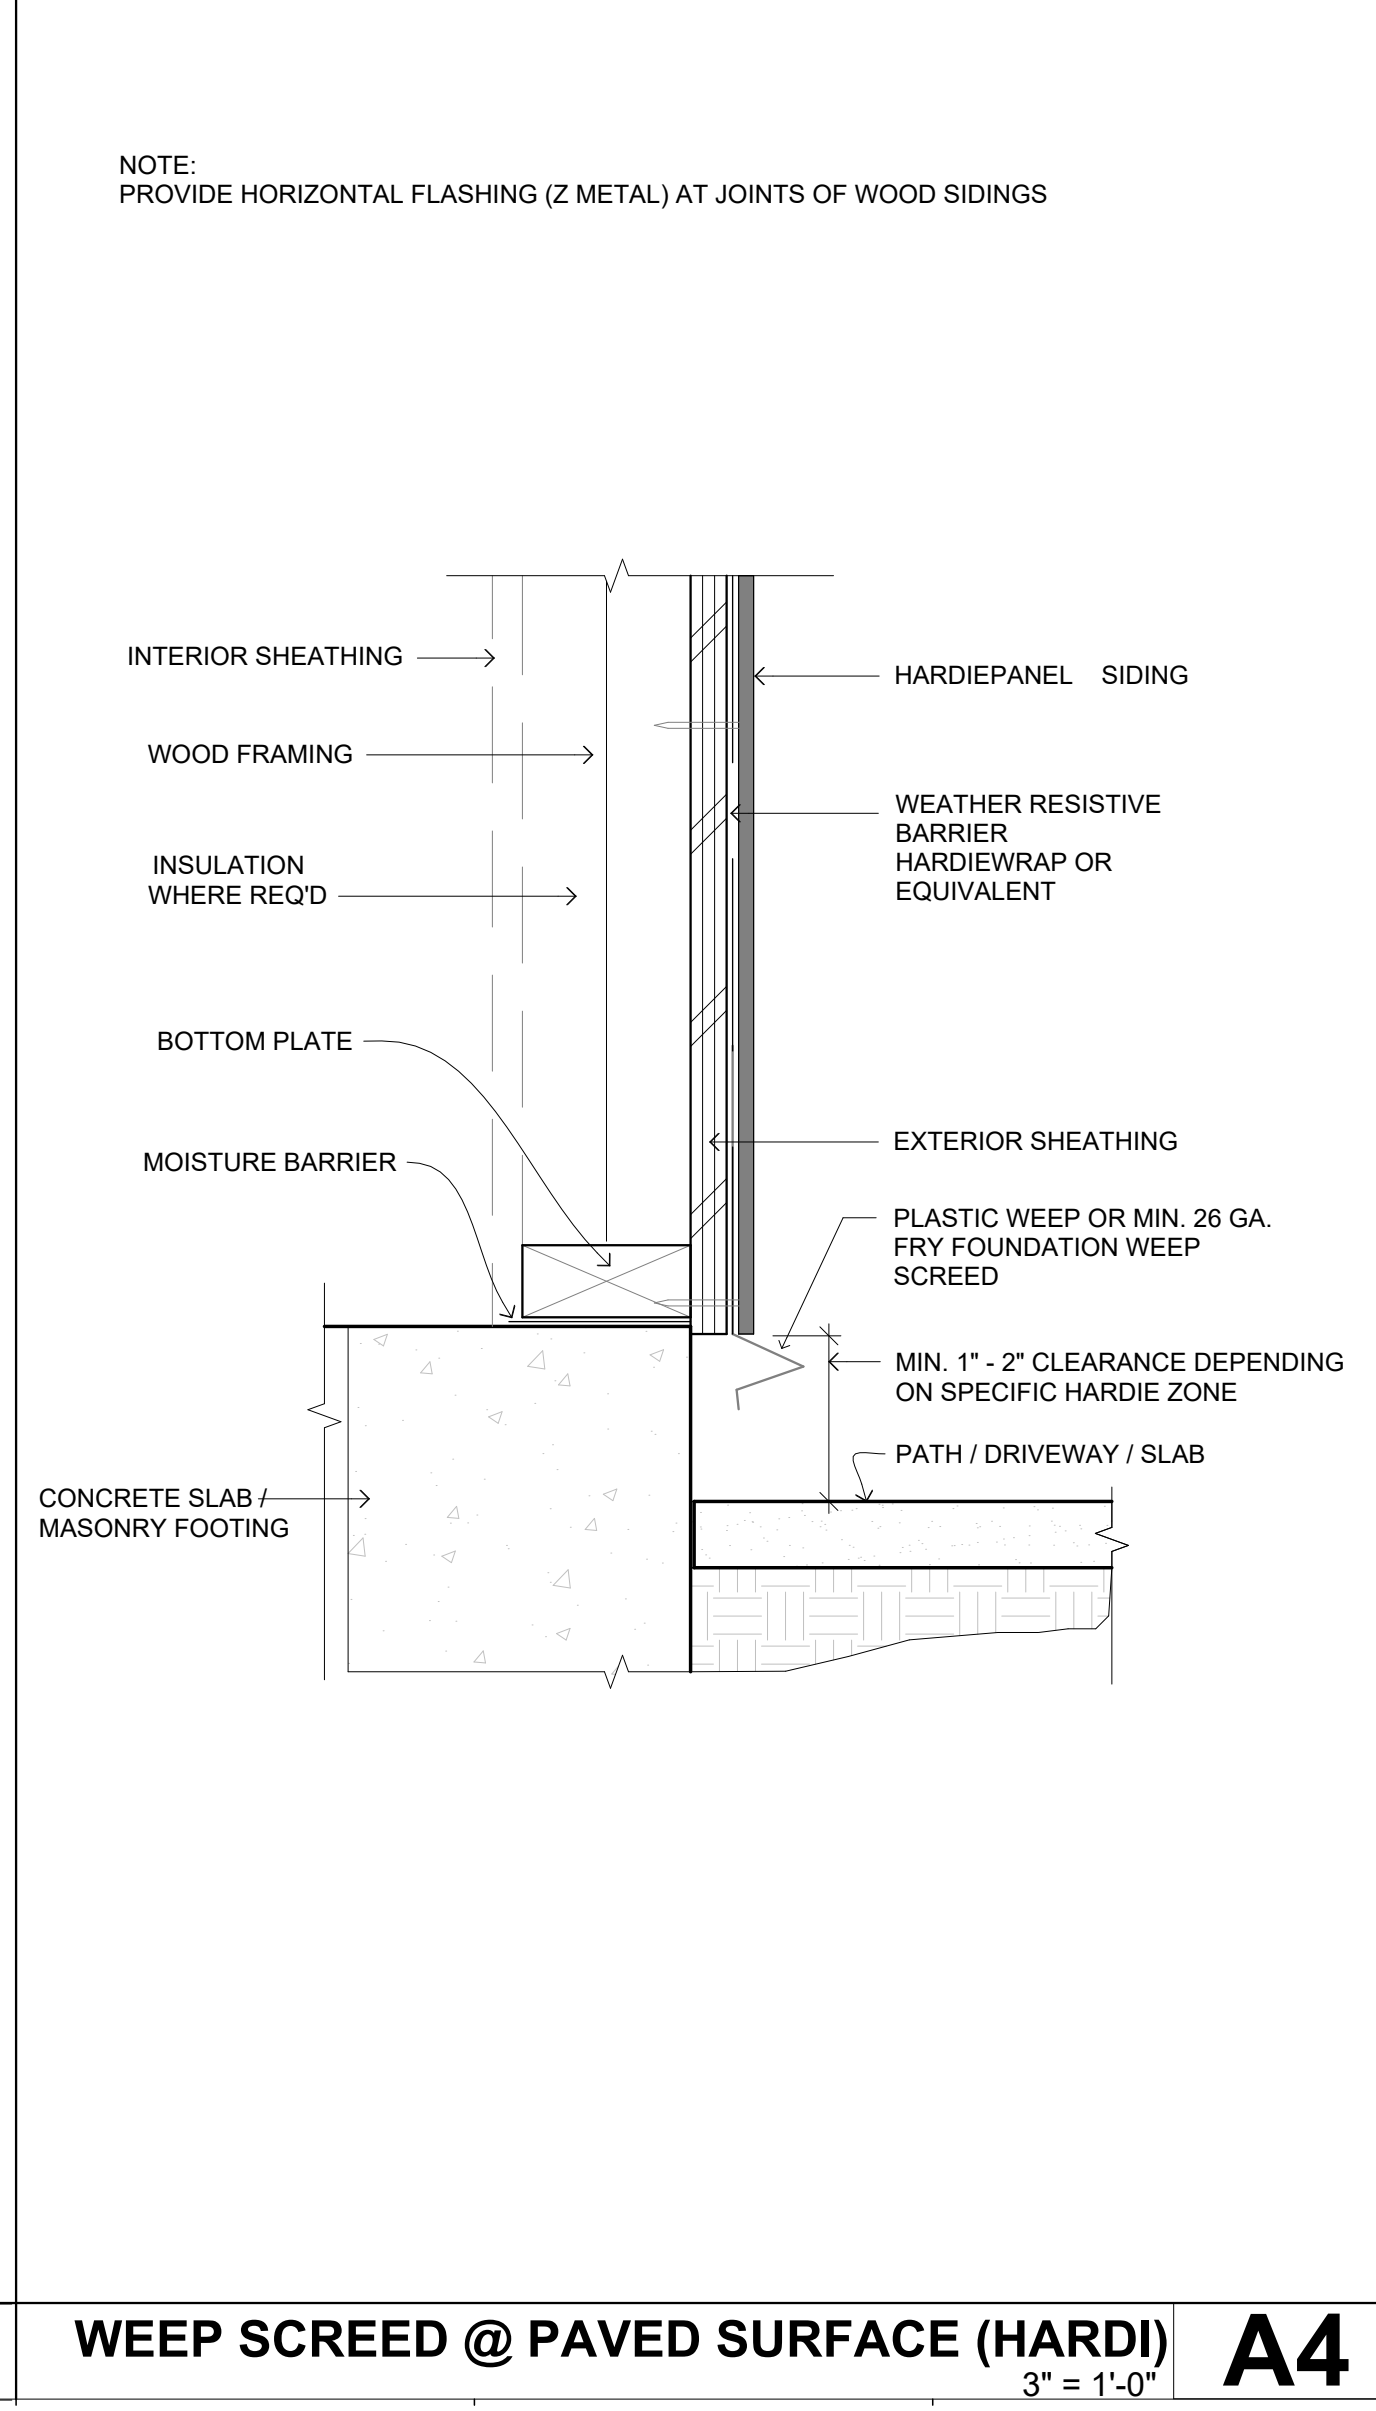

WEEP SCREED @ PAVED SURFACE (HARDI) **A4**
3" = 1'-0"

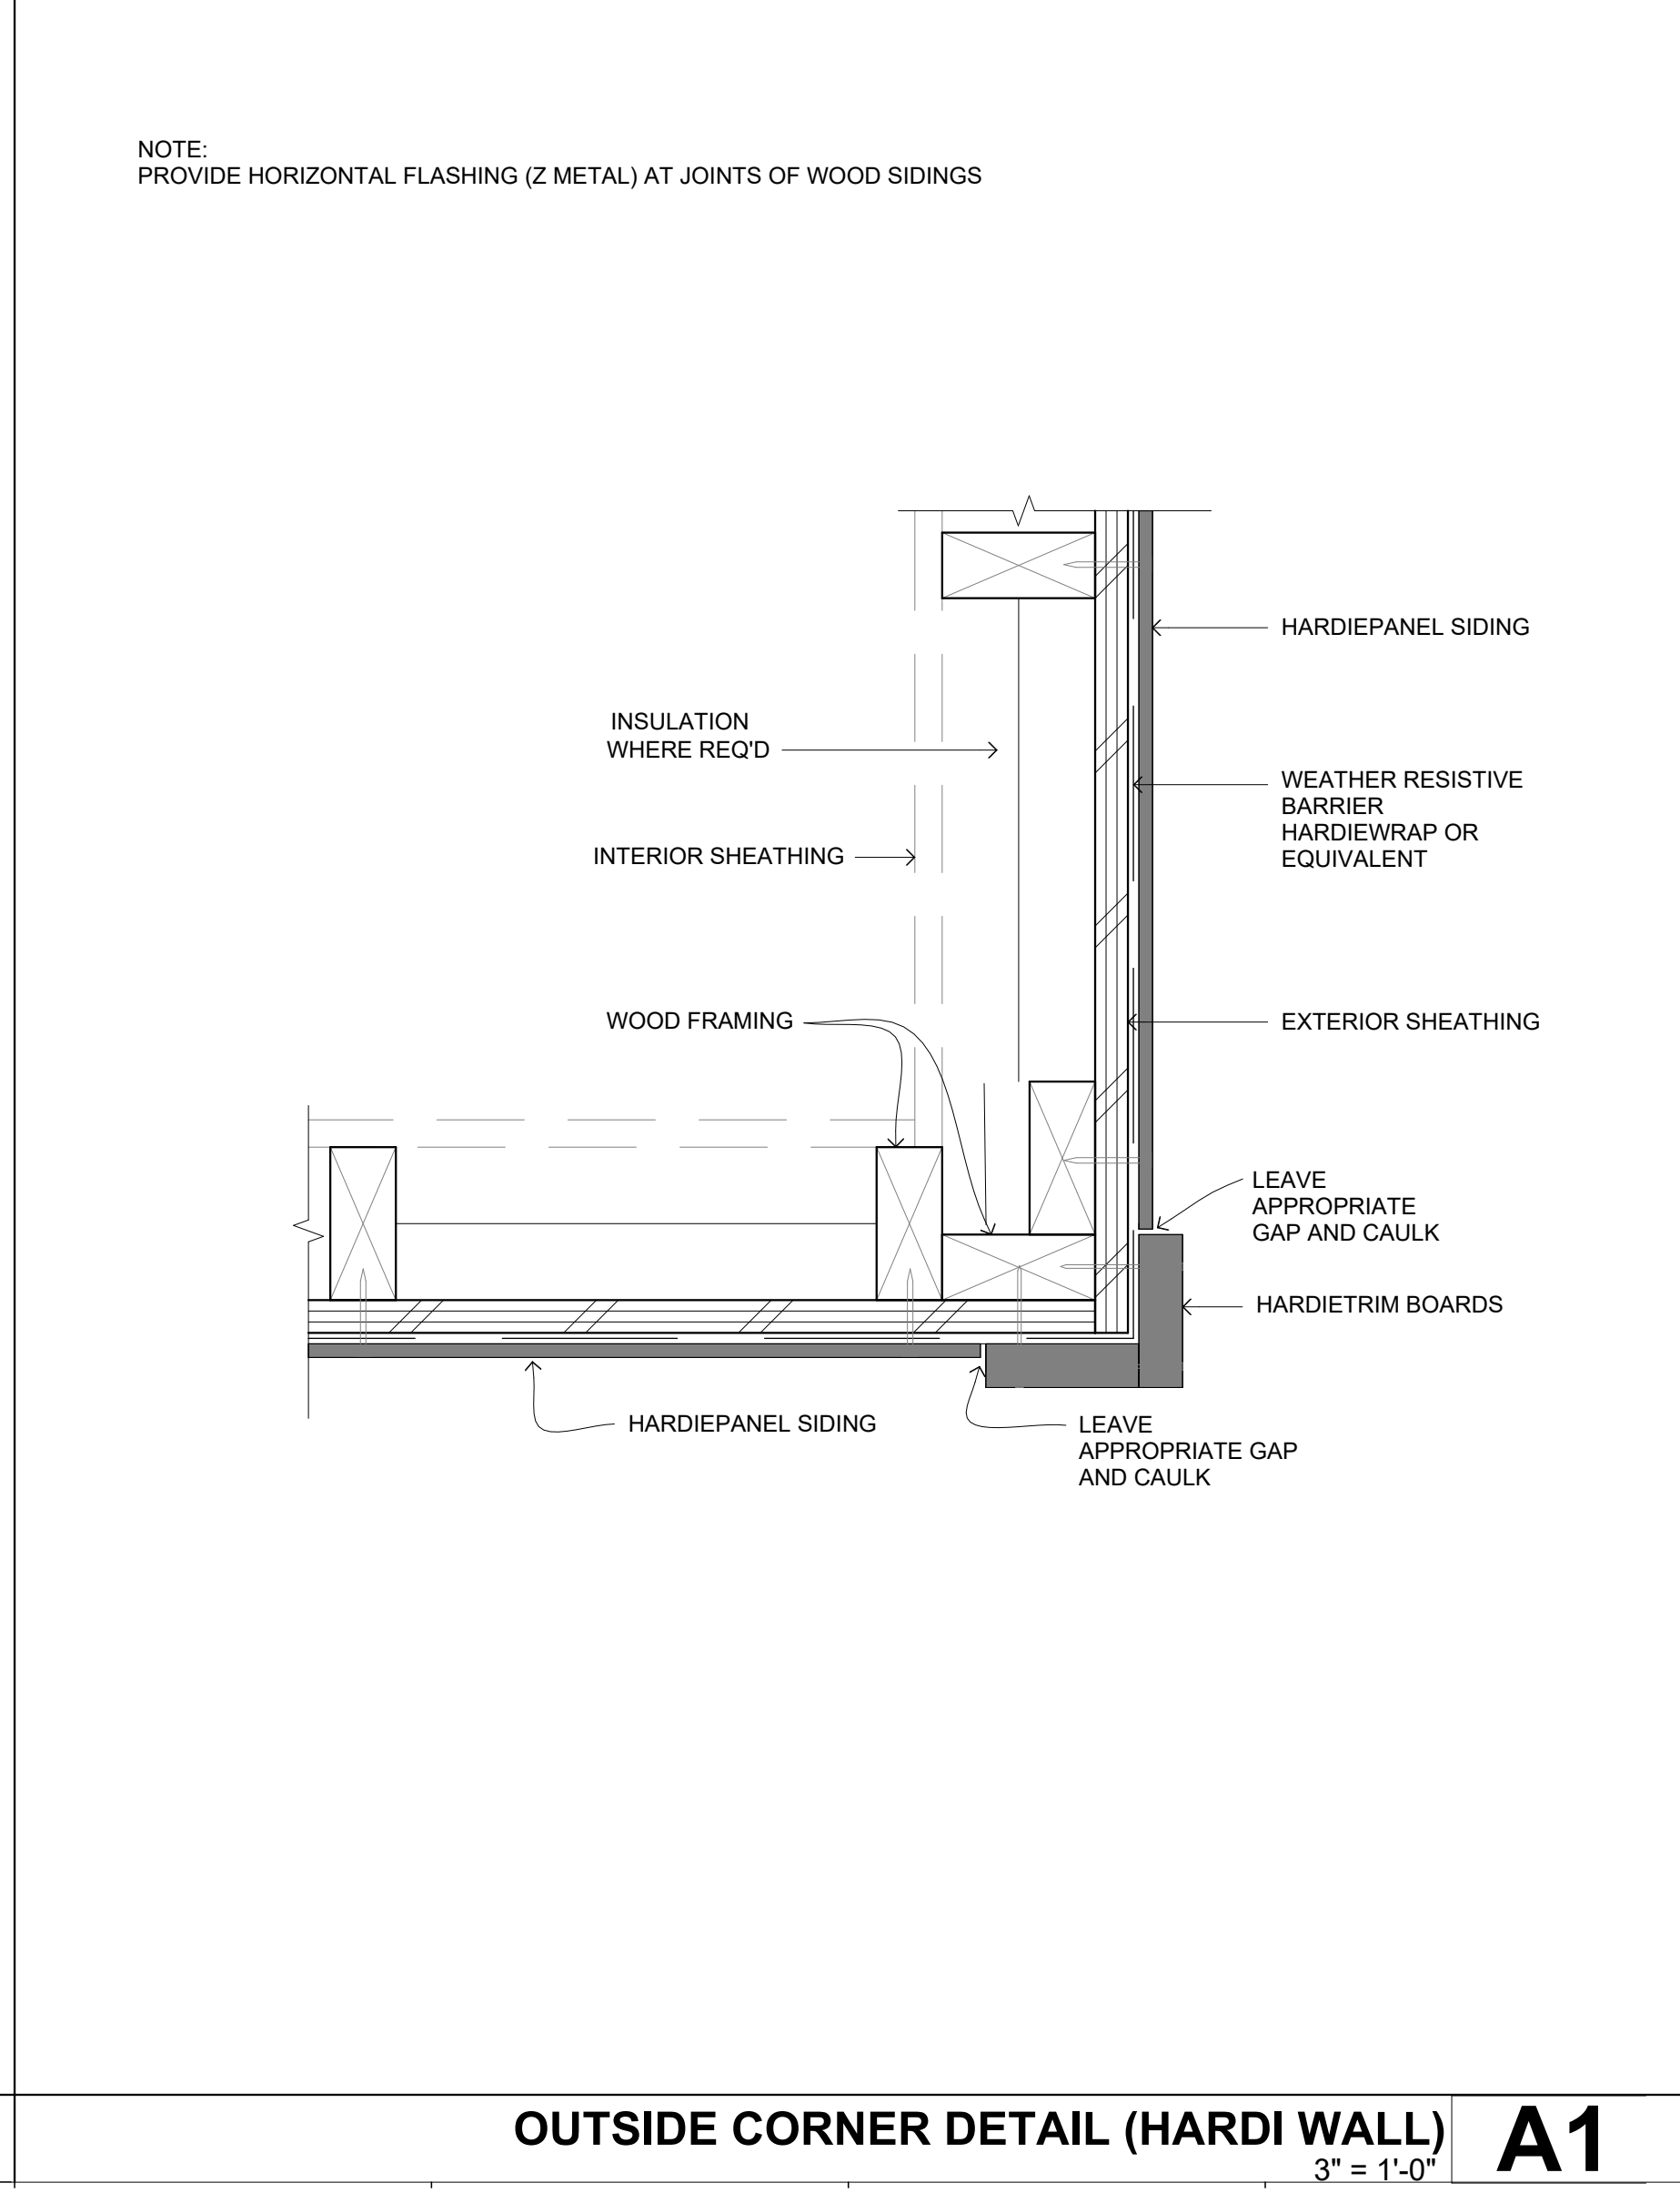


OUTSIDE CORNER DETAIL (HARDI WALL) **A1**
3" = 1'-0"

TRIPLEX DWELLING UNIT

OPTION #2

PROJECT
TRIPLEX
DWELLING UNIT

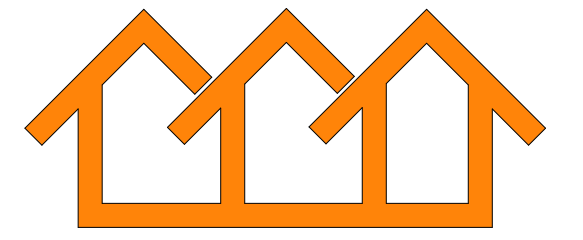

PWP23-005


DEPARTMENT OF PUBLIC
WORKS AND PLANNING



CAPITAL PROJECTS
DIVISION

2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

SEAL & SIGNATURE

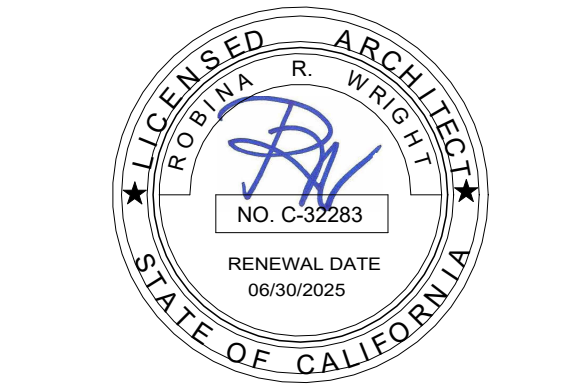

UPDATE

JANUARY 2, 2024

THESE DRAWINGS AND SPECIFICATIONS
ARE THE PROPERTY AND COPYRIGHT OF
THE ARCHITECT AND SHALL NOT BE
USED ON ANY OTHER PROJECT OR
LOCATIONS EXCEPT AS DESCRIBED ON
THE DRAWINGS WITHOUT WRITTEN
AGREEMENT WITH THE ARCHITECT.

TITLE


WALL SIDING
TYPICAL DETAILS

SCALE 3" = 1'-0"

A-804

ISSUE DATE	JOB NUMBER
MARCH 7, 2023	2023_11
DRAWN BY	CHECKED BY
Author	Checker


©

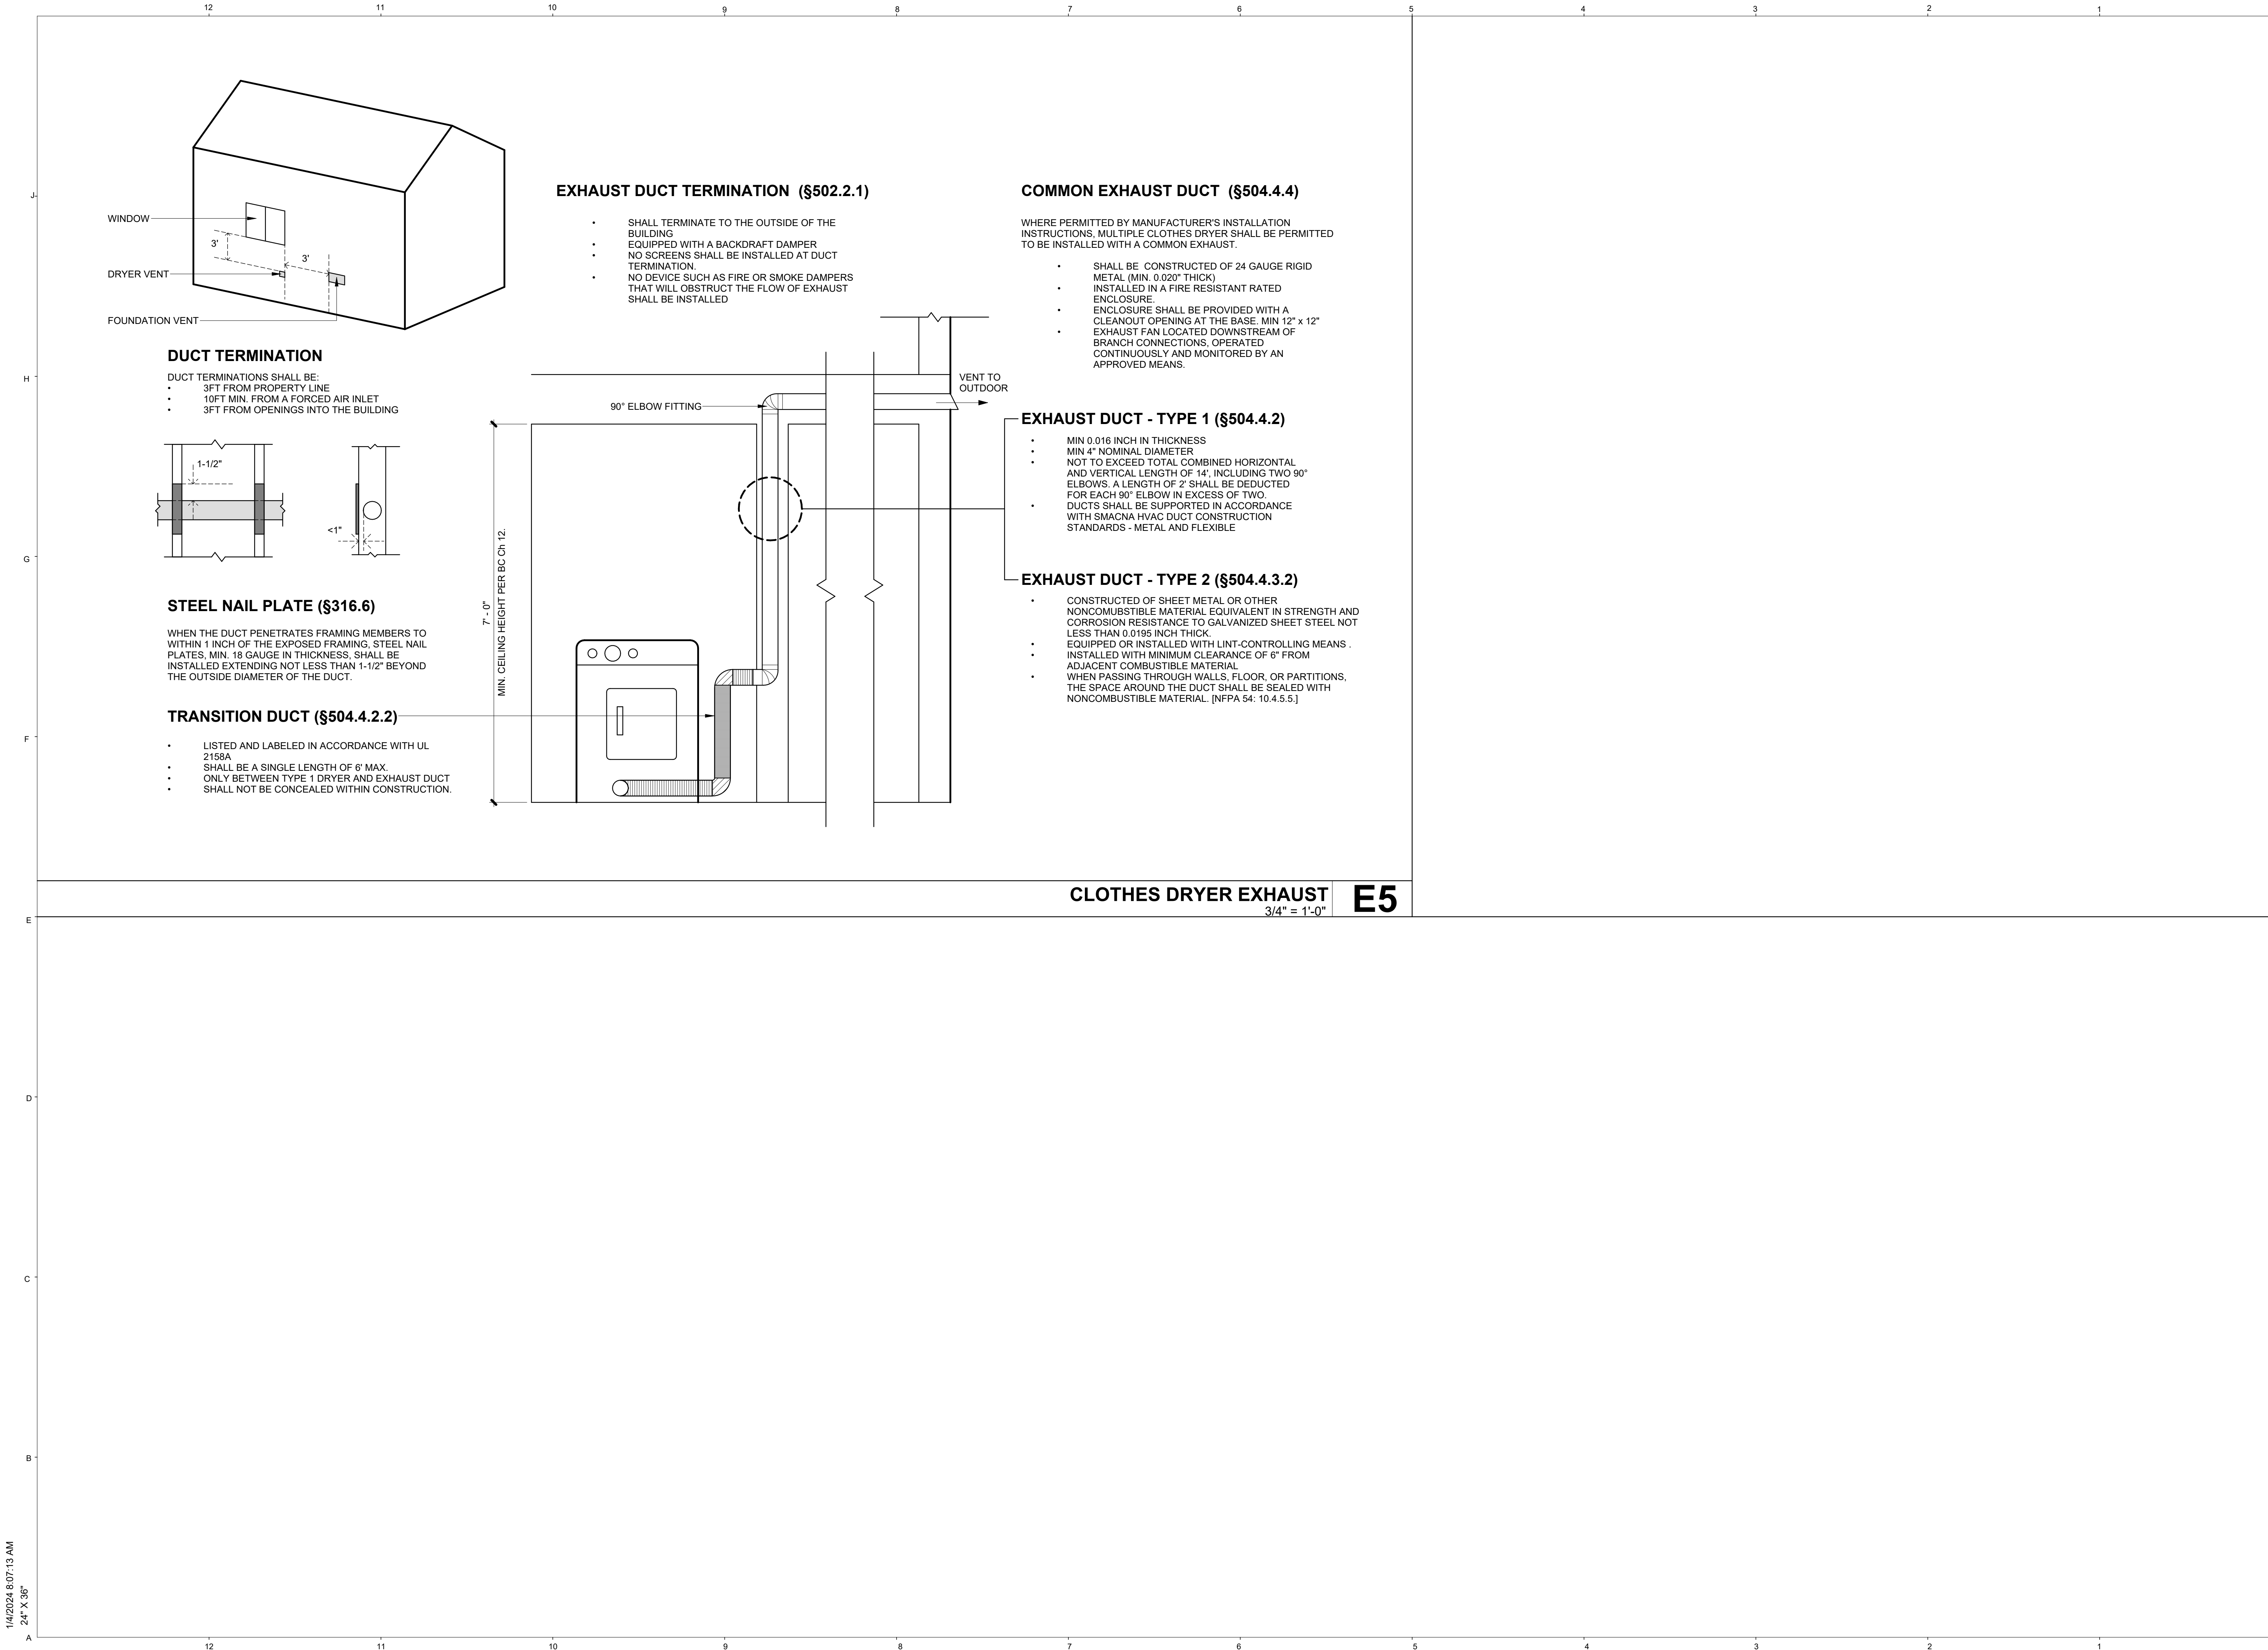

1/4/2024 8:07:13 AM
24" X 36"

OPTION #2

PROJECT
TRIPLEX
DWELLING UNIT

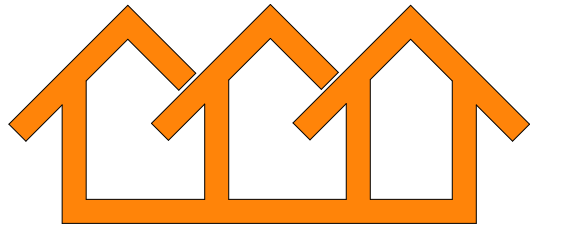

PWP23-005

DEPARTMENT OF PUBLIC
WORKS AND PLANNING



CAPITAL PROJECTS
DIVISION

2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

SEAL & SIGNATURE



UPDATE

JANUARY 2, 2024

THESE DRAWINGS AND SPECIFICATIONS
ARE THE PROPERTY AND COPYRIGHT OF
THE ARCHITECT AND SHALL NOT BE
USED ON ANY OTHER PROJECT OR
LOCATIONS EXCEPT AS DESCRIBED ON
THE DRAWINGS WITHOUT WRITTEN
AGREEMENT WITH THE ARCHITECT.


TITLE

CLOTHES DRYER
EXHAUST DETAILS

SCALE 3/4" = 1'-0"

A-805

ISSUE DATE	JOB NUMBER
MARCH 7, 2023	2023_11
DRAWN BY	CHECKED BY
Author	Checker


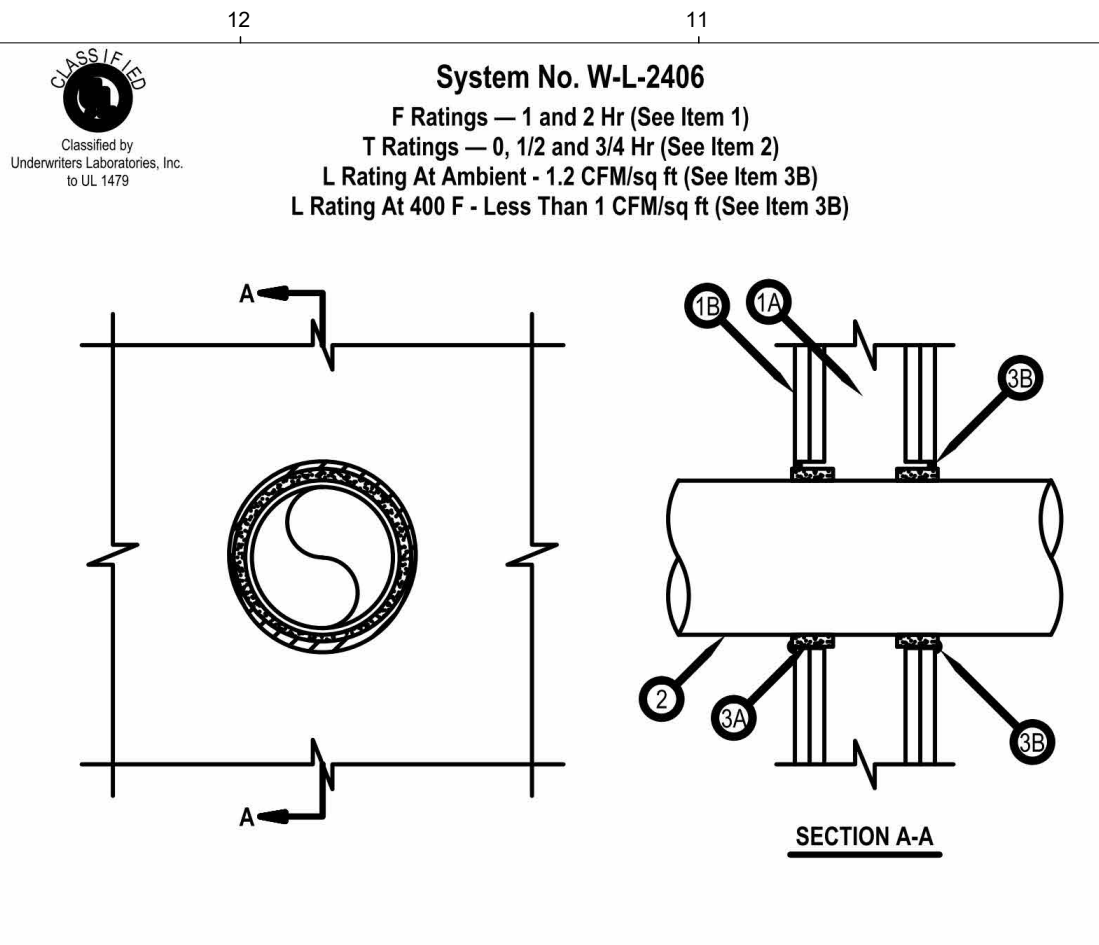


System No. W-L-2406
F Ratings — 1 and 2 Hr (See Item 1)
T Ratings — 0, 1/2 and 3/4 Hr (See Item 2)
L Rating At Ambient - 1.2 CFM/sq ft (See Item 3B)
L Rating At 400 F - Less Than 1 CFM/sq ft (See Item 3B)

1. Wall Assembly — The 1 or 2 hr fire-rated gypsum board/stud wall assembly shall be constructed of the materials and in the manner specified in the individual U300, U400, V400 or W400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:
 A. Studs — Wall framing may consist of either wood studs or steel channel studs. Wood studs to consist of nom 2 by 4 in. (51 by 102 mm) lumber spaced 16 in. (406 mm) OC. Steel studs to be min 3-1/2 in. (89 mm) wide and spaced max 24 in. (610 mm) OC.
 B. Gypsum Board — One or two layers of nom 5/8 in. (16 mm) thick gypsum board, as specified in the individual Wall and Partition Design. See Table under Item 3B for max diam of opening.
 2. Through-Penetrants — One nonmetallic pipe installed within the freestop system. See Table under Item 3B for annular space required in the freestop system. Pipe to be rigidly supported on both sides of wall assembly. The following types and sizes of nonmetallic pipes may be used:
 A. Polyvinyl Chloride (PVC) Pipe — Nom 6 in. (152 mm) diam (or smaller) Schedule 40 cellular or solid core PVC pipe for use in closed (process or supply) or vented (drain, waste or vent) piping system.
 B. Chlorinated Polyvinyl Chloride (CPVC) Pipe — Nom 6 in. (152 mm) diam (or smaller) SDR 13.5 CPVC pipe for use in closed (process or supply) piping system.
 C. Acrylonitrile Butadiene Styrene (ABS) Pipe — Nom 4 in. (102 mm) diam (or smaller) Schedule 40 cellular or solid core ABS pipe for use in closed (process or supply) or vented (drain, waste or vent) piping system.
 3. Firestop System — The firestop system shall consist of the following:
 A. Fill, Void or Cavity Material — Wrap Strip — See Table under Item 3B for min size of intumescent wrap strip. The wrap strip is continuously wrapped around the outer circumference of the pipe once and laid into the annular space such that approx 1/8 in. (3 mm) of the wrap strip protrudes from the wall surface. Wrap strip is held in place with integral fastening tape. Wrap strip installed on each surface of wall.
 HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC. — CP 648S - 1.5" US, CP 648S - 2" US, CP 648S - 3" US, CP 648S - 4" US and CP 648S - 4" US
 B. Fill, Void or Cavity Material — Sealant — Min 1/4 in. (6 mm) thickness of fill material applied within the annulus, flush with both surfaces of wall. For 2 hr fire-rated walls, 1/4 in. (6 mm) bead fill material also applied at wrap strip/gypsum wall interface. In 1 hr fire-rated walls, fill material is optional for nom 1-1/2, 2, 3 and 4 in. (38, 51, 76 and 102 mm) diam penetrants. In 2 hr fire-rated walls, fill material is optional for nom 1-1/2, 2 and 3 in. (38, 51 and 76 mm) diam penetrants. Fill material is required to be used to attain L Ratings.
 HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC. — FS-ONE Sealant or FS-ONE MAX Intumescent Sealant

Nom Pipe Diam, in. (mm)	Wrap Strip US	Wrap Strip Size, thick, X width, in. (mm)	Max Diam of Opening, in. (mm)	Annular Space, in. (mm)	
				Min	Max
1-1/2 (38)	CP 648S - 1.5" US	3/16 x 1 (5 x 25)	2-3/8 (60)	3/16 (5)	5/16 (8)
2 (51)	CP 648S - 2" US	3/16 x 1 (5 x 25)	3 (76)	3/16 (5)	5/16 (8)
3 (76)	CP 648S - 3" US	3/16 x 1-3/4 (5 x 44)	4 (102)	3/16 (5)	5/16 (8)
4 (102)	CP 648S - 4" US	3/8 x 1-3/4 (10 x 44)	5-3/8 (137)	3/8 (10)	1/2 (13)
6 (152)	CP 648S - 6" US	1/2 x 1-3/4 (13 x 44)	8 (203)	9/16 (14)	13/16 (21)


* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

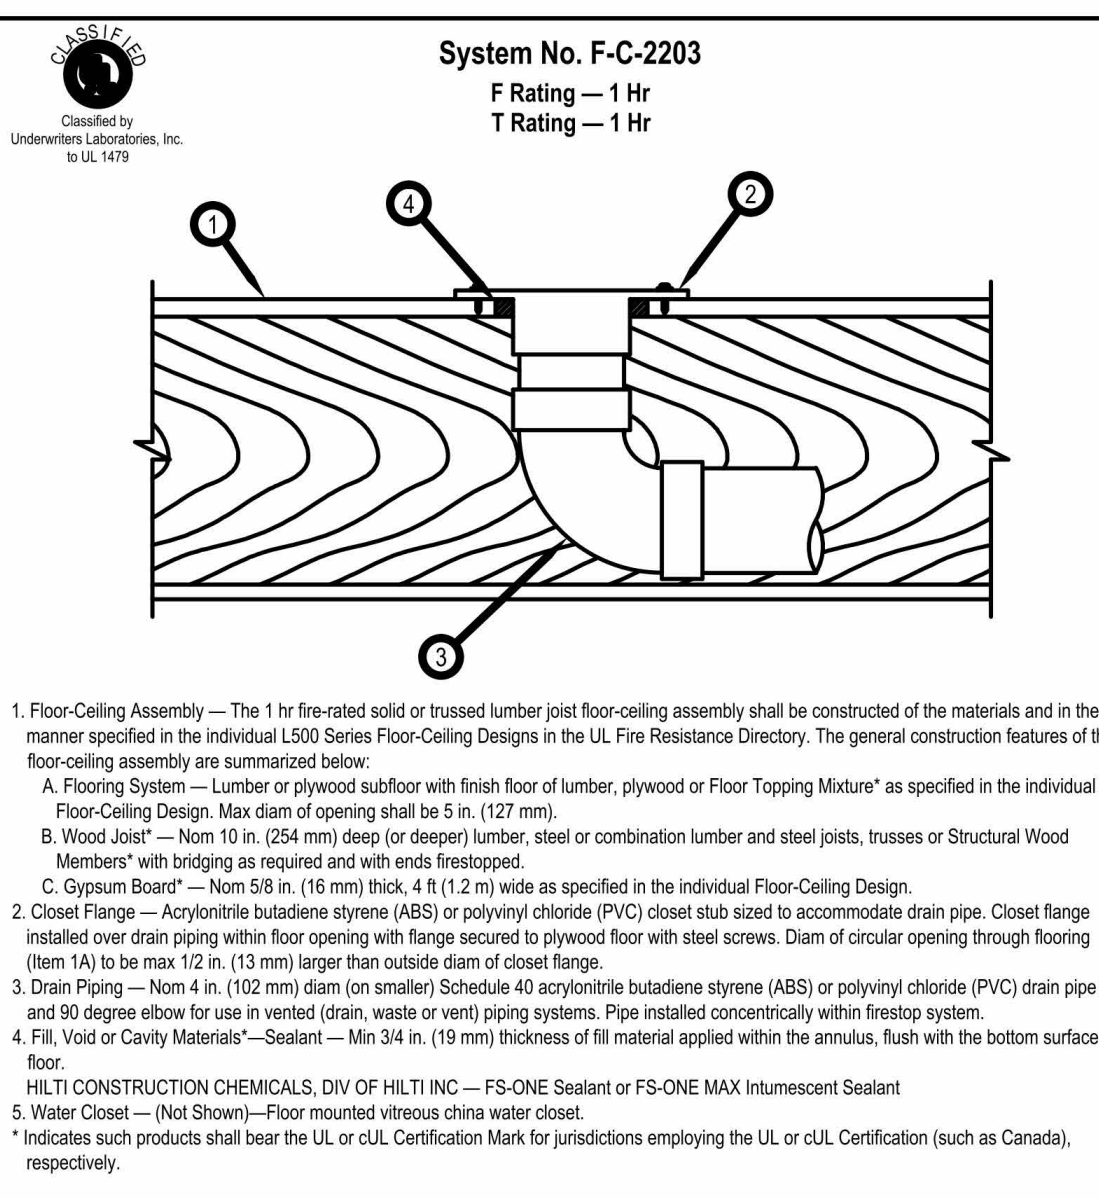

System No. F-C-2203
F Rating — 1 Hr
T Rating — 1 Hr

1. Floor-Ceiling Assembly — The 1 hr fire-rated solid or trussed lumber joist floor-ceiling assembly shall be constructed of the materials and in the manner specified in the individual L500 Series Floor-Ceiling Designs in the UL Fire Resistance Directory. The general construction features of the floor-ceiling assembly are summarized below:
 A. Flooring System — Lumber or plywood subfloor with finish floor of lumber, plywood or Floor Topping Mixture as specified in the individual Floor-Ceiling Design. Max diam of opening shall be 5 in. (127 mm).
 B. Wood Joists — Nom 10 in. (254 mm) deep (or deeper) lumber, steel or combination lumber and steel joists, trusses or Structural Wood Members with bridging as required and with ends freestopped.
 C. Gypsum Board — Nom 5/8 in. (16 mm) thick as specified in the individual Floor-Ceiling Design. Gypsum board secured to joists as specified in the individual Floor-Ceiling Design. Max diam of opening to be 2 in. (51 mm).
 2. Through Penetrants — One nonmetallic pipe to be installed either concentrically or eccentrically within the freestop system. The annular space within the freestop system shall be min 0 in. (point contact) to max 7/8 in. (22 mm). Pipe to be rigidly supported on both sides of floor-ceiling assembly. The following types and sizes of nonmetallic pipes may be used:
 A. Crosslinked Polyethylene (PEX) Tubing — Nom 2 in. (51 mm) diam (or smaller) SDR 9 PEX tubing for use in closed (process or supply) or vented (drain, waste or vent) piping systems.
 B. Chlorinated Polyvinyl Chloride (CPVC) Pipe — Nom 6 in. (152 mm) diam (or smaller) SDR 13.5 CPVC pipe for use in closed (process or supply) piping systems.
 C. Acrylonitrile Butadiene Styrene (ABS) Pipe — Nom 6 in. (152 mm) diam (or smaller) Schedule 40 solid or cellular core ABS pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.
 3. Firestop System — The firestop system shall consist of the following:
 A. Fill, Void or Cavity Material — Sealant — Min 3/4 in. (19 mm) thickness of fill material applied within annulus, flush with top surface of subfloor. Min 5/8 in. (16 mm) thickness of fill material applied within annulus, flush with bottom surface of ceiling. At point contact locations, a min 1/2 in. (13 mm) diam bead of fill material shall be applied at the penetrant/gypsum board and penetrant/flooring interface.
 HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC. — FS-ONE Sealant or FS-ONE MAX Intumescent Sealant


* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

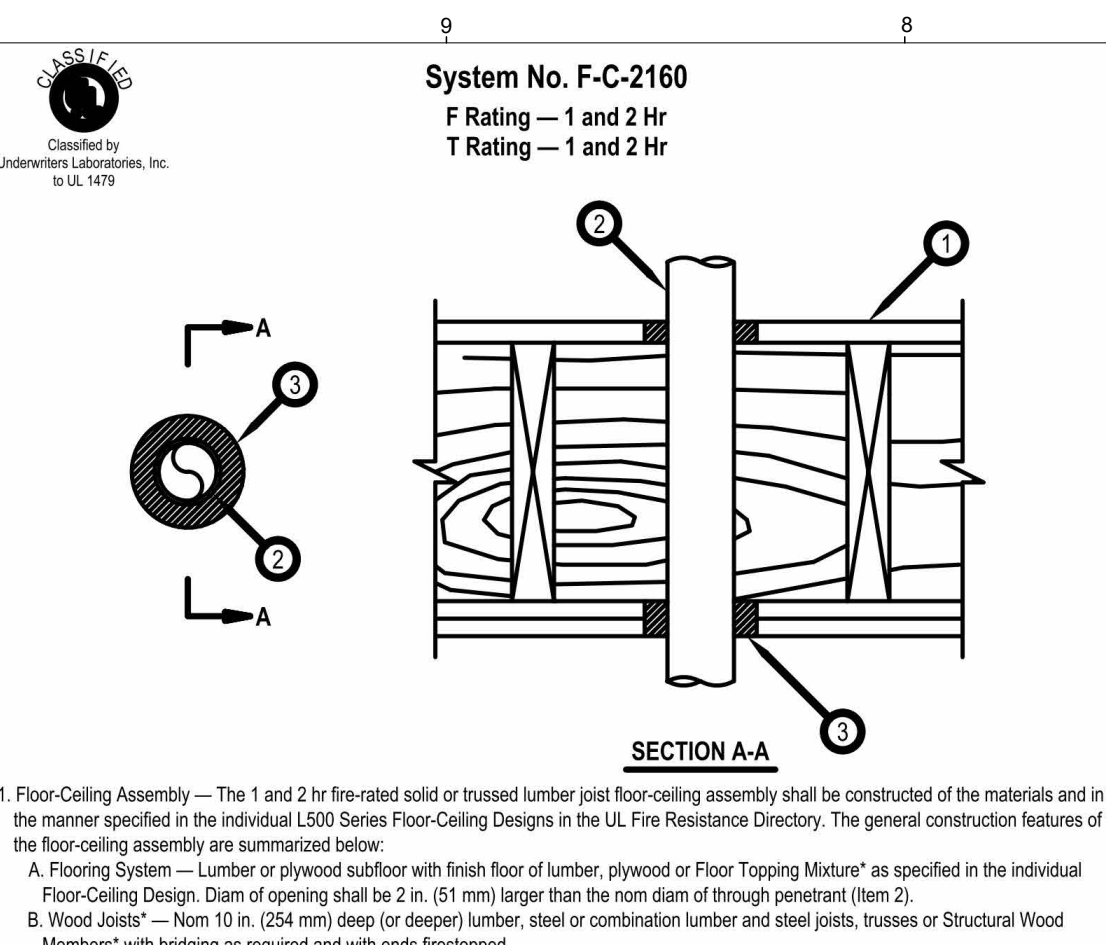

System No. F-C-2160
F Rating — 1 and 2 Hr
T Rating — 1 and 2 Hr

1. Floor-Ceiling Assembly — The 1 and 2 hr fire-rated solid or trussed lumber joist floor-ceiling assembly shall be constructed of the materials and in the manner specified in the individual L500 Series Floor-Ceiling Designs in the UL Fire Resistance Directory. The general construction features of the floor-ceiling assembly are summarized below:
 A. Flooring System — Lumber or plywood subfloor with finish floor of lumber, plywood or Floor Topping Mixture as specified in the individual Floor-Ceiling Design. Max diam of opening shall be 2 in. (51 mm) larger than the nom diam of through penetrant (Item 2).
 B. Wood Joists — Nom 10 in. (254 mm) deep (or deeper) lumber, steel or combination lumber and steel joists, trusses or Structural Wood Members with bridging as required and with ends freestopped.
 C. Furring Channels (Not Shown) — Resilient galv steel furring installed perpendicular to wood joists between first and second layers of wallboard (Item 1). Furring channels spaced max 24 in. (610 mm).
 D. Gypsum Board — Nom 4 1/2 in. wide by 5/8 in. (16 mm) thick as specified in the individual Floor-Ceiling Design. First layer of wallboard nailed to wood joists. Second layer of wallboard screw-attached to furring channels. Diam of opening shall be 2 in. (51 mm) larger than the nom diam of through penetrant (Item 2).
 2. Through Penetrants — One nonmetallic pipe to be installed either concentrically or eccentrically within the freestop system. The annular space between pipe and conduit and edge of opening to be min 1/2 in. (13 mm) and max 1-1/8 in. (29 mm). Pipe or conduit to be rigidly supported on both sides of floor-ceiling assembly. The following types and sizes of nonmetallic pipes or conduits may be used:
 A. Polyvinyl Chloride (PVC) Pipe — Nom 2 in. (51 mm) diam (or smaller) Schedule 40 solid or cellular core PVC pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.
 B. Chlorinated Polyvinyl Chloride (CPVC) Pipe — Nom 2 in. (51 mm) diam (or smaller) SDR 13.5 CPVC pipe for use in closed (process or supply) piping systems.
 3. Firestop System — The firestop system shall consist of the following:
 A. Fill, Void or Cavity Material — Sealant — Fill Material forced into annular space to fill space to max extent possible. Sealant shall be installed flush with top surface of floor sole plate and bottom surface of ceiling or lower top plate.
 HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC. — FS-ONE Sealant or FS-ONE MAX Intumescent Sealant


* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

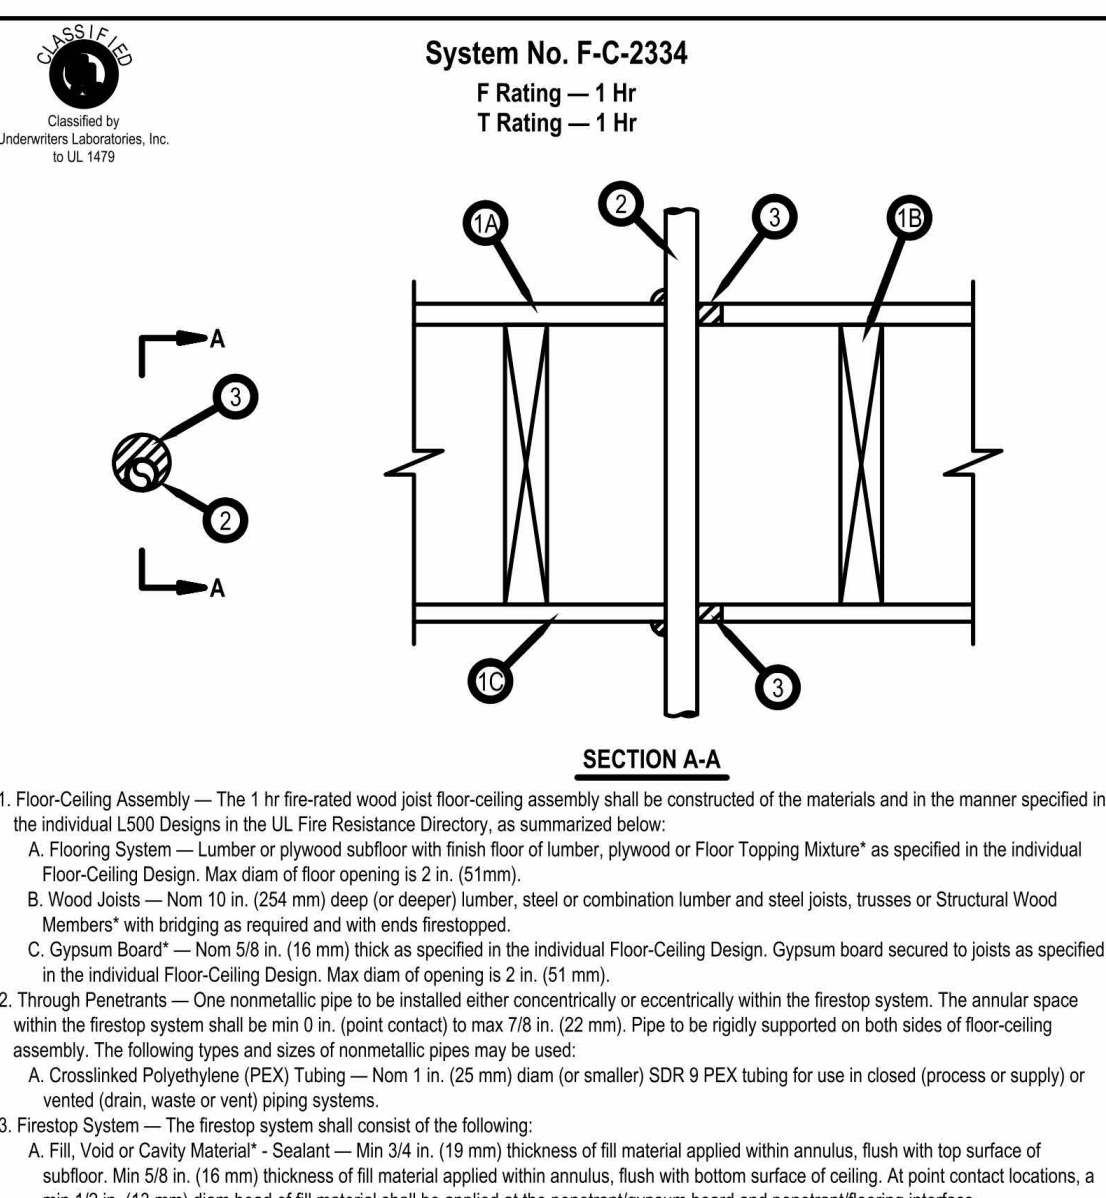

System No. F-C-2334
F Rating — 1 Hr
T Rating — 1 Hr

1. Floor-Ceiling Assembly — The 1 hr fire-rated wood joist floor-ceiling assembly shall be constructed of the materials and in the manner specified in the individual L500 Series in the UL Fire Resistance Directory, as summarized below:
 A. Flooring System — Lumber or plywood subfloor with finish floor of lumber, plywood or Floor Topping Mixture as specified in the individual Floor-Ceiling Design. Max diam of opening to be 2 in. (51 mm).
 B. Wood Joists — Nom 10 in. (254 mm) deep (or deeper) lumber, steel or combination lumber and steel joists, trusses or Structural Wood Members with bridging as required and with ends freestopped.
 C. Gypsum Board — Nom 5/8 in. (16 mm) thick as specified in the individual Floor-Ceiling Design. Gypsum board secured to joists as specified in the individual Floor-Ceiling Design. Max diam of opening to be 2 in. (51 mm).
 2. Through Penetrants — One nonmetallic pipe to be installed either concentrically or eccentrically within the freestop system. The annular space within the freestop system shall be min 0 in. (point contact) to max 7/8 in. (22 mm). Pipe to be rigidly supported on both sides of floor-ceiling assembly. The following types and sizes of nonmetallic pipes may be used:
 A. Crosslinked Polyethylene (PEX) Tubing — Nom 2 in. (51 mm) diam (or smaller) SDR 9 PEX tubing for use in closed (process or supply) or vented (drain, waste or vent) piping systems.
 B. Chlorinated Polyvinyl Chloride (CPVC) Pipe — Nom 6 in. (152 mm) diam (or smaller) SDR 13.5 CPVC pipe for use in closed (process or supply) piping systems.
 C. Acrylonitrile Butadiene Styrene (ABS) Pipe — Nom 6 in. (152 mm) diam (or smaller) Schedule 40 solid or cellular core ABS pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.
 3. Firestop System — The firestop system shall consist of the following:
 A. Fill, Void or Cavity Material — Sealant — Min 3/4 in. (19 mm) thickness of fill material applied within annulus, flush with top surface of subfloor. Min 5/8 in. (16 mm) thickness of fill material applied within annulus, flush with bottom surface of ceiling. At point contact locations, a min 1/2 in. (13 mm) diam bead of fill material shall be applied at the penetrant/gypsum board and penetrant/flooring interface.
 HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC. — FS-ONE Sealant or FS-ONE MAX Intumescent Sealant



* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

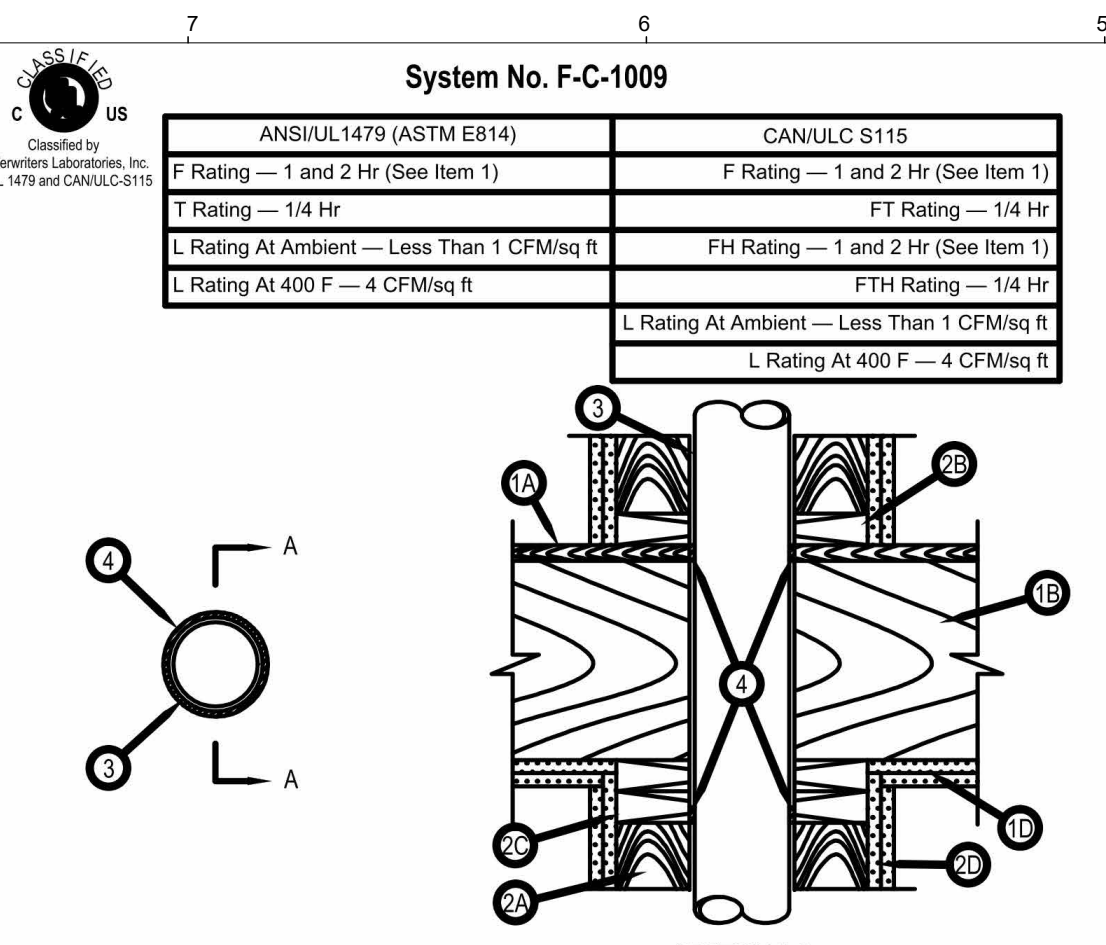

System No. F-C-1009
F Rating — 1 and 2 Hr (See Item 1)
T Rating — 1 and 2 Hr (See Item 1)
L Rating At Ambient - 3 CFM/sq ft
L Rating At 400 F - Less Than 1 CFM/sq ft

1. Floor-Ceiling Assembly — The 1 or 2 hr fire-rated solid or trussed lumber joist floor-ceiling assembly shall be constructed of the materials and in the manner specified in the individual L500 Series Floor-Ceiling Designs in the UL Fire Resistance Directory. The F Rating of the freestop system is equal to the rating of the floor-ceiling assembly. The general construction features of the floor-ceiling assembly are summarized below:
 A. Flooring System — Lumber or plywood subfloor with finish floor of lumber, plywood or Floor Topping Mixture as specified in the individual Floor-Ceiling Design. Max diam of opening shall be max 1 in. (25 mm) larger than the nom diam of pipe. As an alternate, the opening may be square-cut with a max dimension 1 in. (25 mm) greater than the diam of the pipe.
 B. Wood Joists — Nom 10 in. (254 mm) deep (or deeper) lumber, steel or combination lumber and steel joists, trusses or Structural Wood Members with bridging as required and with ends freestopped.
 C. Furring Channels — (Not Shown) — As required Resilient galvanized steel furring installed in accordance with the manner specified in the individual L500 Series Designs in the Fire Resistance Directory.
 D. Gypsum Board — Thickness, type, number of layers and fasteners shall be as specified in the individual Floor-Ceiling Design. Diam of opening to be max 1 in. (25 mm) larger than diam of pipe.
 2. Chase Wall — (Optional) — The through penetrant (Item 3) may be routed through a 1 or 2 hr fire-rated single, double or staggered wood subgypsum board chase wall having a fire rating consistent with that of the floor-ceiling assembly. The chase wall shall be min 1 in. greater than the diameter of the through penetrant. The chase wall shall be constructed of the materials and in the manner specified in the individual U300 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:
 A. Studs — Nom 2 by 4 in. (51 by 102 mm) or double nom 2 by 4 in. (51 by 102 mm) lumber studs. Nom 2 by 4 in. (51 by 102 mm) studs are allowed for through-penetrants (Item 3) not exceeding nom 2 in. (51 mm) diam.
 B. Sole Plate — Nom 2 by 4 in. (51 by 102 mm), 2 by 6 in. (51 by 152 mm) or parallel 2 by 4 in. (51 by 102 mm) lumber plates, tightly butted. Diam of opening to be max 1 in. (25 mm) larger than diam of pipe. As an alternate, the opening may be square-cut with a max dimension 1 in. (25 mm) greater than the diam of the pipe. Plates may be discontinuous over opening, terminating at two opposing edges of opening. Max length of discontinuity to be 1 in. (25 mm) greater than diam of through penetrant.
 C. Top Plate — The double top plate shall consist of two nom 2 by 4 in. (51 by 102 mm), 2 by 6 in. (51 by 152 mm) or two sets of parallel 2 by 4 in. (51 by 102 mm) lumber plates, tightly butted. Max opening is to be max 1 in. (25 mm) larger than diam of pipe. As an alternate, the opening may be square-cut with a max dimension 1 in. (25 mm) greater than the diam of the pipe. Plates may be discontinuous over opening, terminating at two opposing edges of opening. Max length of discontinuity to be 1 in. (25 mm) greater than diam of through penetrant.
 D. Steel Plate — When lumber plates are discontinuous, nom 1-1/2 in. (38 mm) wide No. 20 gauge (or heavier) galv steel plates shall be installed to connect each discontinuous lumber plate and to provide a form for the fill material. Steel plates sized to lap 2 in. (51 mm) onto each discontinuous lumber plate and secured to lumber plates with steel screws or nails.
 E. Gypsum Board — Thickness, type, number of layers and fasteners shall be as specified in individual Wall and Partition Design.
 3. Through Penetrants — One metallic pipe, conduit or tubing to be installed within the freestop system, pipe, conduit or tubing to be rigidly supported on both sides of floor assembly. The annular space within the freestop system shall be min 0 in. (point contact) to max 1 in. (25 mm). The following types and sizes of metallic pipes or conduits may be used:
 A. Studs — Nom 2 by 4 in. (51 by 102 mm) or double nom 2 by 4 in. (51 by 102 mm) lumber studs. Nom 2 by 4 in. (51 by 102 mm) studs are allowed for through-penetrants (Item 3) not exceeding nom 2 in. (51 mm) diam.
 B. Iron Pipe — Nom 4 in. (102 mm) diam (or smaller) cast or ductile iron pipe.
 C. Conduit — Nom 4 in. (102 mm) diam (or smaller) steel electrical metallic tubing or steel conduit.
 D. Copper Tubing — Nom 102 mm (4 in. diam) or smaller Type L (or heavier) copper tubing.
 E. Copper Pipe — Nom 102 mm (4 in. diam) or smaller Regular (or heavier) copper pipe.
 4. Fill, Void or Cavity Material — Sealant — Min 3/4 in. (19 mm) thickness of fill material applied within the annulus, flush with top surface of the floor or the sole plate. Min 5/8 in. (16 mm) thickness of fill material applied within the annulus, flush with bottom surface of ceiling or lower top plate.
 HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC. — CP601S, CFS-S SIL GG, CP606, FS-ONE Sealant or FS-ONE MAX Intumescent Sealant (Note: L Ratings apply only when FS-ONE Sealant is used.)

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

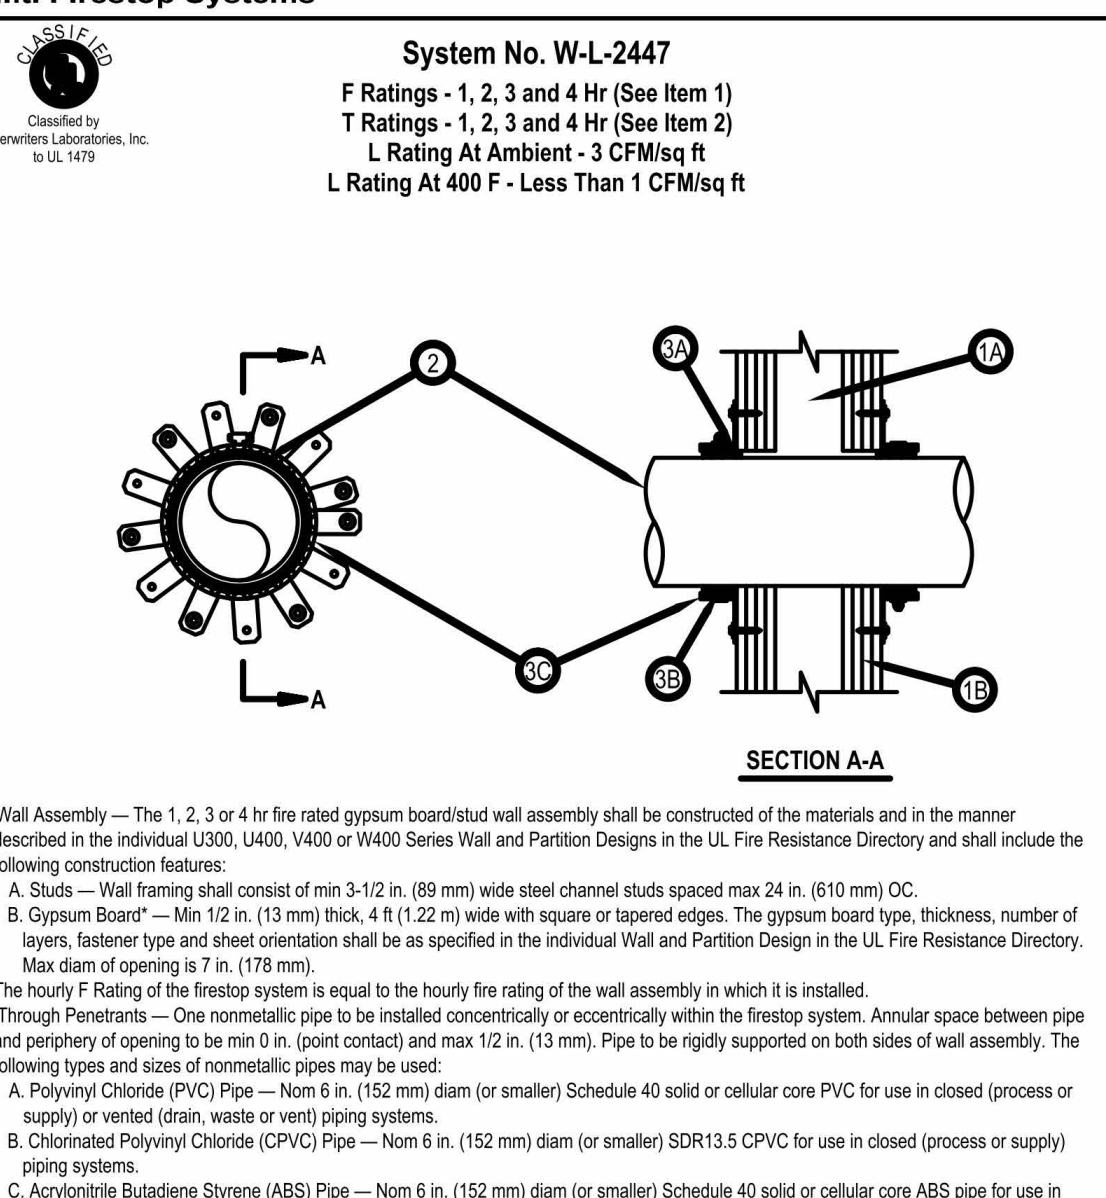


System No. W-L-2447
F Ratings - 1, 2, 3 and 4 Hr (See Item 1)
T Ratings - 1, 2, 3 and 4 Hr (See Item 2)
L Rating At Ambient - 3 CFM/sq ft
L Rating At 400 F - Less Than 1 CFM/sq ft

1. Wall Assembly — The 1, 2, 3 or 4 hr fire-rated gypsum board/stud wall assembly shall be constructed of the materials and in the manner specified in the individual U300, U400, V400 or W400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:
 A. Studs — Wall framing may consist of either wood studs or steel channel studs spaced max 24 in. (610 mm) OC.
 B. Gypsum Board — Nom 5/8 in. (16 mm) thick, 4 ft (1.22 m) wide with square or beveled edges. The gypsum board type, thickness, number of layers, fastener type and sheet orientation shall be as specified in the individual Wall and Partition Design in the UL Fire Resistance Directory. Max diam of opening is 7 in. (178 mm).
 2. Through Penetrants — One nonmetallic pipe to be installed concentrically or eccentrically within the freestop system. Annular space between pipe and periphery of opening to be min 0 in. (point contact) to max 7/8 in. (22 mm). Pipe to be rigidly supported on both sides of wall assembly. The following types and sizes of nonmetallic pipes may be used:
 A. Polyvinyl Chloride (PVC) Pipe — Nom 6 in. (152 mm) diam (or smaller) Schedule 40 solid or cellular core PVC pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.
 B. Chlorinated Polyvinyl Chloride (CPVC) Pipe — Nom 6 in. (152 mm) diam (or smaller) SDR 13.5 CPVC pipe for use in closed (process or supply) piping systems.
 C. Acrylonitrile Butadiene Styrene (ABS) Pipe — Nom 6 in. (152 mm) diam (or smaller) Schedule 40 solid or cellular core ABS pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.
 3. Firestop System — The firestop system shall consist of the following:
 A. Fill, Void or Cavity Materials — Sealant — Min 1/4 in. (6 mm) thickness of fill material applied within the annulus, flush with both surfaces of wall.
 HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC. — FS-ONE Sealant or FS-ONE MAX Intumescent Sealant
 B. Fill Void or Cavity Material — Wrap Strip — Nom 3/16 in. (5 mm) thick by 1-3/4 in. (45 mm) wide intumescent wrap strip continuously wrapped around the pipe. Wrap strip butted tightly against both surfaces of wall. The number of layers of wrap strip required depends on penetrant size as specified in the Table below.
 HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC. — CP48E-W481-1-34

Nom Pipe Diam, in.	No. of Layers of Wrap Strip Required
6 (or smaller)	3
4 (or smaller)	2
2 (or smaller)	1


C. Steel Collar — Collar fabricated from coils of precut min 0.017 in. (0.43 mm) thick (No. 28 MSG) galv steel available from the sealant manufacturer. Collar shall be nom 1-3/4 in. (45 mm) deep with 1 in. (25 mm) wide by 2 in. (51 mm) long anchor tabs on 2 in. (51 mm) centers for securement to wall assembly. The anchor tabs shall be bent 90 degrees outward for securement to the wall assembly. The opposite side incorporates relative tabs, 1/2 in. (13 mm) wide by 1/2 in. (13 mm) long, bent toward the pipe surface. Collar shall be tightly wrapped over the wrap strip, overlapping min 1 in. (25 mm) at seams. A nom 1/2 in. (13 mm) wide stainless steel band clamp shall be secured to the collar at its mid-height. Anchor tabs of collar secured to surface of wall by means of nom 3/16 in. diam by 2-1/2 in. long steel toggle bolts in conjunction with 1-1/4 in. (32 mm) diam steel fender washers at every other anchor tab. As an alternate, in 1 and 2 hr rated walls, every anchor tab of collar may be secured to surface of wall by means of nom 1-1/4 in. (32 mm) long steel laminating drywall screws in conjunction with 1-1/4 in. (32 mm) diam steel fender washers. A collar is used on both sides of wall.

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

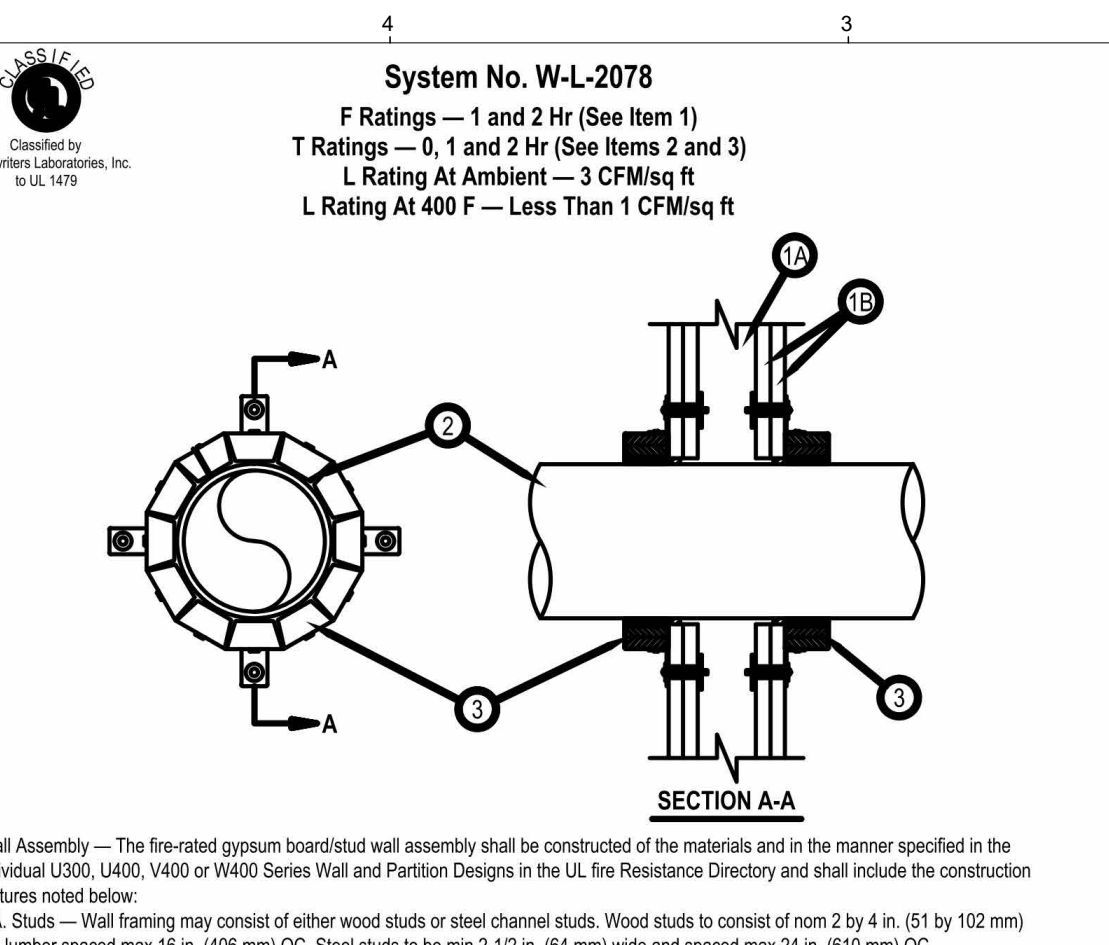

System No. W-L-2078
F Ratings — 1 and 2 Hr (See Item 1)
T Ratings — 0, 1/2 and 2 Hr (See Items 2 and 3)
L Rating At Ambient — 3 CFM/sq ft
L Rating At 400 F — Less Than 1 CFM/sq ft

1. Wall Assembly — The fire-rated gypsum board/stud wall assembly shall be constructed of the materials and in the manner specified in the individual U300, U400, V400 or W400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the construction features noted below:
 A. Studs — Wall framing may consist of either wood studs or steel channel studs. Wood studs to consist of nom 2 by 4 in. (51 by 102 mm) lumber spaced max 16 in. (406 mm) OC. Steel studs to be min 2-1/2 in. (64 mm) wide and spaced max 24 in. (610 mm) OC.
 B. Gypsum Board — Nom 5/8 in. (16 mm) thick gypsum board, as specified in the individual Wall and Partition Design. Max diam of opening is 11-1/2 in. (292 mm).
 2. Through-Penetrants — One nonmetallic pipe, conduit or tubing to be installed within the freestop system. The annular space between pipe and periphery of opening shall be min 0 in. (point contact) to max 1/2 in. (13 mm). Pipe or conduit to be rigidly supported on both sides of the wall assembly. The following types and sizes of nonmetallic pipes may be used:
 A. Polyvinyl Chloride (PVC) Pipe — Nom 10 in. (254 mm) diam (or smaller) Schedule 40 solid-core or cellular core PVC pipe for use in closed (process or supply) or vented (drain, waste or vent) piping system.
 B. Chlorinated Polyvinyl Chloride (CPVC) Pipe — Nom 10 in. (254 mm) diam (or smaller) SDR 13.5 CPVC pipe for use in closed (process or supply) piping systems.
 C. Acrylonitrile Butadiene Styrene (ABS) Pipe — Nom 6 in. (152 mm) diam (or smaller) Schedule 40 solid-core or cellular core ABS pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.
 D. Flame Retardant Polypropylene (FRPP) Pipe — Nom 6 in. (152 mm) diam (or smaller) Schedule 40 FRPP pipe for use in closed (process or supply) or vented (drain, waste or vent) piping system.
 E. Polyvinylidene Fluoride (PVDF) Pipe — Nom 4 in. (102 mm) diam (or smaller) PVDF pipe for use in closed (process or supply) or vented (drain, waste or vent) piping system.
 3. Firestop System — The firestop system is equal to the hourly fire rating of the wall assembly in which it is installed.
 4. Penetrants — One nonmetallic pipe, conduit or tubing to be installed within the freestop system. The annular space between pipe and periphery of opening shall be min 0 in. (point contact) to max 1/2 in. (13 mm). Pipe or conduit to be rigidly supported on both sides of wall assembly. The following types and sizes of nonmetallic pipes may be used:
 A. Polyvinyl Chloride (PVC) Pipe — Nom 6 in. (152 mm) diam (or smaller) Schedule 40 solid-core or cellular core PVC pipe for use in closed (process or supply) or vented (drain, waste or vent) piping system.
 B. Chlorinated Polyvinyl Chloride (CPVC) Pipe — Nom 6 in. (152 mm) diam (or smaller) SDR 13.5 CPVC pipe for use in closed (process or supply) piping systems.
 C. Acrylonitrile Butadiene Styrene (ABS) Pipe — Nom 6 in. (152 mm) diam (or smaller) Schedule 40 solid-core or cellular core ABS pipe for use in closed (process or supply) or vented (drain, waste or vent) piping system.
 D. Flame Retardant Polypropylene (FRPP) Pipe — Nom 6 in. (152 mm) diam (or smaller) Schedule 40 FRPP pipe for use in closed (process or supply) or vented (drain, waste or vent) piping system.
 E. Polyvinylidene Fluoride (PVDF) Pipe — Nom 4 in. (102 mm) diam (or smaller) PVDF pipe for use in closed (process or supply) or vented (drain, waste or vent) piping system.
 5. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 6. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 7. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 8. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 9. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 10. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 11. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 12. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 13. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 14. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 15. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 16. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 17. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 18. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 19. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 20. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 21. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 22. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 23. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 24. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 25. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 26. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 27. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 28. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 29. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 30. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 31. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 32. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 33. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 34. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 35. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 36. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 37. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 38. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 39. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 40. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 41. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 42. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 43. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 44. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 45. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 46. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 47. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 48. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 49. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 50. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (203 or 254 mm) diam pipe is used, T Rating is 0 hr.
 51. Firestop System — The firestop system is equal to the hourly fire rating of the wall. When nom 8 in. or 10 in. (

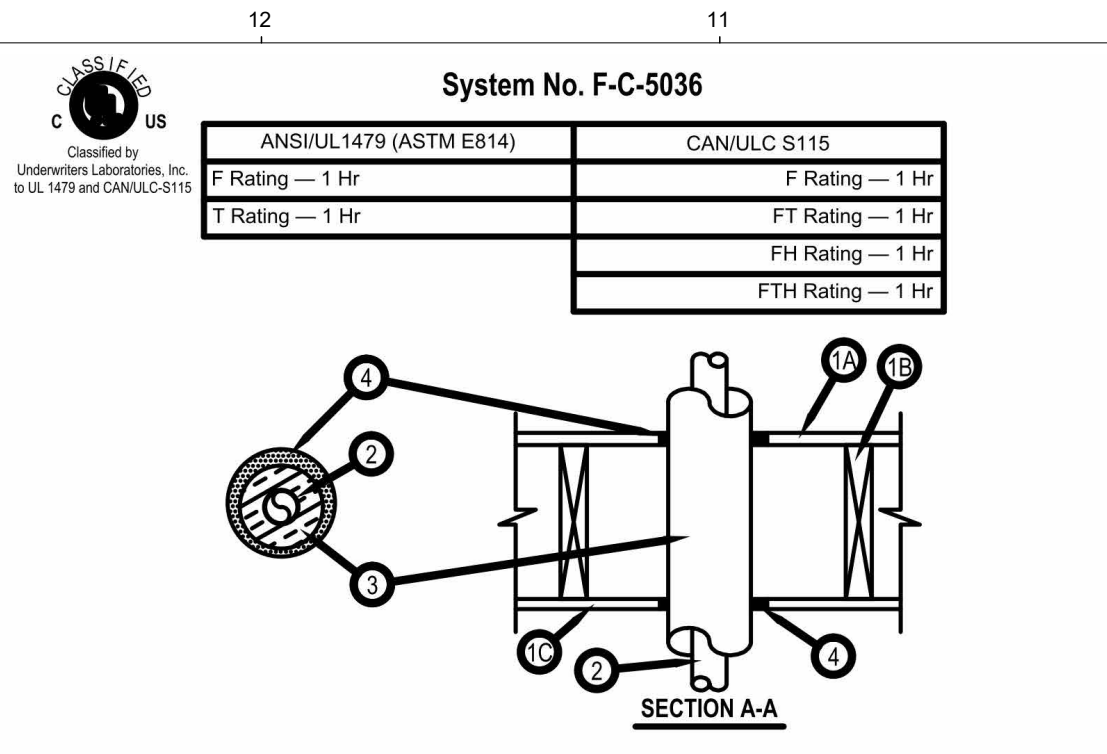


- Floor-Ceiling Assembly — The 1 hr fire-rated solid or trussed lumber joist floor-ceiling assembly shall be constructed of the materials and in the manner specified in the individual U500 Series Floor-Ceiling Designs in the UL Fire Resistance Directory. The general construction features of the floor-ceiling assembly are summarized below:
 - Flooring System — Lumber or plywood subfloor with finish floor of lumber, plywood or Floor Topping Mixture* as specified in the individual Floor-Ceiling Design. Max diam of opening shall be 6-7/8 in. (175 mm).
 - Wood Joists* — Nom 10 in. (254 mm) deep (or deeper) lumber, steel or combination lumber and steel joists, trusses or Structural Wood Members* with bridging as required and with ends firestoppped.
 - Gypsum Board* — Nom 4 1/2 in. (112 mm) by 5/8 in. (16 mm) thick as specified in the individual Floor-Ceiling Design. Max diam of opening shall be 6-7/8 in. (175 mm).
- Chase Wall — (Not Shown, Optional) The through penetrants (Item 2) may be routed through a 1 hr fire-rated angle, double or staggered wood stud/gypsum wallboard chase wall having a fire rating consistent with that of the floor-ceiling assembly. The chase wall shall be constructed of the materials and in the manner specified in the individual U300 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:
 - Studs — Nom 2 by 4 in. (51 by 102 mm) lumber or double nom 2 by 4 in. (51 by 102 mm) lumber studs, tightly butted. Max diam of opening shall be 6-7/8 in. (175 mm).
 - Side Plate — Nom 2 by 6 in. (51 by 203 mm) lumber or parallel 2 by 4 in. (51 by 102 mm) lumber plates, tightly butted. Max diam of opening shall be 6-7/8 in. (175 mm).
 - C Top Plate — The double top plate shall consist of two nom 2 by 6 in. (51 by 203 mm) lumber plates or two sets of nom 2 by 4 in. (51 by 102 mm) lumber plates, tightly butted. Max diam of opening is 6-7/8 in. (175 mm).
 - D Gypsum Board* — Thickness, type, number of layers and fasteners shall be as specified in individual Wall and Partition Design.
- Through Penetrants* — One metallic tube or pipe to be installed within the firestop system. Tube or pipe to be rigidly supported on both sides of floor-ceiling assembly. The following types and sizes of metallic tubes or pipes may be used:
 - Copper Tubing — Nom 2 in. (51 mm) diam (or smaller) Type L (or heavier) copper tubing.
 - Copper Pipe — Nom 2 in. (51 mm) diam (or smaller) Regular (or heavier) copper pipe.
 - Steel Pipe — Nom 2 in. (51 mm) diam (or smaller) Schedule 10 (or heavier) steel pipe.
- Pipe Covering — Nom 1-1/2 in. (38 mm) thick hollow cylindrical heavy density (min 3.5 pcf (56 kg/m³)) glass fiber units jacketed on the outside with an air service jacket. Longitudinal joints sealed with metal fasteners or factory-applied self-sealing tape. Transverse joints secured with metal fasteners or with bolt type supplied with the product. The annular space shall be min 1/2 in. (13 mm) and max 1 in. (25 mm). See Pipe and Equipment Covering Materials (BROU) category in the Building Materials Directory for names of manufacturers. Any pipe covering material meeting the above specifications and bearing the UL Classification Marking with a Flame Spread Index of 25 or less and a Smoke Developed Index of 50 or less may be used.
- Fill, Void or Cavity Material* — Sealant — Min 3/4 in. (19 mm) thickness of sealant applied within annular space, flush with top surface of subfloor or sole plate. Min 5/8 in. (16 mm) thickness of sealant applied within the annular space, flush with bottom surface of gypsum wallboard or lower top plate.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC. — FS-ONE Sealant or FS-ONE MAX Intumescent Sealant
 *Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. January 20, 2015

HilTI Firestop Systems

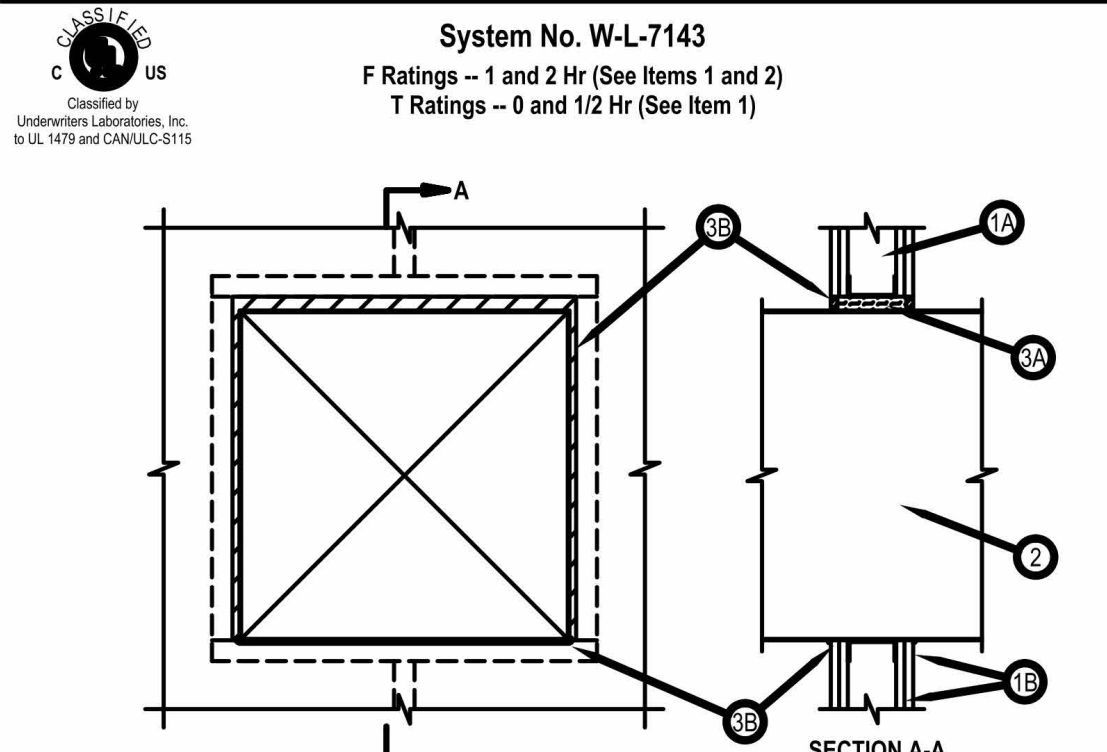


- Wall Assembly — The 1 and 2 hr fire-rated gypsum wallboard/stud wall assembly shall be constructed of the materials and in the manner specified in the individual U400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:
 - Studs — Wall framing shall consist of min. 3-1/2 in. (89 mm) wide steel channel studs and spaced max 24 in. (610 mm) OC. Additional 3-1/2 in. (89 mm) wide steel studs shall be used to completely frame opening.
 - Gypsum Board — One or two layers of 5/8 in. (16 mm) thick gypsum board as specified in the individual Wall and Partition Design. Max size of opening is 625 sq in. (4032 cm²) with a max dimension of 25 in. (635 mm).
 - The hourly F Rating of the firestop system is equal to the hourly fire rating of the wall assembly in which it is installed. The hourly T Rating of the firestop system is 12 hr for 2 hr fire-rated walls and 0 hr for 1 hr fire-rated walls.
- Steel Stud — Nom 24 in. by 24 in. (610 by 610 mm) (or smaller) No. 24 gauge (or heavier) galv. steel duct to be installed within the firestop system. An annular space of min 1/2 in. (13 mm) to max 1 in. (25 mm) is required within the firestop system. As an option, for systems with a 2 hr F Rating only, the min annular space may be 0 in. (point contact). Steel duct to be rigidly supported on both sides of wall assembly.
- Firestop System — The firestop system shall consist of the following:
 - Packing Material — Min 3-3/4 in. (95 mm) or 5 in. (127 mm) thickness of min 4 pcf (13 kg/m³) mineral wool batt insulation firmly packed into opening as a permanent form for 1 and 2 hr rated assemblies, respectively. Packing material to be recessed from both surfaces of wall to accommodate the required thickness of fill material.
 - Fill, Void or Cavity Material* — Sealant — Min 1/2 in. (13 mm) thickness of sealant applied within annulus, flush with both surfaces of wall assembly. Min 1/4 in. (6 mm) diam bead of sealant shall be applied at the duct/gypsum board interface at any point contact location, on both surfaces of wall assembly.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC. — CP 606 Sealant

*Bearing the UL Classification Mark
 Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. October 12, 2012

HilTI Firestop Systems

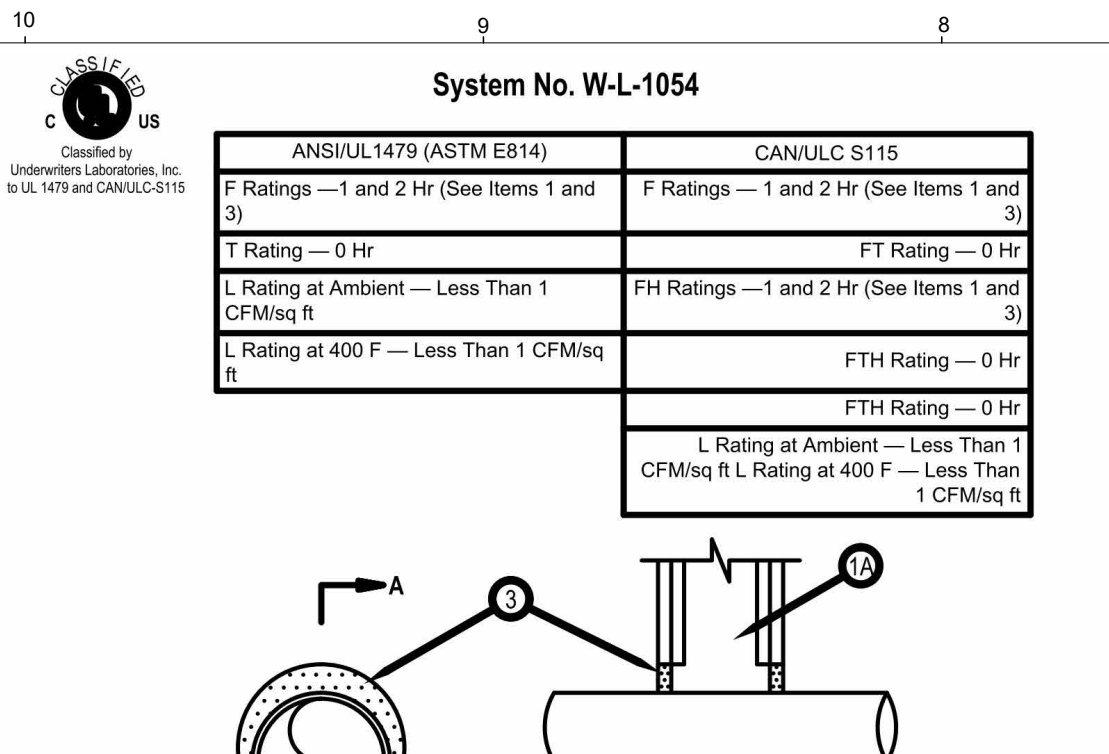


- Wall Assembly — The 1 or 2 hr fire-rated gypsum wallboard/stud wall assembly shall be constructed of the materials and in the manner specified in the individual U300 or U400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:
 - Studs — Wall framing may consist of either wood studs or steel channel studs. Wood studs to consist of nom 2 by 4 in. (51 by 102 mm) lumber spaced 16 in. (406 mm) OC. Steel studs to be min 2-1/2 in. (64 mm) wide and spaced max 24 in. (610 mm) OC. When steel studs are used and the diam of opening exceeds the width of stud cavity, the opening shall be framed on all sides using lengths of steel stud installed between the vertical studs and screw-attached to the steel studs at each end. The framed opening in the wall shall be 4 to 6 in. (102 to 152 mm) wide and 4 to 6 in. (102 to 152 mm) higher than the diam of the penetrating item such that, when the penetrating item is installed in the opening, a 2 to 3 in. (51 to 76 mm) clearance is present between the penetrating item and the framing on all four sides.
 - Gypsum Board* — 5/8 in. (16 mm) thick, 4 ft (122 cm) wide with square or tapered edges. The gypsum board type, thickness, number of layers, fastener type and sheet orientation shall be as specified in the individual U300 or U400 Series Design in the UL Fire Resistance Directory. Max diam of opening is 32-1/4 in. (819 mm) for steel stud walls. Max diam of opening is 14-1/2 in. (368 mm) for wood stud walls. The F and FH Ratings of the firestop system are equal to the fire rating of the wall assembly.
 - Through-Penetrants* — One metallic pipe, conduit or tubing to be installed either concentrically or eccentrically within the firestop system. The annular space shall be min 0 in. (point contact) to max 1 in. (25 mm). Pipes may be installed with continuous point contact. Pipes, conduit or tubing may be installed at an angle not greater than 45 degrees from perpendicular. Pipe, conduit or tubing to be rigidly supported on both sides of wall assembly. The following types and sizes of metallic pipes, conduits or tubing may be used:
 - Steel Pipe — Nom 3/8 in. (9.5 mm) diam (or smaller) Schedule 10 (or heavier) steel pipe.
 - Copper Pipe — Nom 3/8 in. (9.5 mm) diam (or smaller) cast or ductile iron pipe.
 - Copper Tubing — Nom 3/8 in. (9.5 mm) diam (or smaller) steel electrical metallic tubing or 6 in. (152 mm) diam steel conduit.
 - Copper Tubing — Nom 3/8 in. (9.5 mm) diam (or smaller) steel electrical metallic tubing or 6 in. (152 mm) diam steel conduit.
 - Copper Pipe — Nom 3/8 in. (9.5 mm) diam (or smaller) Regular (or heavier) copper pipe.
 - Fill, Void or Cavity Material* — Sealant — Min 3/4 in. (19 mm) thickness of fill material applied within the annulus, flush with both surfaces of wall. At the point or continuous contact location between pipe and wall, a min 1/2 in. (13 mm) diam bead of fill material shall be applied at the pipe wall interface on both surfaces of wall.
- HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC. — FS-ONE Sealant or FS-ONE MAX Intumescent Sealant

*Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. January 23, 2015

HilTI Firestop Systems

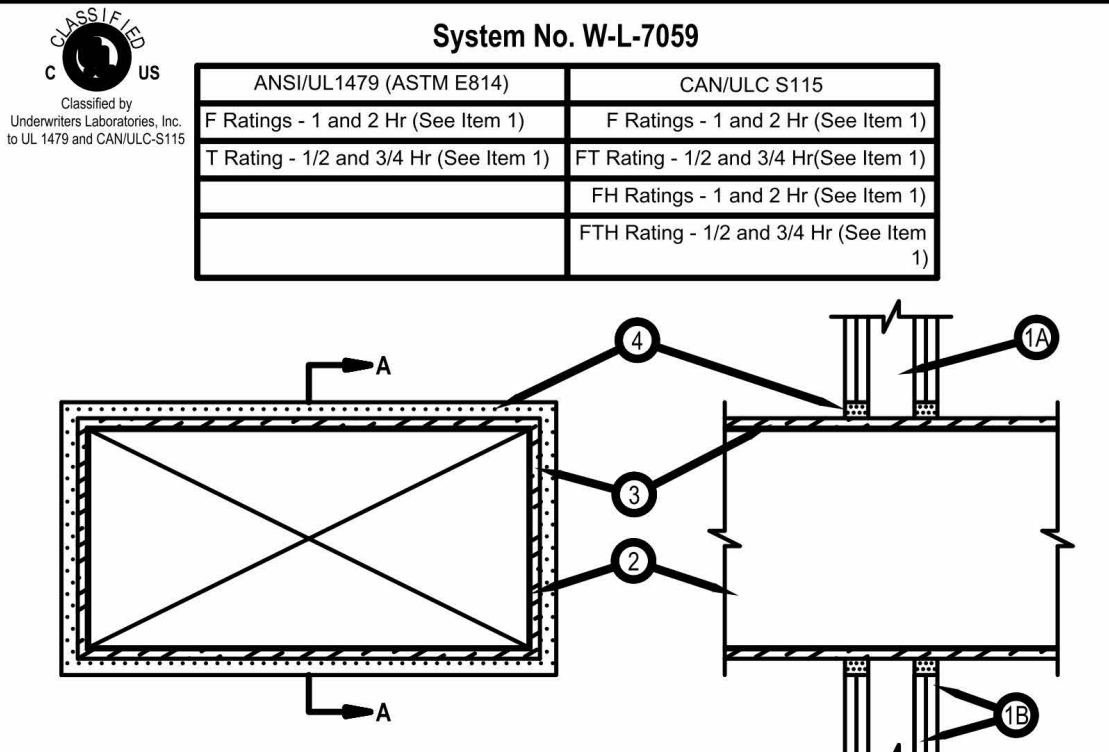


- Wall Assembly — The 1 or 2 hr fire-rated gypsum wallboard/stud wall assembly shall be constructed of the materials and in the manner described in the individual U400, V400 or W400 Series Wall or Partition Design in the UL Fire Resistance Directory and shall include the following construction features:
 - Studs — Wall framing shall consist of channel studs. Steel studs to be min 2-1/2 in. (64 mm) wide and spaced max 24 in. (610 mm) OC. The opening in the wall to accommodate the steel duct (Item 2) shall be framed on all sides using lengths of studs installed between the vertical studs and attached to the studs at each end. The framed opening in the wall shall be a nom 6 in. (152 mm) wide and 12 in. (305 mm) higher than the width and height of the steel duct.
 - Wallboard, Gypsum* — 5/8 in. (16 mm) thick, 4 ft (122 mm) wide with square or tapered edges. The gypsum wallboard type, thickness, number of layers, fastener type and sheet orientation shall be as specified in the individual U300, U400, V400 or W400 Series Design in the UL Fire Resistance Directory. Max area of opening is 355 sq in. (2295 cm²) with max dimensions of 26-3/4 in. (679 mm) for steel studs. The hourly F and FH Ratings of the firestop system are equal to the hourly fire rating of the wall assembly in which it is installed. The hourly T, FT and FTH Ratings are 1/2 hr and 3/4 hr for 1 and 2 hr rated assemblies, respectively.
 - Steel Duct — Nom 24 in. by 12 in. (610 by 305 mm) (or smaller) No. 24 gauge (or heavier) steel duct to be installed concentrically within the framed opening. The annular space shall be min 1 in. (25 mm) to max 1-3/4 in. (45 mm) for steel studs. The steel duct to be rigidly supported on both sides of wall assembly.
 - Batts and Blankets* — Max 1-1/2 in. (38 mm) thick glass fiber batt or blanket (min 3/4 pcf or 12 kg/m³) jacketed on the outside with a foil-scum-kraft facing. Longitudinal and transverse joints sealed with aluminum foil tape. During the installation of the fill material, the batt or blanket shall be compressed 50% such that the annular space within the firestop system shall be min 1/4 in. (6 mm) to max 1 in. (25 mm). See Batts and Blankets (BKWV) category in the Building Materials Directory for names of manufacturers. Any batt or blanket meeting the above specifications and bearing the UL Classification Marking with a Flame Spread Index of 25 or less and a Smoke Developed Index 50 or less may be used.
 - Fill, Void or Cavity Material* — Sealant — Min 5/8 in. (16 or 1/4 in. (16 or 32 mm) thickness of fill material applied within annulus, flush with both surfaces of wall for 1 or 2 hr walls, respectively. If voids develop after the fill materials zones, the voids shall be sealed with additional fill material.
- HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC. — FS-ONE Sealant or FS-ONE MAX Intumescent Sealant

*Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. January 27, 2015

HilTI Firestop Systems

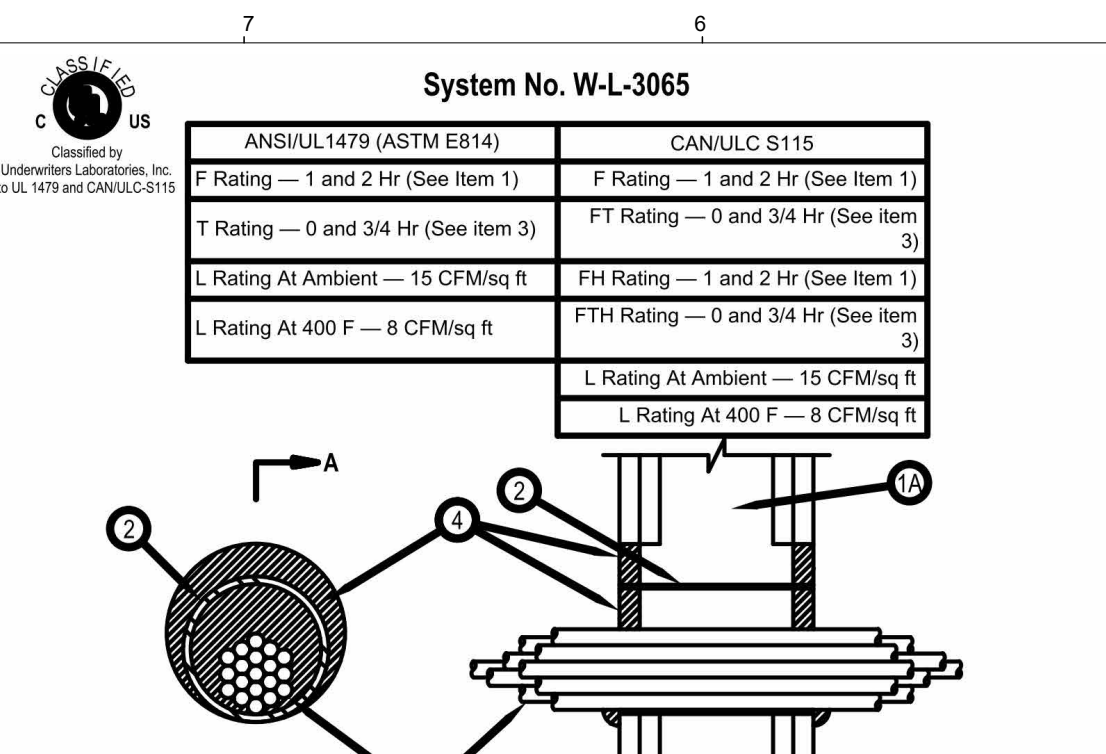


- Wall Assembly — The 1 or 2 hr fire-rated gypsum wallboard/stud wall assembly shall be constructed of the materials and in the manner specified in the individual U300, U400, V400 or W400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:
 - Studs — Wall framing may consist of either wood studs or steel channel studs. Wood studs to consist of nom 2 by 4 in. (51 by 102 mm) lumber spaced 16 in. (406 mm) OC. Steel studs to be min 2-1/2 in. (64 mm) wide and spaced max 24 in. (610 mm) OC.
 - Gypsum Board* — Nom 5/8 in. (16 mm) thick gypsum board, with square or tapered edges. The gypsum board type, thickness, number of layers, fastener type and sheet orientation shall be as specified in the individual Wall and Partition Design in the UL Fire Resistance Directory. Max diam of opening is 6-7/8 in. (175 mm) for steel stud walls. Max diam of opening is 14-1/2 in. (368 mm) for wood stud walls. Max diam of opening is 6-7/8 in. (175 mm) when sleeve (Item 2) is employed. Max diam of opening is 4 in. (102 mm) when sleeve (Item 2) is not employed.
 - The F, FH Ratings of the firestop system are equal to the fire rating of the wall assembly.
 - Metallic Sleeve* — (Optional) — Nom 4 in. (102 mm) diam (or smaller) steel electrical metallic tubing (EMT) or Schedule 5 (or heavier) steel pipe or min 0.106 in. thick (0.141 in. No. 28 galv) galv steel sleeve installed flush with wall surfaces. The annular space between steel sleeve and periphery of opening shall be min 0 in. (point contact) to max 1 in. (25 mm). When sleeve is continuous on one side of wall (see Item 2), the cable fill may be to 45% and the max annular space is not limited. Cables to be rigidly supported on both sides of the wall assembly. Cable bundle, using cables described below, may penetrate the wall at an angle not greater than 45 degrees. Any combination of the following types and sizes of copper conductor cables may be used:
 - Max 7C No. 12 AWG with polyvinyl chloride (PVC) insulation and jacket.
 - Max 25 pair No. 24 AWG telephone cable with PVC insulation and jacket.
 - Max 4 pair No. 24 AWG Cat 5 or Cat 6 computer cables.
 - Type RGU coaxial cable with polyethylene (PE) insulation and PVC jacket having a max outside diameter of 1/2 in. (13 mm).
 - Max RG 60 coaxial cable with fluorinated ethylene insulation and jacketing.
 - Multiple fiber optical communication cable jacketed with PVC and having a max OD of 5/8 in. (16 mm).
 - Through Penetrating Products* — Max three copper conductor No. 8 AWG Metal-Clad Cable.
 - AFC CABLE SYSTEMS INC
 - Max 3C with ground (or smaller) No. 8 AWG copper conductor cable with PVC insulation and jacketing.
 - Max 34 in. (863 mm) diam copper ground cable with or without a PVC jacket.
 - Fire Resistant Cable* — Max 1-1/4 in. (32 mm) diam single conductor or multi conductor Type MI cable. A min 1/8 in. (3 mm) separation shall be maintained between MI cables and any other types of cable.
 - Max 4C with ground 300 kV (or smaller) aluminum RER steel cable with PVC insulation and jacket.
 - Through Penetrating Product* — Any cables, Metal-Clad Cable or Armored Cable* currently Classified under the Through Penetrating Products category.
 - Maximum 3C No. 8 AWG metal-clad cable.
 - Maximum 5/8 diam fiber-optic cable with PVC jacket.
 - For cable bundle penetrating the wall assembly at an angle of 45 degrees, the T, FT, FTH Ratings are 0 hr and 3/4 hr for 1 and 2 hr wall assemblies, respectively.
 - See Through Penetrating Product (XHVLY) category in the Fire Resistance Directory for names of manufacturers.
 - Fill, Void or Cavity Material* — Sealant or Putty — Fill material applied within the annulus, flush with each end of the steel sleeve or wall surface. Fill material installed symmetrically on both sides of the wall. A min 5/8 in. (16 mm) thickness of sealant is required for the 1 or 2 hr F Rating. An additional 1/2 in. (13 mm) diam bead of fill material shall be applied at the interface of sleeve with gypsum board.
- HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC. — CP6015, CP606, FS-ONE Sealants or FS-ONE MAX Intumescent Sealant or CP618 Putty
- Packing Material* — (Optional, Not Shown) — Mineral wool forming material may be used as a backer for the fill material (Item 4). When used, it shall be firmly packed into annular space within the sleeve as a permanent form and recessed from end of sleeve to accommodate the required thickness of fill material.

*Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

Bearing the UL Listing Mark

Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. January 23, 2015


HilTI Firestop Systems

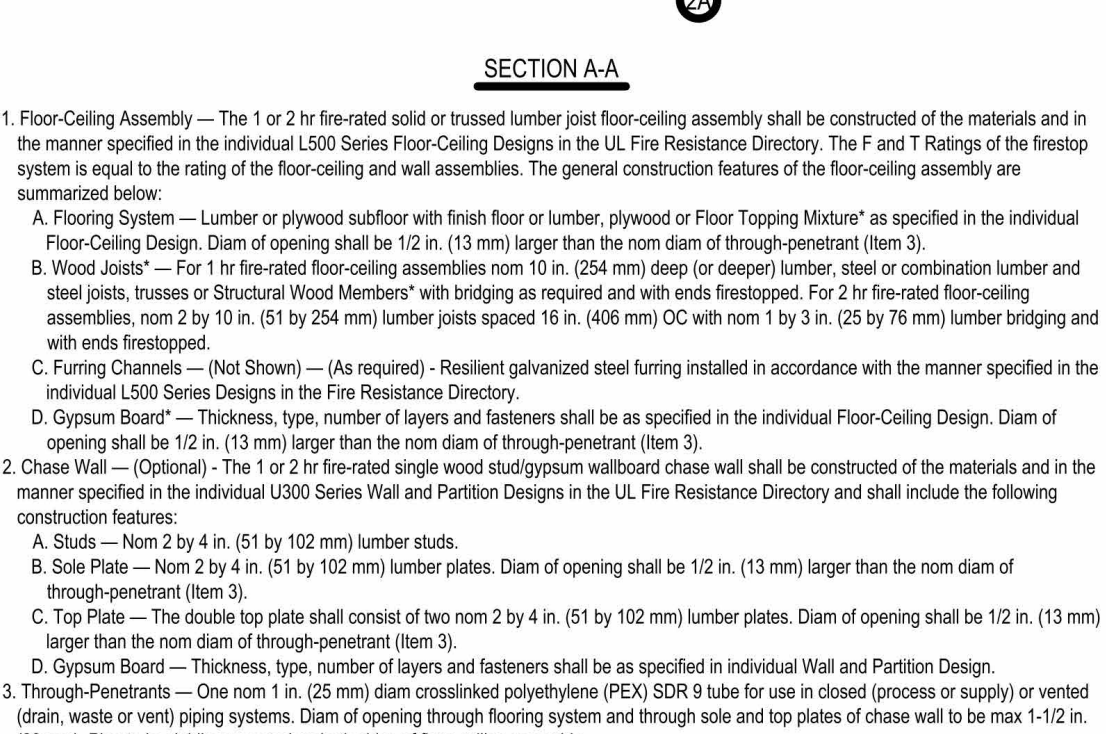

*Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. January 20, 2015

HilTI Firestop Systems

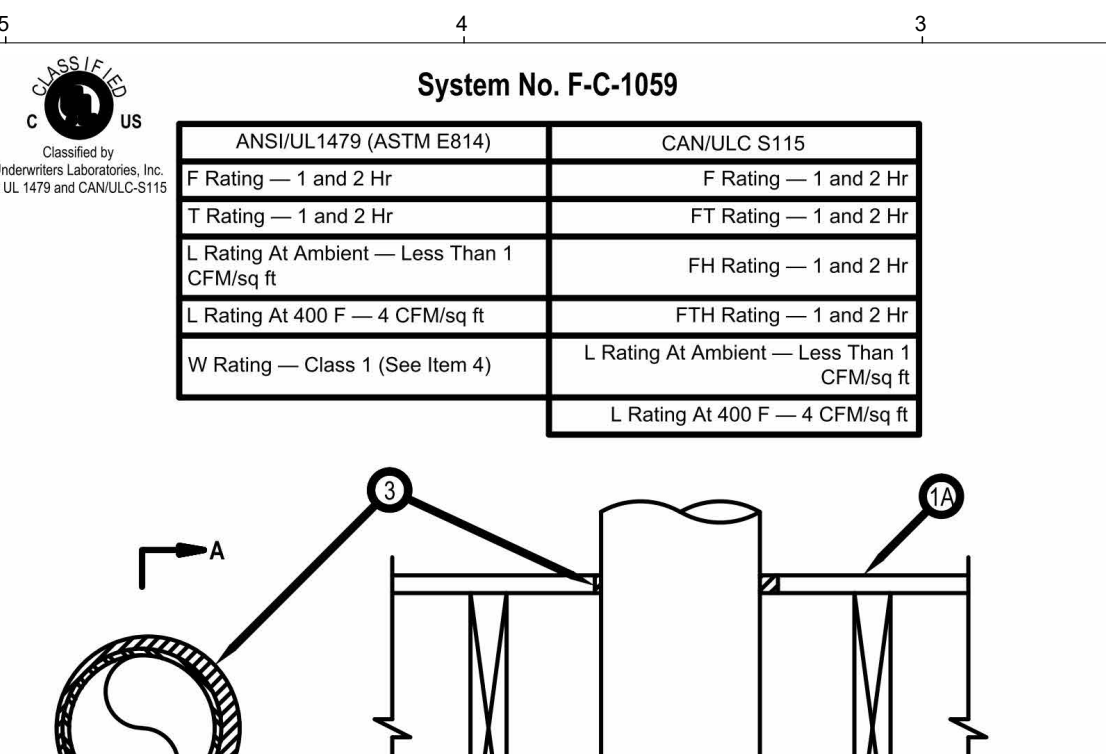


- Floor-Ceiling Assembly — The 1 or 2 hr fire-rated solid or trussed lumber joist floor-ceiling assembly shall be constructed of the materials and in the manner specified in the individual U500 Series Floor-Ceiling Designs in the UL Fire Resistance Directory. The F, FH Rating of the firestop system is equal to the rating of the floor-ceiling and wall assemblies. The T, FT and FTH Rating of the firestop system is 0 hr for 1 hr rated floor ceiling assembly and 12 hr for 2 hr rated floor ceiling assembly. The general construction features of the floor-ceiling assembly are summarized below:
 - Flooring System — Lumber or plywood subfloor with finish floor of lumber, plywood or Floor Topping Mixture* as specified in the individual Floor-Ceiling Design. Max diam of opening shall be 7-5/8 in. (194 mm).
 - Wood Joists* — Nom 10 in. (254 mm) deep (or deeper) lumber, steel or combination lumber and steel joists, trusses or Structural Wood Members* with bridging as required and with ends firestoppped.
 - Gypsum Board* — Thickness, type, number of layers and fasteners shall be as specified in the individual Floor-Ceiling Design. Max diam of opening shall be 7-5/8 in. (194 mm).
 - Furring Channels* — (Not Shown) (As required) Resilient galvanized steel furring installed in accordance with the manner specified in the individual U500 Series Designs in the Fire Resistance Directory.
 - Chase Wall — (Not Shown, Optional) — The through penetrants (Item 2) may be routed through a 1 or 2 hr fire-rated angle, double or staggered wood stud/gypsum wallboard chase wall having a fire rating consistent with that of the floor-ceiling assembly. The chase wall shall be constructed of the materials and in the manner specified in the individual U300 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:
 - Studs — Nom 2 by 4 in. (51 by 102 mm) lumber or double nom 2 by 6 in. (51 by 152 mm) lumber studs, tightly butted. Max diam of opening shall be 7-5/8 in. (194 mm).
 - Side Plate — Nom 2 by 6 in. (51 by 203 mm) lumber or parallel 2 by 6 in. (51 by 152 mm) lumber plates, tightly butted. Max diam of opening shall be 7-5/8 in. (194 mm).
 - C Top Plate — The double top plate shall consist of two nom 2 by 6 in. (51 by 203 mm) lumber plates or two sets of nom 2 by 4 in. (51 by 152 mm) lumber plates tightly butted. Max diam of opening is 7-5/8 in. (194 mm).
 - D Gypsum Board* — Thickness, type, number of layers and fasteners shall be as specified in individual Wall and Partition Designs.
 - Through Penetrants* — One metallic tubing, pipe or conduit to be installed concentrically or eccentrically within the firestop system. Annular space between pipe or conduit and edge of opening to be min 1/4 in. (6 mm) and max 3/4 in. (19 mm). Pipe, tubing or conduit to be rigidly supported on both sides of floor-ceiling assembly. The following types and sizes of metallic pipes, tubing or conduit may be used:
 - Steel Pipe — Nom 6 in. (152 mm) diam (or smaller) Schedule 40 (or heavier) steel pipe.
 - Iron Pipe — Nom 6 in. (152 mm) diam (or smaller) Regular (or heavier) steel pipe.
 - Copper Pipe — Nom 6 in. (152 mm) diam (or smaller) Regular (or heavier) steel pipe.
 - Copper Tubing — Nom 6 in. (152 mm) diam (or smaller) steel electrical metallic tubing or 6 in. diam (or smaller) steel pipe.
 - Steel Flexible Metal Conduit* — Nom 2 in. (51 mm) diam (or smaller) steel flexible metal conduit.
 - See Flexible Metal Conduit (DMU) category in the Electrical Construction Materials Directory for names of manufacturers.
 - Fill, Void or Cavity Material* — Sealant — Min 5/8 in. (16 mm) or 1-1/4 in. (32 mm) thickness of sealant applied within annular space, flush with the bottom surface of gypsum wallboard or lower top plate for 1 and 2 hr floors respectively. Min. 3/4 in. (19 mm) thickness of sealant applied within annular space, flush with top surface of floor or sole plate.
- HILTI INC. — FS-ONE Sealant or FS-ONE MAX Intumescent Sealant

*Bearing the UL Listing Mark
 *Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. January 15, 2015

HilTI Firestop Systems

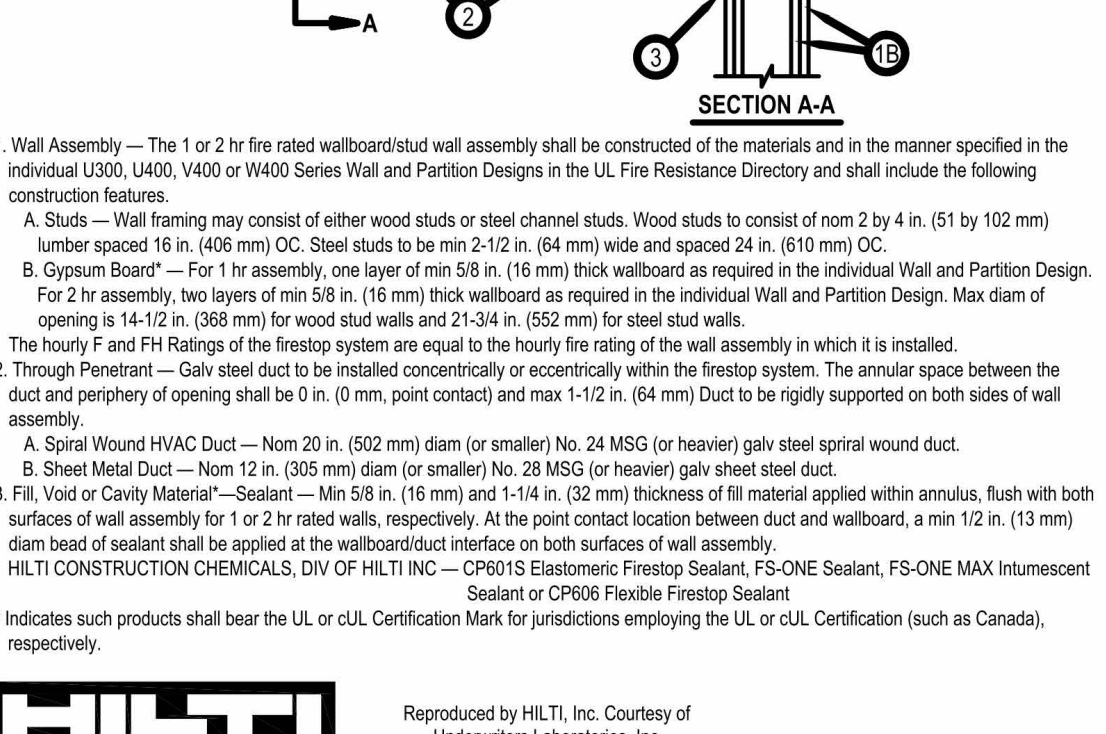

*Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. January 27, 2015

HilTI Firestop Systems

Notes:


- Refer to section 15084 of the specifications. For Quality Control requirements, refer to the Quality Control portion of the specification.
- Details shown are typical details. If field conditions do not match requirements of typical details, approved alternate details shall be utilized. Field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
 - * Minimum and maximum Width of Joints
 - * Type and thickness of fire-rated construction. The minimum assembly rating of the firestop assembly shall meet or exceed the highest rating of the adjacent construction.
- If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable. Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.
- References:
 - * 2013 Underwriter's Laboratories Fire Resistance Directory, Volume 2
 - * NFPA 101 Life Safety Code
 - * All governing local and regional building codes
- Firestop System installation must meet requirements of ASTM E-814 (UL 1479) tested assemblies that provide a fire rating equal to that of construction being penetrated.
- All rated through-penetrations shall be prominently labeled with the following information:
 - * ATTENTION: Fire Rated Assembly
 - * UL System #
 - * Product(s) used
 - * Hourly Rating (F-Rating)
 - * Installation Date

TRIPLEX DWELLING UNIT

OPTION #2

PROJECT

TRIPLEX DWELLING UNIT

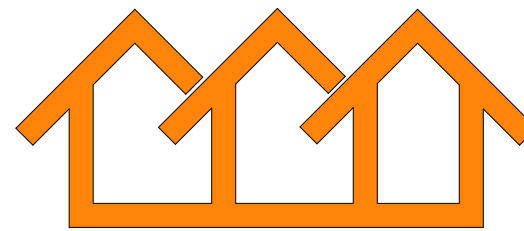

PWP23-005


DEPARTMENT OF PUBLIC WORKS AND PLANNING



CAPITAL PROJECTS DIVISION

2220 Tulare St., Ste. 720, Fresno, CA. 93721
 Phone: (559) 262-4212 Fax: (559) 262-4879

SEAL & SIGNATURE

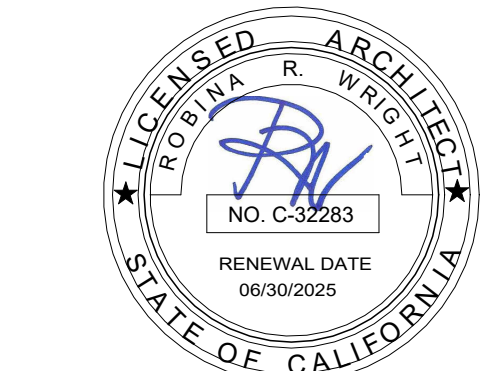

UPDATE

JANUARY 2, 2024

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY AND COPYRIGHT OF THE ARCHITECT AND SHALL NOT BE USED ON ANY OTHER PROJECT OR LOCATIONS EXCEPT AS DESCRIBED ON THE DRAWINGS WITHOUT WRITTEN AGREEMENT WITH THE ARCHITECT.

TITLE

TYPICAL FIRESTOP DETAILS

SCALE

1/2" = 1'-0"

A-808

ISSUE DATE	JOB NUMBER
MARCH 7, 2023	2023_11
DRAWN BY	CHECKED BY
Author	Checker

RESIDENTIAL MANDATORY MEASURES, SHEET 1 (January 2023)

04 MAY 2007

Exception: A raceway is not required if a minimum 40-ampere 208/240-volt dedicated EV branch circuit is installed in close proximity to the location or the proposed location of the EV space, at the time of original construction in accordance with the California Electrical Code.

TABLE - MAXIMUM FIXTURE WATER USE	
FIXTURE TYPE	FLOW RATE
SHOWER HEADS (RESIDENTIAL)	1.8 GMP @ 80 PSI
LAVATORY FAUCETS (RESIDENTIAL)	MAX. 1.2 GPM @ 60 PSI MIN. 0.8 GPM @ 20PSI
LAVATORY FAUCETS IN COMMON & PUBLIC USE AREAS	0.5 GPM @ 60 PSI
KITCHEN FAUCETS	1.8 GPM @ 60 PSI
METERING FAUCETS	0.2 GAL/CYCLE
WATER CLOSET	1.28 GAL/FLUSH
URINALS	0.125 GAL/FLUSH

Exception: Rural jurisdictions that meet and apply for the exemption in Public Resources Code Section 42649.82 (a)(2)(A) et seq. are not required to comply with the organic waste portion of this section.

OPTION
#2

TRIPLEX
DWELLING UNIT



2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

Professional Engineer Seal for Robina R. Wright, State of California, License No. C-32283, Renewal Date 06/30/2025.

JANUARY 2, 2024

This image shows a single sheet of white paper with horizontal blue or grey ruling lines. The lines are evenly spaced and run across the width of the page. There are approximately 20 lines visible. The paper has a slightly textured appearance and is set against a dark background.

SCALE 12" = 1'-0"

ISSUE DATE	JOB NUMBER
MARCH 7, 2023	2023_11
DRAWN BY	CHECKED BY
RW	RW

2022 CALIFORNIA GREEN BUILDING STANDARDS CODE

RESIDENTIAL MANDATORY MEASURES, SHEET 2


(January 2023)

TRIPLEX DWELLING UNIT

OPTION
#2

PROJECT

TRIPLEX
DWELLING UNIT

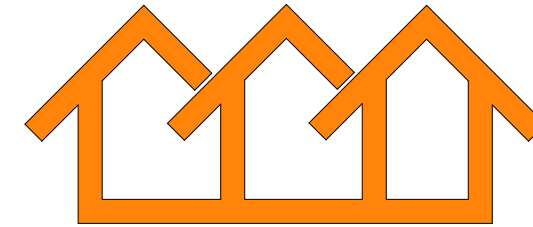

PWP23-005


DEPARTMENT OF PUBLIC
WORKS AND PLANNING



CAPITAL PROJECTS
DIVISION

2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

SEAL & SIGNATURE

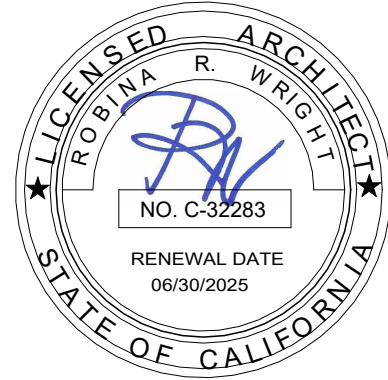

UPDATE

JANUARY 2, 2024

THESE DRAWINGS AND SPECIFICATIONS
ARE THE PROPERTY AND COPYRIGHT OF
THE ARCHITECT AND SHALL NOT BE
USED ON ANY OTHER PROJECT OR
LOCATIONS EXCEPT AS DESCRIBED ON
THE DRAWINGS WITHOUT WRITTEN
AGREEMENT WITH THE ARCHITECT.

TITLE

GREEN BUILDING
MANDATORY
MEASURES 2

SCALE

12" = 1'-0"

GBC-2

ISSUE DATE	JOB NUMBER
MARCH 7, 2023	2023_11
DRAWN BY	CHECKED BY
RW	RW

©

CONT.

TABLE 4.504.1 - ADHESIVE VOC LIMIT^{1,2}

SPECIALTY APPLICATIONS

PVC WELDING	510
CPVC WELDING	490
ABS WELDING	325
PLASTIC CEMENT WELDING	250
ADHESIVE PRIMER FOR PLASTIC	550
CONTACT ADHESIVE	80
SPECIAL PURPOSE CONTACT ADHESIVE	250
STRUCTURAL WOOD MEMBER ADHESIVE	140
TOP & TRIM ADHESIVE	250
SUBSTRATE SPECIFIC APPLICATIONS	
METAL TO METAL	30
PLASTIC FOAMS	50
POROUS MATERIAL (EXCEPT WOOD)	50
WOOD	30
FIBERGLASS	80

1. IF AN ADHESIVE IS USED TO BOND DISSIMILAR SUBSTRATES TOGETHER, THE ADHESIVE WITH THE HIGHEST VOC CONTENT SHALL BE ALLOWED.
2. FOR ADDITIONAL INFORMATION REGARDING METHODS TO MEASURE THE VOC CONTENT SPECIFIED IN THIS TABLE, SEE SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT RULE 1168.

TABLE 4.504.2 - SEALANT VOC LIMIT

(Less Water and Less Exempt Compounds in Grams per Liter)

SEALANTS	VOC LIMIT
ARCHITECTURAL	250
MARINE DECK	760
NONMEMBRANE ROOF	300
ROADWAY	250
SINGLE-PLY ROOF MEMBRANE	450
OTHER	420
SEALANT PRIMERS	
ARCHITECTURAL	
NON-POROUS	250
POROUS	775
MODIFIED BITUMINOUS	500
MARINE DECK	760
OTHER	750

Adhesives, sealant and caulks used on the project shall meet the

TABLE 4.504.3 - VOC CONTENT LIMITS FOR ARCHITECTURAL COATINGS³

GRAMS OF VOC PER LITER OF COATING, LESS WATER & LESS EXEMPT COMPOUNDS

COATING CATEGORY	VOC LIMIT
FLAT COATINGS	50
NON-FLAT COATINGS	100
NONFLAT-HIGH GLOSS COATINGS	150
SPECIALTY COATINGS	
ALUMINUM ROOF COATINGS	400
BASEMENT SPECIALTY COATINGS	400
BITUMINOUS ROOF COATINGS	50
BITUMINOUS ROOF PRIMERS	350
BOND BREAKERS	350
CONCRETE CURING COMPOUNDS	350
CONCRETE/MASONRY SEALERS	100
DRIVEWAY SEALERS	50
DRY FOG COATINGS	150
FAUX FINISHING COATINGS	350
FIRE RESISTIVE COATINGS	350
FLOOR COATINGS	100
FORM-RELEASE COMPOUNDS	250
GRAPHIC ARTS COATINGS (SIGN PAINTS)	500
HIGH TEMPERATURE COATINGS	420
INDUSTRIAL MAINTENANCE COATINGS	250
LOW SOLIDS COATINGS ¹	120
MAGNESITE CEMENT COATINGS	450
MASTIC TEXTURE COATINGS	100
METALLIC PIGMENTED COATINGS	500
MULTICOLOR COATINGS	250
PRETREATMENT WASH PRIMERS	420
PRIMERS, SEALERS, & UNDERCOATERS	100
REACTIVE PENETRATING SEALERS	350
RECYCLED COATINGS	250
ROOF COATINGS	50
RUST PREVENTATIVE COATINGS	250
SHELLACS	
CLEAR	730
OPAQUE	550
SPECIALTY PRIMERS, SEALERS & UNDERCOATERS	100
STAINS	250

Adhesives, sealant and caulks used on the project shall meet the

TABLE 4.504.3 - VOC CONTENT LIMITS FOR ARCHITECTURAL COATINGS³

SPECIALTY COATINGS (CONT.)	VOC LIMIT
STONE CONSOLIDANTS	450
SWIMMING POOL COATINGS	340
TRAFFIC MARKING COATINGS	100
TUB & TILE REFINISH COATINGS	420
WATERPROOFING MEMBRANES	250
WOOD COATINGS	275
WOOD PRESERVATIVES	350
ZINC-RICH PRIMERS	340
1. GRAMS OF VOC PER LITER OF COATING, INCLUDING WATER & EXEMPT COMPOUNDS	
2. THE SPECIFIED LIMITS REMAIN IN EFFECT UNLESS REVISED LIMITS ARE LISTED IN SUBSEQUENT COLUMNS IN THE TABLE.	
3. VALUES IN THIS TABLE ARE DERIVED FROM THOSE SPECIFIED BY THE CALIFORNIA AIR RESOURCES BOARD, ARCHITECTURAL COATINGS SUGGESTED CONTROL MEASURE, FEB. 1, 2008. MORE INFORMATION IS AVAILABLE FROM THE AIR RESOURCES BOARD.	

TABLE 4.504.5 - FORMALDEHYDE LIMITS¹

MAXIMUM FORMALDEHYDE EMISSIONS IN PARTS PER MILLION

PRODUCT	CURRENT LIMIT
HARDWOOD PLYWOOD VENEER CORE	0.05
HARDWOOD PLYWOOD COMPOSITE CORE	0.05
PARTICLE BOARD	0.09
MEDIUM DENSITY FIBERBOARD	0.11
THIN MEDIUM DENSITY FIBERBOARD ²	0.13
1. VALUES IN THIS TABLE ARE DERIVED FROM THOSE SPECIFIED BY THE CALIF. AIR RESOURCES BOARD, AIR TOXIC CONTROL MEASURE FOR COMPOSITE WOOD AS TESTED IN ACCORDANCE WITH ASTM E 1333. FOR ADDITIONAL INFORMATION, SEE CALIF. CODE OF REGULATIONS, TITLE 17, SECTIONS 93120 THROUGH 93120.12.	
2. THIN MEDIUM DENSITY FIBERBOARD HAS A MAXIMUM THICKNESS OF 5/16" (8 MM).	

DIVISION 4.5 ENVIRONMENTAL QUALITY (CONT.)

4.504.3 CARPET SYSTEMS. All carpet installed in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specification 01350)

See California Department of Public Health's website for certification programs and testing labs.

<https://www.cdph.ca.gov/Programs/CDC/PHP/DEODC/EHLB/IAQ/Pages/VOC.aspx>.

4.504.3.1 Carpet cushion. All carpet cushion installed in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specification 01350)

See California Department of Public Health's website for certification programs and testing labs.

<https://www.cdph.ca.gov/Programs/CDC/PHP/DEODC/EHLB/IAQ/Pages/VOC.aspx>.

4.504.3.2 Carpet adhesive. All carpet adhesive shall meet the requirements of Table 4.504.1.

4.504.4 RESILIENT FLOORING SYSTEMS. Where resilient flooring is installed, at least 80% of floor area receiving resilient flooring shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specification 01350)

See California Department of Public Health's website for certification programs and testing labs.

<https://www.cdph.ca.gov/Programs/CDC/PHP/DEODC/EHLB/IAQ/Pages/VOC.aspx>.

4.504.5 COMPOSITE WOOD PRODUCTS. Hardwood plywood, particleboard and medium density fiberboard composite wood products used on the interior or exterior of the buildings shall meet the requirements for formaldehyde as specified in ARB's Air Toxic Control Measure for Composite Wood (17 CCR 93120 et seq.), by or before the dates specified in those sections, as shown in Table 4.504.5

4.504.5.1 Documentation. Verification of compliance with this section shall be provided as requested by the enforcing agency. Documentation shall include at least one of the following:

1. Product certifications and specifications.
2. Chain of custody certifications.
3. Product labeled and invoiced as meeting the Composite Wood Products regulation (see CCR, Title 17, Section 93120, et seq.).
4. Exterior grade products marked as meeting the PS-1 or PS-2 standards of the Engineered Wood Association, the Australian AS/NZS 2269, European 636 3S standards, and Canadian CSA 0121, CSA 0151, CSA 0153 and CSA 0325 standards.
5. Other methods acceptable to the enforcing agency.

4.505 INTERIOR MOISTURE CONTROL

4.505.1 General. Buildings shall meet or exceed the provisions of the *California Building Standards Code*.

4.505.2 CONCRETE SLAB FOUNDATIONS. Concrete slab foundations required to have a vapor retarder by California Building Code, Chapter 19, or concrete slab-on-ground floors required to have a vapor retarder by the California Residential Code, Chapter 5, shall also comply with this section.

4.505.2.1 Capillary break. A capillary break shall be installed in compliance with at least one of the following:

1. A 4-inch (101.6 mm) thick base of 1/2 inch (12.7mm) or larger clean aggregate shall be provided with a vapor barrier in direct contact with concrete and a concrete mix design, which will address bleeding, shrinkage, and curling, shall be used. For additional information, see American Concrete Institute, ACI 302.2R-06.
2. Other equivalent methods approved by the enforcing agency.
3. A slab design specified by a licensed design professional.

4.505.3 MOISTURE CONTENT OF BUILDING MATERIALS. Building materials with visible signs of water damage shall not be installed. Wall and floor framing shall not be enclosed when the framing members exceed 19 percent moisture content. Moisture content shall be verified in compliance with the following:

1. Moisture content shall be determined with either a probe-type or contact-type moisture meter. Equivalent moisture verification methods may be approved by the enforcing agency and shall satisfy requirements found in Section 101.8 of this code.
2. Moisture readings shall be taken at a point 2 feet (610 mm) to 4 feet (1219 mm) from the grade stamped end of each piece verified.
3. At least three random moisture readings shall be performed on wall and floor framing with documentation acceptable to the enforcing agency provided at the time of approval to enclose the wall and floor framing.

Insulation products which are visibly wet or have a high moisture content shall be replaced or allowed to dry prior to enclosure in wall or floor cavities. Wet-applied insulation products shall follow the manufacturers' drying recommendations prior to enclosure.

DIVISION 4.5 ENVIRONMENTAL QUALITY

SECTION 4.501 GENERAL

4.501.1 Scope

The provisions of this chapter shall outline means of reducing the quality of air contaminants that are odorous, irritating and/or harmful to the comfort and well being of a building's installers, occupants and neighbors.

SECTION 4.502 DEFINITIONS

5.102.1 DEFINITIONS
The following terms are defined in Chapter 2 (*and are included here for reference*)

AGRIFIBER PRODUCTS. Agrifiber products include wheatboard, strawboard, panel substrates and door cores, not including furniture, fixtures and equipment (FF&E) not considered base building elements.

COMPOSITE WOOD PRODUCTS. Composite wood products include hardwood plywood, particleboard and medium density fiberboard. "Composite wood products" does not include hardboard, structural plywood, structural panels, structural composite lumber, oriented strand board, glued laminated timber, prefabricated wood I-joists or finger-jointed lumber, all as specified in California Code of regulations (CCR), title 17, Section 93120.1.

DIRECT-VENT APPLIANCE. A fuel-burning appliance with a sealed combustion system that draws all air for combustion from the outside atmosphere and discharges all flue gases to the outside atmosphere.
MAXIMUM INCREMENTAL REACTIVITY (MIR). The maximum change in weight of ozone formed by adding a compound to the "Base Reactive Organic Gas (ROG) Mixture" per weight of compound added, expressed to hundredths of a gram (g O₃/g ROG)
Note: MIR values for individual compounds and hydrocarbon solvents are specified in CCR, Title 17, Sections 94700 and 94701.

MOISTURE CONTENT. The weight of the water in wood expressed in percentage of the weight of the oven-dry wood.

PRODUCT-WEIGHTED MIR (PWMIR). The sum of all weighted-MIR for all ingredients in a product subject to this article. The PWMIR is the total product reactivity expressed to hundredths of a gram of ozone formed per gram of product (excluding container and packaging).
Note: PWMIR is calculated according to equations found in CCR, Title 17, Section 94521 (a).

REACTIVE ORGANIC COMPOUND (ROC). Any compound that has the potential, once emitted, to contribute to ozone formation in the troposphere.

VOC. A volatile organic compound (VOC) broadly defined as a chemical compound based on carbon chains or rings with vapor pressures greater than 0.1 millimeters of mercury at room temperature. These compounds typically contain hydrogen and may contain oxygen, nitrogen and other elements. See CCR Title 17, Section 94508(a).

4.503 FIREPLACES

4.503.1 GENERAL. Any installed gas fireplace shall be a direct-vent sealed-combustion type. Any installed woodstove or pellet stove shall comply with U.S. EPA New Source Performance Standards (NSPS) emission limits as applicable, and shall have a permanent label indicating they are certified to meet the emission limits. Woodstoves, pellet stoves and fireplaces shall also comply with applicable local ordinances.

4.504 POLLUTANT CONTROL

4.504.1 COVERING OF DUCT OPENINGS & PROTECTION OF MECHANICAL EQUIPMENT DURING CONSTRUCTION. At the time of rough installation, during storage on the construction site and until final startup of the heating, cooling and ventilating equipment, all duct and other related air distribution component openings shall be covered with tape, plastic, sheet metal or other methods acceptable to the enforcing agency to reduce the amount of water, dust or debris which may enter the system.

4.504.2 FINISH MATERIAL POLLUTANT CONTROL. Finish materials shall comply with this section.

4.504.2.1 Adhesives, Sealants and Caulks. Adhesives, sealant and caulks used on the project shall meet the requirements of the following standards unless more stringent local or regional air pollution or air quality management district rules apply:

1. Adhesives, adhesive bonding primers, adhesive primers, sealants, sealant primers and caulks shall comply with local or regional air pollution control or air quality management district rules where applicable or SCAQMD Rule 1168 VOC limits, as shown in Table 4.504.1 or 4.504.2, as applicable. Such products also shall comply with the Rule 1168 prohibition on the use of certain toxic compounds (chloroform, ethylene dichloride, methylene chloride, perchloroethylene and trichloroethylene), except for aerosol products, as specified in Subsection 2 below.
2. Aerosol adhesives, and smaller unit sizes of adhesives, and sealant or caulking compounds (in units of product, less packaging, which do not weigh more than 1 pound and do not consist of more than 16 fluid ounces) shall comply with statewide VOC standards and other requirements, including prohibitions on use of certain toxic compounds, of *California Code of Regulations*, Title 17, commencing with section 94507.

4.504.2.2 Paints and Coatings. Architectural paints and coatings shall comply with VOC limits in Table 1 of the ARB Architectural Suggested Control Measure, as shown in Table 4.504.3, unless more stringent local limits apply. The VOC content limit for coatings that do not meet the definitions for the specialty coatings categories listed in Table 4.504.3 shall be determined by classifying the coating as a Flat, Nonflat or Nonflat-High Gloss coating, based on its gloss, as defined in subsections 4.21, 4.36, and 4.37 of the 2007 California Air Resources Board, Suggested Control Measure, and the corresponding Flat, Nonflat or Nonflat-High Gloss VOC limit in Table 4.504.3 shall apply.

4.504.2.3 Aerosol Paints and Coatings. Aerosol paints and coatings shall meet the Product-weighted MIR Limits for ROC in Section 94522(a)(2) and other requirements, including prohibitions on use of certain toxic compounds and ozone depleting substances, in Sections 94522(e)(1) and (f)(1) of *California Code of Regulations*, Title 17, commencing with Section 94520, and in areas under the jurisdiction of the Bay Area Air Quality Management District additionally comply with the percent VOC by weight of product limits of Regulation 8, Rule 49.













4.504.2.4 Verification. Verification of compliance with this section shall be provided at the request of the enforcing agency. Documentation may include, but is not limited to, the following:

1. Manufacturer's product specification.
2. Field verification of on-site product containers.

TABLE 4.504.1 - ADHESIVE VOC LIMIT^{1,2}

(Less Water and Less Exempt Compounds in Grams per Liter)


ARCHITECTURAL APPLICATIONS	VOC LIMIT
INDOOR CARPET ADHESIVES	50
CARPET PAD ADHESIVES	50
OUTDOOR CARPET ADHESIVES	150
WOOD FLOORING ADHESIVES	100
RUBBER FLOOR ADHESIVES	60
SUBFLOOR ADHESIVES	50
CERAMIC TILE ADHESIVES	65
VCT & ASPHALT TILE ADHESIVES	50
DRYWALL & PANEL ADHESIVES	50
COVE BASE ADHESIVES	50
MULTIPURPOSE CONSTRUCTION ADHESIVE	70
STRUCTURAL GLAZING ADHESIVES	100
SINGLE-PLY ROOF MEMBRANE ADHESIVES	250
OTHER ADHESIVES NOT LISTED	50

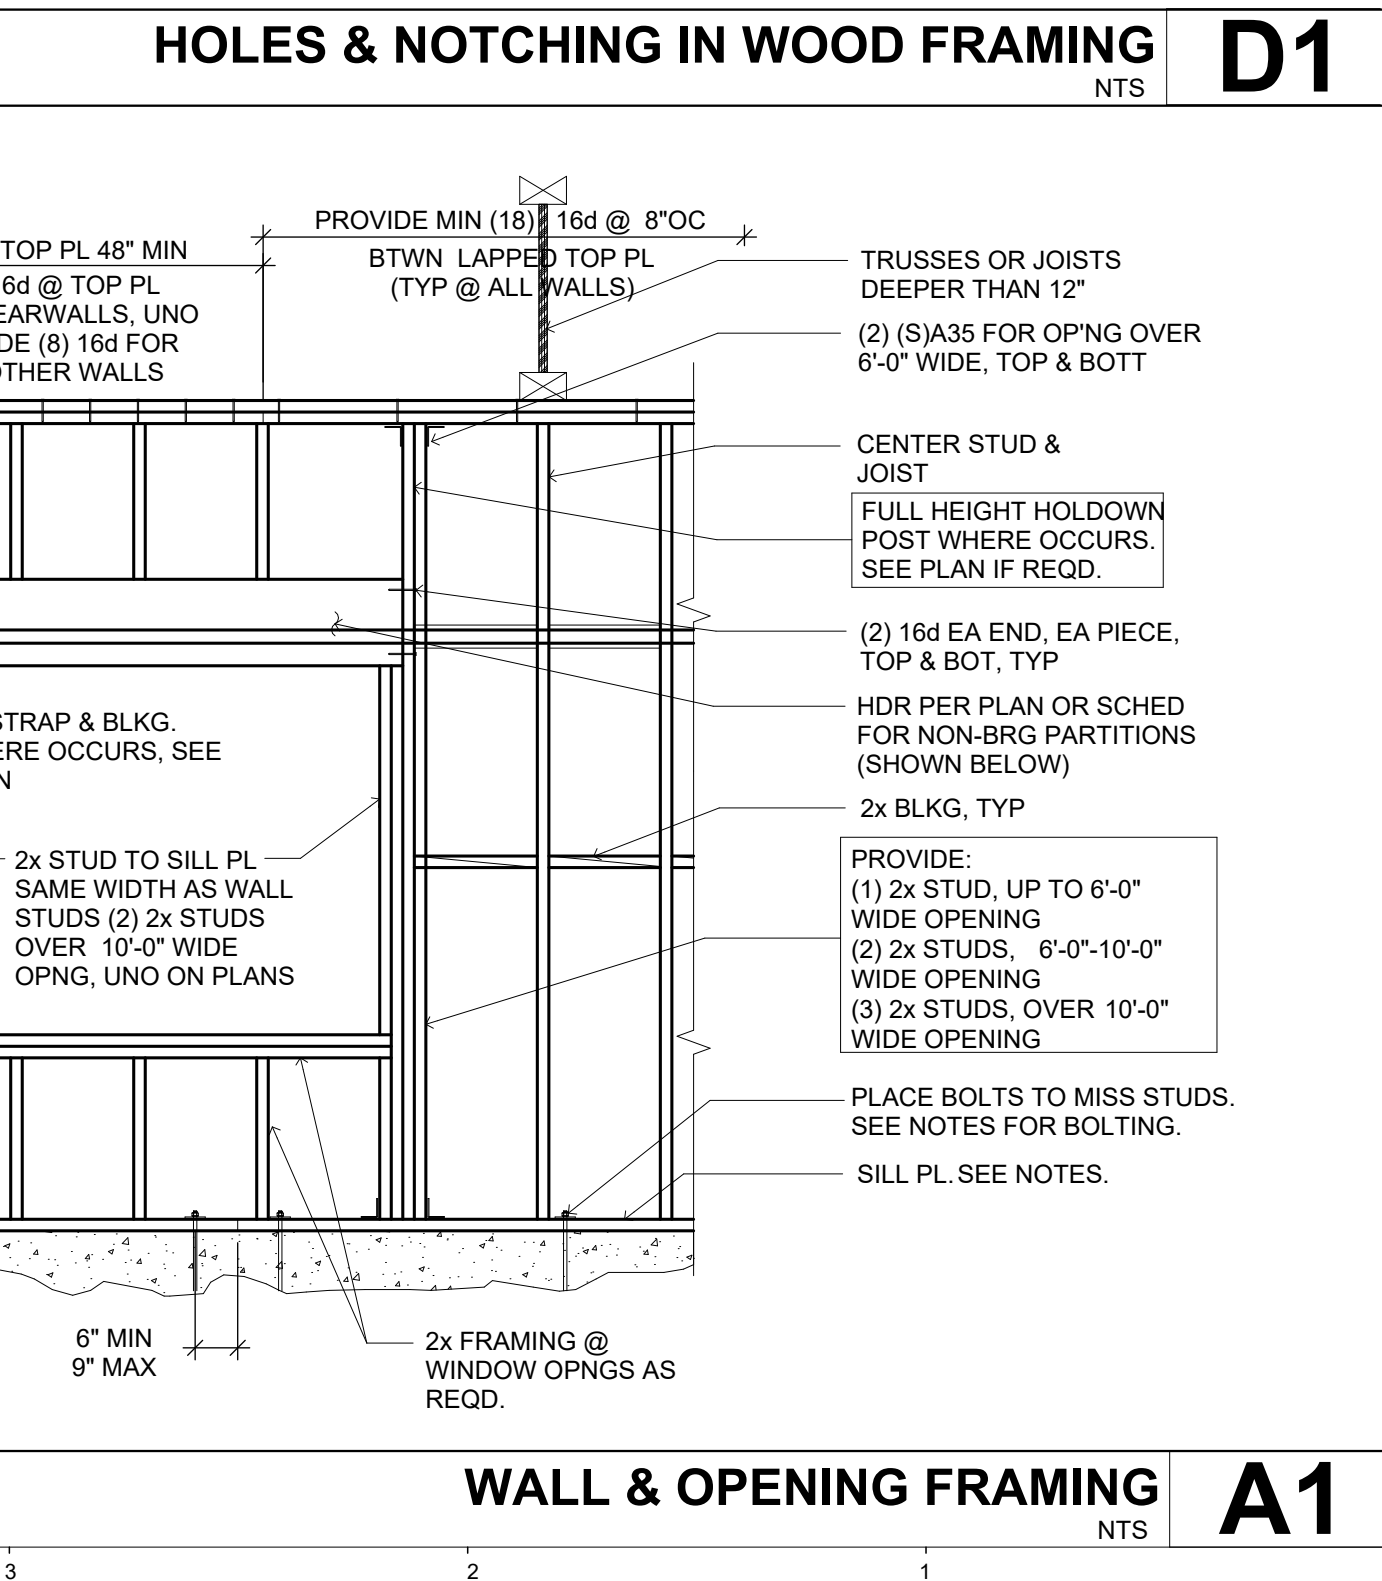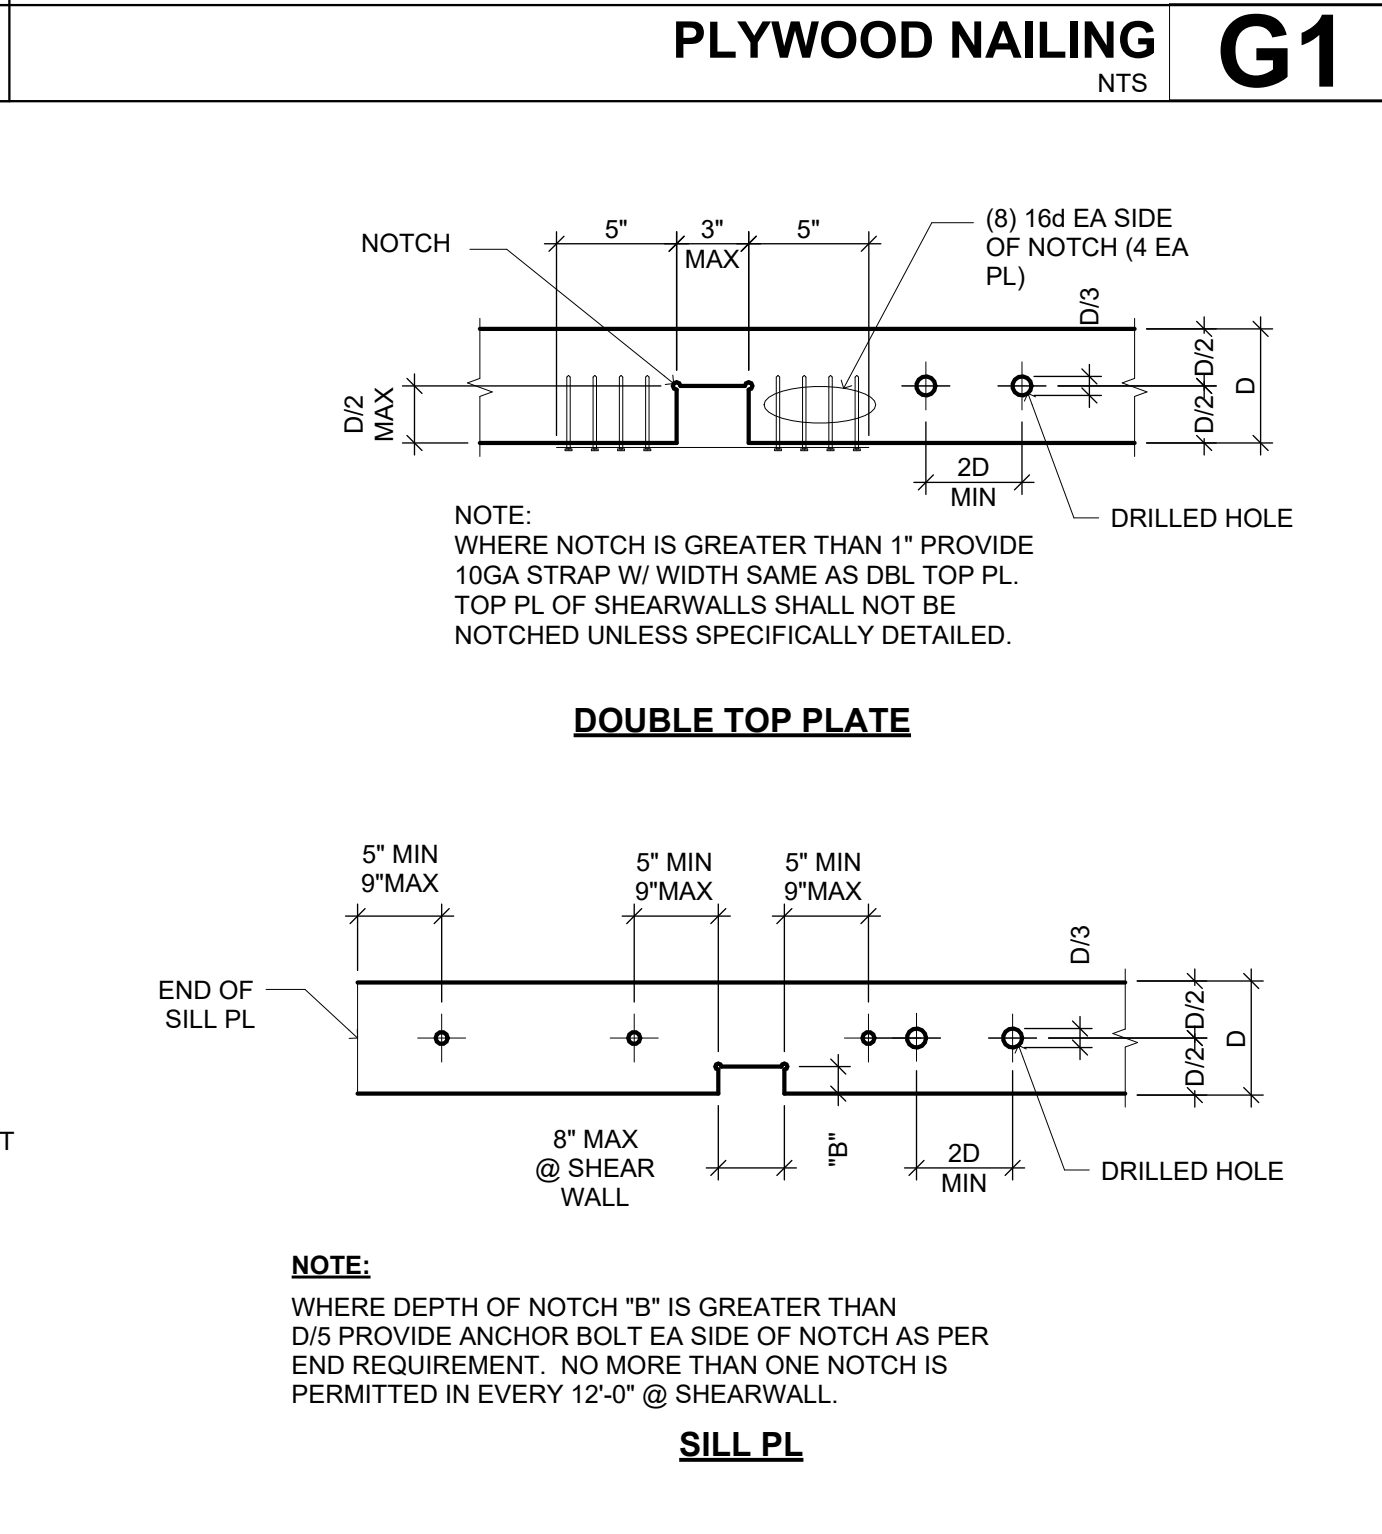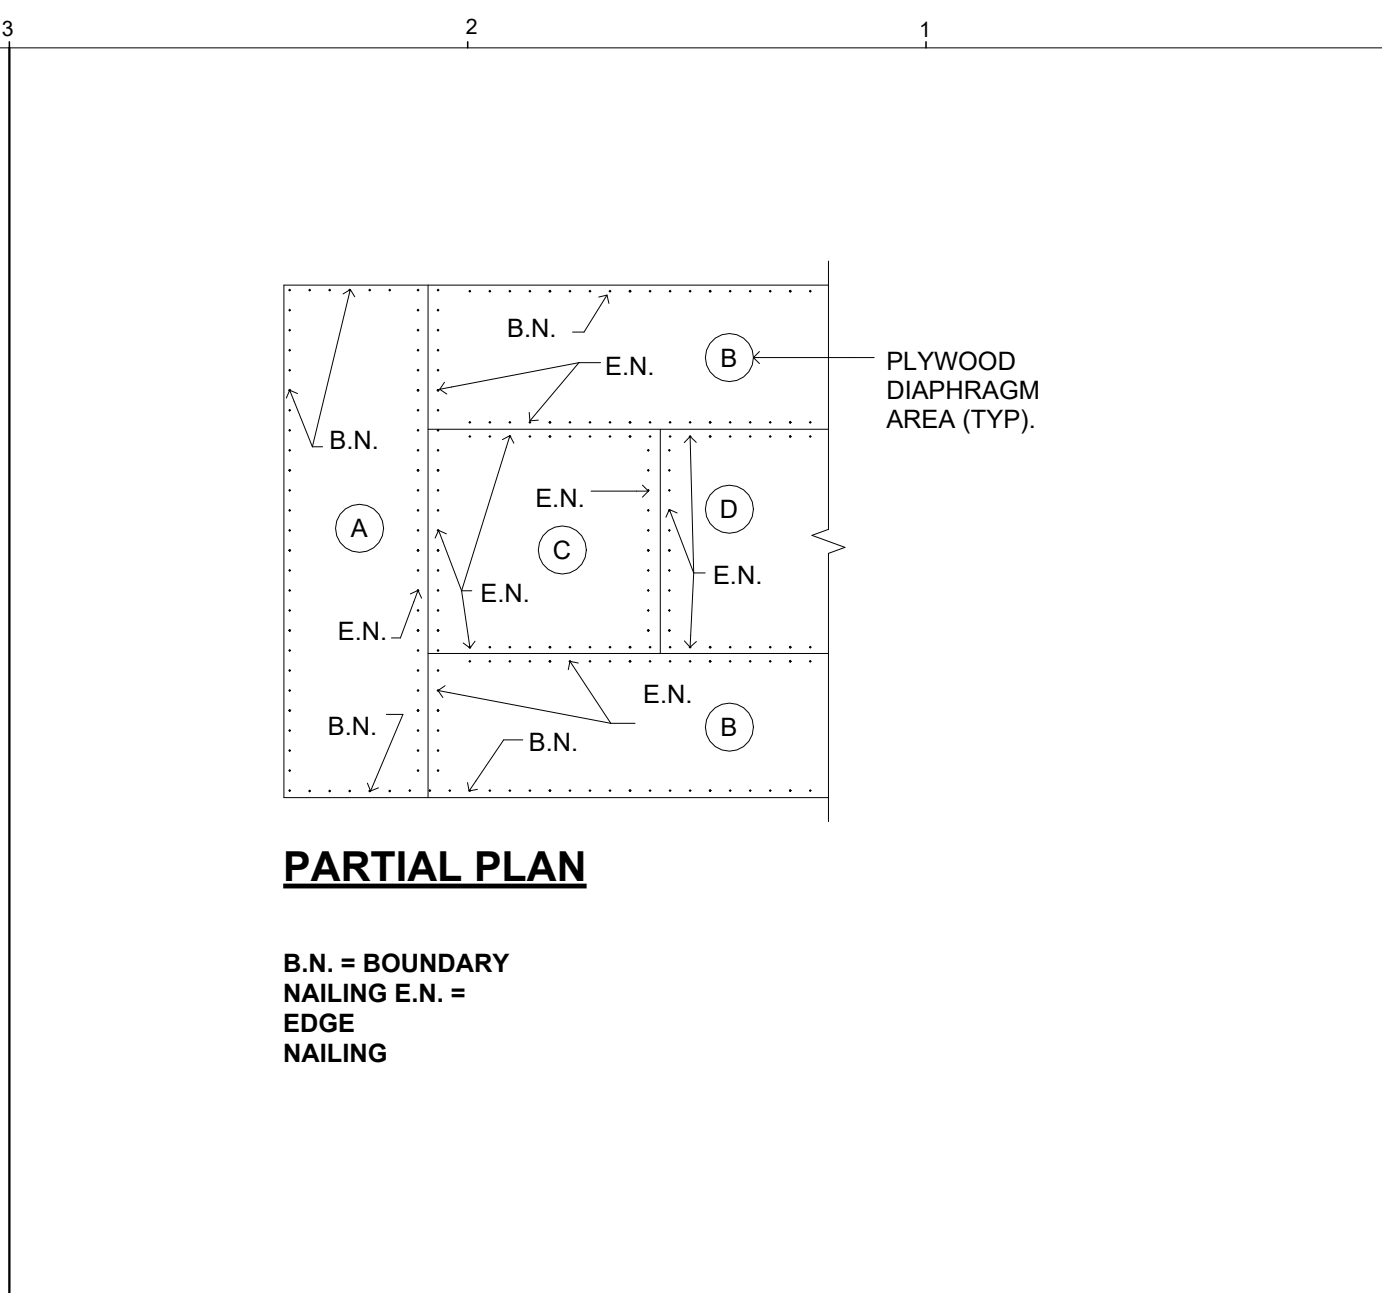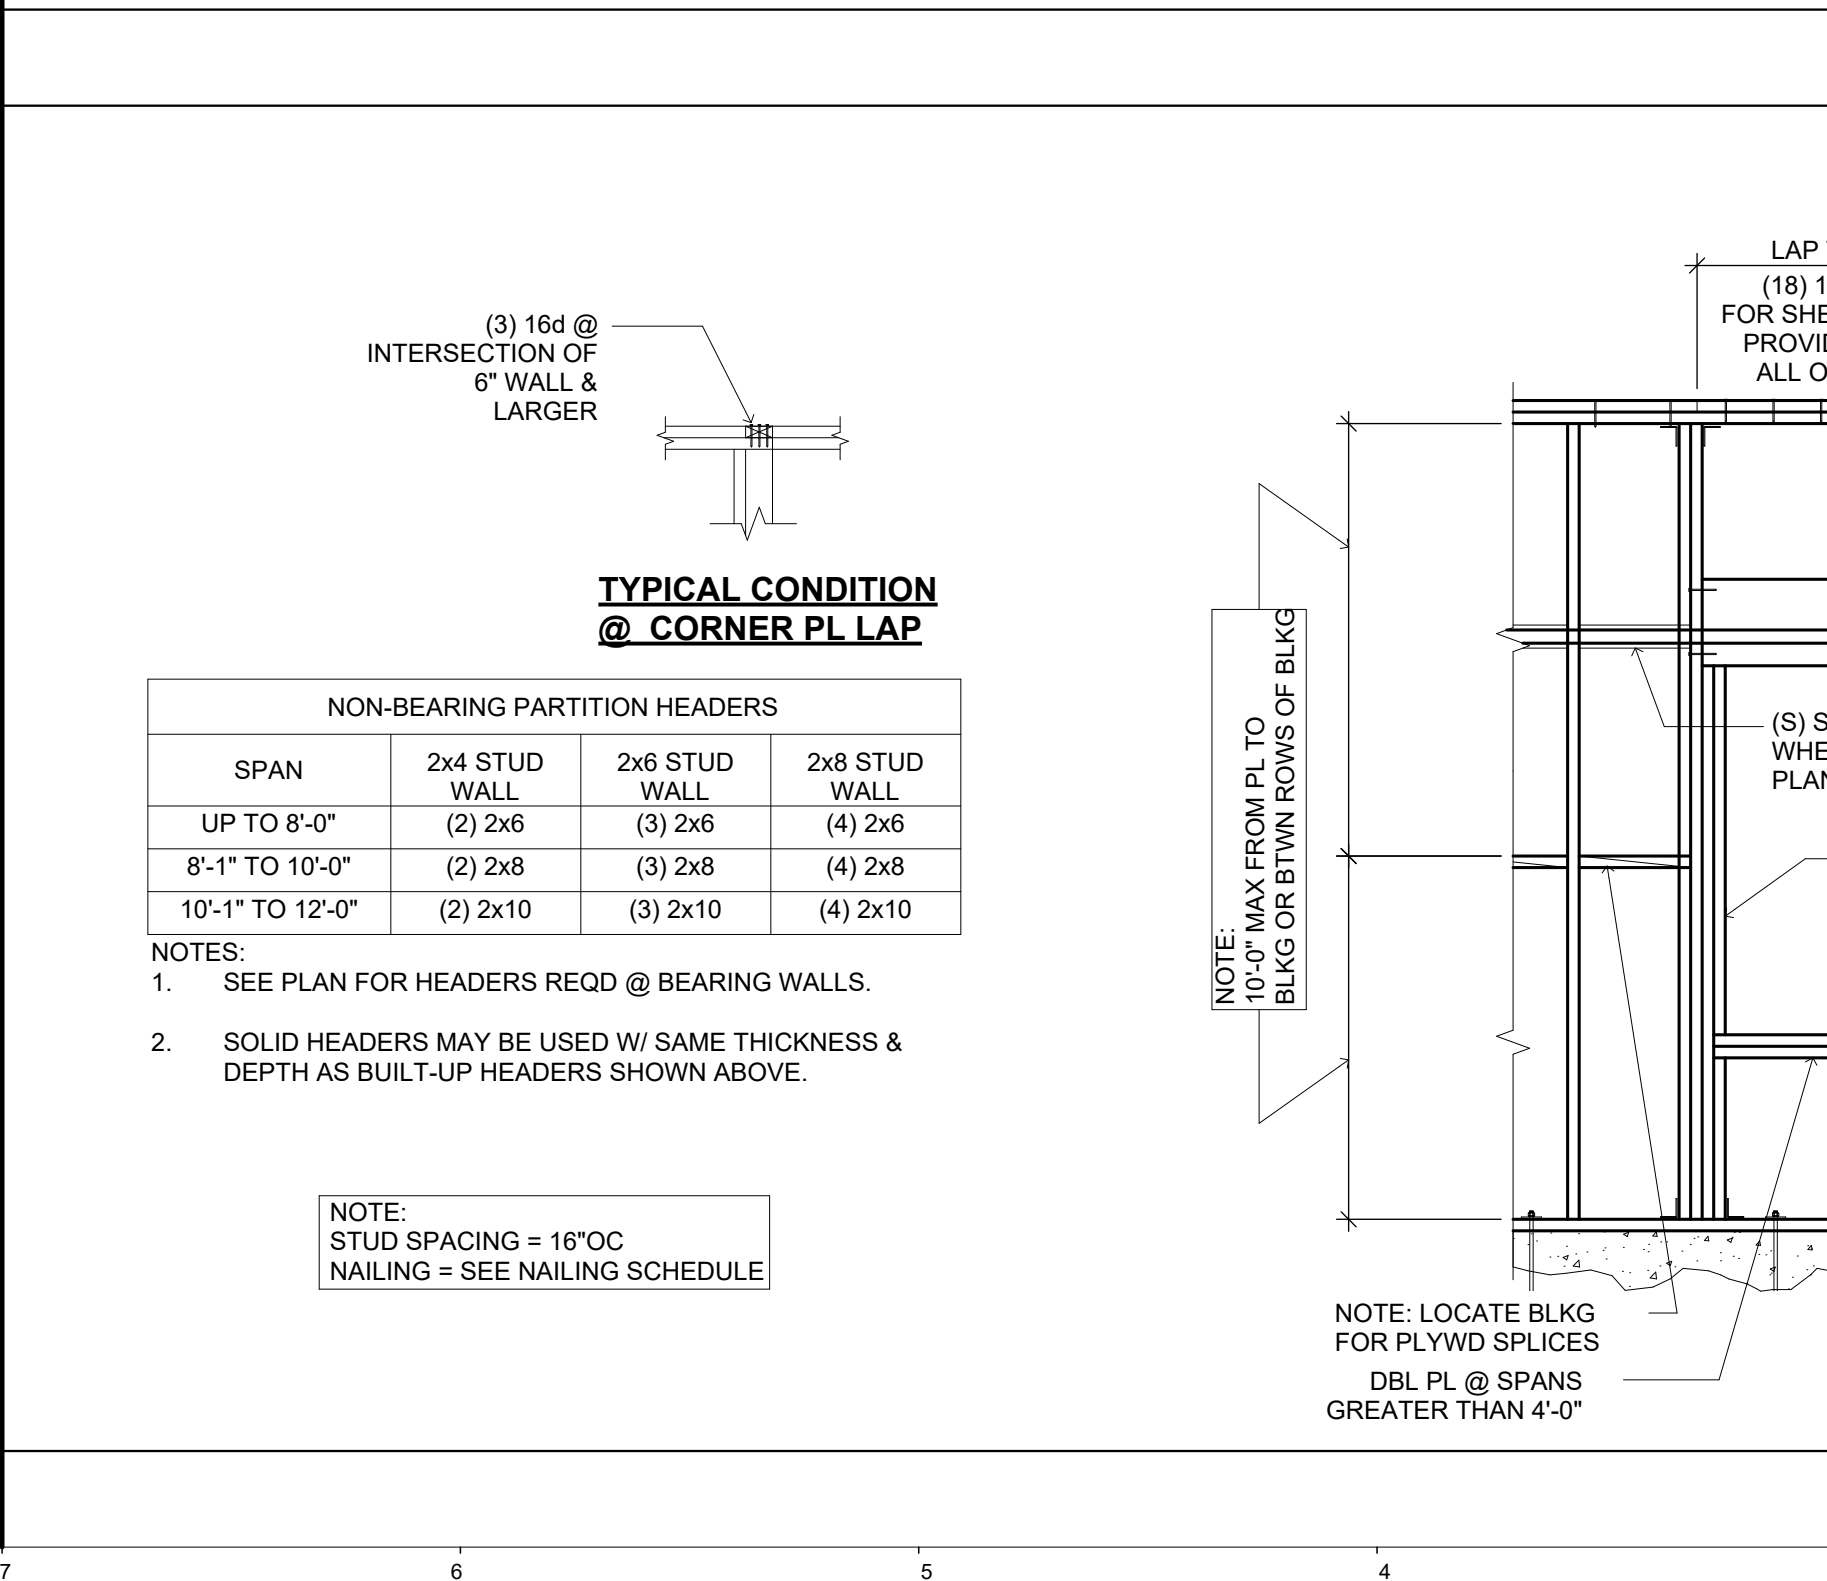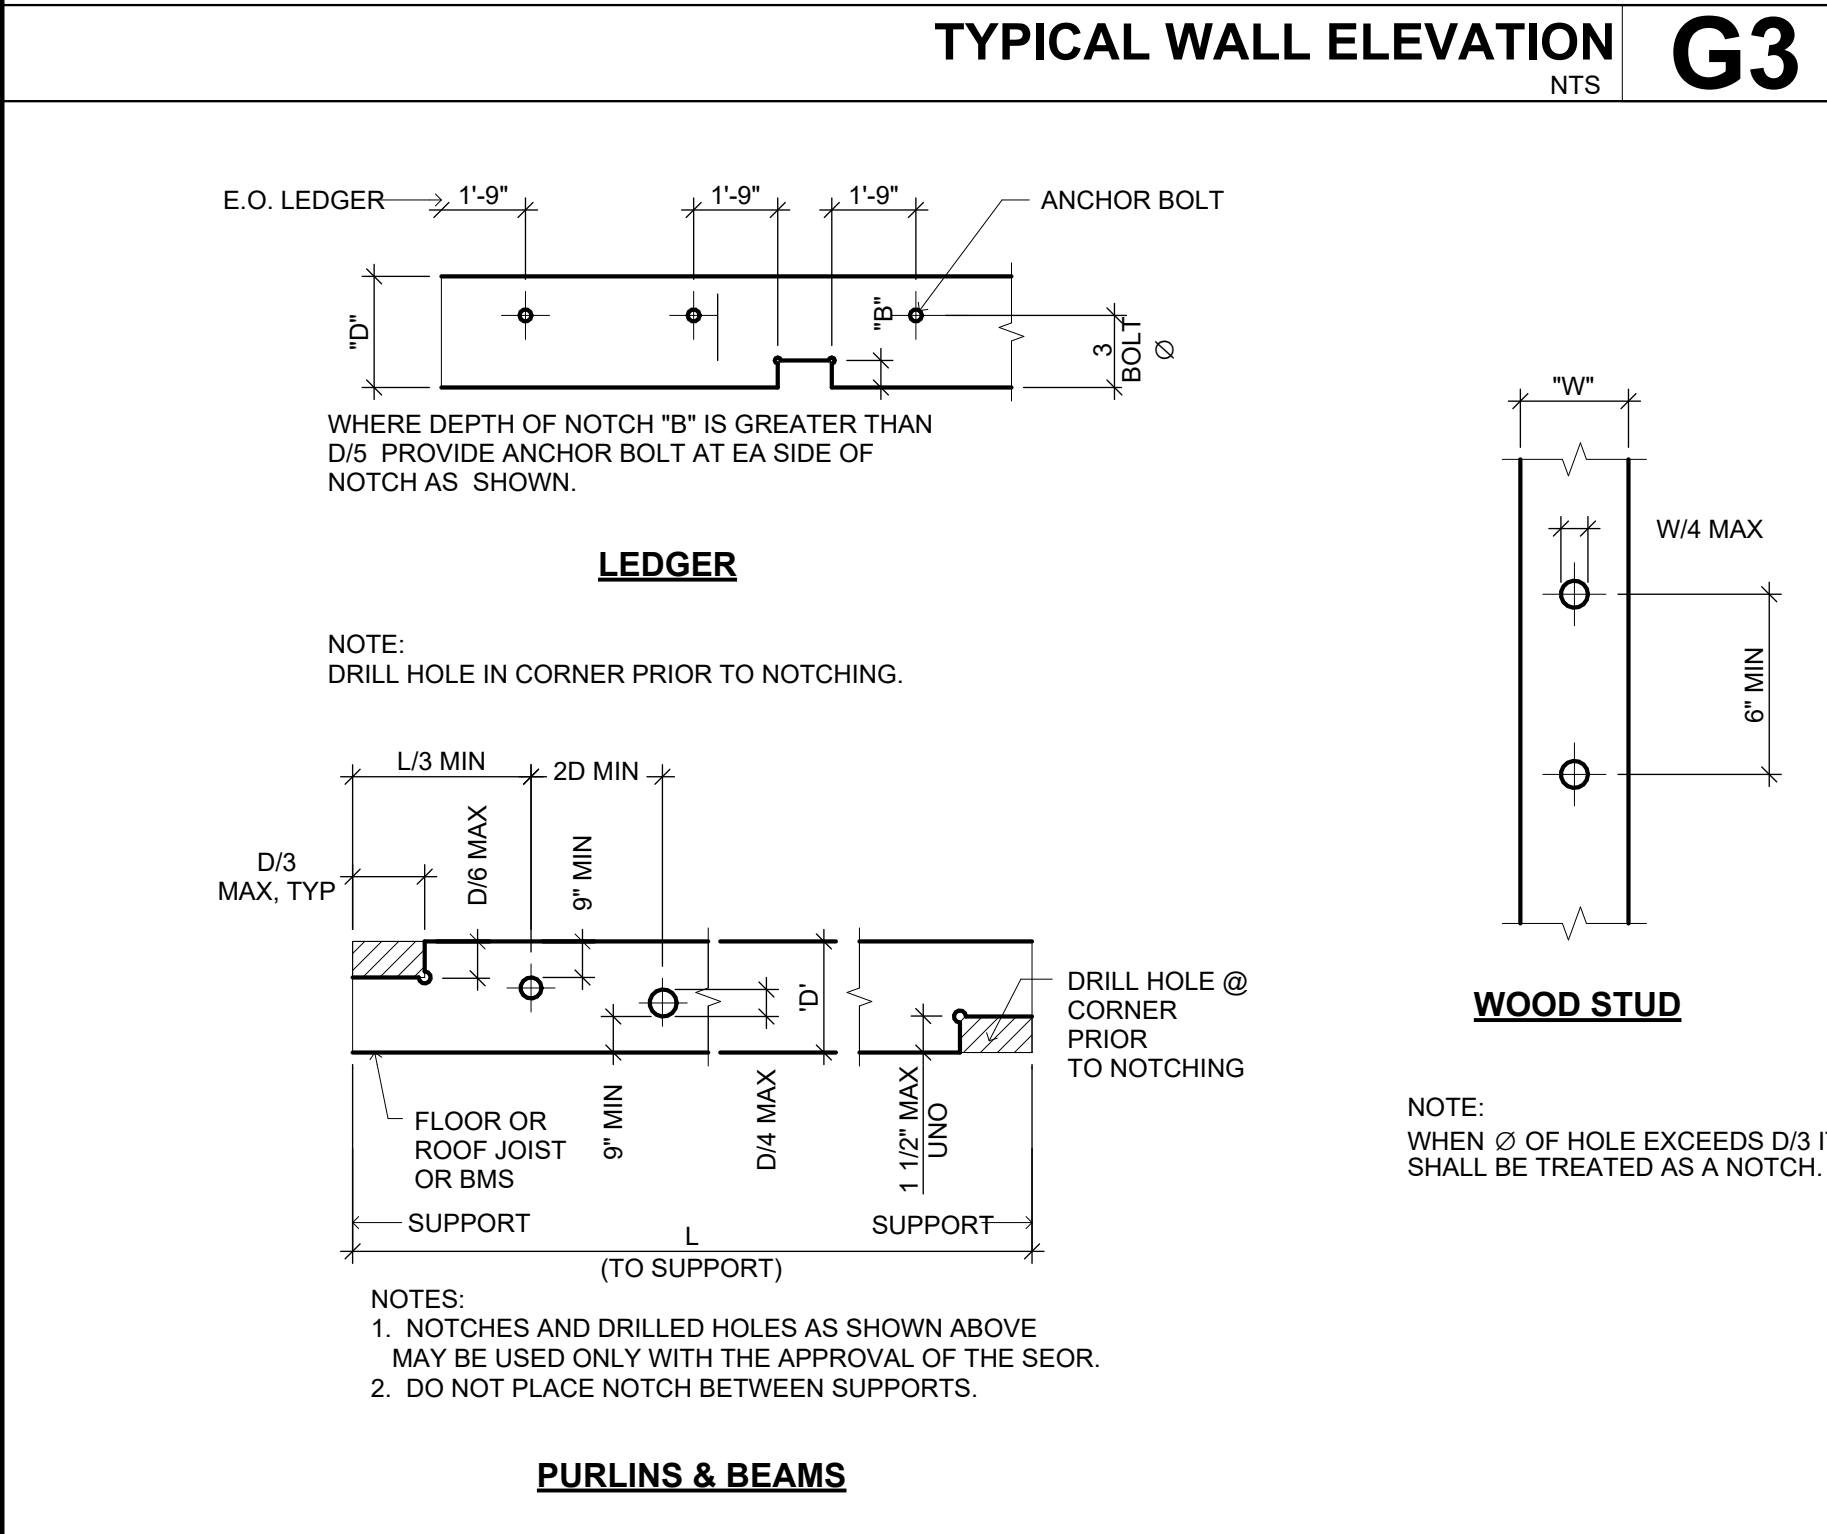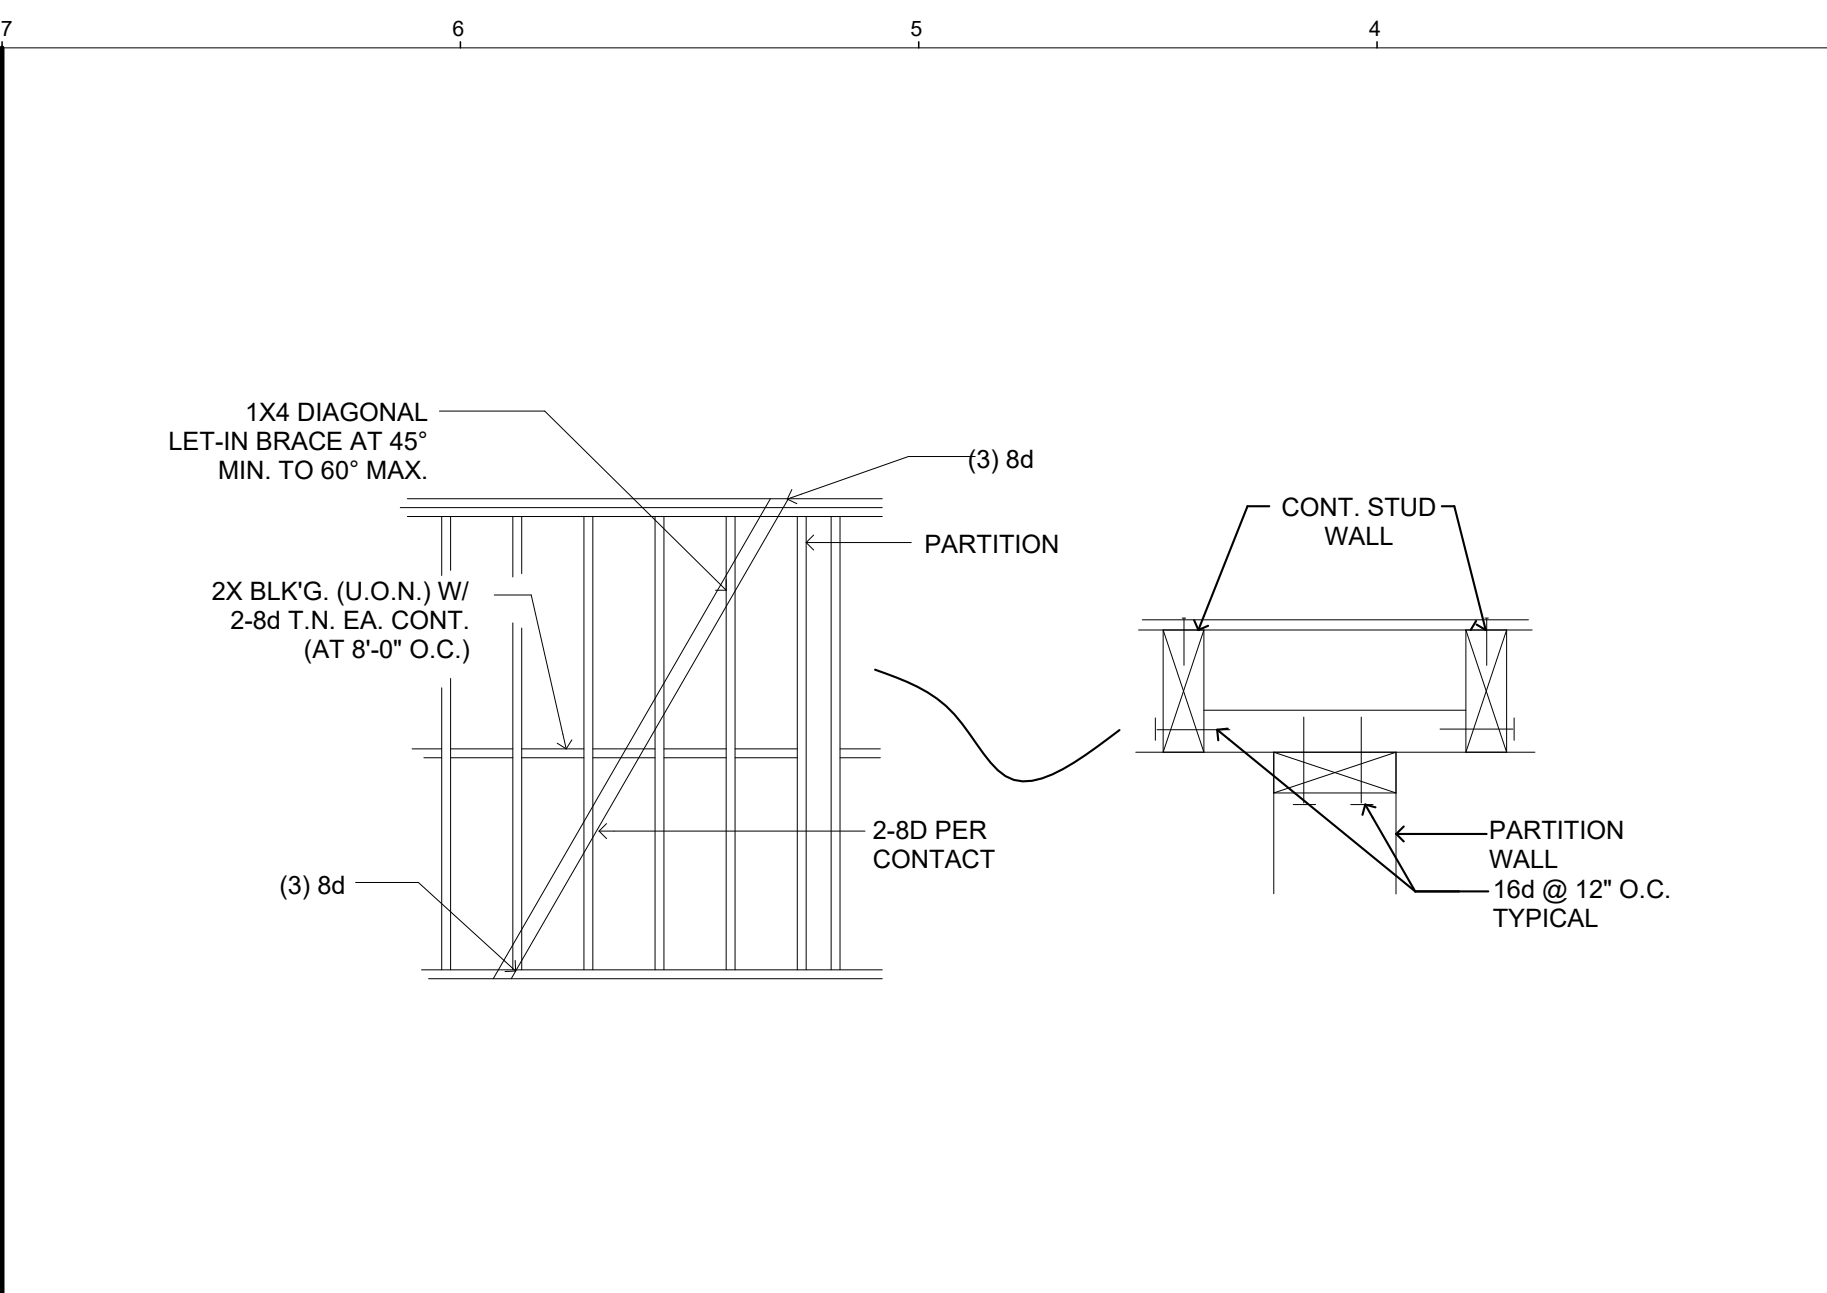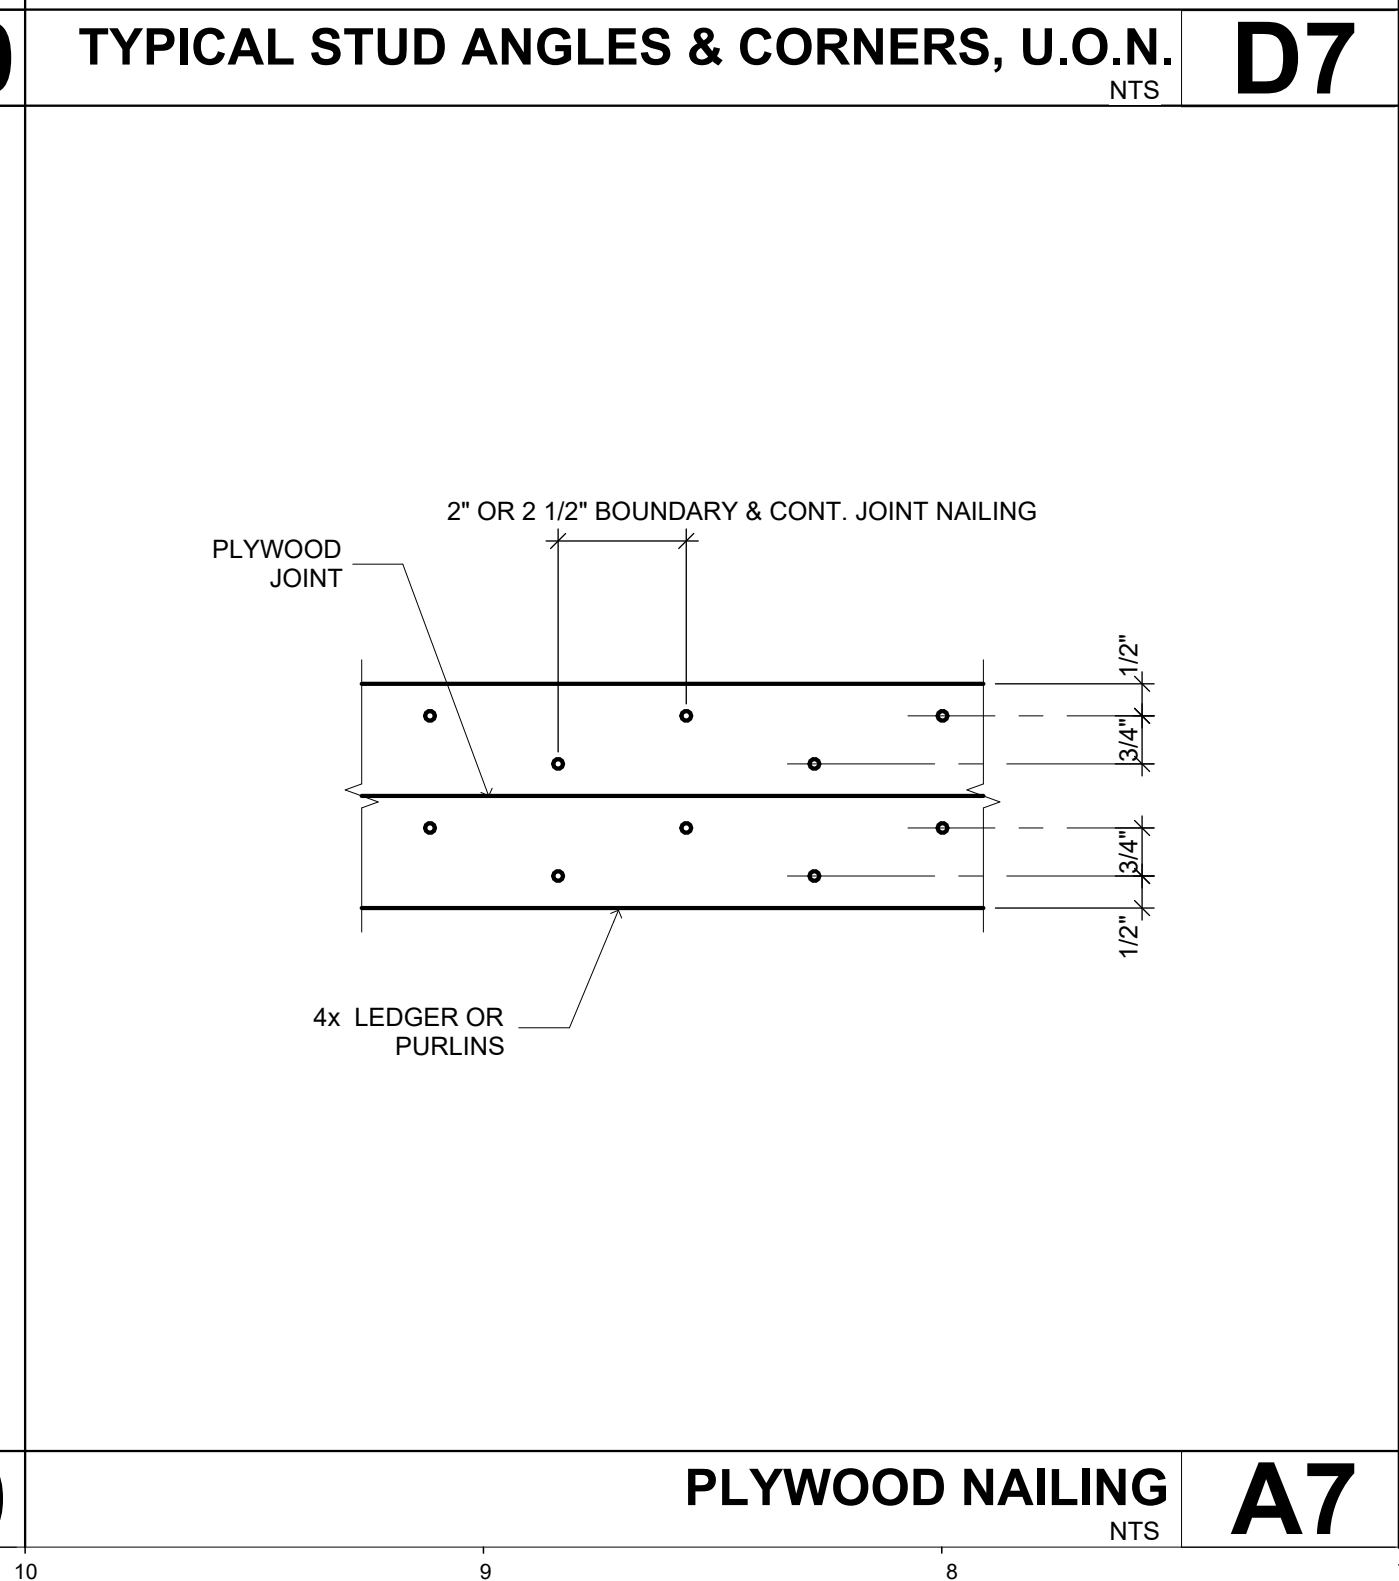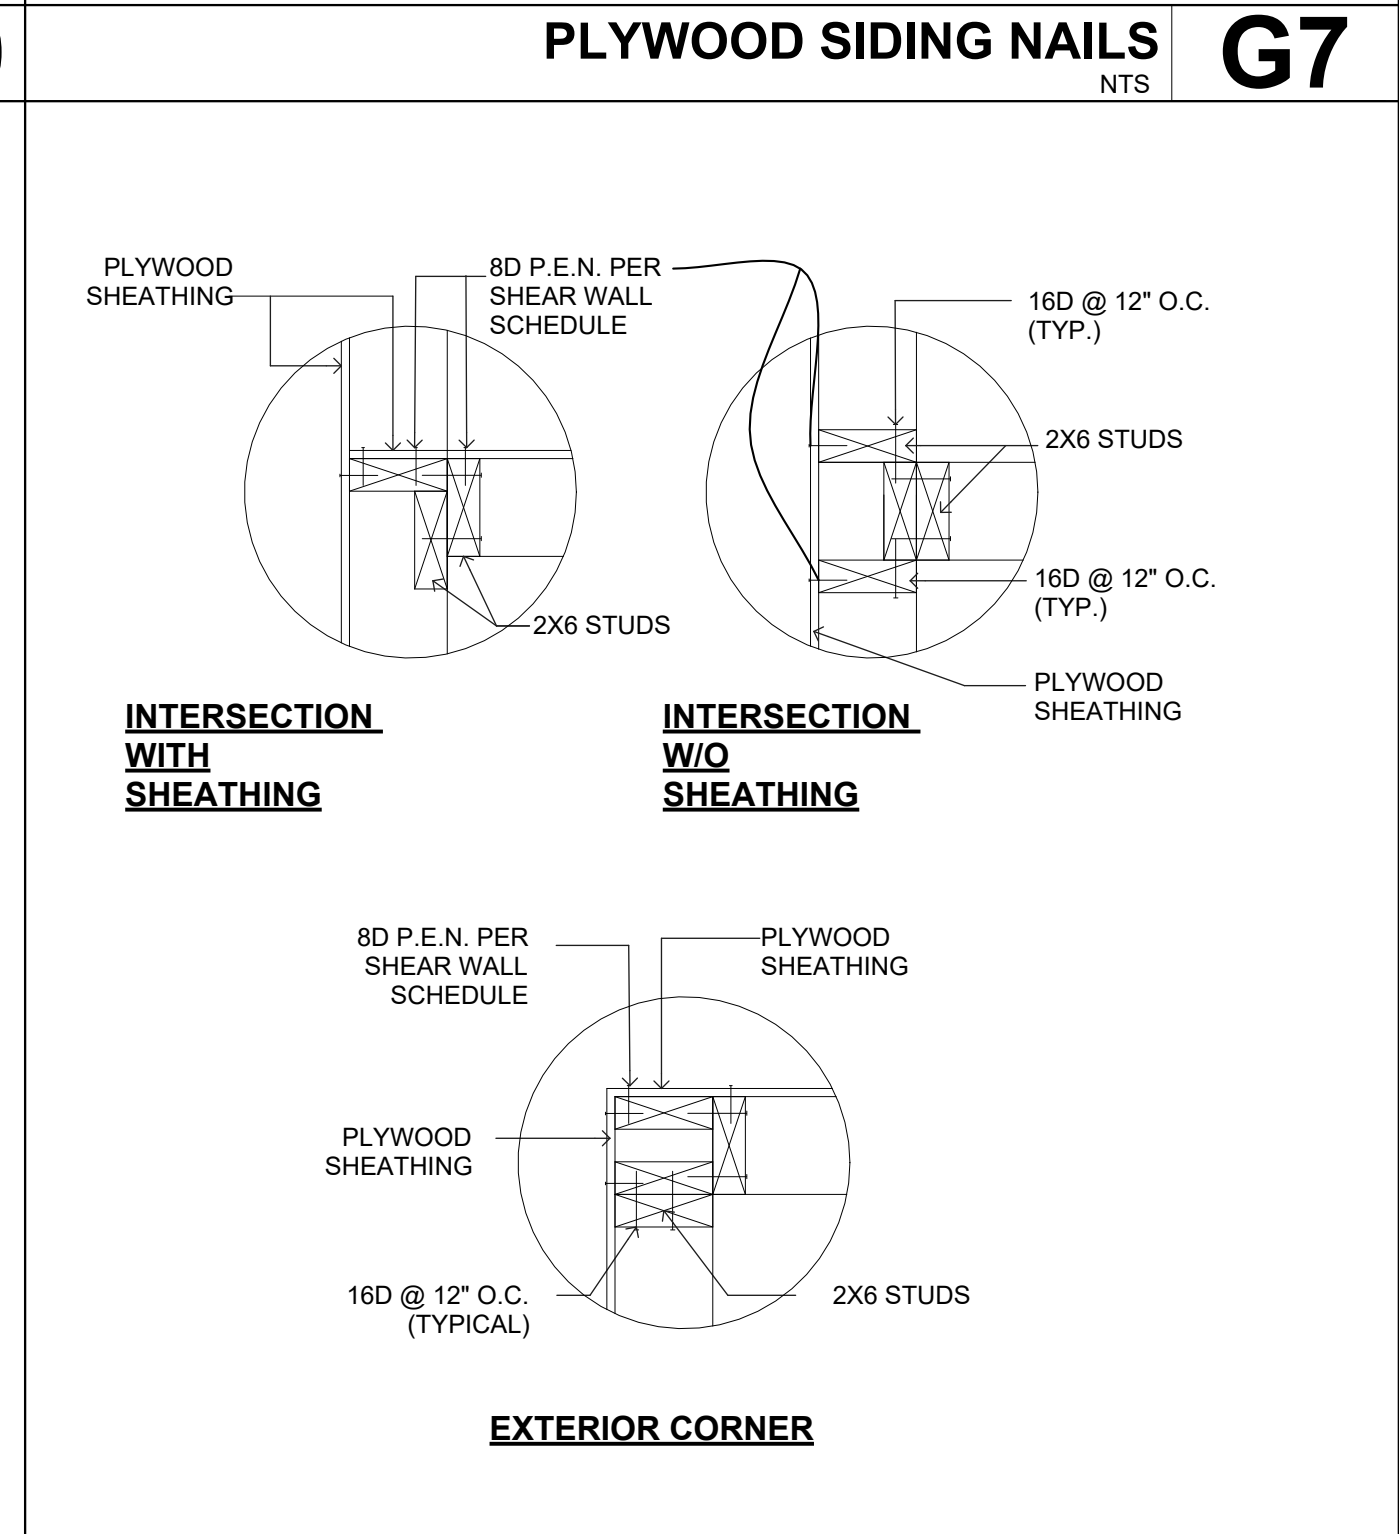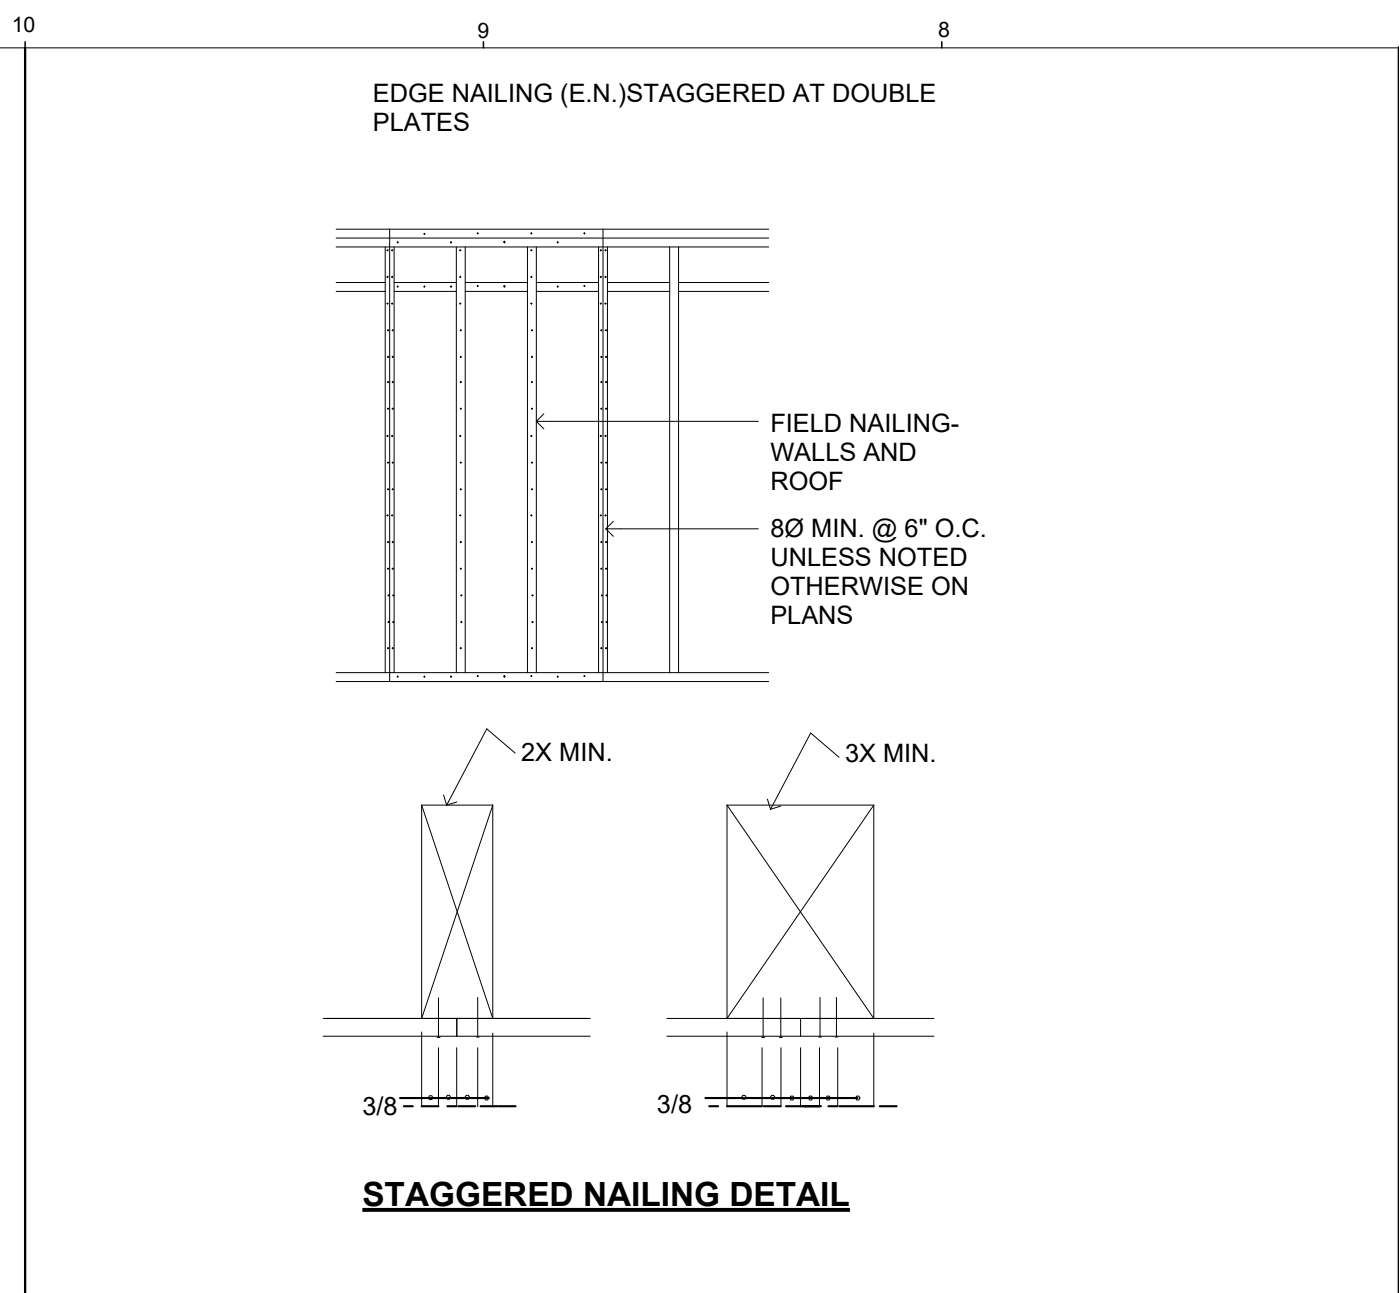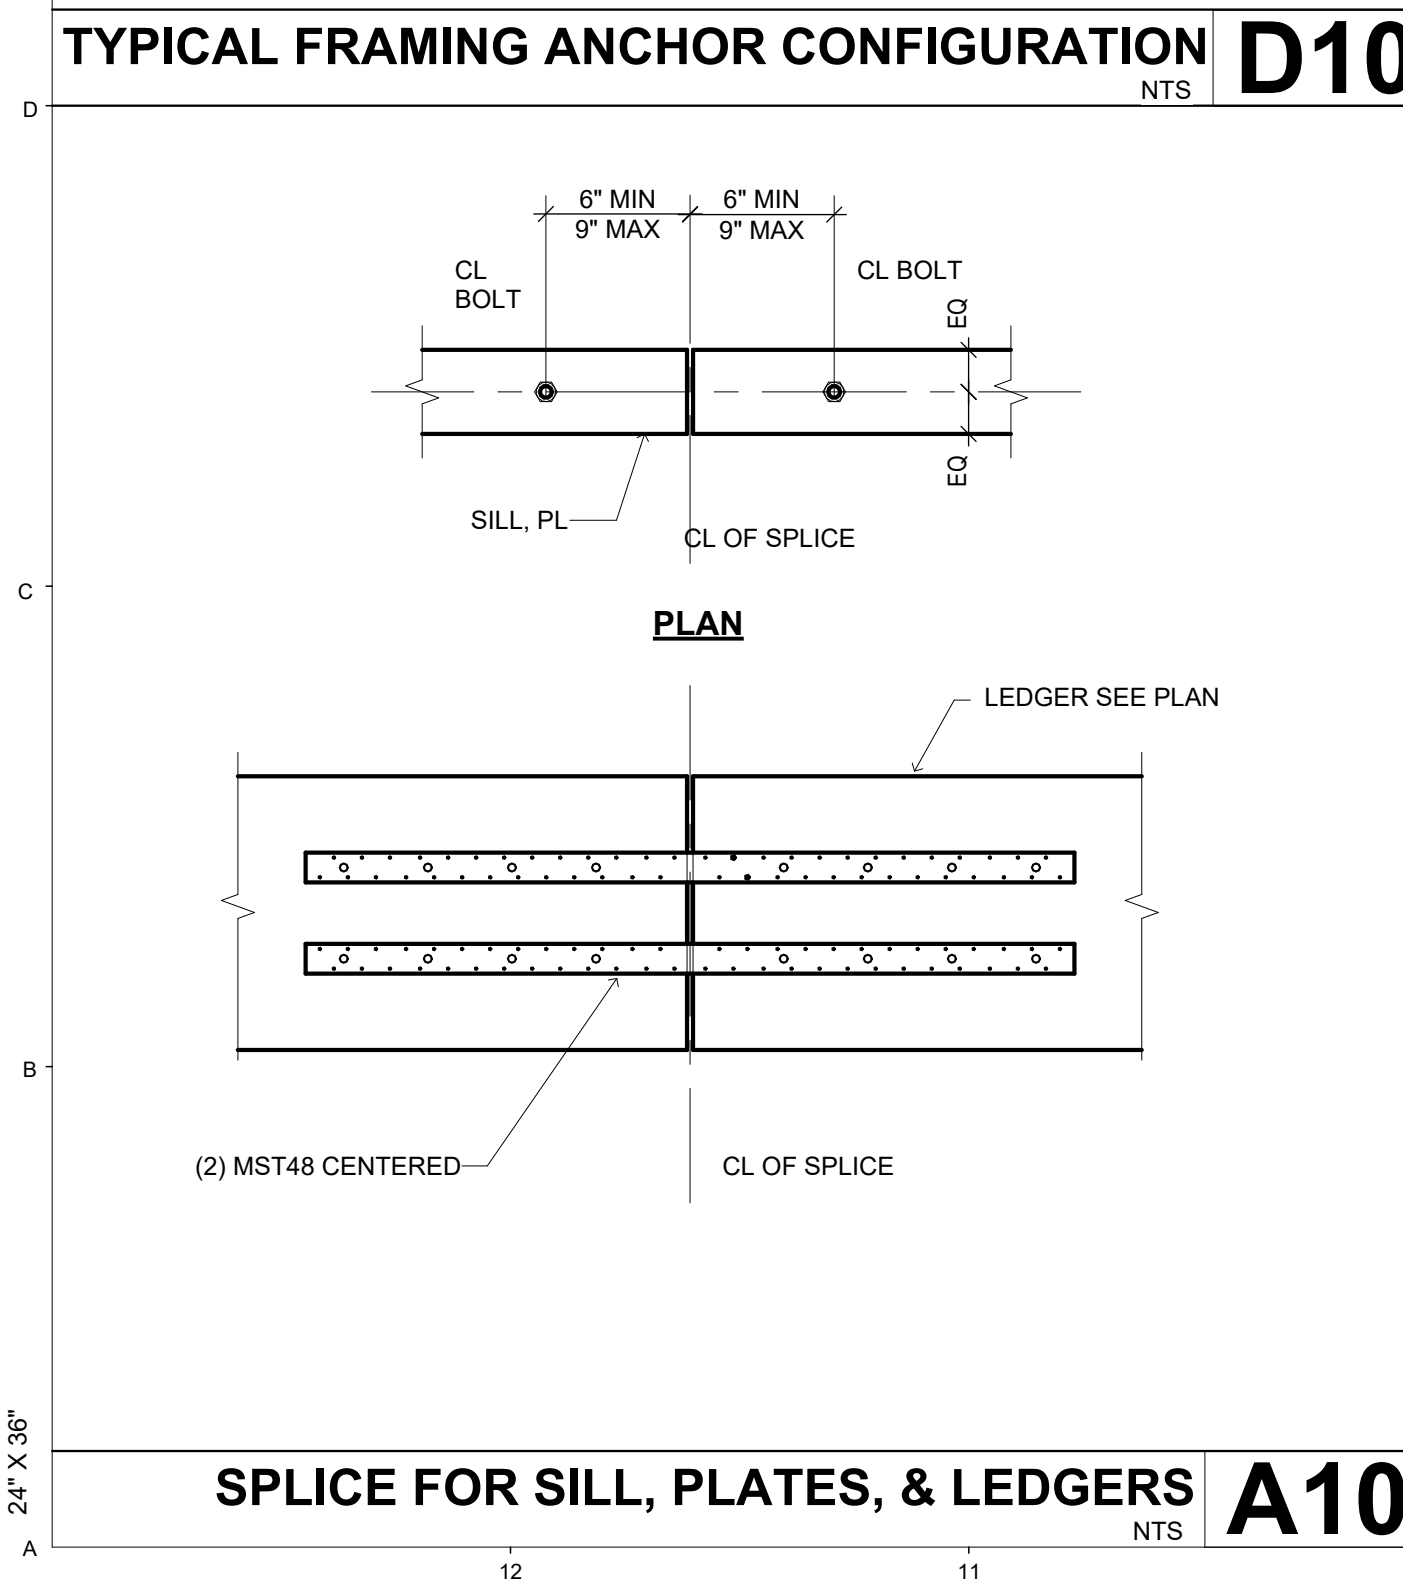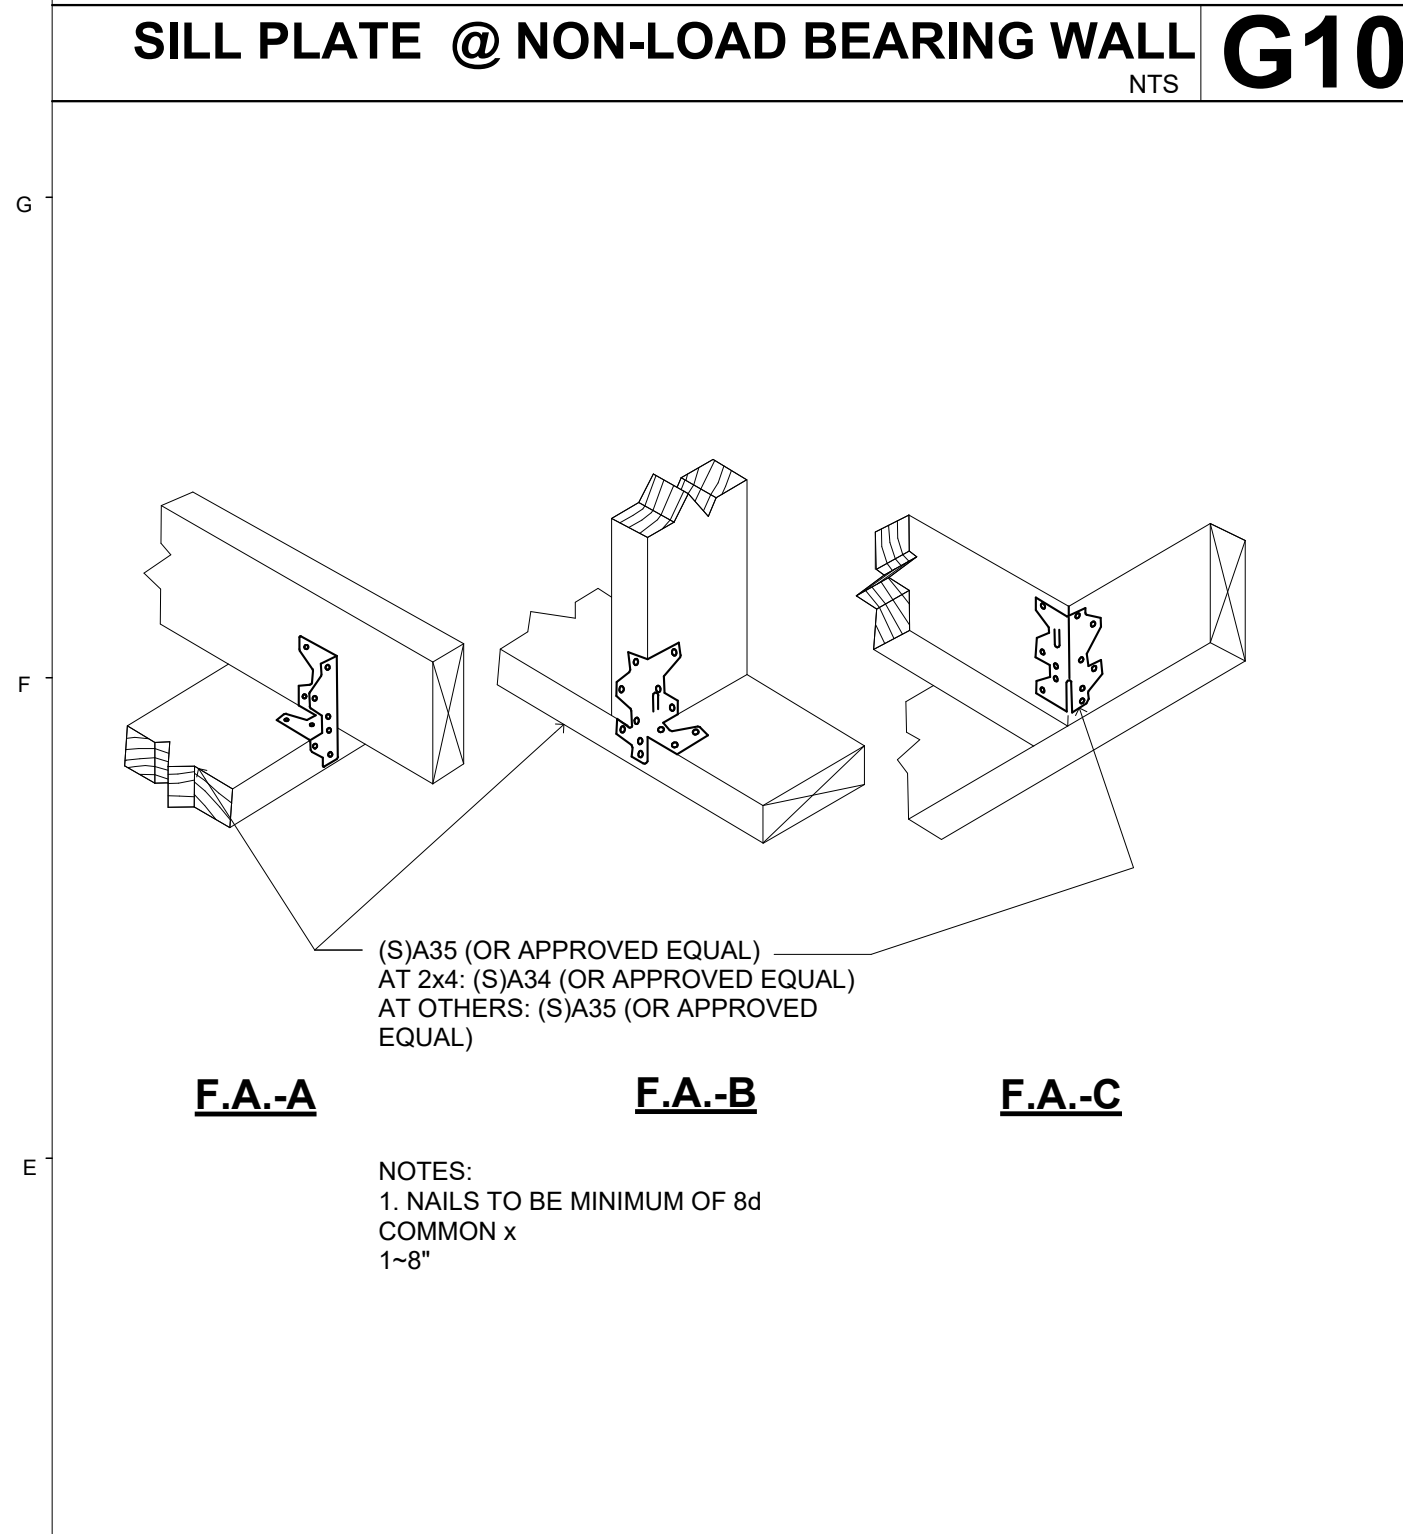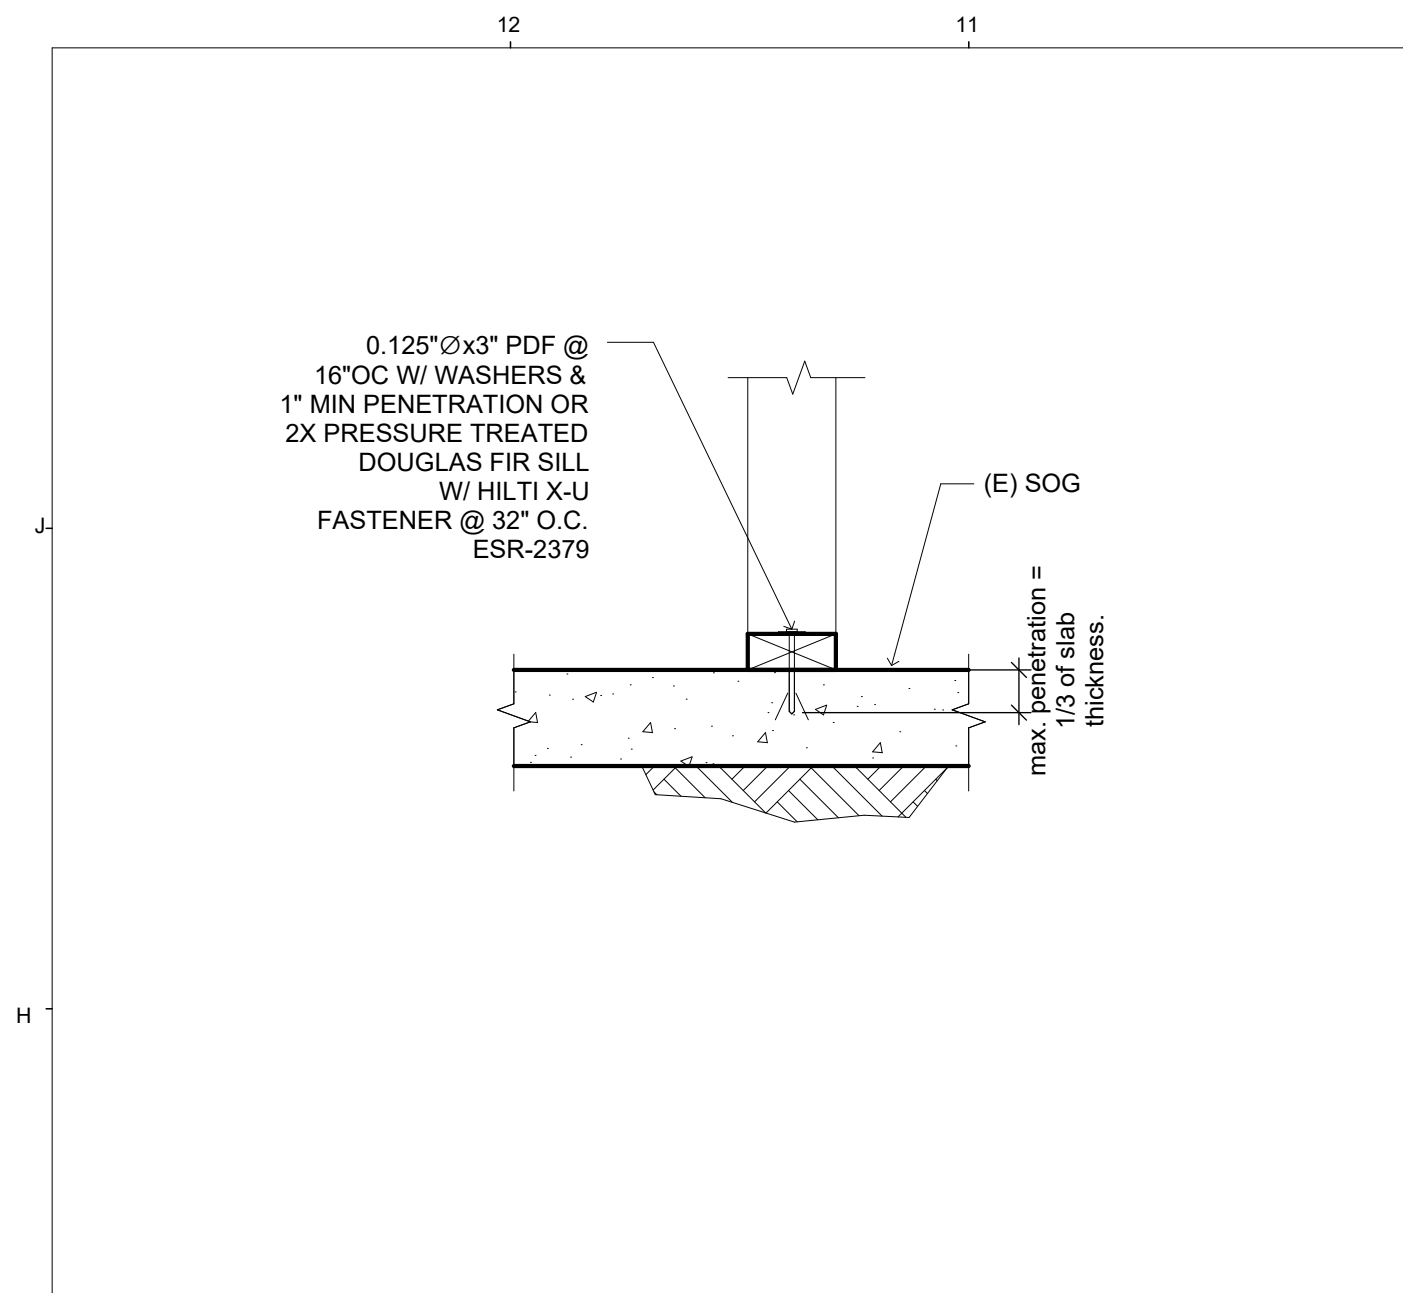

OPTION
#2

PROJECT

TRIPLEX
DWELLING UNIT

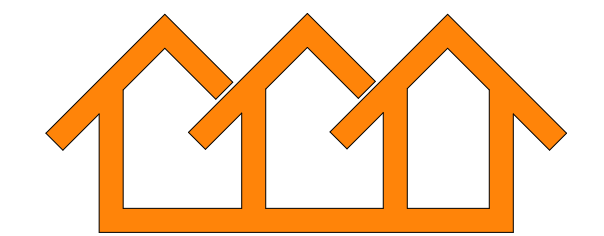


PWP23-005

**DEPARTMENT OF PUBLIC
WORKS AND PLANNING**

**CAPITAL PROJECTS
DIVISION**

2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

SEAL & SIGNATURE

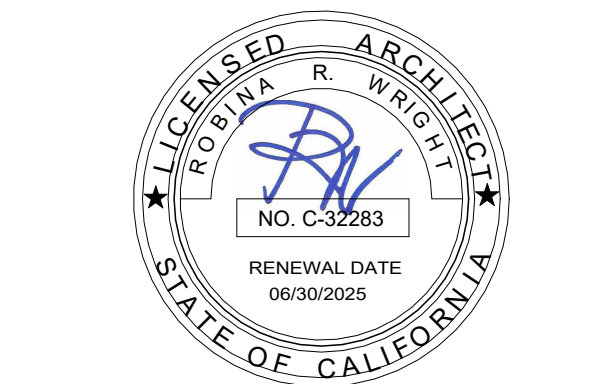

UPDATE

JANUARY 2, 2024

THESE DRAWINGS AND SPECIFICATIONS
ARE THE PROPERTY AND COPYRIGHT OF
THE ARCHITECT AND SHALL NOT BE
USED ON ANY OTHER PROJECT OR
LOCATIONS EXCEPT AS DESCRIBED ON
THE DRAWINGS WITHOUT WRITTEN
AGREEMENT WITH THE ARCHITECT.

TITLE _____


TYPICAL WOOD FRAMING DETAILS

SCALE $1/4" = 1'-0"$

S-101

ISSUE DATE	JOB NUMBER
MARCH 7, 2023	2023_11


DRAWN BY	CHECKED BY
RL	RW

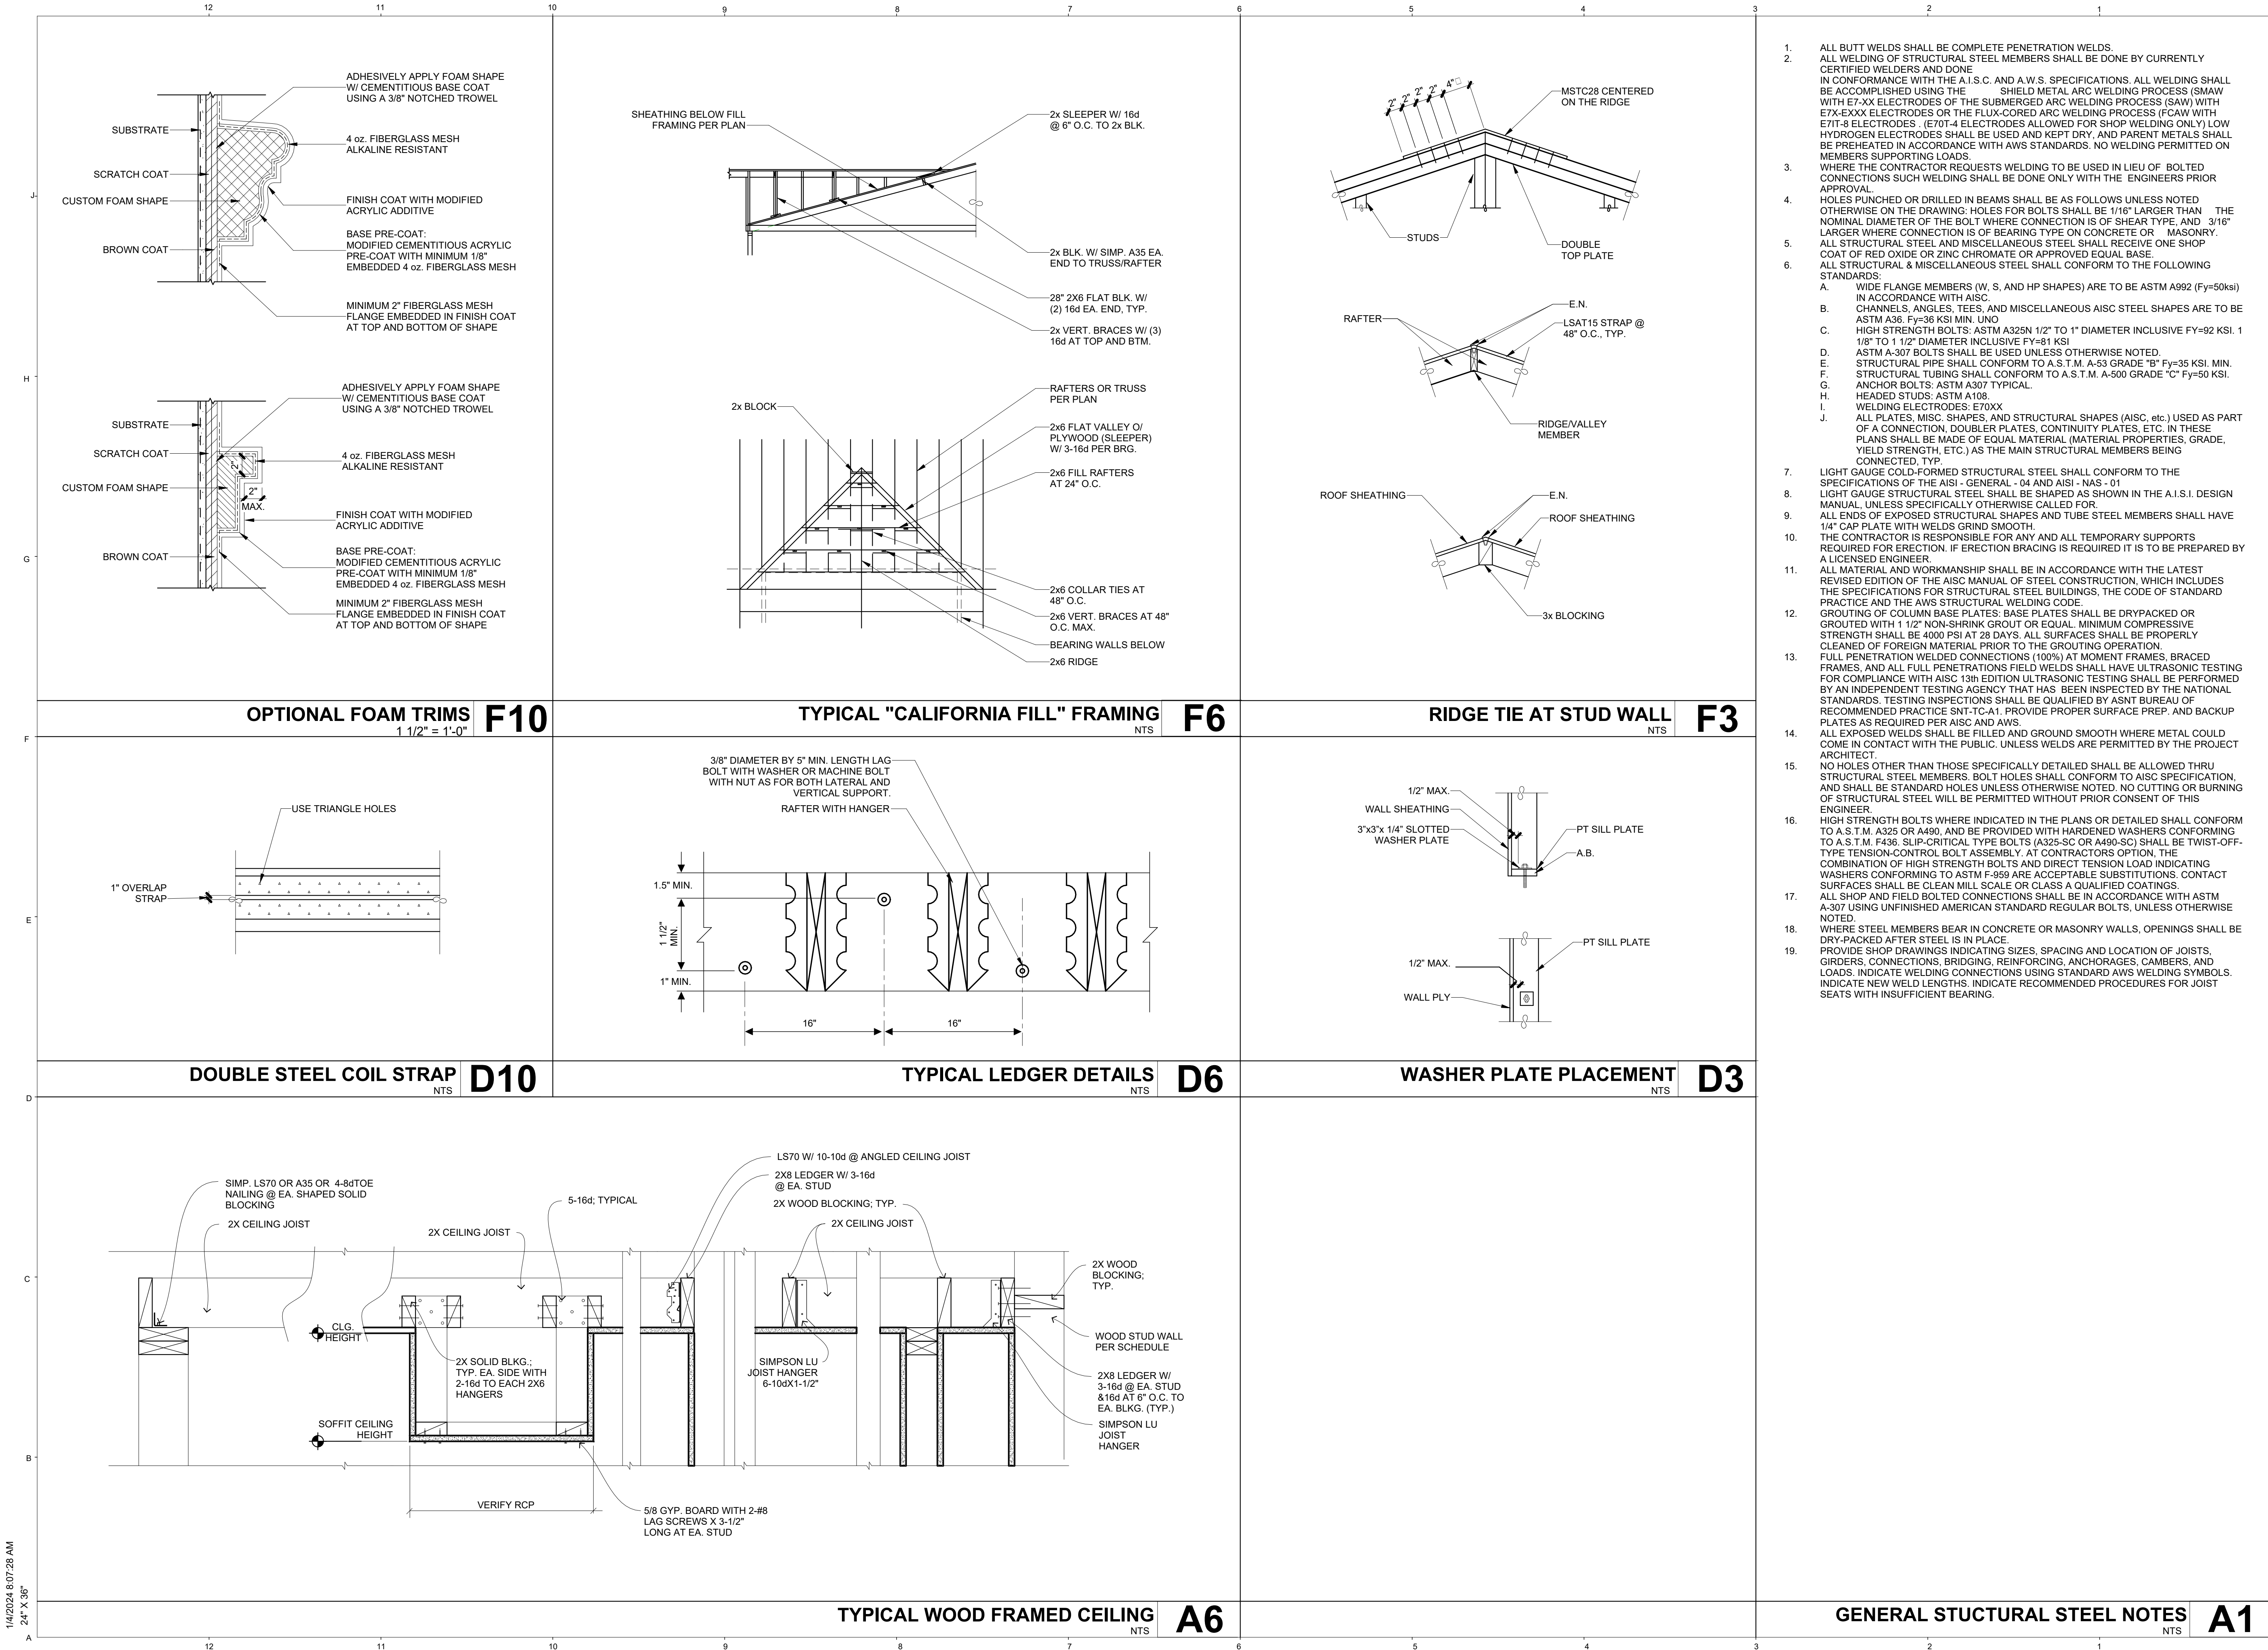

TRIPLEX DWELLING UNIT

OPTION #2

PROJECT
TRIPLEX DWELLING UNIT

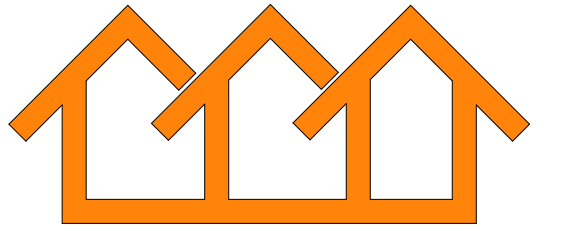

PWP23-005


DEPARTMENT OF PUBLIC WORKS AND PLANNING



CAPITAL PROJECTS DIVISION

2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

SEAL & SIGNATURE

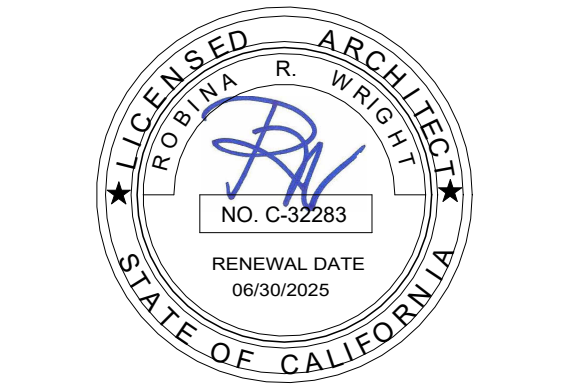

UPDATE

JANUARY 2, 2024

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY AND COPYRIGHT OF THE ARCHITECT AND SHALL NOT BE USED ON ANY OTHER PROJECT OR LOCATIONS EXCEPT AS DESCRIBED ON THE DRAWINGS WITHOUT WRITTEN AGREEMENT WITH THE ARCHITECT.

TITLE

TYPICAL STRUCTURAL DETAILS

SCALE

As indicated


S-102

ISSUE DATE	JOB NUMBER
MARCH 7, 2023	2023_11
DRAWN BY	CHECKED BY
Author	Checker

1/4/2024 8:07:29 AM
24" X 36"

1/4/2024 8:07:29 AM
24" X 36"

1/4/2024 5:07:30 AM
24" X 36"

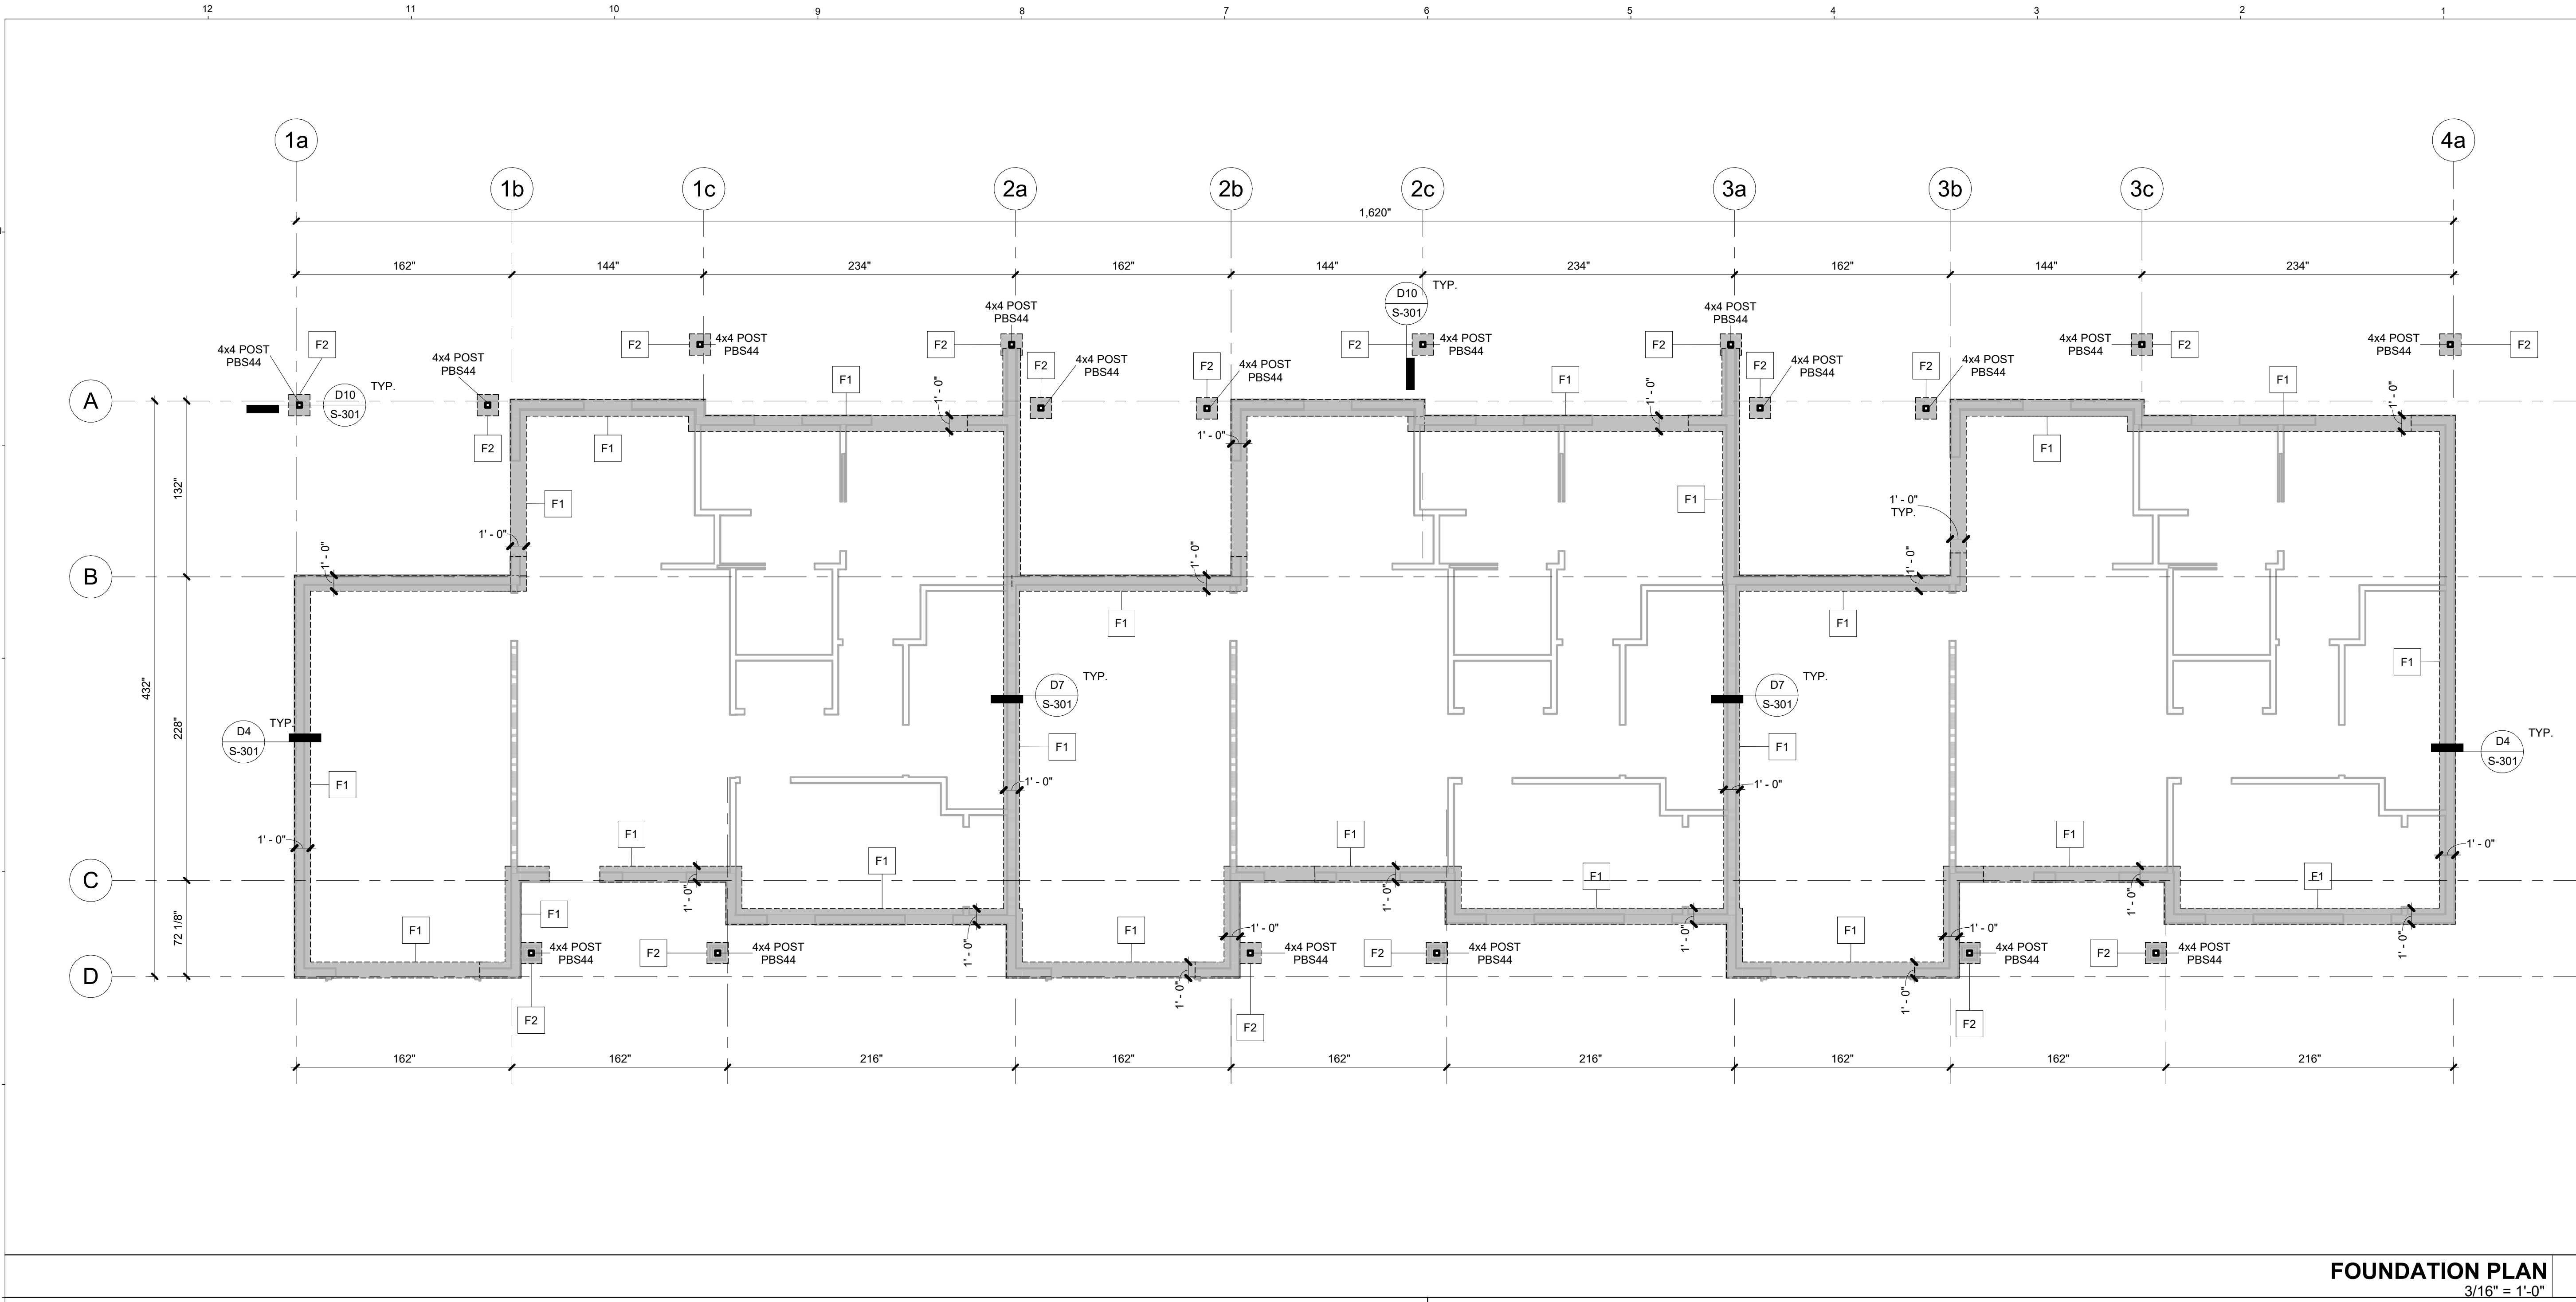

FOUNDATION PLAN
3/16" = 1'-0"

D1

FOOTING SCHEDULE					
FOOTING ID	PAD SIZE	LUMBER GRADE			H
		# REQ'D	BAR #	DETAIL	
F1	1'-0" WIDE CONT. FOOTING	1	4	D4 / S-301	12
F2	1' - 4" SQUARE	2	4	D10 / S-301	12

FOUNDATION NOTES

- THE CONTRACTOR MUST READ & UNDERSTAND ALL STANDARDS NOTES & DETAILS BEFORE BEGINNINGS CONSTRUCTION OR FABRICATION.
- ALL UNCLEAR AND / OR MISSING DETAILS OR INFO. SHALL BE BROUGHT TO THE ENGINEER IS ATTENTION BEFORE PROCEEDING N/ CONSTRUCTION.
- ALL CONCRETE PLACEMENT SHALL MEET WITH THE 2022 CALIFORNIA BUILDING CODE REQUIREMENTS.
- CONCRETE SHALL BE PROTECTED ADEQUATELY FROM INJURIOUS ACTION BY THE SUN, RAIN, WIND, FLOWING WATER, FROST AND MECHANICAL INURT, AND SHALL NOT BE ALLOWED TO DRY OUT FROM THE TIME IT IS PLACED UNTIL THE EXPIRATION OF THE MINIMUM CURING PERIOD. A FINE FOG SPRAY SHALL BE USED TO REDUCE PLASTIC SHRINKAGE CRACKS AFTER FINISHING OPERATIONS. IMMEDIATELY AFTER THE NET CONCRETE HAS BEEN BROUGHT TO A FLAT SURFACE AND THE SHINY SURFACE HAS DISAPPEARED, ADDITIONAL MOISTURE SHALL BE APPLIED TO RESTORE SHINE, USING AN ATOMIZING TYPE FOG SPRATER. FREQUENT LIGHT APPLICATION OF MOISTURE SHALL BE PROVIDED AS REQUIRED BY NEITHER CONDITIONS.
- SLOPE ALL LANDINGS AND WALKWAYS AWAY FROM THE BUILDING.
- FOUNDATION WALLS SHALL EXTEND AT LEAST 8" ABOVE THE FINISHED GRADE ADJACENT TO THE FOUNDATION AT ALL POINTS. FOR MASONRY OR CONCRETE CONSTRUCTION, THE MINIMUM FOUNDATION WALL WILL BE 6 INCHES.
- WOOD SOLE PLATES AT ALL EXTERIOR WALLS ON MONOLITHIC SLABS, WOOD SOLE PLATES OF BRACED WALL PANELS AT BUILDING INTERIORS ON MONOLITHIC SLABS AND ALL WOOD SILL PLATES SHALL BE ANCHORED TO THE FOUNDATION WITH MINIMUM 1/2-INCH-DIAMETER ANCHOR BOLTS SPACED NOT GREATER THAN 6 FEET ON CENTER OR APPROVED ANCHORS OR ANCHOR STRAPS SPACED AS REQUIRED TO PROVIDE EQUIVALENT ANCHORAGE TO 1/2-INCH-DIAMETER ANCHOR BOLTS.
- BOLTS SHALL EXTEND NOT LESS THAN 7 INCHES INTO CONCRETE OR GROUTED CELLS OF CONCRETE MASONRY UNITS. THE BOLTS SHALL BE LOCATED IN THE MIDDLE THIRD OF THE WIDTH OF THE PLATE. A NUT AND WASHER SHALL BE TIGHTENED ON EACH ANCHOR BOLT. THERE SHALL BE NOT FEWER THAN TWO BOLTS PER PLATE SECTION WITH ONE BOLT LOCATED NOT MORE THAN 12 INCHES OR LESS THAN SEVEN BOLT DIAMETERS FROM EACH END OF THE PLATE SECTION.
- INTERIOR BEARING WALL SOLE PLATES ON MONOLITHIC SLAB FOUNDATION THAT ARE NOT PART OF A BRACED WALL PANEL SHALL BE POSITIVELY ANCHORED WITH APPROVED FASTENERS. SILL PLATES AND SOLE PLATES SHALL BE PROTECTED AGAINST DECAY AND TERMITES WHERE REQUIRED BY SECTIONS R317 AND R318. ANCHOR BOLTS SHALL BE PERMITTED TO BE LOCATED WHILE CONCRETE IS STILL PLASTIC AND BEFORE IT HAS SET. WHERE ANCHOR BOLTS RESIST PLACEMENT OR THE CONSOLIDATION OF CONCRETE AROUND ANCHOR BOLTS IS IMPEDED, THE CONCRETE SHALL BE VIBRATED TO ENSURE FULL CONTACT BETWEEN THE ANCHOR BOLTS AND CONCRETE.
- ALL DISTURBED OR FILL SOIL UNDER CONCRETE SHALL BE COMPACTED TO A MINIMUM OF 90 % RELATIVE COMPACTION BASED ON ASTM STANDARD D1557, INCLUDING RETAINING WALL BACKFILL.
- ***CONTRACTOR TO FIELD VERIFY ALL DIMENSIONS AND TO BRING ANY OMISSIONS OR DISCREPANCIES TO THE ATTENTION OF THE ENGINEER.***
- HOLDDOWN HARDWARE MUST BE SECURED IN FACE PRIOR TO FOUNDATION INSPECTION
- FINISH GRADE FOR THE FIRST 1 FT FROM THE FOUNDATION SHALL SLOPE MINIMUM OF 5% ON ALL SIDES. THIS INCLUDES ANY IMPREVIOUS SURFACES.
- WOOD FRAMING MEMBERS THAT REST ON EXTERIOR FOUNDATION WALL AND ARE LESS THAN 8" FROM EXPOSED EARTH SHALL BE ON NATURALLY DURABLE OR PRESERVATIVE-TREATED WOOD.
- PONDER DRIVEN FASTENERS SHALL NOT BE USED IN STEM WALLS LESS THAN 5 1/2" WIDE OR GREATER THAN 5 1/2" HIGH
- THE FASTENERS AND CONNECTORS IN DIRECT CONTACT WITH PRESERVATIVE-TREATED WOOD SHALL BE HOT DIPPED ZING-COATED GALVANIZED STEEL, STAINLESS STEEL, SILICON BRONZE OR COPPER

GENERAL NOTES

- CBC 1803.1.1 GENERAL AND WHERE REQUIRED FOR APPLICATIONS LISTED IN SECTION 1.8.2.1.1 REGULATED BY THE DEPARTMENT OF HOUSING AND COMMUNITY DEVELOPMENT. FOUNDATIONS AND SOILS INVESTIGATIONS SHALL BE CONDUCTED IN CONFORMANCE WITH HEALTH AND SAFETY CODE SECTIONS 17953 THROUGH 17957 AS SUMMARIZED BELOW.
- CBC 1803.1.1.1 PRELIMINARY SOIL REPORT
EACH CITY, COUNTY, OR CITY AND COUNTY SHALL ENACT AN ORDINANCE WHICH REQUIRES A PRELIMINARY SOIL REPORT, PREPARED BY A CIVIL ENGINEER WHO IS REGISTERED BY THE STATE. THE REPORT SHALL BE BASED UPON ADEQUATE TEST BORINGS OR EXCAVATIONS, OF EVERY SUBDIVISION, WHERE A TENTATIVE AND FINAL MAP IS REQUIRED PURSUANT TO SECTION 66426 OF THE GOVERNMENT CODE. THE PRELIMINARY SOIL REPORT MAY BE WAIVED IF THE BUILDING DEPARTMENT OF THE CITY, COUNTY OR CITY AND COUNTY, OR OTHER ENFORCEMENT AGENCY CHARGED WITH THE ADMINISTRATION AND ENFORCEMENT OF THE PROVISIONS OF SECTION 1803.1.1, SHALL DETERMINE THAT, DUE TO THE KNOWLEDGE SUCH DEPARTMENT HAS AS TO THE SOIL QUALITIES OF THE SOIL OF THE SUBDIVISION OR LOT, NO PRELIMINARY ANALYSIS IS NECESSARY.
- CBC 1803.1.1.2 SOIL INVESTIGATION BY LOT, NECESSITY, PREPARATION AND RECOMMENDATIONS
IF THE PRELIMINARY SOIL REPORT INDICATES THE PRESENCE OF CRITICALLY EXPANSIVE SOILS OR OTHER SOIL PROBLEMS WHICH, IF NOT CORRECTED, WOULD LEAD TO STRUCTURAL DEFECTS, SUCH ORDINANCE SHALL REQUIRE A SOIL INVESTIGATION OF EACH LOT IN THE SUBDIVISION. THE SOIL INVESTIGATION SHALL BE PREPARED BY A CIVIL ENGINEER WHO IS REGISTERED IN THIS STATE. IT SHALL RECOMMEND CORRECTIVE ACTION WHICH IS LIKELY TO PREVENT STRUCTURAL DAMAGE TO EACH DWELLING PROPOSED TO BE CONSTRUCTED ON THE EXPANSIVE SOIL.
- CBC 1803.1.1.3 APPROVAL, BUILDING PERMIT CONDITIONS, APPEAL
THE BUILDING DEPARTMENT OF EACH CITY, COUNTY OR CITY AND COUNTY, OR OTHER ENFORCEMENT AGENCY CHARGED WITH THE ADMINISTRATION AND ENFORCEMENT OF THE PROVISIONS OF THIS CODE, SHALL APPROVE THE SOIL INVESTIGATION IF IT DETERMINES THAT THE RECOMMENDED ACTION IS LIKELY TO PREVENT STRUCTURAL DAMAGE TO EACH DWELLING TO BE CONSTRUCTED. AS A CONDITION TO THE BUILDING PERMIT, THE ORDINANCE SHALL REQUIRE THAT THE APPROVED RECOMMENDED ACTION BE INCORPORATED IN THE CONSTRUCTION OF EACH DWELLING. APPEAL FROM SUCH DETERMINATION SHALL BE TO THE LOCAL APPEALS BOARD.
- CBC 1803.1.1.4 LIABILITY
A CITY, COUNTY, CITY AND COUNTY, OR OTHER ENFORCEMENT AGENCY CHARGED WITH THE ADMINISTRATION AND ENFORCEMENT OF SECTION 1803.1.1, IS NOT LIABLE FOR ANY INJURY WHICH ARISES OUT OF ANY ACT OR OMISSION OF THE CITY, COUNTY, CITY AND COUNTY, OTHER ENFORCEMENT AGENCY, OR A PUBLIC EMPLOYEE OR ANY OTHER PERSON UNDER SECTION 1803.1.1.


- CBC 1803.1.1.5 ALTERNATE PROCEDURES
THE GOVERNING BODY OF ANY CITY, COUNTY, OR CITY AND COUNTY MAY ENACT AN ORDINANCE PRESCRIBING AN ALTERNATE PROCEDURE WHICH IS EQUAL TO OR MORE RESTRICTIVE THAN THE PROCEDURE SPECIFIED IN SECTION 1803.1.1.
- CBC 1808.5 SHIFTING OR MOVING SOILS
WHERE IT IS KNOWN THAT THE SHALLOW SUBSOILS ARE OF A SHIFTING OR MOVING CHARACTER, FOUNDATIONS SHALL BE CARRIED TO A SUFFICIENT DEPTH TO ENSURE STABILITY.

TRIPLEX DWELLING UNIT

OPTION #2

PROJECT

TRIPLEX
DWELLING UNIT

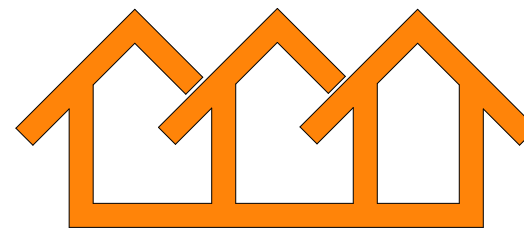

PWP23-005

DEPARTMENT OF PUBLIC
WORKS AND PLANNING



CAPITAL PROJECTS
DIVISION

2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

SEAL & SIGNATURE



UPDATE

JANUARY 2, 2024

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY AND COPYRIGHT OF THE ARCHITECT AND SHALL NOT BE USED ON ANY OTHER PROJECT OR LOCATIONS EXCEPT AS DESCRIBED ON THE DRAWINGS WITHOUT WRITTEN AGREEMENT WITH THE ARCHITECT.

TITLE

FOUNDATION PLAN



SCALE

As indicated

S-201

ISSUE DATE	JOB NUMBER
MARCH 7, 2023	2023_11
DRAWN BY	CHECKED BY
Author	Checker

©

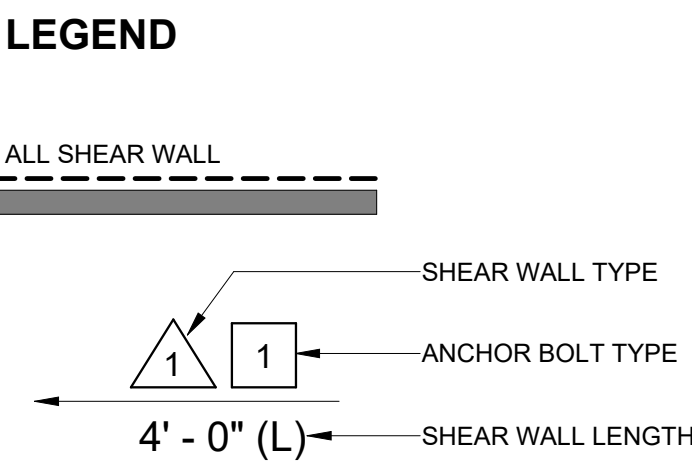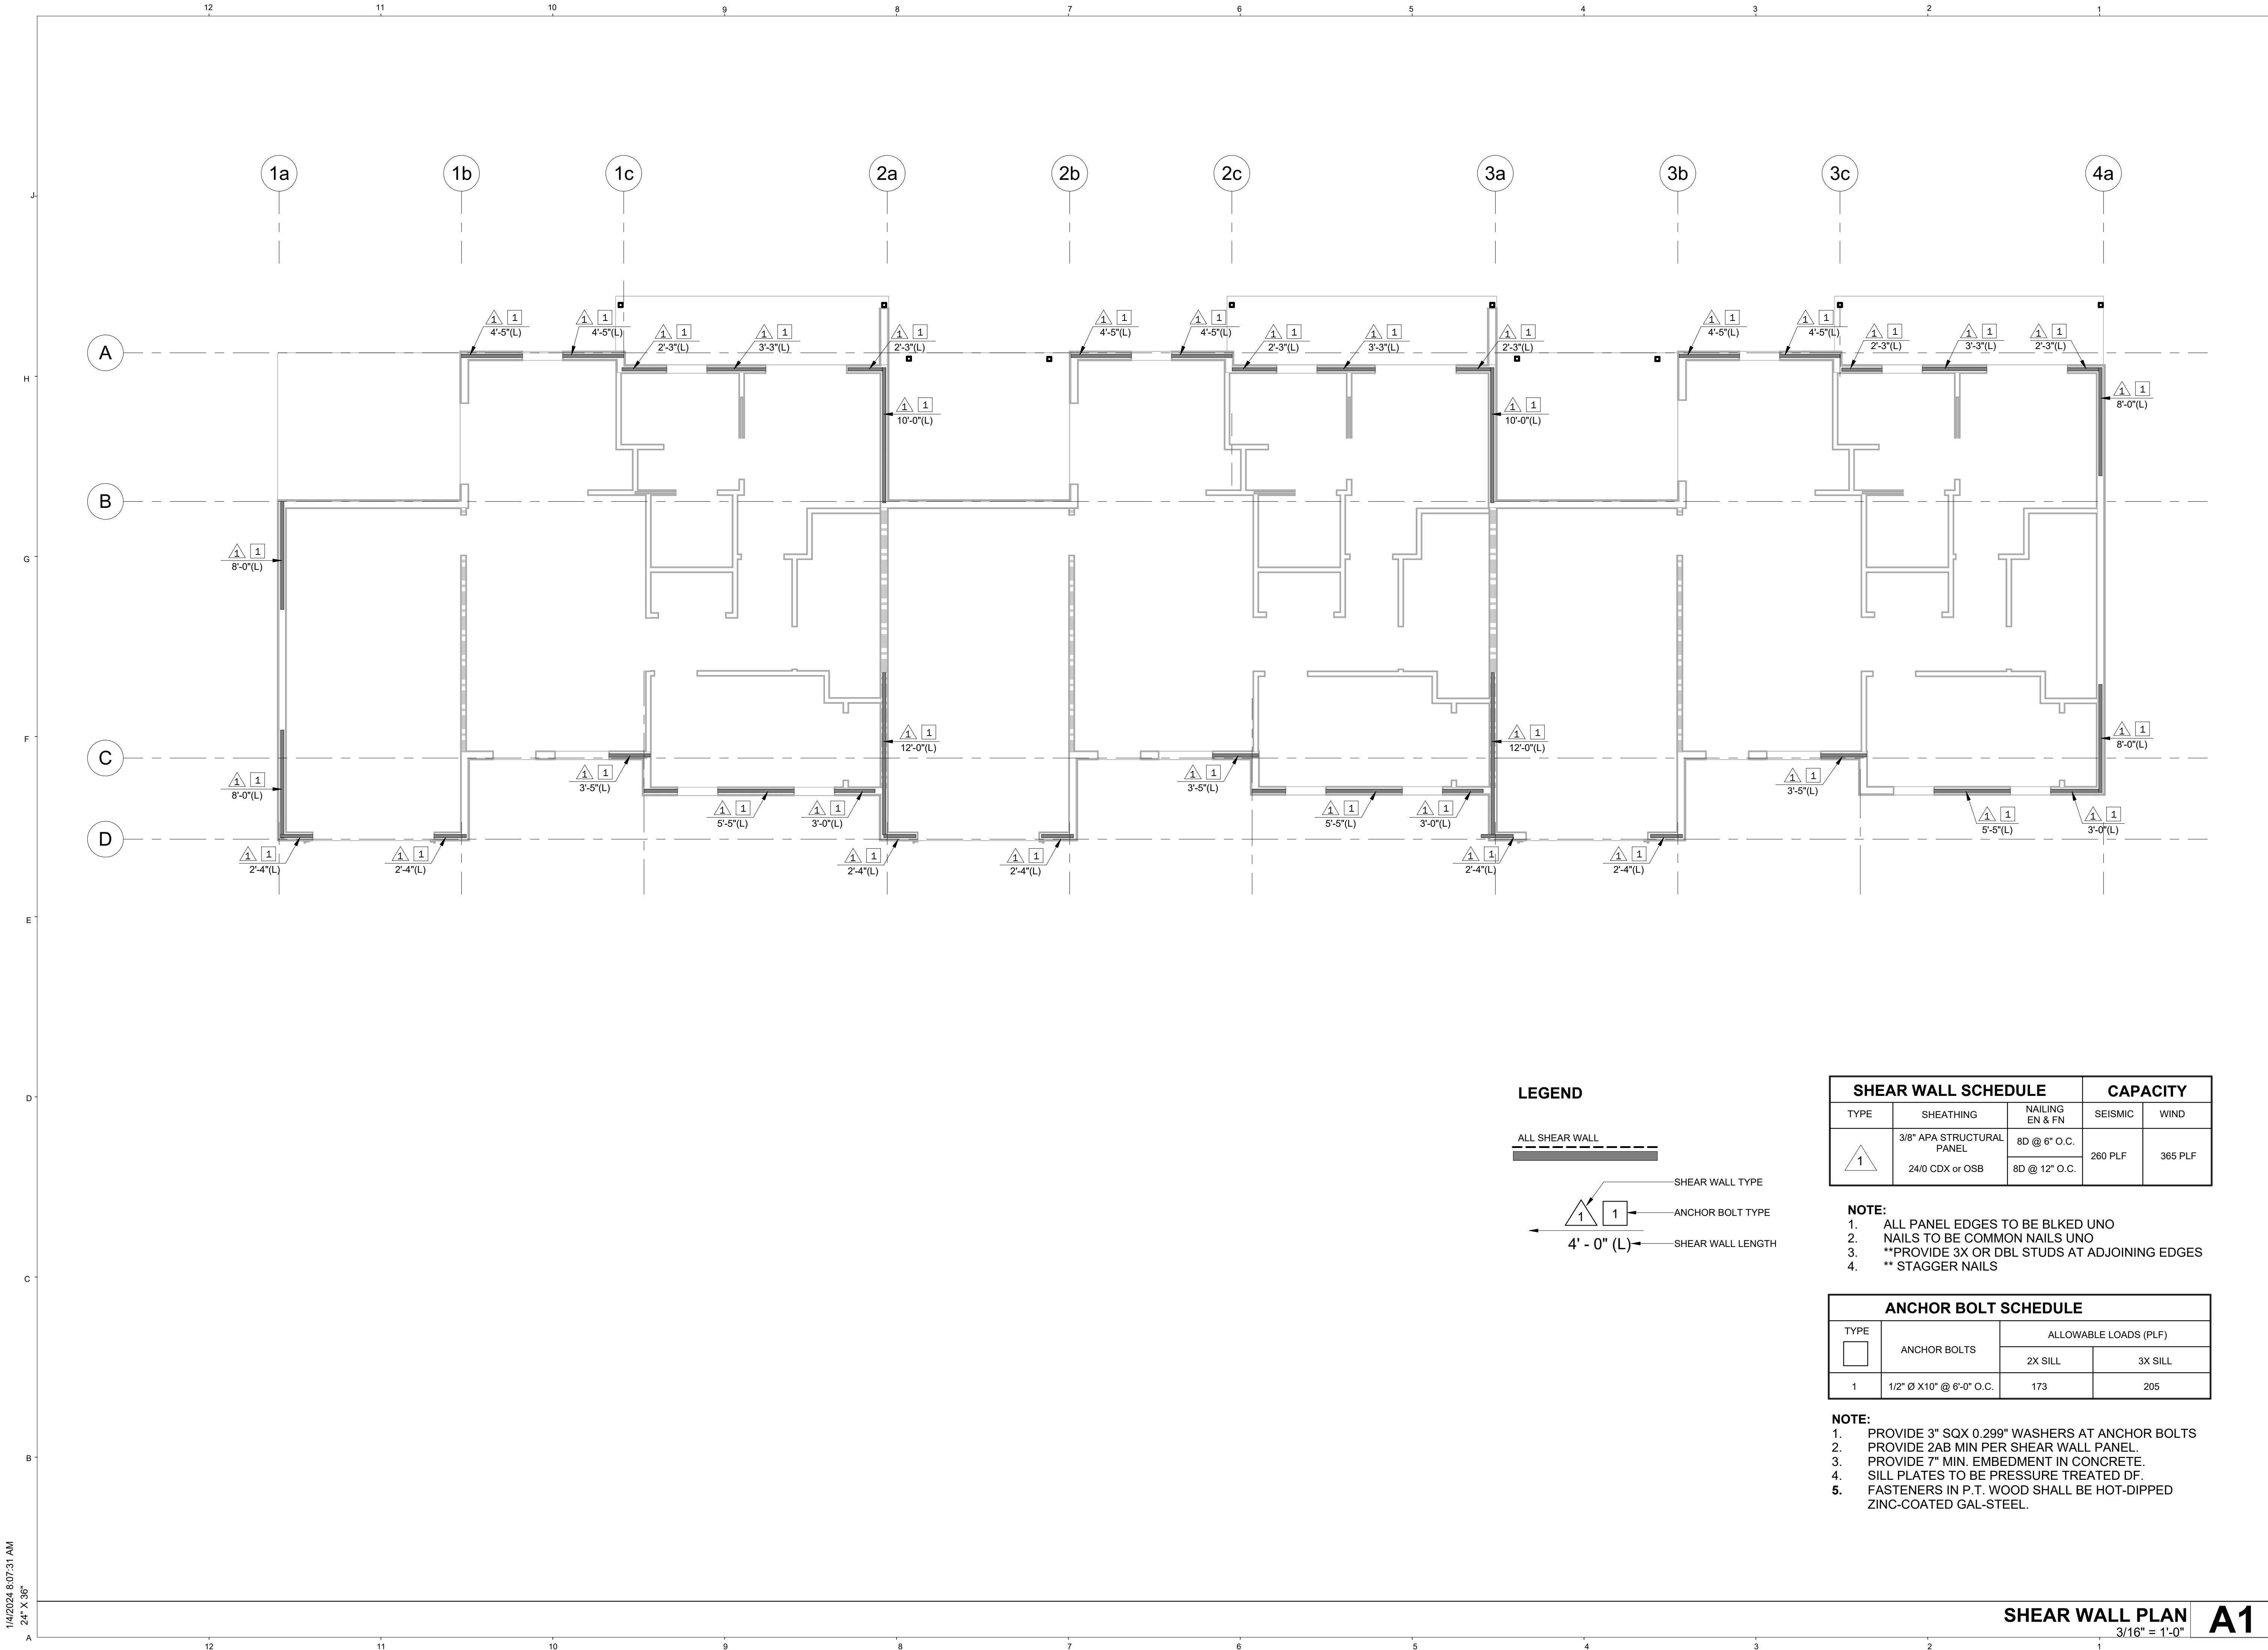

SHEAR WALL SCHEDULE			CAPACITY	
TYPE	SHEATHING	NAILING EN & FN	SEISMIC	WIND
1	3/8" APA STRUCTURAL PANEL 24/0 CDX or OSB	8D @ 6" O.C.	260 PLF	365 PLF
		8D @ 12" O.C.		

- NOTE:**
- ALL PANEL EDGES TO BE BLKD UNO
 - NAILS TO BE COMMON NAILS UNO
 - **PROVIDE 3X OR DBL STUDS AT ADJOINING EDGES
 - ** STAGGER NAILS


ANCHOR BOLT SCHEDULE			
TYPE	ANCHOR BOLTS	ALLOWABLE LOADS (PLF)	
		2X SILL	3X SILL
1	1/2" Ø X10" @ 6'-0" O.C.	173	205

- NOTE:**
- PROVIDE 3" SQX 0.299" WASHERS AT ANCHOR BOLTS
 - PROVIDE 2AB MIN PER SHEAR WALL PANEL.
 - PROVIDE 7" MIN. EMBEDMENT IN CONCRETE.
 - SILL PLATES TO BE PRESSURE TREATED DF.
 - FASTENERS IN P.T. WOOD SHALL BE HOT-DIPPED ZINC-COATED GAL-STEEL.

TRIPLEX DWELLING UNIT

OPTION #2

PROJECT
TRIPLEX DWELLING UNIT

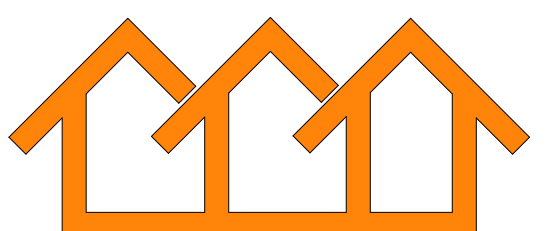

PWP23-005


DEPARTMENT OF PUBLIC WORKS AND PLANNING



CAPITAL PROJECTS DIVISION

2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

SEAL & SIGNATURE

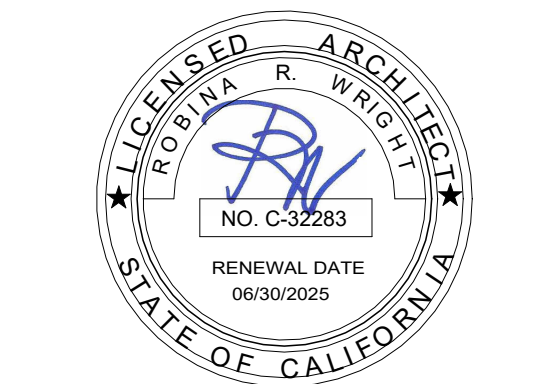

UPDATE
JANUARY 2, 2024

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY AND COPYRIGHT OF THE ARCHITECT AND SHALL NOT BE USED ON ANY OTHER PROJECT OR LOCATIONS EXCEPT AS DESCRIBED ON THE DRAWINGS WITHOUT WRITTEN AGREEMENT WITH THE ARCHITECT.

TITLE

SHEAR WALL PLAN

SCALE As indicated


ISSUE DATE MARCH 7, 2023
JOB NUMBER 2023_11

DRAWN BY Author
CHECKED BY Checker

SHEAR WALL PLAN
3/16" = 1'-0"

A1

1/4/2024 8:07:31 AM
24" X 36"

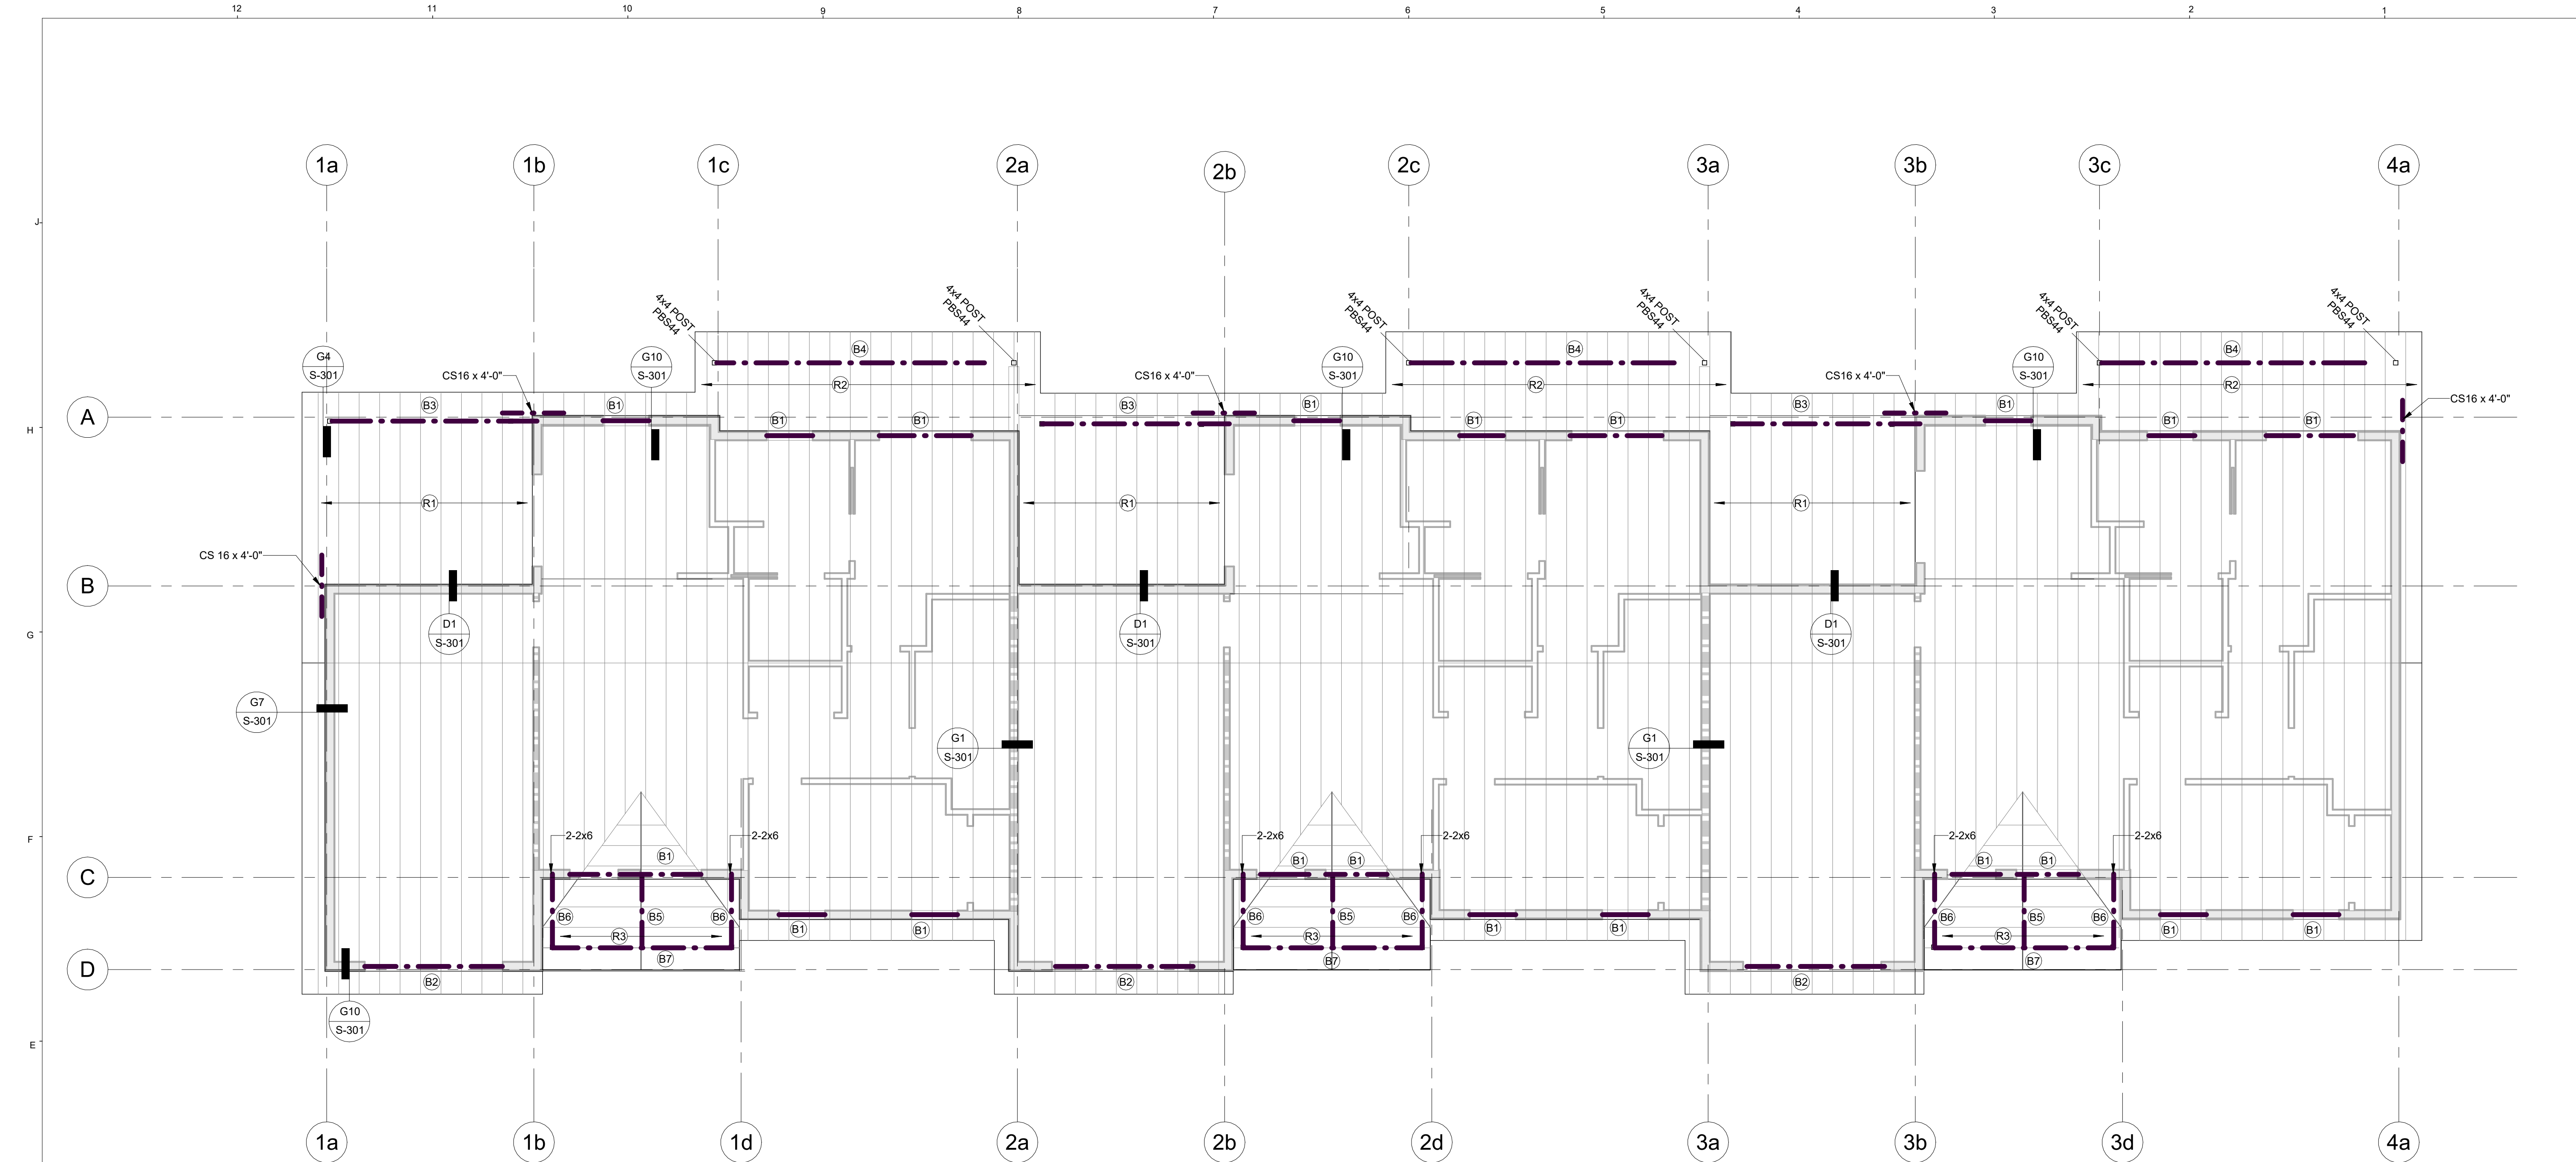

ROOF FRAMING PLAN
3/16" = 1'-0"

D1

ROOF BEAM SCHEDULE		
BEAM ID	SIZE	LUMBER GRADE
B1	6 x 8	DF NO. 2
B2	6 x 10	DF NO. 2
B3	4 x 10	DF NO. 2
B4	4 x 12	DF NO. 2
B5	2- 2 x 6	DF NO. 2
B6	4 x 8	DF NO. 2
B7	4 x 8	DF NO. 2
R1	2 x 8 @ 24" O.C.	DF NO. 2
R2	2 x 4 @ 24" O.C.	DF NO. 2
R3	2 x 4 @ 16" O.C.	DF NO. 2


- TRUSSES ARE UNDER A DEFERRED SUBMITTAL.
- THE OWNER / BUILDER IS RESPONSIBLE FOR SUBMITTING ALL ITEMS LISTED UNDER THE DEFERRED SUBMITTAL AS REQUIRED BY THE RELEVANT AUTHORITIES. THIS INCLUDES ANY ADDITIONAL DOCUMENTS, PERMITS, OR INFORMATION THAT WERE NOT INCLUDED IN THE PRE-APPROVED PLANS.
 - THE OWNER IS RESPONSIBLE IN SELECTING A TRUSS COMPANY TO SUPPLY THE TRUSSES. THE TRUSS COMPANY THAT WILL SUPPLY THE TRUSSES SHALL PROVIDE ADDITIONAL DOCUMENTS AND INFORMATION AS REQUIRED BY RELEVANT AUTHORITIES.
 - ALL TRUSS MANUFACTURERS SHALL HAVE AN "IN PLANT" INSPECTION BY AN APPROVED AGENCY PER CBC [A] 107.1 SUBMIT CERTIFICATION TO THE FRESNO COUNTY DEVELOPMENT SERVICES DIVISION.

- TRUSS NOTES
- STRUCTURAL CALCULATIONS SHALL BE PROVIDED BY TRUSS MANUFACTURER FOR ALL TRUSS TYPES AND SHALL INCLUDE SUPPORT FOR MECHANICAL UNIT, PLATFORM AND ACCESS CATWALK.
 - TRUSS FABRICATOR SHALL PROVIDE A SCHEMATIC LAYOUT OF ALL TRUSSES SEQUENCE OF ERECTION AND INSTALLATION TO THE DESIGNER FOR REVIEW PRIOR TO PROCEEDING WITH CONSTRUCTION.
 - TRUSS-TO-TRUSS CONNECTIONS AND OTHER DETAILS RELATED TO TRUSSES SHALL BE VERIFIED BY TRUSS FABRICATOR, INCLUDING BRACING, STRONG BACKS AND ERECTION DETAILS.
 - ALL TRUSSES AND TRUSS DRAWINGS SHALL BE IN ACCORDANCE WITH APPLICABLE CODES AND DRAWINGS.
 - THE TRUSS DRAWINGS AND STRUCTURAL CALCULATIONS SHALL BE SUPPLIED BY THE TRUSS MANUFACTURER AND SUBMITTED FOR APPROVAL PRIOR TO BUILDING PERMITS BEING ISSUED.
 - TRUSS MANUFACTURER SHALL VERIFY ALL DIMENSIONS AT JOB SITE AND BRING ANT DISCREPANCIES WITH THESE PLANS TO THE ATTENTION OF THE ENGINEER OF RECORD PRIOR TO TRUSS FABRICATION.
 - THE GENERAL CONTRACTOR SHALL NOT PERMIT DRILLING, CUTTING OR ANY OTHER DAMAGE TO TRUSSES.
 - MAINTAIN 1/4" CLEARANCE BETWEEN TOP PLATE OF NON BEARING WALLS AND BOTTOM CHORDS OF TRUSSES. PROVIDE "SIMPSON" (OR EQ) ST TRUSS CLIP AT 48" O.C. (MAX) AT SUCH LOCATION.
 - PROVIDE 2 X 4 CONTINUOUS BRACING AT 10'-0" O.C. MAX. TO BOTTOM CHORDS OR AS REQUIRED BY TRUSS MANUFACTURER.
 - THE CONTRACTOR SHALL INSTALL TEMPORARY HORIZONTAL AND CROSS BRACING TO HOLD TRUSSES PLUMB AND IN SAFE CONDITION.
 - INSTALL PERMANENT BRACING PRIOR TO LOADING TRUSSES
 - PROVIDE SIMPSON CONNECTORS AT E.A. TRUSS END (TYPICAL).
 - INSTALL X BRACE AT BOTH ENDS AND AT 20' O.C. PER PLANS.
 - APPROVED TRUSS DRAWINGS MUST BE ON JOB SITE FOR INSPECTION PURPOSES

TRIPLEX DWELLING UNIT

OPTION #2

PROJECT
TRIPLEX
DWELLING UNIT

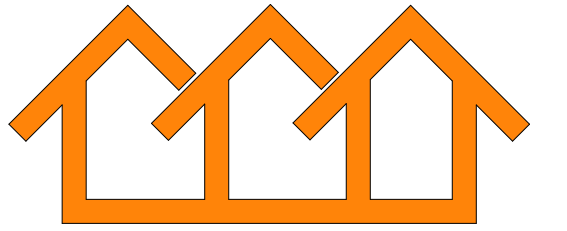

PWP23-005
DEPARTMENT OF PUBLIC
WORKS AND PLANNING



CAPITAL PROJECTS
DIVISION
2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879



UPDATE
JANUARY 2, 2024

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY AND COPYRIGHT OF THE ARCHITECT AND SHALL NOT BE USED ON ANY OTHER PROJECT OR LOCATIONS EXCEPT AS DESCRIBED ON THE DRAWINGS WITHOUT WRITTEN AGREEMENT WITH THE ARCHITECT.


TITLE
ROOF FRAMING
PLAN

SCALE As indicated

S-203

ISSUE DATE MARCH 7, 2023	JOB NUMBER 2023_11
DRAWN BY Author	CHECKED BY Checker


1/4/2024 8:07:33 AM
24" X 36"

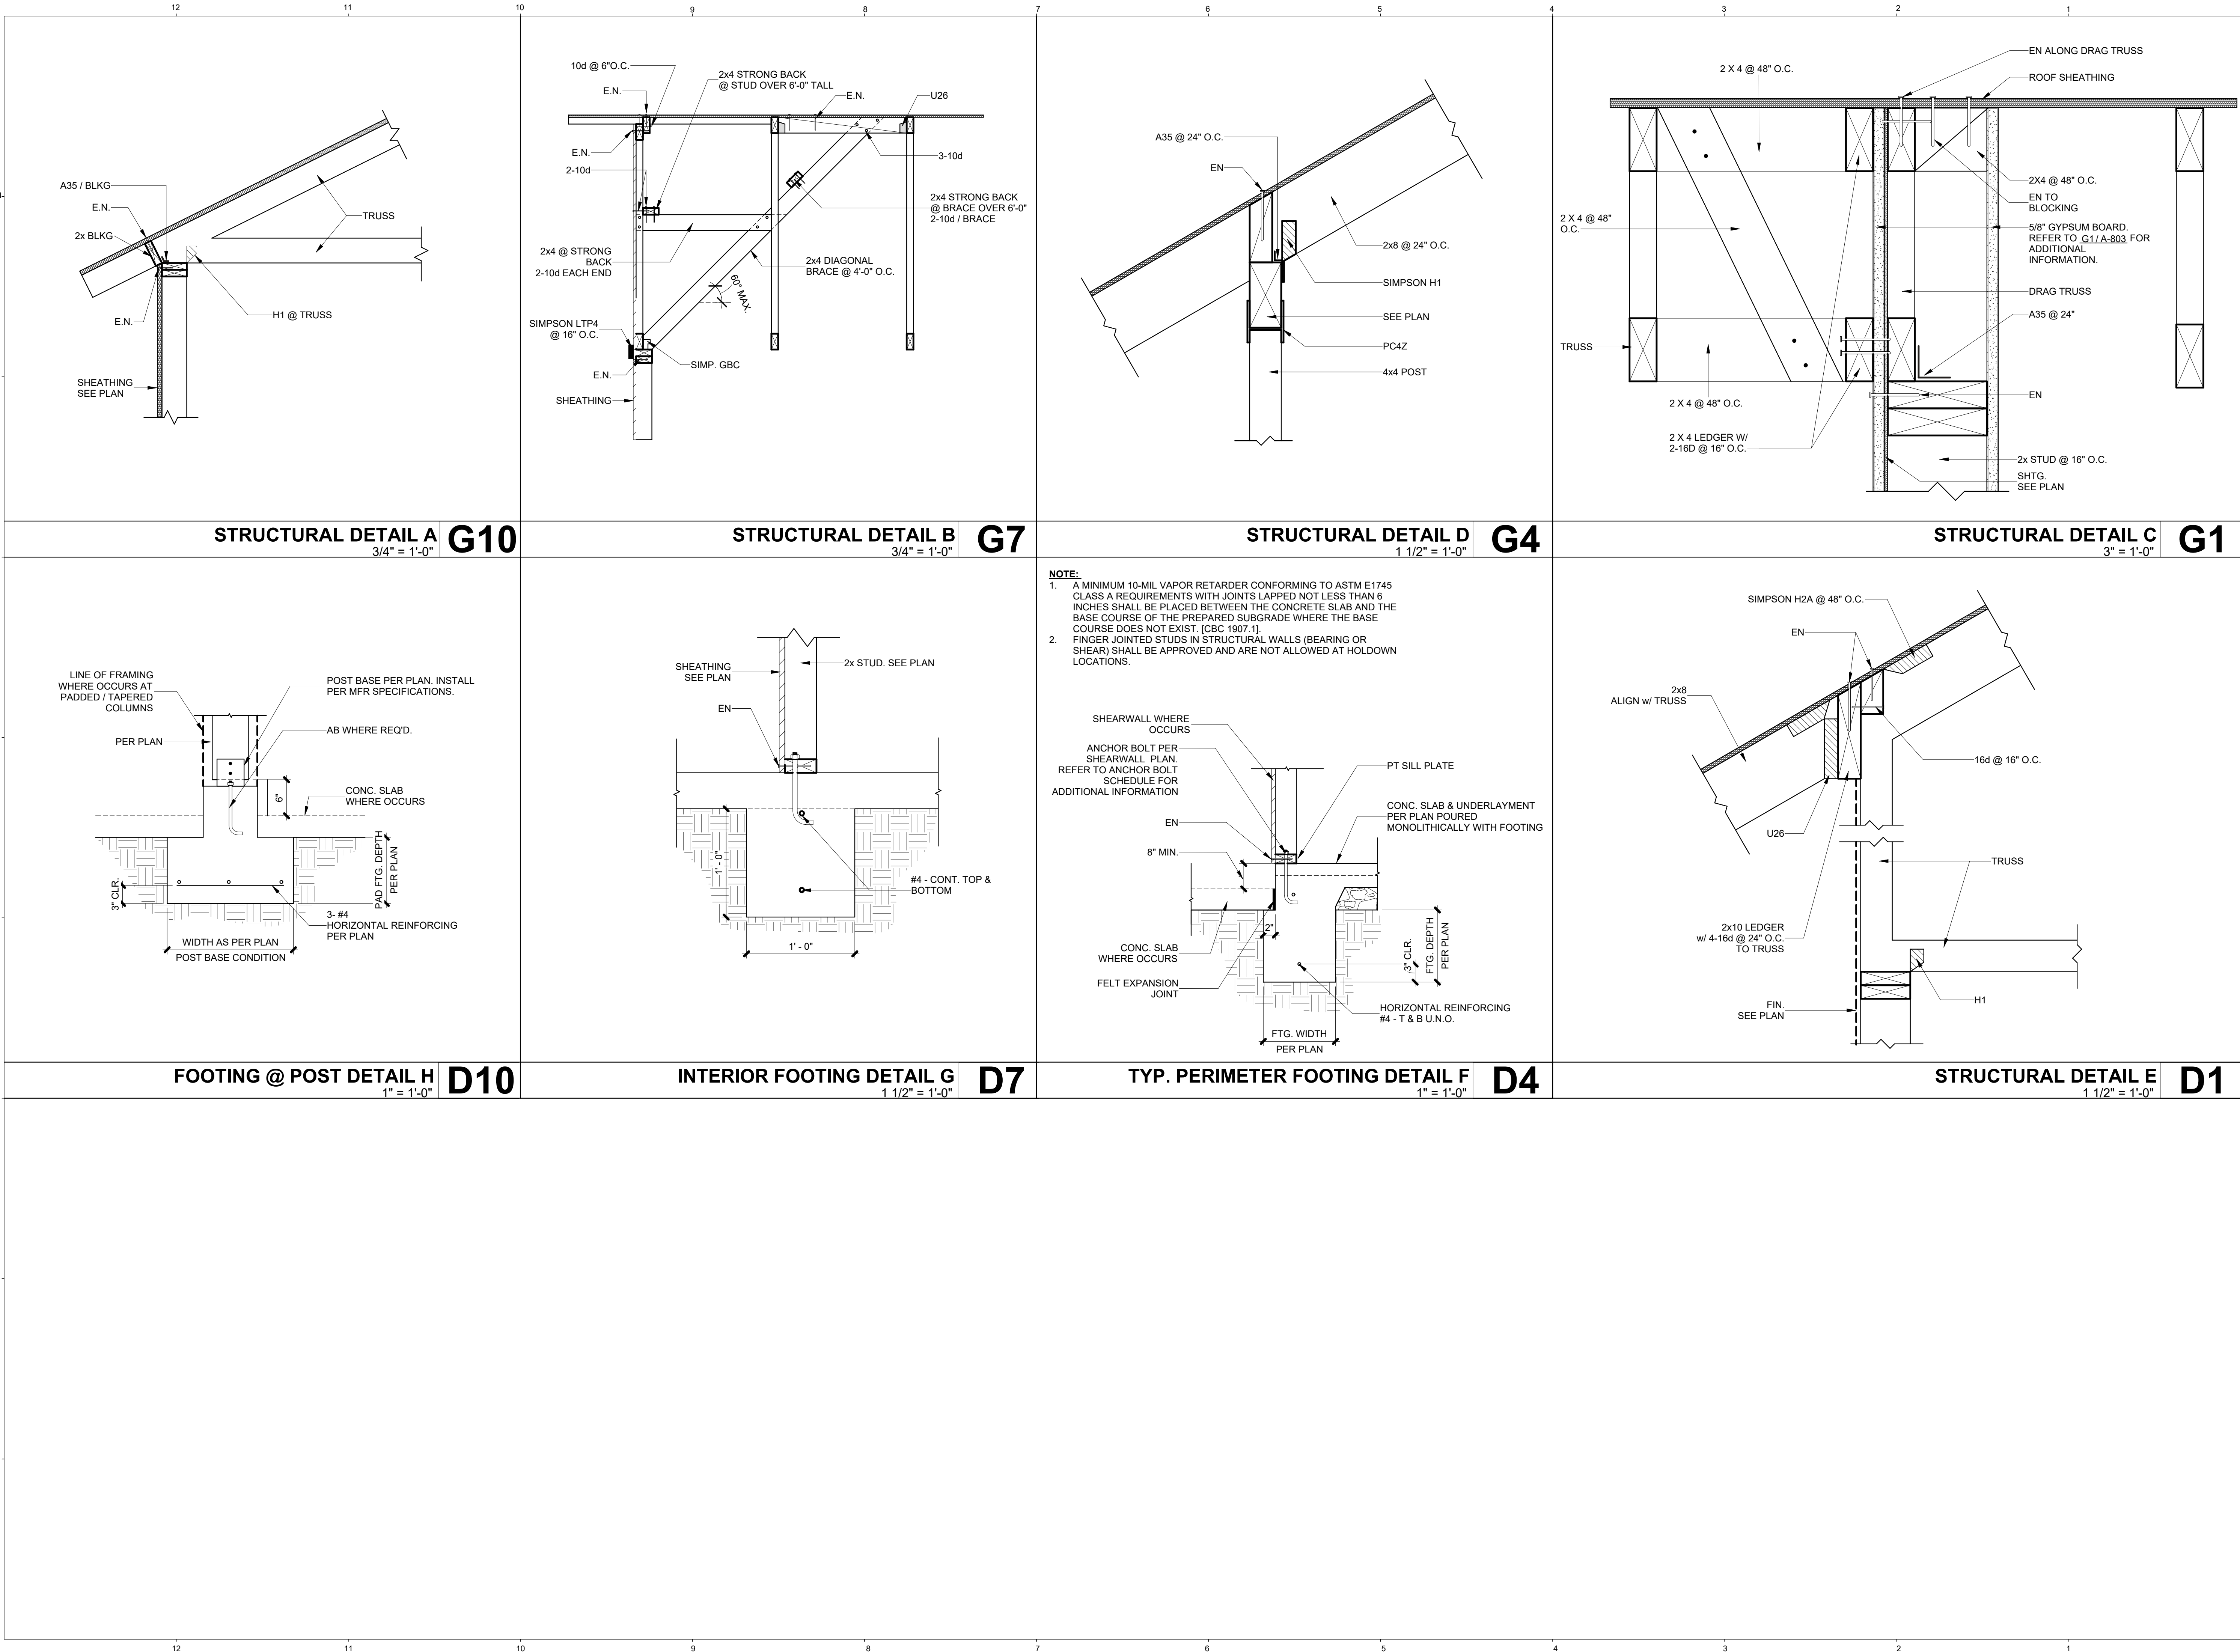

TRIPLEX DWELLING UNIT

OPTION #2

PROJECT
TRIPLEX
DWELLING UNIT

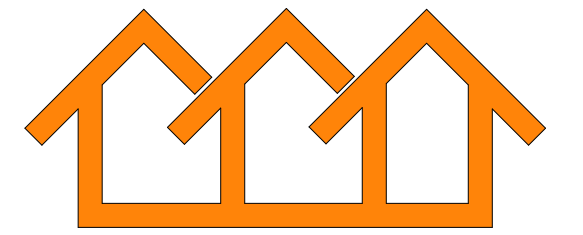

PWP23-005


DEPARTMENT OF PUBLIC
WORKS AND PLANNING



CAPITAL PROJECTS
DIVISION

2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

SEAL & SIGNATURE

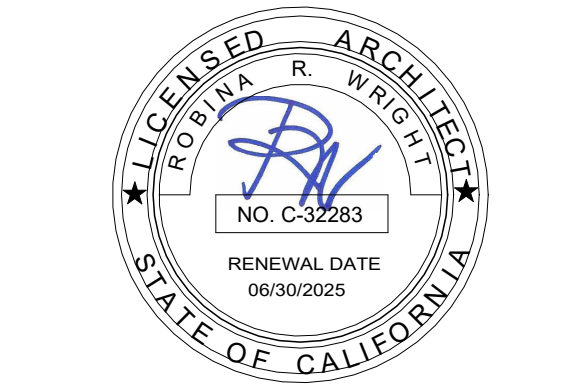

UPDATE

JANUARY 2, 2024

THESE DRAWINGS AND SPECIFICATIONS
ARE THE PROPERTY AND COPYRIGHT OF
THE ARCHITECT AND SHALL NOT BE
USED ON ANY OTHER PROJECT OR
LOCATIONS EXCEPT AS DESCRIBED ON
THE DRAWINGS WITHOUT WRITTEN
AGREEMENT WITH THE ARCHITECT.

TITLE

STRUCTURAL DETAILS

SCALE As indicated

S-301

ISSUE DATE	JOB NUMBER
MARCH 7, 2023	2023_11
DRAWN BY	CHECKED BY
Author	Checker

©

6/8/2023 4:14:52 PM 24" X 36"

GENERAL NOTES:

1. COORDINATION OF WORK: LAYOUT OF MATERIALS, EQUIPMENT AND SYSTEMS ARE GENERALLY DIAGRAMMATIC UNLESS SPECIFICALLY DIMENSIONED. SOME OF THE WORK MAY BE SHOWN OFFSET FOR CLARITY. THE ACTUAL LOCATION OF ALL MATERIALS, PIPING, DUCTWORK, FIXTURES, EQUIPMENT, SUPPORT, ETC. ALL DUCT AND PIPE ELBOWS AND ELEVATIONS ARE NOT SHOWN. CONTRACTOR TO ENSURE BID COVERS ELEVATION CHANGES TO INTERFERENCE WITH OTHER UTILITIES. ALL WORK SHALL BE CAREFULLY PLANNED PRIOR TO INSTALLATION OF ANY WORK TO AVOID ALL INTERFERENCES WITH EACH OTHER, OR WITH STRUCTURAL, ELECTRICAL, ARCHITECTURAL OR OTHER ELEMENTS. VERIFY THE PROPER VOLTAGE AND PHASE FOR ALL EQUIPMENT WITH THE ELECTRICAL PLANS. ALL CONFLICTS SHALL BE CALLED TO THE ATTENTION OF THE ARCHITECT AND ENGINEER PRIOR TO THE INSTALLATION OF ANY WORK OR ORDERING OF ANY EQUIPMENT.

2. CUTTING, BORING, SAW CUTTING OR DRILLING THROUGH THE NEW OR EXISTING STRUCTURAL ELEMENTS TO BE DONE ONLY WHEN SO DETAILED IN THE DRAWINGS OR ACCEPTED BY THE ARCHITECT AND STRUCTURAL ENGINEER WITH THE APPROVAL OF THE DSA REPRESENTATIVE OR AUTHORITY HAVING JURISDICTION.

3. PRIOR TO MECHANICAL PERMIT FINAL, A SMOKE DETECTOR SHUT-OFF TEST WILL BE REQUIRED. COORDINATE TESTING WITH FIRE PREVENTION. IF THERE IS AN ALARM PRESENT, THE SMOKE DETECTORS FOR UNIT SHUT-OFF SHALL BE SUPERVISED BY THE FIRE DETECTION OR ALARM SYSTEM AND INSTALLED IN ACCORDANCE WITH NFPA 72. DETECTION OF SMOKE IN ONE OF THE HVAC SUPPLY DUCT DETECTORS SHALL SHUT OFF THE POWER SOURCE TO ALL OF THE HVAC UNITS. 2022 CMC 608.1.

TITLE 24 MECHANICAL & PLUMBING REQUIREMENTS:

1. ALL AIR COOLED HVAC UNITS SHALL HAVE MINIMUM EFFICIENCIES PER TABLE 110.2-A PER CEC 2022
2. ALL FURNACES SHALL HAVE MINIMUM EFFICIENCIES PER TABLE 110.2-J PER CEC 2022
3. ALL FURNACES SHALL HAVE STAND BY LOSS CONTROLS PER SECTION 110.2 (j) PER CEC 2022
4. ALL THERMOSTATS SHALL COMPLY WITH 110 (b) OR (c) AS APPLICABLE PER CEC 2022
5. ALL HVAC SYSTEMS SHALL HAVE OUTSIDE (VENTILATION) AIR PER 120.1 (b) 2. ALSO SEE MECHANICAL PLANS FOR MINIMUM OUTSIDE AIR SETTINGS PER CEC 2022
6. WHEN CO₂ VENTILATION DEMAND CONTROLS ARE SPECIFIED, PROVIDE IN ACCORDANCE WITH 120.1 C PER CEC 2022
7. MINIMUM VENTILATION RATES SHALL BE INITIATED ONE HOUR PRIOR TO SCHEDULED OCCUPANCY PER 120.1 (c) 2 PER CEC 2022
8. EACH HVAC SYSTEM SHALL HAVE SHUT-OFF AND RESET CONTROLS COMPLYING WITH 120.2 (e) PER CEC 2022
9. ALL OUTSIDE AND EXHAUST DAMPERS SHALL AUTOMATICALLY CLOSE PER 120.2 (f) PER CEC 2022
10. ALL SYSTEMS GREATER THAN A NOMINAL 54 MBH COOLING CAPACITY SHALL HAVE ECONOMIZERS EQUIPPED WITH FAULT DETECTION AND DIAGNOSTICS PER 120.2 (i) PER CEC 2022
11. ALL DUCTWORK INSULATION SHALL COMPLY WITH 120.4 PER CEC 2022
12. SET UP ALL THERMOSTATS WITH A DEAD BAND OF NO LESS THAN (3) DEGREES TO PREVENT CYCLING BETWEEN HEATING AND COOLING.
13. ACCEPTANCE TESTS REQUIRED PRIOR TO GRANTING OCCUPANCY.
- 13.1. OUTDOOR AIR VENTILATION SYSTEMS PER NA 7.5.1.
- 13.2. CONSTANT VOLUME SINGLE ZONE SYSTEM CONTROLS PER NA 7.5.2.
- 13.3. AIR ECONOMIZERS PER NA 7.5.4.
- 13.4. DEMAND CONTROL (CO₂) CONTROLS, WHEN REQUIRED, PER NA 7.5.5.
- 13.5. FAULT DETECTION & DIAGNOSTICS (FDD) PER NA 7.5.11.
14. DUCT CONSTRUCTION STANDARD NOTE:
- 14.1. All air distribution system ducts and plenums, including but not limited to building cavities, mechanical closets, air-handler boxes and support platforms used as ducts or plenums, shall meet the requirements of the CMC Sections 601.0, 602.0, 603.0, 604.0, and ANSI/SMACNA-09-2008 HVAC Duct Construction Standards Metal and Flexible, 3rd Edition incorporated herein by reference. Connections of metal ducts and the inner core of flexible ducts shall be mechanically fastened. Openings shall be sealed with mastic, tape, aerosol sealant or other duct-closure system that meets the applicable requirements of UL 181, UL 181A, or UL 181B. If mastic or tape is used to seal openings greater than 1/4 inch, the combination of mastic and either mesh or tape shall be used. Portions of supply-air and return-air ducts conveying heated or cooled air located in one or more of the following spaces shall be insulated to a minimum installed level of R-6:
- 14.1.1. Outdoors; or
- 14.1.2. In a space between the roof and an insulated ceiling; or
- 14.1.3. In a space directly under a roof with fixed vents or openings to the outside or unconditioned spaces; or
- 14.1.4. In an unconditioned crawlspace; or
- 14.1.5. In other unconditioned spaces.
- 14.1.6. Portions of supply-air ducts that are not in one of these spaces, including ducts buried in concrete slab, shall be insulated to a minimum installed level of R-4.2 or be enclosed in directly conditioned space.

EQUIPMENT ANCHORAGE:

ALL MECHANICAL, PLUMBING AND ELECTRICAL COMPONENTS SHALL BE ANCHORED AND INSTALLED PER THE DETAILS ON THE APPROVED CONSTRUCTION DOCUMENTS. WHERE NO DETAIL IS INDICATED, THE FOLLOWING COMPONENTS SHALL BE ANCHORED OR BRACES TO MEET THE FORCE AND DISPLACEMENT REQUIREMENTS PRESCRIBED IN THE 2022 CBC, SECTIONS 1616A.1.18 THROUGH 1616A.1.28 AND ASCE 7-10 CHAPTER 13, 29 AND 30.

1. ALL PERMANENT EQUIPMENT AND COMPONENTS
2. TEMPORARY OR MOVABLE EQUIPMENT THAT IS PERMANENTLY ATTACHED (E.G. HARD WIRED) TO THE BUILDING UTILITY SERVICES SUCH AS ELECTRICITY, GAS OR WATER.
3. MOVABLE EQUIPMENT WHICH IS STATIONED IN ONE PLACE FOR MORE THAN 8 HOURS AND HEAVIER THAN 400 POUNDS OR HAS A CENTER MASS LOCATED 4 FEET OR MORE ABOVE THE ADJACENT FLOOR OR ROOF LEVEL THAT DIRECTLY SUPPORT THE COMPONENT ARE REQUIRED TO BE ANCHORED WITH TEMPORARY ATTACHMENTS.

THE FOLLOWING MECHANICAL AND ELECTRICAL COMPONENTS SHALL BE POSITIVELY ATTACHED TO THE STRUCTURE, BUT THE ATTACHMENT NEED NOT BE DETAILED ON THE PLANS. THESE COMPONENTS SHALL HAVE FLEXIBLE CONNECTIONS PROVIDED BETWEEN THE COMPONENT AND ASSOCIATED DUCTWORK, PIPING AND CONDUIT.

- A. COMPONENTS WEIGHING LESS THAN 400 POUNDS AND HAVE A CENTER OF MASS LOCATED 4 FEET OR LESS ABOVE THE ADJACENT FLOOR OR ROOF LEVEL THAT DIRECTLY SUPPORT THE COMPONENT.
- B. COMPONENTS WEIGHING LESS THAN 20 POUNDS OR IN THE CASE OF DISTRIBUTED SYSTEMS, LESS THAN 5 POUNDS PER FOOT, WHICH ARE SUSPENDED FROM A ROOF OR FLOOR OR HUNG FROM A WALL.

NOTE: PRIOR TO MECHANICAL PERMIT FINAL, A SMOKE DETECTOR SHUT OFF TEST WILL BE REQUIRED. COORDINATE TESTING WITH FIRE PREVENTION. IF THERE IS AN ALARM PRESENT, THE SMOKE DETECTOR FOR THE UNIT SHUT OFF SHALL BE SUPERVISED BY THE FIRE DETECTION OR ALARM SYSTEM AND INSTALLED IN ACCORDANCE WITH NFPA 72. DETECTION OF SMOKE IN ONE OF THE HVAC SUPPLY DUCT DETECTORS SHALL SHUT OFF THE POWER SOURCE TO ALL OF THE HVAC UNITS. 2022 CMC 608.1.

APPLICABLE CODES AND REGULATIONS:

CALIFORNIA CODE OF REGULATIONS (C.C.R.)

PART 1 - 2022 CALIFORNIA STANDARDS ADMINISTRATIVE CODE, TITLE 24, C.C.R.

PART 2 - 2022 CALIFORNIA BUILDING CODE (C.B.C.), TITLE 24, C.C.R. VOLUMES 1-3.

PART 3 - 2022 CALIFORNIA ELECTRICAL CODE, TITLE 24, C.C.R.

PART 4 - 2022 CALIFORNIA MECHANICAL CODE (C.M.C.), TITLE 24 C.C.R.

PART 5 - 2022 CALIFORNIA PLUMBING CODE (C.P.C.), TITLE 24, C.C.R.

PART 6 - 2022 CALIFORNIA ENERGY CODE, TITLE 24, C.C.R.

PART 9 - 2022 CALIFORNIA FIRE CODE, TITLE 24, C.C.R.

AIR CONDITIONING LEGEND		
SYMBOL	ITEM	ABBR
	ROUND DUCT	
	EXISTING ROUND DUCT	
	SHEET METAL DUCT	
	DUCT WITH ACOUSTIC LINING	
	SUPPLY AIR DUCT DROP	
	RETURN AIR DUCT DROP	
	EXHAUST AIR DUCT DROP	
	SUPPLY AIR DUCT RISE	
	RETURN AIR DUCT RISE	
	EXHAUST AIR DUCT RISE	
	VOLUME DAMPER	
	FIRE DAMPER WITH ACCESS PANEL	FD
	FIRE/SMOKE DAMPER WITH ACCESS PANEL	FSD
CFM	CUBIC FEET OF AIR PER MINUTE	CFM
	THERMOSTAT 48" AFF	
	HUMIDISTAT	
	DIRECTION OF FLOW	
	SUPPLY AIR	SA
	RETURN AIR	RA
	EXHAUST AIR	EA
	OUTSIDE AIR	OSA
	PIPE OR DUCT TURN DOWN	
	PIPE OR DUCT TURN UP	
	POINT OF CONNECTION	POC
	EXISTING (DESIGNATED)	(E)
	SMOKE DETECTOR	SD
	DUCT TO BE DEMOLISHED	
	REMOTE SENSOR	RS
	BACK-DRAFT DAMPER	BDD

OUTDOOR UNIT SCHEDULE

TAG	ODU-1
MANUFACTURER	LG
MODEL#	LUU249HV
SIZE	2 TON
COOLING CAPACITY (MBH)	24
HEATING CAPACITY (MBH)	27
SEER	16.85
HSPF	9.0
COP (47°)	-
AIRFLOW (CFM)	2048
EER	11.7
VOLTAGE/ PHASE	208 - 230 / 1
MCA / MOCF / RLA / FLA	20 / 30 / - / -
WEIGHT (LBS)	150
ACCESSORIES	1

ACCESSORIES:

1. ROOF MOUNTED PER MANUFACTURES SPACING AND CLEARANCES. REFER TO DETAIL 'A'/M002 FOR ADDITIONAL INFORMATION

GRILLE SCHEDULE

TAG	A (SUPPLY)	B (RET / EX)	C (SUPPLY)
TYPE	HARD CEILING	HARD CEILING	WALL-MOUNTED
DESCRIPTION	TITUS 250-AA RECTANGULAR DIFFUSER, STANDARD #26 WHITE FINISH. TWO-WAY	TITUS 355FLF1 FACE FILTER GRILLE. STANDARD #26 WHITE FINISH. 1/2" BLADE SPACING.	TITUS-310RL-HD-1. STANDARD FINISH-#26 WHITE 1/2" BLADE SPACING/STEEL

INDOOR UNIT SCHEDULE

TAG	IDU-1
MANUFACTURER	LG
TYPE	HIGH STATIC DUCTED
MODEL#	LHN248HV
SIZE (TON)	2
COOLING (MBH)	24
HEATING (MBH)	27
SUPPLY (CFM)	777
ESP (IN.WG)	0.59
HP	-
POWER (KW)	2.05
VOLTAGE / PHASE	208-230 / 1
MCA / MOP / FLA	- / - / 1.6
WEIGHT (LBS)	72
ACCESSORIES	1, 2, 3

ACCESSORIES:

1. TITLE 24 COMPLIANT THERMOSTAT INSTALLED 48" AFF
2. INSTALL PER DETAIL 'B'/M002
3. MITSUBISHI, LG, OR APPROVED EQUAL OKAY FOR SUBSTITUTION

RANGE HOOD SCHEDULE

TAG	RH-1
MANUFACTURER	BROAN
MODEL#	EW4830
DESIGN CFM	400
EXTERNAL SP (IN WG)	0.1
SPEEDS	3
AMPS	1.6
VOLTAGE / PHASE	120 / 1
SONES	6.5
WEIGHT (LBS)	20
ACCESSORIES	1

EXHAUST FAN SCHEDULE

TAG	CEF-1
MANUFACTURER	PANASONIC
MODEL#	FV-0511VQ1
CFM	110
ESP	0.1
RPM	957
VOLTAGE / PHASE	120 / 1
FLA	-
WEIGHT (LBS)	11
SONES	0.3
ACCESSORIES	1.2

ACCESSORIES:

1. PROVIDE BACK DRAFT DAMPER
2. INTERLOCK WITH LIGHT SWITCH


INDEX:
M001 - MECHANICAL GENERAL NOTES, LEGEND, AND SCHEDULES
M002 - MECHANICAL DETAILS
M100 - MECHANICAL FLOOR PLANS

Enter address here

PLAN
#2

PROJECT

TRIPLEX
DWELLING UNIT

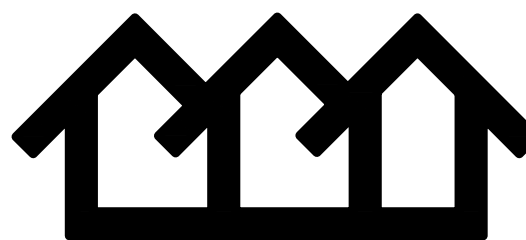

PWP23-005


DEPARTMENT OF PUBLIC
WORKS AND PLANNING



CAPITAL PROJECTS
DIVISION

2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

SEAL & SIGNATURE

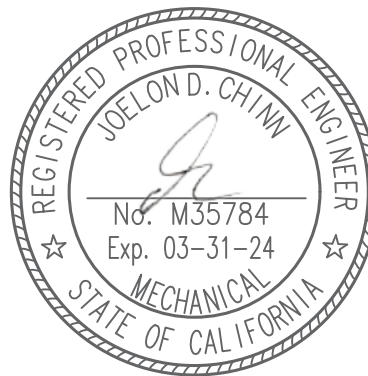

UPDATE

APRIL 20, 2023_DD Phase

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY AND COPYRIGHT OF THE ARCHITECT AND SHALL NOT BE USED ON ANY OTHER PROJECT OR LOCATIONS EXCEPT AS DESCRIBED ON THE DRAWINGS WITHOUT WRITTEN AGREEMENT WITH THE ARCHITECT.

TITLE

GN, LEGEND, AND
SCHEDULES

SCALE

As indicated

M001

ISSUE DATE	JOB NUMBER
MARCH 7, 2023	2023_11
DRAWN BY	CHECKED BY
Author	Checker

B

C

D

E

F


G

H

A 2747



F



C

B

95

A

SCALE: N.T.S.

SWAY BRACE (TYP)




SCALE: N.T.S.

ROUND GALVANIZED SHEET DUCT THROUGH ROOF

ROUND GALVANIZED SHEET


DUCT THROUGH ROOF



SCALE: N.T.S.

SCALE: N.T.S.

TRIPLEX
DWELLING UNIT



SEAL & SIGNATURE



THESE DRAWINGS AND SPECIFICATIONS
ARE THE PROPERTY AND COPYRIGHT OF
THE ARCHITECT AND SHALL NOT BE
USED ON ANY OTHER PROJECT OR
LOCATIONS EXCEPT AS DESCRIBED ON
THE DRAWINGS WITHOUT WRITTEN
AGREEMENT WITH THE ARCHITECT.

TITLE

SCALE

s indicated

M100

ISSUE DATE

MARCH 7, 2023

DRAWN BY

CHECKED BY _____

Checker



ENLARGED PLAN VIEW

6/8/2023 4:14:52 PM

24" X 36"

GENERAL NOTES

- COORDINATION OF WORK, LAYOUT OF MATERIALS, EQUIPMENT AND SYSTEMS ARE GENERALLY DIAGRAMMATIC UNLESS SPECIFIC DIMENSIONS ARE SHOWN. CONTRACTOR TO ENSURE BID COVERS ELEVATION CHANGES TO INTERFERENCE WITH OTHER UTILITIES. ALL WORK SHALL BE CAREFULLY PLANNED PRIOR TO INSTALLATION OF ANY WORK TO AVOID ALL INTERFERENCES WITH EACH OTHER, OR WITH STRUCTURAL, ELECTRICAL, ARCHITECTURAL OR OTHER ELEMENTS. VERIFY THE PROPER VOLTAGE AND PHASE FOR ALL EQUIPMENT WITH THE ELECTRICAL PLANS. ALL CONFLICTS SHALL BE CALLED TO THE ATTENTION OF THE ARCHITECT AND ENGINEER PRIOR TO THE INSTALLATION OF ANY WORK OR ORDERING OF ANY EQUIPMENT.
- CUTTING, BORING, SAW CUTTING OR DRILLING THROUGH THE NEW OR EXISTING STRUCTURAL ELEMENTS TO BE DONE ONLY WHEN SO DETAILED IN THE DRAWINGS OR ACCEPTED BY THE ARCHITECT AND STRUCTURAL ENGINEER WITH THE APPROVAL OF THE DSA REPRESENTATIVE OR AUTHORITY HAVING JURISDICTION.
- ALL WASTE PIPES THAT ARE SMALLER THAN 4" MUST HAVE A MINIMUM SLOPE OF 2%.
- PROVIDE CLEANOUTS FOR WASTE LINES EXCEEDING 5 FEET FROM THE MAIN. CLEANOUTS SHALL BE SIZED PER CPC TABLE 707 (CPC 707.4).
- ALL TUB AND SHOWER VALVES ARE TO BE SINGLE CONTROL, PRESSURE BALANCING OR THERMOSTATIC ANTI-SCALD TYPE.
- WATER HAMMER ARRESTORS SHALL BE INSTALLED AT THE FOLLOWING QUICK-ACTING SHUT-OFF VALVES [CPC 609.10]:
 - AUTOMATIC WASHING MACHINE (HOT AND COLD WATER)
 - ICE MAKER
 - DISHWASHER
 - FRONT AND REAR SPRINKLER OUTLET

TITLE 24 MECHANICAL & PLUMBING REQUIREMENTS

- ALL AIR COOLED HVAC UNITS SHALL HAVE MINIMUM EFFICIENCIES PER TABLE 110.2.A.
- ALL FURNACES SHALL HAVE MINIMUM EFFICIENCIES PER TABLE 110.2.J.
- ALL FURNACES SHALL HAVE STAND BY LOSS CONTROLS PER SECTION 110.2 (d).
- ALL THERMOSTATS SHALL COMPLY WITH 110 (b) (i) OR (c) AS APPLICABLE.
- ALL HVAC SYSTEMS SHALL HAVE OUTSIDE VENTILATION AIR PER 120.1 (b) 2. ALSO SEE MECHANICAL PLANS FOR MINIMUM OUTSIDE AIR SETTINGS.
- WHEN CO₂ VENTILATION DEMAND CONTROLS ARE SPECIFIED, PROVIDE IN ACCORDANCE WITH 120.1 c.
- MINIMUM VENTILATION RATES SHALL BE INITIATED ONE HOUR PRIOR TO SCHEDULED OCCUPANCY PER 120.1 (c) 2.
- EACH HVAC SYSTEM SHALL HAVE SHUT-OFF AND RESET CONTROLS COMPLYING WITH 120.2 (e).
- ALL OUTSIDE AND EXHAUST DAMPERS SHALL AUTOMATICALLY CLOSE PER 120.2 (f).
- ALL SYSTEMS GREATER THAN A NOMINAL 50 MBH COOLING CAPACITY SHALL HAVE ECONOMIZERS EQUIPPED WITH FAULT DETECTION AND DIAGNOSTICS PER 120.2 (i).
- ALL DUCTWORK INSULATION SHALL COMPLY WITH 120.4.
- SET UP ALL THERMOSTATS WITH A DEAD BAND OF NO LESS THAN (3) DEGREES TO PREVENT CYCLING BETWEEN HEATING AND COOLING.
- ACCEPTANCE TESTS REQUIRED PRIOR TO GRANTING OCCUPANCY:
 - OUTDOOR AIR VENTILATION SYSTEMS PER NA 7.5.1.
 - CONSTANT VOLUME SINGLE ZONE SYSTEM CONTROLS PER NA 7.5.2.
 - AIR ECONOMIZERS PER NA 7.5.4.
 - DEMAND CONTROL (CO₂) CONTROLS, WHEN REQUIRED, PER NA 7.5.5.
 - FAULT DETECTION & DIAGNOSTICS (FDD) PER NA 7.5.11.

EQUIPMENT ANCHORAGE:

ALL MECHANICAL, PLUMBING AND ELECTRICAL COMPONENTS SHALL BE ANCHORED AND INSTALLED PER THE DETAILS ON THE APPROVED CONSTRUCTION DOCUMENTS. WHERE NO DETAIL IS INDICATED, THE FOLLOWING COMPONENTS SHALL BE ANCHORED OR BRIGES TO MEET THE FORCE AND DISPLACEMENT REQUIREMENTS PRESCRIBED IN THE 2022 CBC, SECTIONS 1616A AND ASCE 7-10 CHAPTER 13, 26 AND 30.

- ALL PERMANENT EQUIPMENT AND COMPONENTS
- TEMPORARY OR MOVABLE EQUIPMENT THAT IS PERMANENTLY ATTACHED (E.G. HARD WIRED) TO THE BUILDING UTILITY SERVICES SUCH AS ELECTRICITY, GAS OR WATER.
- MOVABLE EQUIPMENT WHICH IS STATIONED IN ONE PLACE FOR MORE THAN 1 HOUR AND HEAVIER THAN 400 POUNDS OR HAS A CENTER MASS LOCATED 4 FEET OR MORE ABOVE THE ADJACENT FLOOR OR ROOF LEVEL THAT DIRECTLY SUPPORT THE COMPONENT ARE REQUIRED TO BE ANCHORED WITH TEMPORARY ATTACHMENTS.

THE FOLLOWING MECHANICAL AND ELECTRICAL COMPONENTS SHALL BE POSITIVELY ATTACHED TO THE STRUCTURE, BUT THE ATTACHMENT NEED NOT BE DETAILED ON THE PLANS. THESE COMPONENTS SHALL HAVE FLEXIBLE CONNECTIONS PROVIDED BETWEEN THE COMPONENT AND ASSOCIATED DUCTWORK, PIPING AND CONDUIT.

- COMPONENTS WEIGHING LESS THAN 400 POUNDS AND HAVE A CENTER OF MASS LOCATED 4 FEET OR LESS ABOVE THE ADJACENT FLOOR OR ROOF LEVEL THAT DIRECTLY SUPPORT THE COMPONENT.
- COMPONENTS WEIGHING LESS THAN 20 POUNDS OR IN THE CASE OF DISTRIBUTED SYSTEMS, LESS THAN 5 POUNDS PER FOOT, WHICH ARE SUSPENDED FROM A ROOF OR FLOOR OR HUNG FROM A WALL.

PIPING MATERIALS:

- SANITARY SEWER AND VENT PIPING BELOW GROUND: JOHNS-MANVILLE RING-TITE OR EQUIVALENT, POLYVINYL CHLORIDE (PVC) GRAVITY PIPE, WHERE PERMITTED BY CODES.
- SANITARY SEWER AND VENT PIPING ABOVE GROUND: ABS SCHEDULE 40 PIPE AND FITTINGS PER ASTM D2661 & ASTM D2689 PER TABLE 701.2.
- WATER PIPING ABOVE GROUND: HOT WATER, COLD WATER, AND FILTER WATER: TYPE "C" COPPER WITH LEAD-FREE SOLDERED JOINTS OR PEX PIPE PER 2019 CPC TABLE 604.1
- DOMESTIC WATER BELOW GRADE, SLAB, PAVED AREAS: POLYVINYL CHLORIDE (PVC) PRESSURE RATED SCHEDULE 40, ASTM D 2241, WITH RUBBER RINGS, ASTM D 1869. GALVANIZED MALLEABLE IRON, GALVANIZED STEEL, TYPE "M," OR TYPE "L" ARE PROHIBITED MATERIALS FOR WATER SUPPLY AND BUILDING WATER PIPING BOTH UNDERGROUND AND IN BUILDINGS.
- INSULATION OF DOMESTIC HOT WATER SUPPLY AND RETURN, CONDENSATE DRAIN PIPING: GLASS FIBER PIPE INSULATION WITH FACTORY APPLIED WHITE JACKET, 3/8" MICRO LOCK 750AP, 1" INCH THICK FOR PIPE SIZES 1" INCH AND SMALLER, AND 1-1/2" INCH THICK FOR PIPE SIZES 1-1/4" INCHES AND LARGER. HOT WATER PIPE INSULATION SHALL HAVE MINIMUM WALL THICKNESS OF, NOT LESS THAN THE DIAMETER OF THE PIPE FOR A PIPE UP TO 2 INCHES IN DIAMETER. INSULATION WALL THICKNESS SHALL NOT BE LESS THAN 2 INCHES FOR A PIPE OF 2 INCHES OR MORE IN DIAMETER.

APPLICABLE CODES AND REGULATIONS:

CALIFORNIA CODE OF REGULATIONS (C.C.R.)
PART 1 - 2022 CALIFORNIA STANDARDS ADMINISTRATIVE CODE, TITLE 24, C.C.R.
PART 2 - 2022 CALIFORNIA BUILDING CODE (C.B.C.), TITLE 24, C.C.R. VOLUMES 1-3.
PART 3 - 2022 CALIFORNIA ELECTRICAL CODE, TITLE 24, C.C.R.
PART 4 - 2022 CALIFORNIA MECHANICAL CODE (C.M.C.), TITLE 24, C.C.R.
PART 5 - 2022 CALIFORNIA PLUMBING CODE (C.P.C.), TITLE 24, C.C.R.
PART 6 - 2022 CALIFORNIA ENERGY CODE, TITLE 24, C.C.R.
PART 7 - 2022 CALIFORNIA FIRE CODE, TITLE 24, C.C.R.

PLUMBING FIXTURE AND EQUIPMENT SCHEDULE						
TAG	FIXTURE	DESCRIPTION	HW	CW	VENT	WASTE/SEWER
B-1	BATHTUB	ALOHA PORCELAIN ENAMEL 60" X 30" X 14 1/4" BATHTUB 40 DEGREE LUMBAR SUPPORT, 67 LBS	1/2"	1/2"	2"	2"
HB-1	HOSE BIBB	WOODFORD MODEL 65 WALL MOUNTED EXTERIOR HOSE BIBB, FREEZESELESS WALL HYDRANTS WITH SINGLE. CHECK HOSE CONNECTION		3/4"		
L-1	WALL HUNG LAVATORY (ADA)	KHOLER, UNDERMOUNT BATHROOM SINK CAXTON OVAL, MODEL #K-2210-NL, VITRIOUS CHINA OVAL BASIN, WITH KHOLER, DEVONSHIRE MODEL #K-394-4 WIDESPREAD BATHROOM SINK FAUCET, 1.2 GPM WITH MIXING VALVE LEONARD 170A-LF MV-2	1/2"	1/2"	2"	2"
MV-1	MIXING VALVE	LEONARD LV-20-E-LF THERMOSTATIC MIXING VALVE ASSE 1017 COMPLIANT 1GPM MIN FLOW CAPACITY, LOCKING TEMPERATURE REGULATING HANDLE SET TO 125°F	3/4"	3/4"		
MV-2	POINT OF USE MIXING VALVE	LEONARD 170A-LF EXPOSED POINT OF USE MIXING VALVE, ASSE 1070 TO CONTROL DOWN TO 0.25GPM ECO-MIX CERTIFIED LEAD-FREE INTEGRAL INLET CHECKS AND STAINLESS STEEL SCREENS, 120°F MAX TEMPERATURE	3/4"	3/4"		
S-1	KITCHEN SINK	ZUHNE MODENA 30" ADA UNDERMOUNT KITCHEN SINK, T304 STAINLESS SINGLE BOWL, WITH KOHLER (OR EQUIVALENT), SINGLE-HANDLE SEMI-PROFESSIONAL KITCHEN FAUCET, MODEL #K22033, 1.5 GPM	1/2"	1/2"	2"	2"
SH-1	SHOWER	FREEDOM ADA ROLL IN SHOWER, APF6232BF5PLR, 1" BARRIER FREE THRESHOLD WITH PRE-LEVELLED AND REINFORCED SHOWER BASE, GRAB BARS, PRESSURE BALANCE VALVE, CAULKLESS DRAIN, AND HAND HELD SHOWER	5/8"	5/8"	2"	2"
WC-1	WATER CLOSET (ADA)	TOTO CST744EL(R) ECO DRAKE TRANSITIONAL - ADA UNIVERSAL HEIGHT, TWO-PIECE ELONGATED, 1.28 GPF WATER CLOSET, FLUSH TANK		3/4"	2"	3"
WH-1	WATER HEATER	RHEEM, MODEL PROPH40 TO RH120, 12,000 BTU/Hr, 3.0 UEF, 40 GALLON STORAGE CAPACITY, 242 LBS	3/4"	3/4"		

PIPE SIZING SCHEDULE				
COLD WATER				
SIZE (IN.)	FLOW (GPM)	FLUSH TANK (FU)	FLUSH VALVE (FU)	VELOCITY (FPS)
1/2	4.3	5	-	6.2
3/4	9	12	-	6.0
1	16	23	-	6.2
1 1/4	28	49	12	7.6
1 1/2	38	80	26	7.4
2	63	188	87	7.0
2 1/2	90	330	199	6.3
BASED ON CALIFORNIA PLUMBING CODE 2022				
EDITION, MAX 8.0 FPS VELOCITY & ADJUSTED TO 3.0 PSIG PER 100 FT MAX PRESSURE DROP				

PLUMBING LEGEND		
SYMBOL	ITEM	ABBR.
	SOIL OR WASTE	S or W
	VENT	V
	VENT THRU ROOF	
	DOMESTIC COLD WATER	CW
	DOMESTIC HOT WATER	HW
	DOMESTIC HOT WATER RETURN	HWR
	CONDENSATE DRAIN	CD
	EXISTING PIPING	(E)
	EXISTING	
	NEW	
	FILTERED WATER	FW
	FLOOR CLEANOUT	FCO
	WALL CLEANOUT	WCO
	PIPING TURN UP	
	PIPING TURN DOWN	
	POINT OF CONNECTION	
	SHUT OFF VALVE BELOW GRADE	
	SHUT OFF VALVE	

WATER CALCULATIONS PER UNIT							
FIXTURES	QTY	COLD WATER*		HOT WATER*		SEWER/WASTE/VENT**	
		WSFU (EACH)	WSFU (TOTAL)	WSFU (EACH)	WSFU (TOTAL)	DFU (EACH)	DFU (TOTAL)
LAVATORY	2	1	2	0.75	1.5	1	2
SHOWER	2	2	4	1.5	3	2	4
WATER CLOSET (FLUSH TANK)	2	2.5	5	0	0	4	8
KITCHEN SINK	1	2	2	1.5	1.5	2	2
HOSE BIB	1	2.5	2.5	0	0	0	0
HOSE BIB (ADDITIONAL)	1	1	1	0	0	0	0
ICE MACHINE	1	2	2	0	0	0	0
CLOTHES WASHER	1	4	4	3	3	6	6
DISH WASHER	1	4	4	3	3	6	6
TOTAL			26.5		12		28
*PER TABLE A 103.1.3, 2022 CALIFORNIA PLUMBING CODE							
**PER TABLE 702.1, 2022 CALIFORNIA PLUMBING CODE							


INDEX:
P001 - PLUMBING GENERAL NOTES, LEGEND, AND SCHEDULES
P002 - PLUMBING DETAILS
P100 - PLUMBING FLOOR PLAN

Enter address here

PLAN
#2

PROJECT

TRIPLEX
DWELLING UNIT

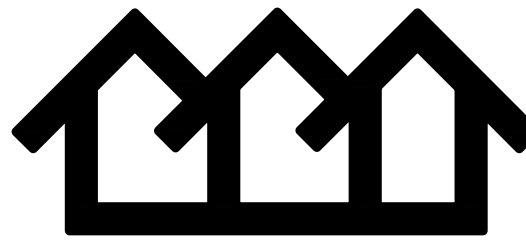

PWP23-005

DEPARTMENT OF PUBLIC
WORKS AND PLANNING



CAPITAL PROJECTS
DIVISION

2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

SEAL & SIGNATURE



UPDATE

2023 12 18

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY AND COPYRIGHT OF THE ARCHITECT AND SHALL NOT BE USED ON ANY OTHER PROJECT OR LOCATIONS EXCEPT AS DESCRIBED ON THE DRAWINGS WITHOUT WRITTEN AGREEMENT WITH THE ARCHITECT.

TITLE

PLUMBING GN,
LEGEND, AND
SCHEDULES

SCALE

As indicated

P001

ISSUE DATE

MARCH 7, 2023

JOB NUMBER

2023_11

DRAWN BY

Author

CHECKED BY

Checker


PLUMBING GENERAL NOTES, LEGEND, AND SCHEDULES

SCALE: N.T.S.


6/8/2023 4:14:52 PM
24" X 36"

PLUMBING DETAILS


SCALE: N.T.S.

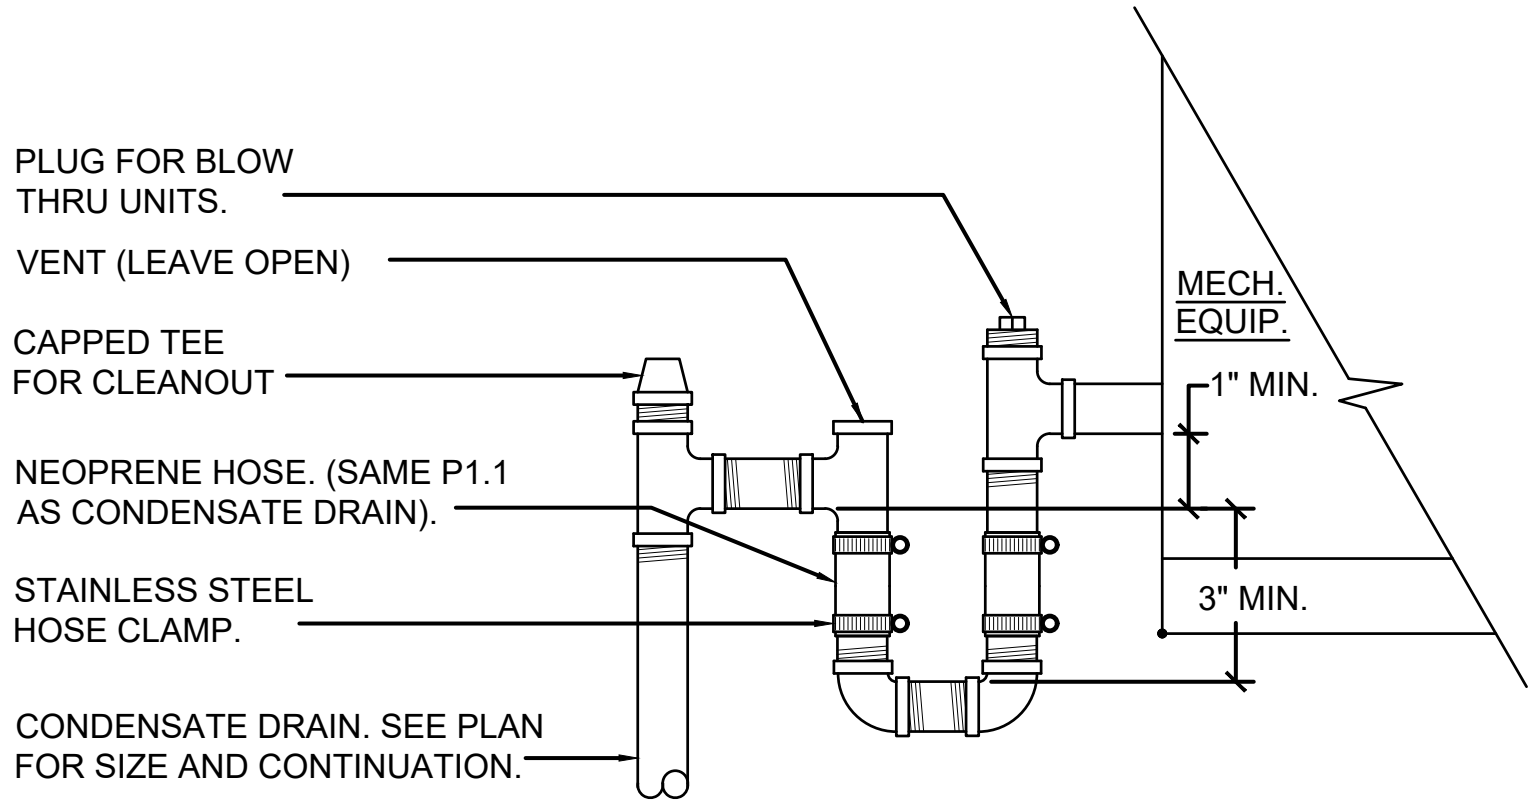

C CONDENSATE DRAIN CONNECTON
SCALE: N.T.S.

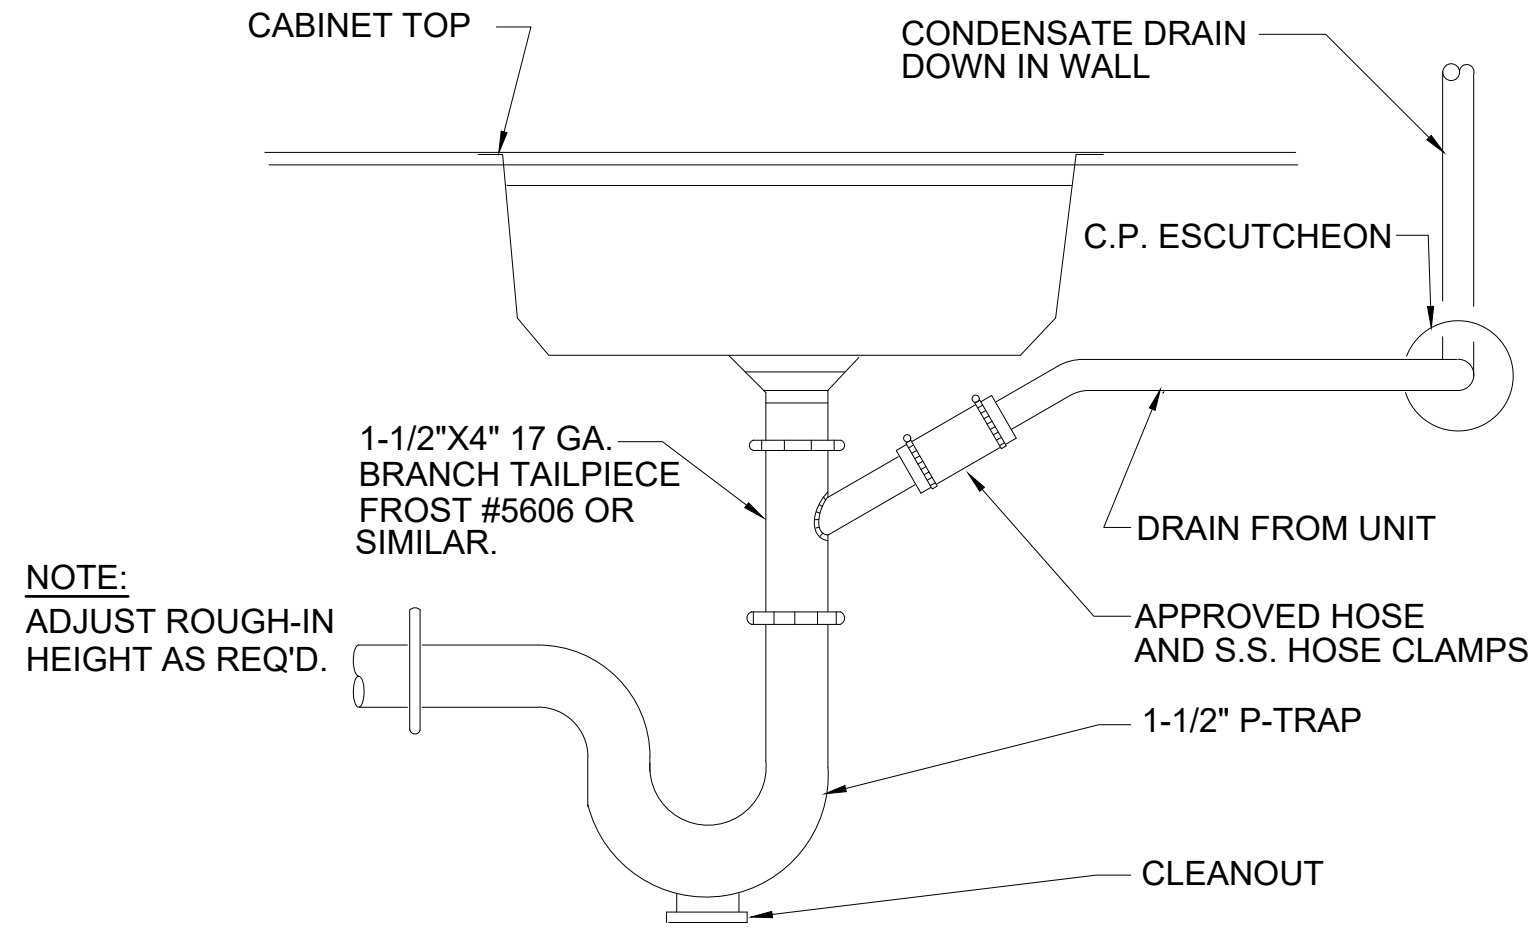

A CONDENSATE TO TAILPIECE DETAIL
SCALE: N.T.S.

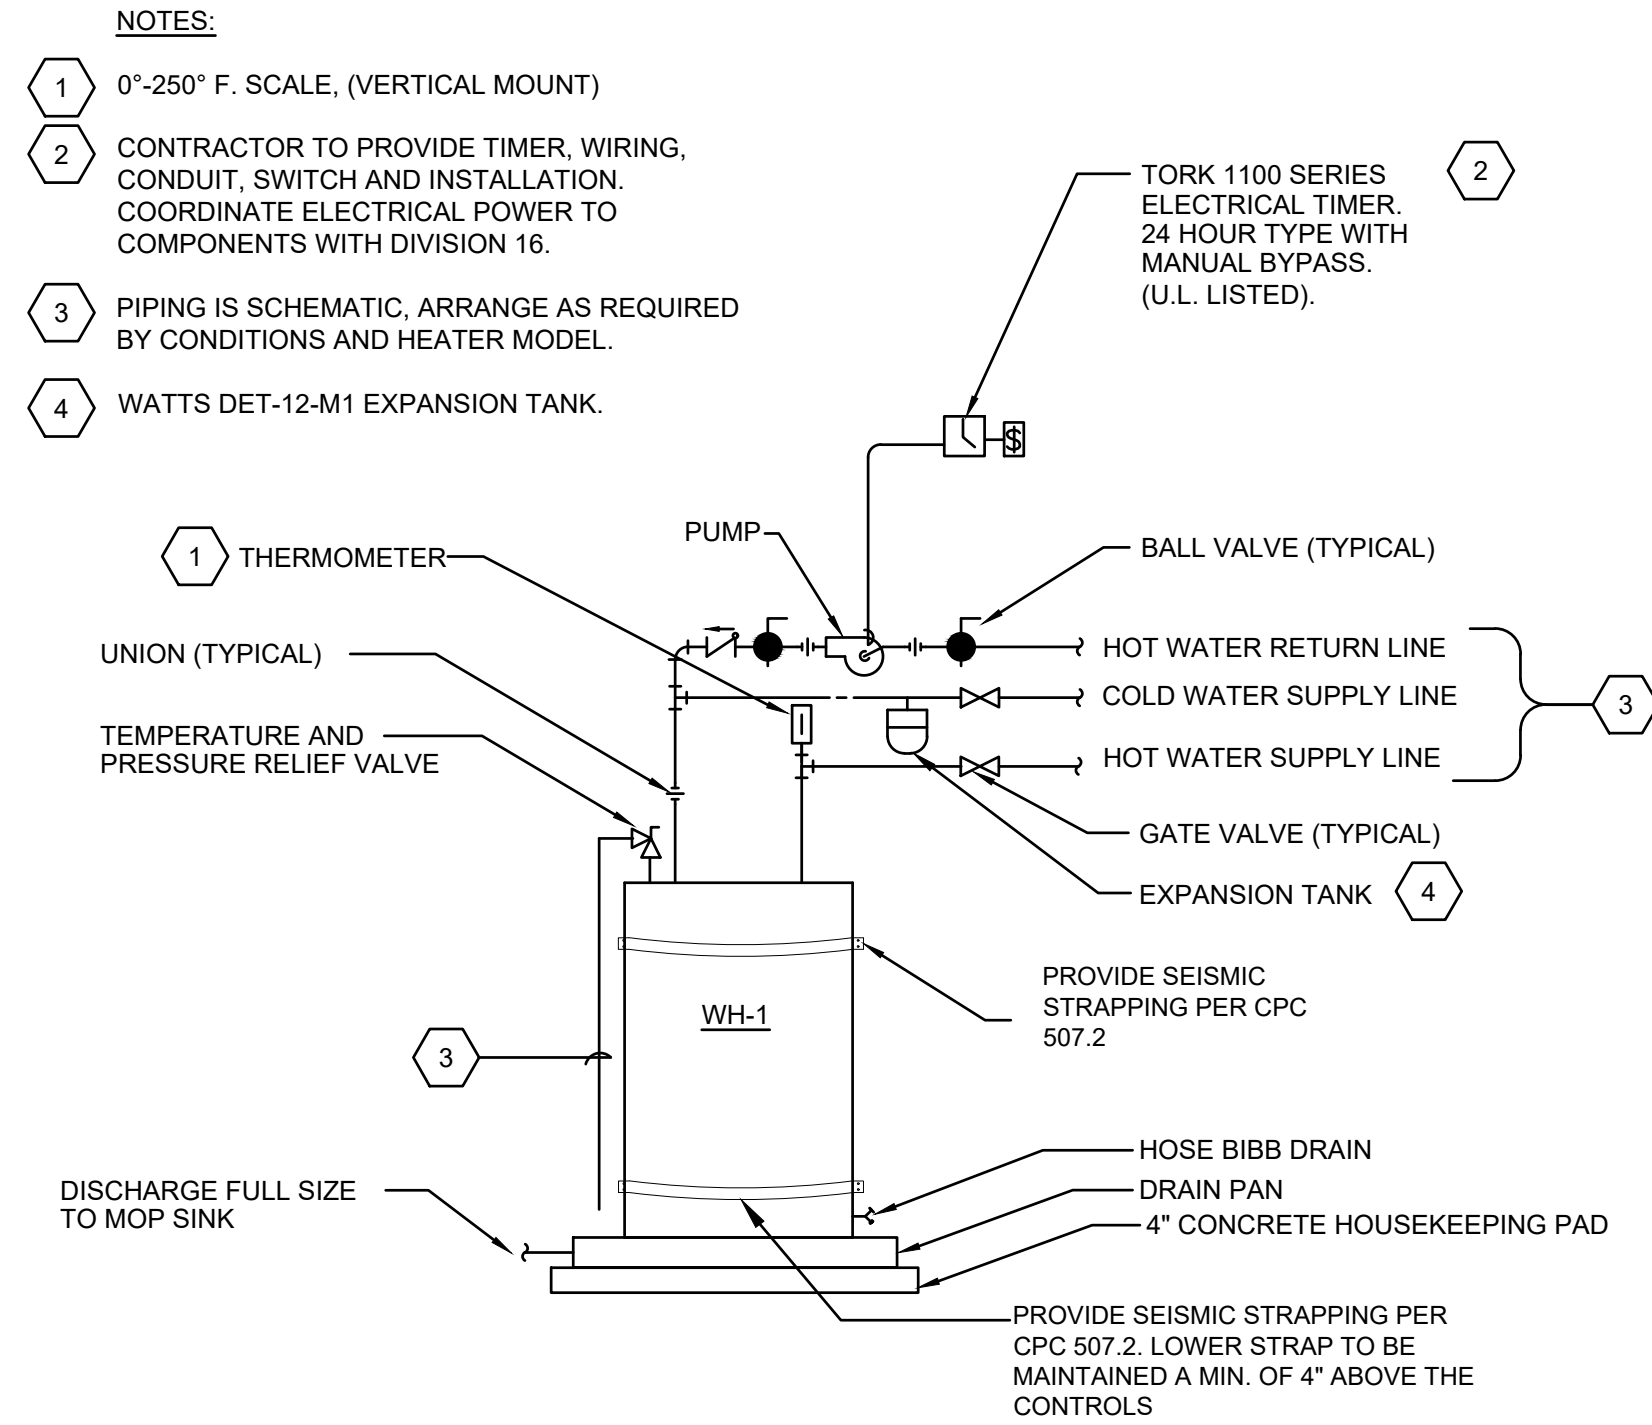


B TANK WATER HEATER DETAIL
SCALE: N.T.S.

Enter address here

PLAN #2

PROJECT

TRIPLEX
DWELLING UNIT

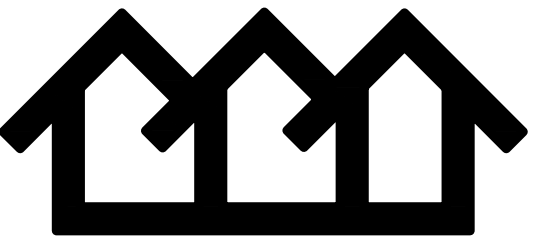

PWP23-005

DEPARTMENT OF PUBLIC
WORKS AND PLANNING



CAPITAL PROJECTS
DIVISION

2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

SEAL & SIGNATURE



UPDATE

2023 12 18

THESE DRAWINGS AND SPECIFICATIONS
ARE THE PROPERTY AND COPYRIGHT OF
THE ARCHITECT AND SHALL NOT BE
USED ON ANY OTHER PROJECT OR
LOCATIONS EXCEPT AS DESCRIBED ON
THE DRAWINGS WITHOUT WRITTEN
AGREEMENT WITH THE ARCHITECT.

TITLE

PLUMBING DETAILS

SCALE

As indicated

P002

ISSUE DATE

MARCH 7, 2023

JOB NUMBER

2023_11


DRAWN BY

Author


CHECKED BY

Checker

TRIPLEX
DWELLING UNIT



SEAL & SIGNATURE



TITLE _____

s indicated

Checker




ENLARGED PLUMBING FLOOR PLAN

6/8/2023 4:14:52 PM

SMOKE/CARBON MONOXIDE NOTES

R314.2 SMOKE DETECTION SYSTEMS
R314.3 LOCATION. SMOKE ALARMS SHALL BE INSTALLED IN THE FOLLOWING LOCATIONS:
1. IN EACH SLEEPING ROOM.
2. OUTSIDE EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS.
R314.4 POWER SOURCE. SMOKE ALARMS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING PROVIDED THAT SUCH WIRING IS SERVED FROM A COMMERCIAL SOURCE AND SHALL BE EQUIPPED WITH A BATTERY BACKUP. SMOKE ALARMS WITH INTEGRAL STROBES THAT ARE NOT EQUIPPED WITH BATTERY BACKUP SHALL BE CONNECTED TO AN EMERGENCY ELECTRICAL SYSTEM. SMOKE ALARMS SHALL EMIT A SIGNAL WHEN THE BATTERIES ARE LOW.
R314.5 INTERCONNECTION.
WHERE MORE THAN ONE SMOKE ALARM IS REQUIRED TO BE INSTALLED WITHIN AN INDIVIDUAL DWELLING OR SLEEPING UNIT, THE SMOKE ALARM SHALL BE INTERCONNECTED IN SUCH A MANNER THAT THE ACTIVATION OF ONE ALARM WILL ACTIVATE ALL OF THE ALARMS IN THE INDIVIDUAL UNIT. THE ALARMS SHALL BE CLEARLY AUDIBLE IN ALL BEDROOMS OVER BACKGROUND NOISE LEVELS WITH ALL INTERVENING DOORS CLOSED.
R315.1 CARBON MONOXIDE ALARMS.
R315.1.1 POWER SUPPLY. FOR NEW CONSTRUCTION REQUIRED CARBON MONOXIDE ALARMS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING
WHERE SUCH WIRING IS SERVED FROM A COMMERCIAL SOURCE AND SHALL BE EQUIPPED WITH A BATTERY BACK-UP.
R315.1.2 INTERCONNECTION. WHERE MORE THAN ONE CARBON MONOXIDE ALARM IS REQUIRED TO BE INSTALLED WITHIN THE DWELLING UNIT OR WITHIN A
SLEEPING UNIT THE ALARMS SHALL BE INTERCONNECTED IN A MANNER THAT ACTIVATION OF ONE ALARM SHALL ACTIVATE ALL OF THE ALARMS IN THE. INDIVIDUAL UNIT.
R315.3 ALARM REQUIREMENTS. CARBON MONOXIDE ALARMS REQUIRED BY SECTION R315.1 AND R315.2 SHALL BE INSTALLED IN THE FOLLOWING LOCATIONS:
1. OUTSIDE OF EACH SEPARATE DWELLING UNIT SLEEPING AREA. IN THE IMMEDIATE VICINITY OF THE BEDROOM(S).
2. AT EVERY LEVEL OF A DWELLING UNIT INCLUDING BASEMENTS.

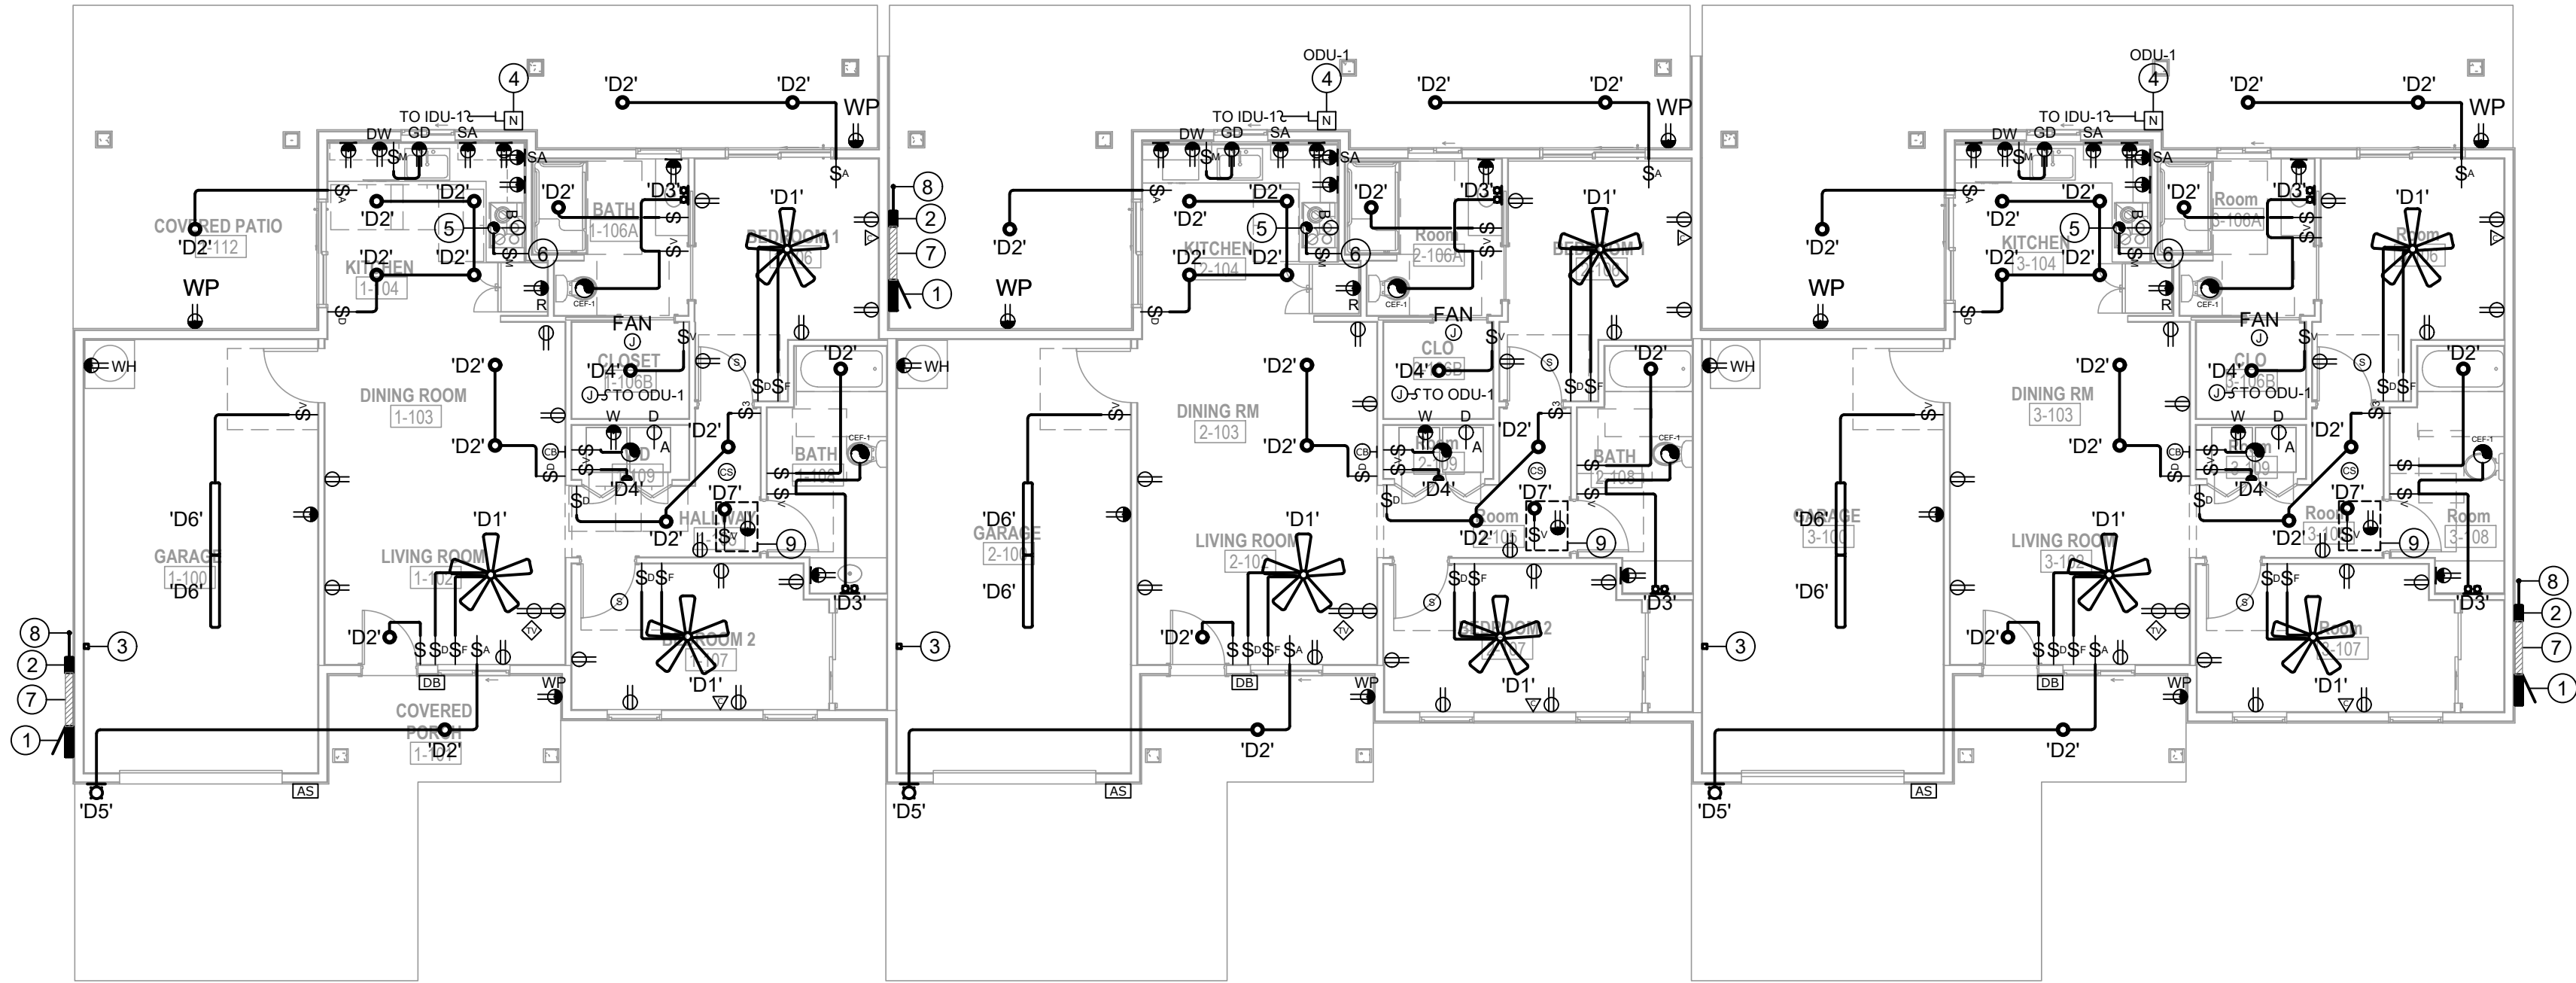

- FLOOR NOTES:
- FOR ADAPTABLE UNITS, PLEASE REFER TO ARCHITECTURAL DRAWINGS FOR REACH RANGE REQUIREMENTS.
 - ELECTRICAL RECEPTACLE OUTLETS, SWITCHES, AND CONTROLS (INCLUDING CONTROLS FOR HEATING AND VENTILATION AND AIR CONDITIONING) INTENDED TO BE USED BY THE OCCUPANTS SHALL BE LOCATED NO MORE THAN 48 INCHES MEASURED FROM THE TOP OF THE OUTLET BOX AND NOT LESS THAN 15 INCHES MEASURE FROM THE BOTTOM OF THE OUTLET BOX ABOVE THE FINISH FLOOR.

UNIT 1	979 SF
UNIT 2	979 SF
UNIT 3	979 SF
TOTAL: 2	2937 SF

UNIT FIXTURE SCHEDULE

SYMB.	TYPE	MAKE AND MODEL	MNTG.	LAMP / BULB	VOLT	NOTES
	'D1'	AIRE DELUXE #FP6285B	J-BOX	20W LED	120	
	'D2'	LITHONIA# WF6ELED-30K-90CRI-MW-M6	REC.	11W LED	120	DIM, WET RATD.
	'D3'	PROJECT SOURCE MOD# 42007 ITEM# 1362638	SURF.	60W LED	120	DAMP RATED
	'D4'	C-LITE# C-DS4-650-27	SURF.	11W LED	120	DIM, WET RATD.
	'D5'	PROJECT SOURCE MOD# 40683 ITEM# 338648	SURF.	11W LED	120	WET RATD.
	'D6'	ENERGETIC LIGHTING #E3SLA10D-840	SURF.	60W LED	120	WET RATD.
	'D7'	DESIGNHOUSE# MOD#587238 ITEM#1004060081	FLUSH	60W LED	120	DAMP RATD.

LIGHTING FIXTURE SCHEDULE

N.T.S

GROUND ROD DETAIL

N.T.S

ELECTRICAL FLOOR PLAN

1/8" = 1'-0"

E1

- INDOOR LUMINAIRES SHALL HAVE A COLOR RENDERING INDEX (CRI) OF AT LEAST 90.
- ALL INSTALLED LUMINAIRES SHALL MEET THE REQUIREMENTS OF CALIFORNIA ENERGY CODE TABLE 150.0-A. SEE SECTION 150(K)1A FOR EXCEPTIONS.
- SCREW-BASED LUMINAIRES SHALL CONTAIN LAMPS THAT COMPLY WITH REFERENCE JOINT APPENDIX JA8.
- RECESSED DOWNLIGHT LUMINAIRES IN CEILINGS. LUMINAIRES RECESSED INTO CEILINGS SHALL MEET ALL OF THE FOLLOWING REQUIREMENTS:
 - I. SHALL NOT CONTAIN SCREW BASE LAMP SOCKETS; AND
 - II. HAVE A LABEL THAT CERTIFIES THE LUMINAIRE IS AIRTIGHT WITH AIR LEAKAGE LESS THAN 2.0 CFM AT 75 PASCALS WHEN TESTED IN ACCORDANCE WITH ASTM E283. AN EXHAUST FAN HOUSING WITH INTEGRAL LIGHT SHALL NOT BE REQUIRED TO BE CERTIFIED AIRTIGHT; AND
 - III. BE SEALED WITH A GASKET OR CAULK BETWEEN THE LUMINAIRE HOUSING AND CEILING, AND HAVE ALL AIR LEAK PATHS BETWEEN CONDITIONED AND UNCONDITIONED SPACES SEALED WITH A GASKET OR CAULK, OR BE INSTALLED PER MANUFACTURER'S INSTRUCTIONS TO MAINTAIN AIR TIGHTNESS BETWEEN THE LUMINAIRE HOUSING AND CEILING; AND
 - IV. MEET THE CLEARANCE AND INSTALLATION REQUIREMENTS OF CALIFORNIA ELECTRICAL CODE SECTION 410.116 FOR RECESSED LUMINAIRES.
- BLANK ELECTRICAL BOXES. THE NUMBER OF ELECTRICAL BOXES THAT ARE MORE THAN 5 FEET ABOVE THE FINISHED FLOOR AND DO NOT CONTAIN A LUMINAIRE OR OTHER DEVICE SHALL BE NO GREATER THAN THE NUMBER OF BEDROOMS. THESE ELECTRICAL BOXES MUST BE SERVED BY A DIMMER, VACANCY SENSOR CONTROL, LOW VOLTAGE WIRING OR FAN SPEED CONTROL.
- LIGHTING SHALL HAVE READILY ACCESSIBLE WALL-MOUNTED CONTROLS THAT ALLOW THE LIGHTING TO BE MANUALLY TURNED ON AND OFF.
 - EXCEPTION TO SECTION 150.0(K)2A: CEILING FANS MAY PROVIDE CONTROL OF INTEGRATED LIGHTING VIA A REMOTE CONTROL.
- NO CONTROLS SHALL BYPASS A DIMMER, OCCUPANT SENSOR OR VACANCY SENSOR FUNCTION WHERE THAT DIMMER OR SENSOR HAS BEEN INSTALLED TO COMPLY WITH SECTION 150.0(K).
- AUTOMATIC-OFF CONTROLS.
 - I. IN BATHROOMS, GARAGES, LAUNDRY ROOMS, UTILITY ROOMS AND WALK-IN CLOSETS, AT LEAST ONE INSTALLED LUMINAIRE SHALL BE CONTROLLED BY AN OCCUPANCY OR VACANCY SENSOR PROVIDING AUTOMATIC-OFF FUNCTIONALITY.
 - II. FOR LIGHTING INTERNAL TO DRAWERS AND CABINETS WITH OPAQUE FRONTS OR DOORS, CONTROLS THAT TURN THE LIGHT OFF WHEN THE DRAWER OR DOOR IS CLOSED SHALL BE PROVIDED.
- VACANCY SENSOR CONTROLS SHALL USE A NEUTRAL CONDUCTOR FOR OPERATING CURRENT.
- DIMMING CONTROLS. LIGHTING IN HABITABLE SPACES, INCLUDING BUT NOT LIMITED TO LIVING ROOMS, DINING ROOMS, KITCHENS AND BEDROOMS, SHALL HAVE READILY ACCESSIBLE WALL-MOUNTED DIMMING CONTROLS THAT ALLOW THE LIGHTING TO BE MANUALLY ADJUSTED UP AND DOWN.
- INDEPENDENT CONTROLS. INTEGRATED LIGHTING OF EXHAUST FANS SHALL BE CONTROLLED INDEPENDENTLY FROM THE FANS.
- FOR SINGLE-FAMILY RESIDENTIAL BUILDINGS, OUTDOOR LIGHTING PERMANENTLY MOUNTED TO A RESIDENTIAL BUILDING OR TO OTHER BUILDINGS ON THE SAME LOT SHALL MEET THE REQUIREMENT IN ITEM I AND THE REQUIREMENTS IN EITHER ITEM II OR ITEM III:
 - I. CONTROLLED BY A MANUAL ON AND OFF CONTROL SWITCH THAT PERMITS THE AUTOMATIC ACTIONS OF ITEMS II OR III BELOW; AND
 - II. CONTROLLED BY A PHOTOCELL AND EITHER A MOTION SENSOR OR AN AUTOMATIC TIME SWITCH CONTROL; OR
 - III. CONTROLLED BY AN ASTRONOMICAL TIME CLOCK CONTROL.
- CONTROLS THAT OVERRIDE TO ON SHALL NOT BE ALLOWED UNLESS THE OVERRIDE AUTOMATICALLY RETURNS THE AUTOMATIC CONTROL TO ITS NORMAL OPERATION WITHIN 6 HOURS. AN ENERGY MANAGEMENT CONTROL SYSTEM THAT PROVIDES THE SPECIFIED LIGHTING CONTROL FUNCTIONALITY AND COMPLIES WITH ALL REQUIREMENTS APPLICABLE TO THE SPECIFIED CONTROLS MAY BE USED TO MEET THESE REQUIREMENTS.
- ILLUMINATED ADDRESS SIGN SHALL NOT CONSUMER NO MORE THAN 5 WATTS OF POWER.
- ENERGY STORAGE SYSTEMS (ESS) READY. AT LEAST ONE OF THE FOLLOWING SHALL BE PROVIDED:
 - A. ESS READY INTERCONNECTION EQUIPMENT WITH A MINIMUM BACKED-UP CAPACITY OF 60 AMPS AND A MINIMUM OF FOUR ESS-SUPPLIED BRANCH CIRCUITS, OR
 - B. A DEDICATED RACEWAY FROM THE MAIN SERVICE TO A PANELBOARD (SUBPANEL) THAT SUPPLIES THE BRANCH CIRCUITS IN SECTION 150.0(S)(2). ALL BRANCH CIRCUITS ARE PERMITTED TO BE SUPPLIED BY THE MAIN SERVICE PANEL PRIOR TO THE INSTALLATION OF AN ESS. THE TRADE SIZE OF THE RACEWAY SHALL BE NOT LESS THAN ONE INCH. THE PANELBOARD THAT SUPPLIES THE BRANCH CIRCUITS (SUBPANEL) MUST BE LABELED "SUBPANEL SHALL INCLUDE ALL BACKED-UP LOAD CIRCUITS."
- A MINIMUM OF FOUR BRANCH CIRCUITS SHALL BE IDENTIFIED AND HAVE THEIR SOURCE OF SUPPLY COLLOCATED AT A SINGLE PANELBOARD SUITABLE TO BE SUPPLIED BY THE ESS. AT LEAST ONE CIRCUIT SHALL SUPPLY THE REFRIGERATOR, ONE LIGHTING CIRCUIT SHALL BE LOCATED NEAR THE PRIMARY EGRESS, AND AT LEAST ONE CIRCUIT SHALL SUPPLY A SLEEPING ROOM RECEPTACLE OUTLET.
- THE MAIN PANELBOARD SHALL HAVE A MINIMUM BUSS BAR RATING OF 225 AMPS.
- SUFFICIENT SPACE SHALL BE RESERVED TO ALLOW FUTURE INSTALLATION OF A SYSTEM ISOLATION EQUIPMENT/TRANSFER SWITCH WITHIN 3 FEET OF THE MAIN PANELBOARD. RACEWAYS SHALL BE INSTALLED BETWEEN THE PANELBOARD AND THE. SYSTEM ISOLATION EQUIPMENT/TRANSFER SWITCH LOCATION TO ALLOW THE CONNECTION OF BACKUP POWER SOURCE.
- EXHAUST FANS SHALL BE CONTROLLED INDEPENDENTLY.
- ASTRONOMICAL TIME-SWITCH CONTROLS SHALL:
 - HAVE SUNRISE AND SUNSET PREDICTION ACCURACY WITHIN PLUS-OR-MINUS 15 MINUTES AND TIMEKEEPING ACCURACY WITHIN 5 MINUTES PER YEAR;
 - BE CAPABLE OF DISPLAYING DATE, CURRENT TIME, SUNRISE TIME, SUNSET TIME, AND SWITCHING TIMES FOR EACH STEP DURING PROGRAMMING;
 - BE CAPABLE OF AUTOMATICALLY ADJUSTING FOR DAYLIGHT SAVINGS TIME; AND
 - HAVE THE ABILITY TO INDEPENDENTLY OFFSET THE ON AND OFF FOR EACH CHANNEL BY AT LEAST 90 MINUTES BEFORE AND AFTER SUNRISE OR SUNSET.

CALIFORNIA ENERGY CODE T24 NOTES

N.T.S.

E2

ELECTRICAL PLAN KEYNOTES

- NEW 225ABUSS-120/240V-1PH-3W-N3R MAIN SERVICE PANEL WITH 200A MAIN CIRCUIT BREAKER. MAIN ELECTRICAL POWER PANEL.
- POSSIBLE LOCATION OF FUTURE SOLAR PANEL INVERTER.
- POSSIBLE LOCATION OF FUTURE. EV CHARGING STATION. VERIFY EXACT LOCATION DURING INSTALLATION.
- 240V-30A-2P-N3R DISCONNECT FOR CONDENSING UNIT.
- ABOVE IN CABINET FOR HOOD EXHAUST.
- SWITCH FOR HOOD FAN.
- 3 FT OF ALLOCATED SPACE RESERVED FOR FUTURE SYSTEM ISOLATION/TRANSFER EQUIPMENT. DEDICATED RACEWAY SHALL BE BEHIND CLEARANCE.
- INTERCONNECTION PATHWAY. REFER TO ARCHITECTURAL PLANS FOR SOLAR ZONE AREA.
- LIGHT FIXTURE AND RECEPTACLE IN ATTIC. SEE BUILDING SECTIONS.

ELECTRICAL LEGEND

- SINGLE POLE SWITCH
- 3 WAY SWITCH
- DIMMER SWITCH
- FAN SPEED SWITCH
- MOTOR RATED SWITCH
- VACANCY SWITCH
- ASTRONOMICAL SWITCH
- HUMIDITY SENSOR SWITCH
- DUPLEX - +15" BOTTOM OF RECEPTACLE BOX
- DUPLEX - ABOVE COUNTER - +48" TOP OF RECEPTACLE BOX
- DUPLEX - GROUND FAULT CIRCUIT INTERRUPTER - +15" BOTTOM OF RECEPTACLE BOX
- GFCI DUPLEX - ABOVE COUNTER - +48" TOP OF RECEPTACLE BOX
- RECEPTACLE - SPECIAL (RATING AS INDICATED)
- RECEPTACLE - 30A. 120/240V. NEMA 14-30R (CLOTHES DRYER TYPE)
- RECEPTACLE - 50A. 120/240V. NEMA 14-50R (DOMESTIC RANGE TYPE)
- COMMUNICATION DATA
- TV DATA AND DUPLEX - + 60" (FIELD VERIFY HEIGHT)
- DISCONNECT
- SMOKE ALARM 'BRK', 7010B W/ BATTERY BACK-UP, HARD WIRED, MOUNT WITHIN 6 INCHES OF HIGH POINT OF CEILING. (CSFM 7257-0087:140)
- CARBON MONOXIDE/SMOKE ALARM 'BRK', SC910B W/ BATTERY BACK-UP, HARD WIRED, MOUNT WITHIN 6 INCHES OF HIGH POINT OF CEILING. (CSFM 7256-0087:140)
- (HEARING IMPAIRED UNITS) SMOKE ALARM & STROBE COMBINATION 'BRK' 7010BSL, W/ BATTERY BACK-UP, HARD WIRED. MOUNT WITHIN 6 INCHES OF HIGH POINT OF CEILING. (CSFM 7257-0087:159)
- (HEARING IMPAIRED UNITS) CARBON MONOXIDE ALARM 'BRK' CO5120BN, W/ BATTERY BACK-UP, HARD WIRED. MOUNT WITHIN 6 INCHES OF HIGH POINT OF CEILING. (CSFM 7256-0087:159)
- CHIME BELL
- DOOR BELL
- ILLUMINATED ADDRESS SIGN
- EXHAUST FAN - SPECS PER MECHANICAL PLANS

CALIFORNIA ELECTRICAL CODE NOTES


- COORDINATE WITH UTILITY COMPANY PROVIDER PRIOR TO COMMENCING WORK. THE AVAILABLE FAULT CURRENT WILL BE PROVIDED BY THE UTILITY PROVIDER.
- LIGHTING FIXTURES SPECIFIED CAN BE SUBSTITUTED WITH AN EQUIVALENT FIXTURE.
- UNLESS OTHERWISE NOTED; ELECTRICAL RECEPTACLE OUTLETS ON BRANCH CIRCUITS OF 30 AMPERES OR LESS AND COMMUNICATION SYSTEM RECEPTACLES SHALL BE LOCATED NO MORE THAN 48 INCHES MEASURED FROM THE TOP OF THE RECEPTACLE OUTLET BOX NOR LESS THAN 15 INCHES (381 MM) MEASURED FROM THE BOTTOM OF THE RECEPTACLE OUTLET BOX TO THE LEVEL OF THE FINISHED FLOOR OR WORKING PLATFORM.
- UNLESS OTHERWISE NOTED; CONTROLS OR SWITCHES INTENDED TO BE USED BY THE OCCUPANT OF THE ROOM OR AREA TO CONTROL LIGHTING AND RECEPTACLE OUTLETS, APPLIANCES, ALARMS OR COOLING, HEATING AND VENTILATING EQUIPMENT SHALL BE LOCATED NO MORE THAN 48 INCHES (1219 MM) MEASURED FROM THE TOP OF THE OUTLET BOX NOR LESS THAN 15 INCHES (381 MM) MEASURED FROM THE BOTTOM OF THE OUTLET BOX TO THE LEVEL OF THE FINISHED FLOOR OR WORKING PLATFORM.
- REFER TO EQUIPMENT MANUFACTURER SPECS FOR ADDITIONAL OVER-CURRENT PROTECTIONS OTHER THAN THE BRANCH CIRCUIT BREAKER.
- ALL WIRING IN DWELLINGS TO BE NONMETALLIC SHEATHED CABLES (ROMEX).
- A THREE-WIRE PLUS GROUND BRANCH CIRCUIT IS REQUIRED FOR ALL 240V CIRCUITS SERVING COOKING EQUIPMENT AND CLOTHES DRYER. PROVIDE WEATHER PROOF BOXES FOR ALL EXTERIOR SWITCHES AND CONTROLS.
- ALL 120V-1PH-15A AND 20A BRANCH CIRCUITS SUPPLYING RECEPTACLES IN KITCHENS, FAMILY, DINNING, LIVING, DENS, BEDROOMS, CLOSETS, HALLWAYS, LAUNDRY AREAS OR SIMILAR ROOMS SHALL HAVE A LISTED ARC-PROTECTION CIRCUIT BREAKER INSTALLED IN COMBINATION WITH OUTLET BRANCH CIRCUIT TYPE ARC-FAULT CIRCUIT INTERRUPTER INSTALLED AT THE FIRST BOX. SEE SECTION 210.12(A)(3) FOR WIRING METHODS.
- RECEPTACLES SHALL BE INSTALLED SUCH THAT NO POINT MEASURED HORIZONTALLY ALONG THE FLOOR LINE OF ANY WALL SPACE IS MORE THAN 6 FT FROM A RECEPTACLE OUTLET.
- WATER HEATER SHALL USE A 120/240 VOLT 3 CONDUCTOR, 10 AWG COPPER BRANCH CIRCUIT, WITHIN 3 FEET FROM THE WATER HEATER AND ACCESSIBLE TO THE WATER HEATER WITH NO OBSTRUCTIONS.

TRIPLEX DWELLING UNIT

OPTION
#2

PROJECT

TRIPLEX
DWELLING UNIT

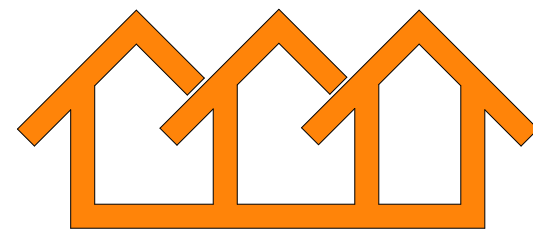

PWP23-005


DEPARTMENT OF PUBLIC
WORKS AND PLANNING



CAPITAL PROJECTS
DIVISION

2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

SEAL & SIGNATURE

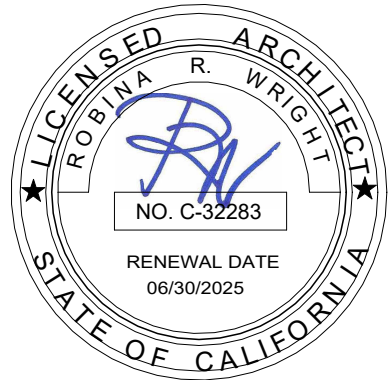

UPDATE

May 2, 2023_ CD Phase

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY AND COPYRIGHT OF THE ARCHITECT AND SHALL NOT BE USED ON ANY OTHER PROJECT OR LOCATIONS EXCEPT AS DESCRIBED ON THE DRAWINGS WITHOUT WRITTEN AGREEMENT WITH THE ARCHITECT.

TITLE

ELECTRICAL FLOOR
PLAN

SCALE 1/8" = 1'-0"

E-101

ISSUE DATE	JOB NUMBER
APRIL 12, 2023	2023_20
DRAWN BY	CHECKED BY
Author	Checker

7/4/2023 10:57:52 AM
24" X 36"

Missing or invalid reference
File: .\CF1R2.pdf
Sheet: 7

Missing or invalid reference
File: .\CF1R2.pdf
Sheet: 8

Missing or invalid reference
File: .\CF1R2.pdf
Sheet: 9

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: Option # 2 Triplex Unit 1

Calculation Date/Time: 2023-06-23T22:13:02+05:30

Calculation Description: Title 24 Analysis

Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit 1_MP_V9.1.rbd22x

01

02

03

04

05

06

07

08

Construction Name	Surface Type	Construction Type	Framing	Total Cavity R-value	Interior / Exterior Continuous R-value	U-factor	Assembly Layers
Attic Garage Roof Cons	Attic Roofs	Wood Framed Ceiling	2x4 @ 24 in. O. C.	R-0	None / 0	0.644	Roofing: Light Roof (Asphalt Shingle) Roof Deck: Wood Siding/sheathing/decking Cavity / Frame: no insul. / 2x4
Attic Roof/Living Area Unit 1	Attic Roofs	Wood Framed Ceiling	2x4 @ 24 in. O. C.	R-19	None / 0	0.059	Roofing: Light Roof (Asphalt Shingle) Roof Deck: Wood Siding/sheathing/decking Cavity / Frame: R-13.0 / 2x4 Around Roof Joists: R-6.0 Insul.
R-0 Roof Attic	Ceilings (below attic)	Wood Framed Ceiling	2x4 @ 24 in. O. C.	R-0	None / None	0.481	Cavity / Frame: no Insul. / 2x4 Inside Finish: Gypsum Board
R-38 Roof Attic + R19 BFD	Ceilings (below attic)	Wood Framed Ceiling	2x4 @ 24 in. O. C.	R-38	None / None	0.025	Over Ceiling Joists: R-38.9 Insul. Cavity / Frame: R-9.1 / 2x4 Inside Finish: Gypsum Board

BUILDING ENVELOPE - HERS VERIFICATION

01

02

03

04

05

Quality Insulation Installation (QII)	High R-value Spray Foam Insulation	Building Envelope Air Leakage	CFM50	CFM50
Required	Not Required	N/A	n/a	n/a

WATER HEATING SYSTEMS

01

02

03

04

05

06

07

08

09

Name	System Type	Distribution Type	Water Heater Name	Number of Units	Solar Heating System	Compact Distribution	HERS Verification	Water Heater Name (#)
DHW Sys 1	Domestic Hot Water (DHW)	Standard	DHW Heater 1	1	n/a	None	n/a	DHW Heater 1 (1)

Registration Number: 423-P010109217A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/24/2023 13:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-23 09:43:53

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: Option # 2 Triplex Unit 1

Calculation Date/Time: 2023-06-23T22:13:02+05:30

Calculation Description: Title 24 Analysis

Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit 1_MP_V9.1.rbd22x

01

02

03

04

05

06

07

08

09

Name	Verified Fan Watt Draw	Required Fan Efficacy (Watts/CFM)
HVAC Fan 1-hers-fan	Required	0.45

INDOOR AIR QUALITY (IAQ) FANS

01

02

03

04

05

06

07

08

09

Dwelling Unit	Airflow (CFM)	Fan Efficacy (W/CFM)	IAQ Fan Type	Includes Heat/Energy Recovery?	IAQ Recovery Effectiveness - SRE	Includes Fault Indicator Display?	HERS Verification	Status
Sfam IAQVentrpt	51	0.35	Exhaust	No	n/a	No	Yes	

COOLING VENTILATION

01

02

03

04

05

06

07

08

09

Name	Airflow Rate (CFM/ft2)	Cooling Vent CFM	Cooling Vent Watts/CFM	Total Watts	Number of Fans	CFVCS Type	Exhausts to	HERS Verification
WH Fan 1	2.45	2400	0.1187	285	1	Not a CFVCS	Outside	Required

Registration Number: 423-P010109217A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/24/2023 13:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-23 09:43:53

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: Option # 2 Triplex Unit 1

Calculation Date/Time: 2023-06-23T22:13:02+05:30

Calculation Description: Title 24 Analysis

Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit 1_MP_V9.1.rbd22x

01

02

03

04

05

06

07

08

Name	# of Units	Tank Vol. (gal)	NEEA Heat Pump Brand	NEEA Heat Pump Model	Tank Location	Duct Inlet Air Source	Duct Outlet Air Source
DHW Heater 1	1	50	Rheem	RheemPK0PH50T2R H37515	Garage__	Garage__	Garage__

WATER HEATING - HERS VERIFICATION

01

02

03

04

05

06

07

Name	Pipe Insulation	Parallel Piping	Compact Distribution	Compact Distribution Type	Recirculation Control	Shower Drain Water Heat Recovery
DHW Sys 1 - 1/1	Not Required	Not Required	Not Required	None	Not Required	Not Required

SPACE CONDITIONING SYSTEMS

01

02

03

04

05

06

07

08

09

Name	System Type	Heating Unit Name	Heating Equipment Count	Cooling Unit Name	Cooling Equipment Count	Fan Name	Distribution Name	Required Thermostat Type
HVAC System1	Heat pump heating cooling	Heat Pump System 1	1	Heat Pump System 1	1	HVAC Fan 1	Air Distribution System 1	Setback

HVAC - HEAT PUMPS

01

02

03

04

05

06

07

08

09

10

11

12

13

Name	System Type	Number of Units	Heating Efficiency Type	HSPF7 HSPF2 / COP	Cap 47	Cap 17	Efficiency Type	SEER / SEER2	EER / EER / CEER	Zonally Controlled	Compressor Type	HERS Verification
Heat Pump System 1	Central split HP	1	HSPF	9	30000	24000	EERSEER	16.85	11.7	Not Zonal	Single Speed	Heat Pump System 1-hers-htump

Registration Number: 423-P010109217A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/24/2023 13:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-23 09:43:53

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: Option # 2 Triplex Unit 1

Calculation Date/Time: 2023-06-23T22:13:02+05:30

Calculation Description: Title 24 Analysis

Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit 1_MP_V9.1.rbd22x

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT

1. I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: Viranchi Shah

Signature Date: 06/24/2023

Company: www.gettitle24.com

Address: 14730 Beach Blvd., #133

City/State/Zip: La Mirada, CA 90638

Phone: 714-888-4736

RESPONSIBLE PERSON'S DECLARATION STATEMENT

I certify the following under penalty of perjury, under the laws of the State of California:

1. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design identified on this Certificate of Compliance.

2. I certify that the energy features and performance specifications identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.

3. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.

Responsible Designer Name: Robina Wright

Date Signed: 06/24/2023

License: C32283

Address: 4025 N. Fresno Suite 107

City/State/Zip: Fresno, CA 93726

Phone: 559-307-7232

Registration Number: 423-P010109217A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/24/2023 13:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-23 09:43:53

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: Option # 2 Triplex Unit 1

Calculation Date/Time: 2023-06-23T22:13:02+05:30

Calculation Description: Title 24 Analysis

Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit 1_MP_V9.1.rbd22x

HVAC HEAT PUMPS - HERS VERIFICATION

01

02

03

04

05

06

07

08

09

Name	Verified Airflow	Airflow Target	Verified EER/EER2	Verified SEER/SEER2	Verified Refrigerant Charge	Verified HSPF/HSPF2	Verified Heating Cap 47	Verified Heating Cap 17
Heat Pump System 1-hers-htump	Required	350	Not Required	Required	Yes	Yes	Yes	Yes

HVAC - DISTRIBUTION SYSTEMS

01

02

03

04

05

06

07

08

09

10

11

12

Name	Type	Design Type	Duct Ins. R-value Supply	Duct Ins. R-value Return	Duct Location Supply	Duct Location Return	Surface Area Supply	Surface Area Return	Bypass Duct	Duct Leakage	HERS Verification
Air Distribution System 1	Unconditioned attic	Non-Verified	R-8	R-8	Attic	Attic	n/a	n/a	No Bypass Duct	Sealed and Tested	Air Distribution System 1-hers-dist

HVAC DISTRIBUTION - HERS VERIFICATION

01

02

03

04

05

06

07

08

09

Name	Duct Leakage Verification	Duct Leakage Target (%)	Verified Duct Location	Verified Duct Design	Buried Ducts	Deeply Buried Ducts	Low-leakage Air Handler	Low Leakage Ducts Entirely in Conditioned Space
Air Distribution System 1-hers-dist	Yes	5.0	Not Required	Not Required	Not Required	Credit not taken	Not Required	No

HVAC - FAN SYSTEMS

01

02

03

04

Name	Type	Fan Power (Watts/CFM)	Name
HVAC Fan 1	HVAC Fan	0.45	HVAC Fan 1-hers-fan

Registration Number: 423-P010109217A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/24/2023 13:36
Report Version: 2022.0.000
Schema Version: rev 20220901


HERS Provider: CHEERS
Report Generated: 2023-06-23 09:43:53

TRIPLEX DWELLING UNIT

OPTION
#2

PROJECT

TRIPLEX
DWELLING UNIT

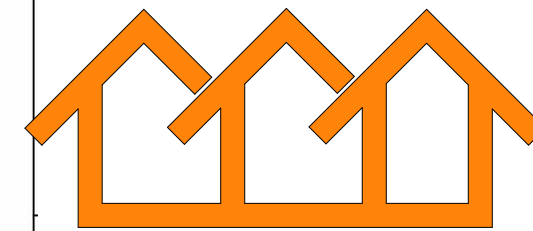

PWP23-005

DEPARTMENT OF PUBLIC
WORKS AND PLANNING



CAPITAL PROJECTS
DIVISION

2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

SEAL & SIGNATURE



UPDATE

JUNE 30, 2023

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY AND COPYRIGHT OF THE ARCHITECT AND SHALL NOT BE USED ON ANY OTHER PROJECT OR LOCATIONS EXCEPT AS DESCRIBED ON THE DRAWINGS WITHOUT WRITTEN AGREEMENT WITH THE ARCHITECT.

TITLE

TITLE 24 ENERGY
COMPLIANCE

SCALE

T24-1.2

ISSUE DATE	JOB NUMBER
MARCH 7, 2023	2023_11
DRAWN BY	CHECKED BY
Author	Checker

7/14/2023 10:57:55 AM
24" X 36"

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Page 1 of 15

Project Name: Option # 2 Triplex Unit 2

Calculation Date/Time: 2023-06-23T22:15:10+05:30

Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit 2_MP_V9.1.rbd22x

Calculation Description: Title 24 Analysis

GENERAL INFORMATION					
01	Project Name	Option # 2 Triplex Unit 2			
02	Run Title	Title 24 Analysis			
03	Project Location	Option # 2 Triplex Unit 2			
04	City	Fresno County	05	Standards Version	2022
06	Zip code		07	Software Version	EnergyPro 9.1
08	Climate Zone	13	09	Front Orientation (deg/ Cardinal)	All orientations
10	Building Type	Single family	11	Number of Dwelling Units	1
12	Project Scope	Newly Constructed	13	Number of Bedrooms	2
14	Addition Cond. Floor Area (ft²)	0	15	Number of Stories	1
16	Existing Cond. Floor Area (ft²)	n/a	17	Fenestration Average U-factor	0.3
18	Total Cond. Floor Area (ft²)	979	19	Glazing Percentage (%)	16.00%
20	ADU Bedroom Count	n/a			

COMPLIANCE RESULTS	
01	Building Complies with Computer Performance
02	This building incorporates features that require field testing and/or verification by a certified HERS rater under the supervision of a CEC-approved HERS provider.
03	This building incorporates one or more Special Features shown below

Registration Number: 423-P010109218A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/24/2023 13:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-23 09:46:03

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Page 4 of 15

Project Name: Option # 2 Triplex Unit 2

Calculation Date/Time: 2023-06-23T22:15:10+05:30

Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit 2_MP_V9.1.rbd22x

Calculation Description: Title 24 Analysis

ENERGY USE SUMMARY						
Energy Use	Standard Design Source Energy (EDR1) (kBtu/ft² - yr)	Standard Design TDV Energy (EDR2) (kTDV/ft² - yr)	Proposed Design Source Energy (EDR1) (kBtu/ft² - yr)	Proposed Design TDV Energy (EDR2) (kTDV/ft² - yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)
Space Heating	3.81	16.81	2.18	16.05	1.63	0.76
Space Cooling	2.29	47.64	2.22	48.75	0.07	-1.11
IAQ Ventilation	0.4	4.32	0.4	4.32	0	0
Water Heating	2.09	21.67	1.41	15.1	0.68	6.57
Self Utilization/Flexibility Credit				0		0
South Facing Efficiency Compliance Total	8.59	90.44	6.21	84.22	2.38	6.22
Space Heating	3.81	16.81	2.31	17.2	1.5	-0.39
Space Cooling	2.29	47.64	2.42	53.7	-0.13	-6.06
IAQ Ventilation	0.4	4.32	0.4	4.32	0	0
Water Heating	2.09	21.67	1.41	15.12	0.68	6.55
Self Utilization/Flexibility Credit				0		0
West Facing Efficiency Compliance Total	8.59	90.44	6.54	90.34	2.05	0.1

Registration Number: 423-P010109218A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/24/2023 13:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-23 09:46:03

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Page 7 of 15

Project Name: Option # 2 Triplex Unit 2

Calculation Date/Time: 2023-06-23T22:15:10+05:30

Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit 2_MP_V9.1.rbd22x

Calculation Description: Title 24 Analysis

ZONE INFORMATION							
01	02	03	04	05	06	07	08
Zone Name	Zone Type	HVAC System Name	Zone Floor Area (ft²)	Avg. Ceiling Height	Water Heating System 1	Status	
Living Area Unit 2	Conditioned	HVAC System1	979	8	DHW Sys 1	New	

OPAQUE SURFACES							
01	02	03	04	05	06	07	08
Name	Zone	Construction	Azimuth	Orientation	Gross Area (ft²)	Window and Door Area (ft²)	Tilt (deg)
Front Wall W	Living Area Unit 2	R-21 Wall + OS	0	Front	252	70.01	90
Rear Wall E	Living Area Unit 2	R-21 Wall + OS	180	Back	252	52.47	90
Right Wall S	Living Area Unit 2	R-21 Wall + OS	270	Right	88	0	90
Left Wall N	Living Area Unit 2	R-21 Wall + OS	90	Left	109.04	34.47	90
Interior Wall	Living Area Unit 2>>_Garage_	R-13 Wall	n/a	n/a	152	0	n/a
Interior Wall 2	Living Area Unit 2>>Living Area Unit 2	R-13 Wall	n/a	n/a	173.04	0	n/a
Interior Wall 3	_Garage_>>_Garag e_	R-13 Wall_	n/a	n/a	173.04	0	n/a
Attic Roof	Living Area Unit 2	R-38 Roof Attic + R19 BRD	n/a	n/a	979	n/a	n/a
Attic Roof 2	_Garage_	R-0 Roof Attic	n/a	n/a	337.5	n/a	n/a
Front Wall W 2	_Garage_	R-0 Wall + OS	0	Front	108	62.37	90
Rear Wall E 2	_Garage_	R-0 Wall + OS	180	Back	108	0	90
Right Wall S 2	_Garage_	R-0 Wall + OS	270	Right	48	0	90
Left Wall N 2	_Garage_	R-0 Wall + OS	90	Left	26.96	0	90

ATTIC							
01	02	03	04	05	06	07	08
Name	Construction	Type	Roof Rise (x in 12)	Roof Reflectance	Roof Emittance	Radiant Barrier	Cool Roof
Attic_Garage_	Attic Garage Roof Cons	Ventilated	4	0.1	0.85	No	No

Registration Number: 423-P010109218A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/24/2023 13:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-23 09:46:03

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Page 2 of 15

Project Name: Option # 2 Triplex Unit 2

Calculation Date/Time: 2023-06-23T22:15:10+05:30

Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit 2_MP_V9.1.rbd22x

Calculation Description: Title 24 Analysis

ENERGY DESIGN RATINGS						
	Energy Design Ratings			Compliance Margins		
	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2/efficiency)	Total ² EDR (EDR2total)	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2/efficiency)	Total ² EDR (EDR2total)
Standard Design	37.4	41.8	34.5			
Proposed Design						
North Facing	31.9	38.2	32.4	5.5	3.6	2.1
East Facing	32.4	41	34.1	5	0.8	0.4
South Facing	31.9	39	32.9	5.5	2.8	1.6
West Facing	32.7	41.8	34.5	4.7	0	0
RESULT ³ : PASS						
¹ Efficiency EDR Includes improvements like a better building envelope and more efficient equipment ² Total EDR includes efficiency and demand response measures such as photovoltaic (PV) system and batteries ³ Building complies when source energy, efficiency and total compliance margins are greater than or equal to zero and unmet load hour limits are not exceeded						
• Standard Design PV Capacity: 2.65 kWdc • Proposed PV Capacity Scaling: North (2.65 kWdc) East (2.65 kWdc) South (2.65 kWdc) West (2.65 kWdc)						

Registration Number: 423-P010109218A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/24/2023 13:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-23 09:46:03

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Page 5 of 15

Project Name: Option # 2 Triplex Unit 2

Calculation Date/Time: 2023-06-23T22:15:10+05:30

Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit 2_MP_V9.1.rbd22x

Calculation Description: Title 24 Analysis

ENERGY USE INTENSITY				
	Standard Design (kBtu/ft² - yr)	Proposed Design (kBtu/ft² - yr)	Compliance Margin (kBtu/ft² - yr)	Margin Percentage
North Facing				
Gross EU1 ¹	24.84	21.3	3.54	14.25
Net EU1 ²	10.17	6.64	3.53	34.71
East Facing				
Gross EU1 ¹	24.84	21.79	3.05	12.28
Net EU1 ²	10.17	7.12	3.05	29.99
South Facing				
Gross EU1 ¹	24.84	21.34	3.6	14.49
Net EU1 ²	10.17	6.57	3.6	35.4
West Facing				
Gross EU1 ¹	24.84	21.83	3.01	12.12
Net EU1 ²	10.17	7.17	3	29.5
Notes 1. Gross EU1 is Energy Use Total (not including PV) / Total Building Area. 2. Net EU1 is Energy Use Total (including PV) / Total Building Area.				

Registration Number: 423-P010109218A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/24/2023 13:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-23 09:46:03

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Page 8 of 15

Project Name: Option # 2 Triplex Unit 2

Calculation Date/Time: 2023-06-23T22:15:10+05:30

Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit 2_MP_V9.1.rbd22x

Calculation Description: Title 24 Analysis

ATTIC													
01	02	03	04	05	06	07	08						
Name	Construction	Type	Roof Rise (x in 12)	Roof Reflectance	Roof Emittance	Radiant Barrier	Cool Roof						
Attic Living Area Unit 2	Attic Roof/Living Area Unit 2	Ventilated	4	0.1	0.85	No	No						

FENESTRATION / GLAZING													
01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Type	Surface	Orientation	Azimuth	Width (ft)	Height (ft)	Mult.	Area (ft²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading
Door 1- 3068_	Window	Front Wall W	Front	0	3	6.67	1	20.01	0.3	NFRC	0.23	NFRC	Bug Screen
Window A- 4050_	Window	Front Wall W	Front	0	4	5	1	20	0.3	NFRC	0.23	NFRC	Bug Screen
Window B- 3050_ 2	Window	Front Wall W	Front	0		15	0.3	NFRC	0.23	NFRC	0.23	NFRC	Bug Screen
Window B- 3050_ 2	Window	Front Wall W	Front	0		15	0.3	NFRC	0.23	NFRC	0.23	NFRC	Bug Screen
Window C- 3030_	Window	Rear Wall E	Back	180		9	0.3	NFRC	0.23	NFRC	0.23	NFRC	Bug Screen
Window C- 3030_ 2	Window	Rear Wall E	Back	180		9	0.3	NFRC	0.23	NFRC	0.23	NFRC	Bug Screen
Door 7A- 5861_	Window	Rear Wall E	Back	180		1	34.47	0.3	NFRC	0.23	NFRC	0.23	Bug Screen
Door B- 5861_	Window	Left Wall N	Left	90		1	34.47	0.3	NFRC	0.23	NFRC	0.23	Bug Screen

OPAQUE DOORS			
01	02	03	04
Name	Side of Building	Area (ft²)	U-factor
Door 2- 90611	Front Wall W 2	62.37	0.7

Registration Number: 423-P010109218A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/24/2023 13:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-23 09:46:03

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Page 3 of 15

Project Name: Option # 2 Triplex Unit 2

Calculation Date/Time: 2023-06-23T22:15:10+05:30

Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit 2_MP_V9.1.rbd22x

Calculation Description: Title 24 Analysis

ENERGY USE SUMMARY						
Energy Use	Standard Design Source Energy (EDR1) (kBtu/ft² - yr)	Standard Design TDV Energy (EDR2) (kTDV/ft² - yr)	Proposed Design Source Energy (EDR1) (kBtu/ft² - yr)	Proposed Design TDV Energy (EDR2) (kTDV/ft² - yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)
Space Heating	3.81	16.81	2.23	16.37	1.58	0.44
Space Cooling	2.29	47.64	2.16	46.7	0.13	0.94
IAQ Ventilation	0.4	4.32	0.4	4.32	0	0
Water Heating	2.09	21.67	1.42	15.28	0.67	6.39
Self Utilization/Flexibility Credit				0		0
North Facing Efficiency Compliance Total	8.59	90.44	6.21	82.67	2.38	7.77
Space Heating	3.81	16.81	2.2	16.07	1.61	0.74
Space Cooling	2.29	47.64	2.41	53.18	-0.12	-5.54
IAQ Ventilation	0.4	4.32	0.4	4.32	0	0
Water Heating	2.09	21.67	1.42	15.14	0.67	6.53
Self Utilization/Flexibility Credit				0		0
East Facing Efficiency Compliance Total	8.59	90.44	6.43	88.71	2.16	1.73

Registration Number: 423-P010109218A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/24/2023 13:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-23 09:46:03

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Page 6 of 15

Project Name: Option # 2 Triplex Unit 2

Calculation Date/Time: 2023-06-23T22:15:10+05:30

Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit 2_MP_V9.1.rbd22x

Calculation Description: Title 24 Analysis

REQUIRED PV SYSTEMS											
01	02	03	04	05	06	07	08	09	10	11	12
DC System Size (kWdc)	Exception	Module Type	Array Type	Power Electronics	CFI	Azimuth (deg)	Tilt Input	Array Angle (deg)	Tilt: (x in 12)	Inverter Eff. (%)	Annual Solar Access (%)
2.65	NA	Standard (14-17%)	Fixed	none	true	150-270	n/a	n/a	<=7:12	96	98

REQUIRED SPECIAL FEATURES											
The following are features that must be installed as condition for meeting the modeled energy performance for this computer analysis.											
• Whole house fan • Insulation below roof deck • Window overhangs and/or fins • Northwest Energy Efficiency Alliance (NEEA) rated heat pump water heater, specific brand/model, or equivalent, must be installed											

HERS FEATURE SUMMARY											
The following is a summary of the features that must be field-verified by a certified HERS Rater as a condition for meeting the modeled energy performance for this computer analysis. Additional detail is provided in the building tables below. Registered CF2Rs and CF3Rs are required to be completed in the HERS Registry											
• Quality insulation installation (QII) • Indoor air quality ventilation • Kitchen range hood • Whole house fan airflow and fan efficacy • Minimum Airflow • Verified SEER/SEER2 • Verified Refrigerant Charge • Fan Efficacy Watts/CFM • Verified HSPF • Verified heat pump rated heating capacity • Duct leakage testing											

BUILDING - FEATURES INFORMATION						
01	02	03	04	05	06	07
Project Name	Conditioned Floor Area (ft²)	Number of Dwelling Units	Number of Bedrooms	Number of Zones	Number of Ventilation Cooling Systems	Number of Water Heating Systems
Option # 2 Triplex Unit 2	979	1	2	1	1	1

Registration Number: 423-P010109218A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/24/2023 13:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-23 09:46:03

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Page 9 of 15

Project Name: Option # 2 Triplex Unit 2

Calculation Date/Time: 2023-06-23T22:15:10+05:30

Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit 2_MP_V9.1.rbd22x

Calculation Description: Title 24 Analysis

OVERHANGS AND FINS													
01	02	03	04	05	06	07	08	09	10	11	12	13	14
Window	Overhang				Left Fin				Right Fin				
	Depth	Dist Up	Left Extent	Right Extent	Flap Ht.	Depth	Top Up	Dist L	Bot Up	Depth	Top Up	Dist R	Bot Up
Door 1- 3068_	6	2.16	6	6	0	0	0	0	0	0	0	0	0
Window A- 4050_	6	2.16	6	6	0	0	0	0	0	0	0	0	0

SLAB FLOORS							
01	02	03	04	05	06	07	08
Name	Zone	Area (ft²)	Perimeter (ft)	Edge Insul. R-value and Depth	Edge Insul. R-value and Depth	Carpeted Fraction	Heated
Slab-on-Grade	Living Area Unit 2	979	165	none	0	80%	No
Slab-on-Grade 2	_Garage_	337.5	36.27	none	0	0%	No

OPAQUE SURFACE CONSTRUCTIONS							
01	02	03	04	05	06	07	08
Construction Name	Surface Type	Construction Type	Framing	Total Cavity R-value	Interior / Exterior Continuous R-value	U-factor	Assembly Layers
R-0 Wall + OS	Exterior Walls	Wood Framed Wall	2x6 @ 16 in. O. C.	R-0	None / None	0.343	Inside Finish: Gypsum Board Cavity / Frame: no insul. / 2x6 Exterior Finish: All Other Siding
R-21 Wall + OS	Exterior Walls	Wood Framed Wall	2x6 @ 16 in. O. C.	R-21	None / None	0.068	Inside Finish: Gypsum Board Cavity / Frame: R-13 / 2x6 Exterior Finish: All Other Siding
R-13 Wall_	Interior Walls	Wood Framed Wall					

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD										CF1R-PRF-01E	
Project Name: Option # 2 Triplex Unit 3					Calculation Date/Time: 2023-06-23T22:17:50+05:30					(Page 1 of 15)	
Calculation Description: Title 24 Analysis					Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit 3_MP_V9.1.rbd22x						
GENERAL INFORMATION											
01	Project Name		Option # 2 Triplex Unit 3				05	Standards Version		2022	
02	Run Title		Title 24 Analysis				07	Software Version		EnergyPro 9.1	
03	Project Location		Option # 2 Triplex Unit 3				09	Front Orientation (deg/ Cardinal)		All orientations	
04	City		Fresno County				11	Number of Dwelling Units		1	
06	Zip code						13	Number of Bedrooms		2	
08	Climate Zone		13				15	Number of Stories		1	
10	Building Type		Single family				17	Fenestration Average U-factor		0.3	
12	Project Scope		Newly Constructed				19	Glazing Percentage (%)		16.00%	
14	Addition Cond. Floor Area (ft²)		0								
16	Existing Cond. Floor Area (ft²)		n/a								
18	Total Cond. Floor Area (ft²)		979								
20	ADU Bedroom Count		n/a								
COMPLIANCE RESULTS											
01	Building Complies with Computer Performance										
02	This building incorporates features that require field testing and/or verification by a certified HERS rater under the supervision of a CEC-approved HERS provider.										
03	This building incorporates one or more Special Features shown below										

Registration Number: 423-P010109219A-000-000-00000000-0000
Registration Date/Time: 06/24/2023 13:36
HERS Provider: CHEERS
NOTE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance
Report Version: 2022.0.000
Schema Version: rev 20220901
Report Generated: 2023-06-23 09:48:42

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Option # 2 Triplex Unit 3

Calculation Date/Time: 2023-06-23T22:17:50+05:30

CF1R-PRF-01E

Calculation Description: Title 24 Analysis

Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit 3_MP_V9.1.rbd22x

(Page 4 of 15)

ENERGY USE SUMMARY

Energy Use	Standard Design Source Energy (EDR1) (kbtu/ft²·yr)	Standard Design TDV Energy (EDR2) (kTDV/ft²·yr)	Proposed Design Source Energy (EDR1) (kbtu/ft²·yr)	Proposed Design TDV Energy (EDR2) (kTDV/ft²·yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)
Space Heating	4.14	18.28	2.39	17.65	1.75	0.63
Space Cooling	2.34	48.95	2.29	50.45	0.05	-1.5
IAQ Ventilation	0.4	4.32	0.4	4.32	0	0
Water Heating	2.09	21.67	1.41	15.11	0.68	6.56
Self Utilization/Flexibility Credit				0		0
South Facing Efficiency Compliance Total	8.97	93.22	6.49	87.53	2.48	5.69
Space Heating	4.14	18.28	2.46	18.29	1.68	-0.01
Space Cooling	2.34	48.95	2.5	55.31	-0.16	-6.36
IAQ Ventilation	0.4	4.32	0.4	4.32	0	0
Water Heating	2.09	21.67	1.41	15.12	0.68	6.55
Self Utilization/Flexibility Credit				0		0
West Facing Efficiency Compliance Total	8.97	93.22	6.77	93.04	2.2	0.18

Registration Number: 423-P010109219A-000-000-00000000-0000
Registration Date/Time: 06/24/2023 13:36
HERS Provider: CHEERS
NOTE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance
Report Version: 2022.0.000
Schema Version: rev 20220901
Report Generated: 2023-06-23 09:48:42

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD							CF1R-PRF-01E	
Project Name: Option # 2 Triplex Unit 3			Calculation Date/Time: 2023-06-23T22:17:50+05:30				(Page 7 of 15)	
Calculation Description: Title 24 Analysis			Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit 3_MP_V9.1.rbd22x					
ZONE INFORMATION								
01	02	03	04	05	06	07		
Zone Name	Zone Type	HVAC System Name	Zone Floor Area (ft²)	Avg. Ceiling Height	Water Heating System 1	Status		
Living Area Unit 2	Conditioned	HVAC System1	979	8	DHW Sys 1	New		
OPAQUE SURFACES								
01	02	03	04	05	06	07	08	
Name	Zone	Construction	Azimuth	Orientation	Gross Area (ft²)	Window and Door Area (ft2)	Tilt (deg)	
Front Wall W	Living Area Unit 2	R-21 Wall + OS	0	Front	252	70.01	90	
Rear Wall E	Living Area Unit 2	R-21 Wall + OS	180	Back	252	52.47	90	
Right Wall S	Living Area Unit 2	R-21 Wall + OS	270	Right	261.04	0	90	
Left Wall N	Living Area Unit 2	R-21 Wall + OS	90	Left	109.04	34.47	90	
Interior Wall	Living Area Unit 2>>_Garage_	R-13 Wall	n/a	n/a	152	0	n/a	
Interior Wall 2	_Garage_>>_Garage_e_	R-13 Wall	n/a	n/a	173.04	0	n/a	
Attic Roof	Living Area Unit 2	R-38 Roof Attic + R19 BRD	n/a	n/a	979	n/a	n/a	
Attic Roof 2	_Garage_	R-0 Roof Attic	n/a	n/a	337.5	n/a	n/a	
Front Wall W 2	_Garage_	R-0 Wall + OS	0	Front	108	62.37	90	
Rear Wall E 2	_Garage_	R-0 Wall + OS	180	Back	108	0	90	
Right Wall S 2	_Garage_	R-0 Wall + OS	270	Right	48	0	90	
Left Wall N 2	_Garage_	R-0 Wall + OS	90	Left	26.96	0	90	
ATTIC								
01	02	03	04	05	06	07	08	
Name	Construction	Type	Roof Rise (x in 12)	Roof Reflectance	Roof Emittance	Radiant Barrier	Cool Roof	
Attic_>_Garage_	Attic Garage Roof Cons	Ventilated	4	0.1	0.85	No	No	
Attic Living Area Unit 2	Attic Roof/Living Area Unit 2	Ventilated	4	0.1	0.85	No	No	

Registration Number: 423-P010109219A-000-000-00000000-0000
Registration Date/Time: 06/24/2023 13:36
HERS Provider: CHEERS
NOTE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance
Report Version: 2022.0.000
Schema Version: rev 20220901
Report Generated: 2023-06-23 09:48:42

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Option # 2 Triplex Unit 3

Calculation Date/Time: 2023-06-23T22:17:50+05:30

CF1R-PRF-01E

Calculation Description: Title 24 Analysis

Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit 3_MP_V9.1.rbd22x

(Page 2 of 15)

ENERGY DESIGN RATINGS

	Energy Design Ratings			Compliance Margins		
	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)	Source Energy (EDR1)	Efficiency ³ EDR (EDR2efficiency)	Total ² EDR (EDR2total)
Standard Design	37.3	41.4	34.3			
Proposed Design						
North Facing	31.8	38.5	32.5	5.5	2.9	1.8
East Facing	32.2	40.7	33.9	5.1	0.7	0.4
South Facing	31.7	38.9	32.8	5.6	2.5	1.5
West Facing	32.3	41.3	34.3	5	0.1	0
RESULT ³ : PASS						

¹Efficiency EDR includes improvements like a better building envelope and more efficient equipment

²Total EDR includes efficiency and demand response measures such as photovoltaic (PV) system and batteries

³Building complies when source energy, efficiency and total compliance margins are greater than or equal to zero and unmet load hour limits are not exceeded

- Standard Design PV Capacity: 2.67 kWdc
- Proposed PV Capacity Scaling: North (2.67 kWdc) East (2.67 kWdc) South (2.67 kWdc) West (2.67 kWdc)

Registration Number: 423-P010109219A-000-000-00000000-0000
Registration Date/Time: 06/24/2023 13:36
HERS Provider: CHEERS
NOTE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance
Report Version: 2022.0.000
Schema Version: rev 20220901
Report Generated: 2023-06-23 09:48:42

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Option # 2 Triplex Unit 3

Calculation Date/Time: 2023-06-23T22:17:50+05:30

CF1R-PRF-01E

Calculation Description: Title 24 Analysis

Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit 3_MP_V9.1.rbd22x

(Page 5 of 15)

ENERGY USE INTENSITY

	Standard Design (kbtu/ft ² ·yr)	Proposed Design (kbtu/ft ² ·yr)	Compliance Margin (kbtu/ft ² ·yr)	Margin Percentage
North Facing				
Gross EU1 ¹	25.31	21.63	3.68	14.54
Net EU2 ²	10.54	6.87	3.67	34.82
East Facing				
Gross EU1 ¹	25.31	22.02	3.29	13
Net EU2 ²	10.54	7.25	3.29	31.21
South Facing				
Gross EU1 ¹	25.31	21.52	3.79	14.97
Net EU2 ²	10.54	6.75	3.79	35.96
West Facing				
Gross EU1 ¹	25.31	22.05	3.26	12.88
Net EU2 ²	10.54	7.28	3.26	30.93

Notes

1. Gross EU1 is Energy Use Total (not including PV) / Total Building Area.

2. Net EU1 is Energy Use Total (including PV) / Total Building Area.

Registration Number: 423-P010109219A-000-000-00000000-0000
Registration Date/Time: 06/24/2023 13:36
HERS Provider: CHEERS
NOTE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance
Report Version: 2022.0.000
Schema Version: rev 20220901
Report Generated: 2023-06-23 09:48:42

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Option # 2 Triplex Unit 3

Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-06-23T22:17:50+05:30

Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit 3_MP_V9.1.rbd22x

CF1R-PRF-01E

(Page 8 of 15)

FENESTRATION / GLAZING

01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Type	Surface	Orientation	Azimuth	Width (ft)	Height (ft)	Mult.	Area (ft²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading
Door 1- 3068_	Window	Front Wall W	Front	0	3	6.67	1	20.01	0.3	NFRC	0.23	NFRC	Bug Screen
Window A- 4050_	Window	Front Wall W	Front	0	4	5	1	20	0.3	NFRC	0.23	NFRC	Bug Screen
Window B- 3050_	Window	Front Wall W	Front	0	3	5	1	15	0.3	NFRC	0.23	NFRC	Bug Screen
Window B- 3050_ 2	Window	Front Wall W	Front	0	3	5	1	15	0.3	NFRC	0.23	NFRC	Bug Screen
Window C- 3030_	Window	Rear Wall E	Back	180			1	9	0.3	NFRC	0.23	NFRC	Bug Screen
Window C- 3030_ 2	Window	Rear Wall E	Back	180			1	9	0.3	NFRC	0.23	NFRC	Bug Screen
Door 7A- 5861_	Window	Rear Wall E	Back	180			1	34.47	0.3	NFRC	0.23	NFRC	Bug Screen
Door B- 5861_	Window	Left Wall N	Left	90			1	34.47	0.3	NFRC	0.23	NFRC	Bug Screen

OPAQUE DOORS

01	02	03	04
Name	Side of Building	Area (ft²)	U-factor
Door 2- 90611_	Front Wall W 2	62.37	0.7

7/4/2023 10:58:02 AM
24" X 36"

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Option # 2 Triplex Unit 3
Calculation Description: Title 24 Analysis

CF1R-PRF-01E
(Page 10 of 15)

Calculation Date/Time: 2023-06-23T22:17:50+05:30
Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit
3_MP_V9.1.rbd22x

01	02	03	04	05	06	07	08
Construction Name	Surface Type	Construction Type	Framing	Total Cavity R-value	Interior / Exterior Continuous R-value	U-factor	Assembly Layers
R-13 Wall_	Interior Walls	Wood Framed Wall	2x4 @ 16 in. O.C.	R-13	None / None	0.092	Inside Finish: Gypsum Board Cavity / Frame: R-13 / 2x4 Other Side Finish: Gypsum Board
R-13 Wall	Interior Walls	Wood Framed Wall	2x4 @ 16 in. O.C.	R-13	None / None	0.092	Inside Finish: Gypsum Board Cavity / Frame: R-13 / 2x4 Other Side Finish: Gypsum Board
Attic Garage Roof Cons	Attic Roofs	Wood Framed Ceiling	2x4 @ 24 in. O.C.	R-0	None / 0	0.644	Roofing: Light Roof (Asphalt Shingle) Roof Deck: Wood Siding/sheathing/decking Cavity / Frame: no insul. / 2x4
Attic Roof Living Area Unit 2	Attic Roofs	Wood Framed Ceiling	2x4 @ 24 in. O.C.	R-19	None / 0	0.059	Roofing: Light Roof (Asphalt Shingle) Roof Deck: Wood Siding/sheathing/decking Cavity / Frame: R-13.0 / 2x4 Around Roof Joists: R-6.0 Insul.
R-0 Roof Attic	Ceilings (below attic)	Wood Framed Ceiling	2x4 @ 24 in. O.C.	R-0	None / None	0.481	Cavity / Frame: no insul. / 2x4 Inside Finish: Gypsum Board
R-38 Roof Attic + R19 BRD	Ceilings (below attic)	Wood Framed Ceiling	2x4 @ 24 in. O.C.	R-38	None / None	0.025	Over Ceiling Joists: R-28.9 Insul. Cavity / Frame: R-5.1 / 2x4 Inside Finish: Gypsum Board

BUILDING ENVELOPE - HERS VERIFICATION

01	02	03	04	05
Quality Insulation Installation (QII)	High R-value Spray Foam Insulation	Building Envelope Air Leakage	CFM50	CFM50
Required	Not Required	N/A	n/a	n/a

Registration Number: 423-P010109219A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/24/2023 13:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-23 09:48:42

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Option # 2 Triplex Unit 3
Calculation Description: Title 24 Analysis

CF1R-PRF-01E
(Page 11 of 15)

Calculation Date/Time: 2023-06-23T22:17:50+05:30
Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit
3_MP_V9.1.rbd22x

01	02	03	04	05	06	07	08	09
Name	System Type	Distribution Type	Water Heater Name	Number of Units	Solar Heating System	Compact Distribution	HERS Verification	Water Heater Name (H)
DHW Sys 1	Domestic Hot Water (DHW)	Standard	DHW Heater 1	1	n/a	None	n/a	DHW Heater 1 (1)

WATER HEATERS - NEEA HEAT PUMP

01	02	03	04	05	06	07	08
Name	# of Units	Tank Vol. (gal)	NEEA Heat Pump Brand	NEEA Heat Pump Model	Tank Location	Duct Inlet Air Source	Duct Outlet Air Source
DHW Heater 1	1	50	Rheem	RheemPROPH50TR H37315	Garage_	Garage_	Garage_

WATER HEATING - HERS VERIFICATION

01	02	03	04	05	06	07
Name	Pipe Insulation	Parallel Piping	Compact Distribution	Compact Distribution Type	Recirculation Control	Shower Drain Water Heat Recovery
DHW Sys 1 - 1/1	Not Required	Not Required	Not Required	None	Not Required	Not Required

SPACE CONDITIONING SYSTEMS

01	02	03	04	05	06	07	08	09
Name	System Type	Heating Unit Name	Heating Equipment Count	Cooling Unit Name	Cooling Equipment Count	Fan Name	Distribution Name	Required Thermostat Type
HVAC System1	Heat pump heating cooling	Heat Pump System 1	1	Heat Pump System 1	1	HVAC Fan 1	Air Distribution System 1	Setback

Registration Number: 423-P010109219A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/24/2023 13:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-23 09:48:42

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Option # 2 Triplex Unit 3
Calculation Description: Title 24 Analysis

CF1R-PRF-01E
(Page 12 of 15)

Calculation Date/Time: 2023-06-23T22:17:50+05:30
Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit
3_MP_V9.1.rbd22x

01	02	03	04	05	06	07	08	09	10	11	12	13
Name	System Type	Number of Units	Efficiency Type	HSPF / HSPF2 / COP	Cap 47	Cap 17	Efficiency Type	SEER / SEER2	EER / EER / CEER	Zonally Controlled	Compressor Type	HERS Verification
Heat Pump System 1	Central split HP	1	HSPF	9	30000	24000	EERSEER	16.85	11.7	Not Zonal	Single Speed	Heat Pump System 1-hers-htpump

HVAC HEAT PUMPS - HERS VERIFICATION

01	02	03	04	05	06	07	08	09
Name	Verified Airflow	Airflow Target	Verified EER/SEER2	Verified SEER/SEER2	Verified Refrigerant Charge	Verified HSPF/HSPF2	Verified Heating Cap 47	Verified Heating Cap 17
Heat Pump System 1-hers-htpump	Required	350	Not Required	Required	Yes	Yes	Yes	Yes

HVAC - DISTRIBUTION SYSTEMS

01	02	03	04	05	06	07	08	09	10	11	12
Name	Type	Design Type	Duct Ins. R-value Supply	Duct Ins. R-value Return	Duct Location Supply	Duct Location Return	Surface Area Supply	Surface Area Return	Bypass Duct	Duct Leakage	HERS Verification
Air Distribution System 1	Unconditioned attic	Non-Verified	R-8	R-8	Attic	Attic	n/a	n/a	No Bypass Duct	Sealed and Tested	Air Distribution System 1-hers-dist

Registration Number: 423-P010109219A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/24/2023 13:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-23 09:48:42

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Option # 2 Triplex Unit 3
Calculation Description: Title 24 Analysis

CF1R-PRF-01E
(Page 14 of 15)

Calculation Date/Time: 2023-06-23T22:17:50+05:30
Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit
3_MP_V9.1.rbd22x

01	02	03	04	05	06	07	08	09
Name	Airflow Rate (CFM/H2)	Cooling Vent CFM	Cooling Vent Watts/CFM	Total Watts	Number of Fans	CFVCS Type	Exhausts to	HERS Verification
WH Fan 1	2.45	2400	0.1187	285	1	Not a CFVCS	Outside	Required

CHEERS

Registration Number: 423-P010109219A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/24/2023 13:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-23 09:48:42

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Option # 2 Triplex Unit 3
Calculation Description: Title 24 Analysis

CF1R-PRF-01E
(Page 15 of 15)

Calculation Date/Time: 2023-06-23T22:17:50+05:30
Input File Name: 2023_13 TRIPLEX DWELLING UNIT_OPTION 2_Unit
3_MP_V9.1.rbd22x

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT

1. I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: Viranchi Shah
Company: www.gettitle24.com
Address: 14730 Beach Blvd., #133
City/State/Zip: La Mirada, CA 90638

Documentation Author Signature: Viranchi Shah
Signature Date: 06/24/2023
Address: 14730 Beach Blvd., #133
City/State/Zip: La Mirada, CA 90638

Responsible Designer Name: Robina Wright
Company: Robina Wright Architects and Associates
Address: 4025 N. Fresno Suite 107
City/State/Zip: Fresno, CA 93726

Responsible Designer Signature: Robina Wright
Signature Date: 06/24/2023
Address: 4025 N. Fresno Suite 107
City/State/Zip: Fresno, CA 93726

Registration Number: 423-P010109219A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/24/2023 13:36
Report Version: 2022.0.000
Schema Version: rev 20220901


HERS Provider: CHEERS
Report Generated: 2023-06-23 09:48:42

TRIPLEX DWELLING UNIT

OPTION
#2

PROJECT

TRIPLEX
DWELLING UNIT

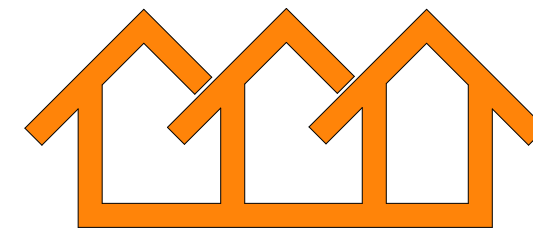

PWP23-005


DEPARTMENT OF PUBLIC
WORKS AND PLANNING



CAPITAL PROJECTS
DIVISION

2220 Tulare St., Ste. 720, Fresno, CA. 93721
Phone: (559) 262-4212 Fax: (559) 262-4879

SEAL & SIGNATURE

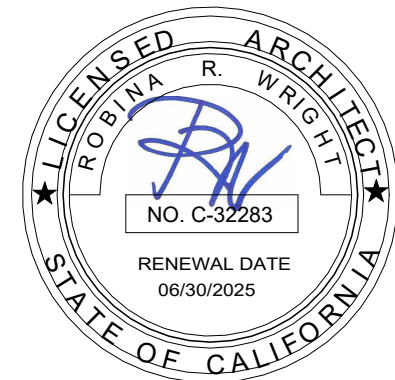

UPDATE

JUNE 30, 2023

THESE DRAWINGS AND SPECIFICATIONS
ARE THE PROPERTY AND COPYRIGHT OF
THE ARCHITECT AND SHALL NOT BE
USED ON ANY OTHER PROJECT OR
LOCATIONS EXCEPT AS DESCRIBED ON
THE DRAWINGS WITHOUT WRITTEN
AGREEMENT WITH THE ARCHITECT.

TITLE

TITLE 24 ENERGY
COMPLIANCE

SCALE

T24-3.2

ISSUE DATE	JOB NUMBER
MARCH 7, 2023	2023_11
DRAWN BY	CHECKED BY
Author	Checker

RESIDENTIAL MEASURES SUMMARY										RMS-1
Project Name		Building Type		<input checked="" type="checkbox"/> Single Family <input type="checkbox"/> Multi Family		<input type="checkbox"/> Addition Alone <input type="checkbox"/> Existing+ Addition/Alteration		Date		24-06-2023
Option # 2 Triplex Unit 2		California Energy Climate Zone		CA Climate Zone 13		Total Cond. Floor Area		Addition		# of Units
Option # 2 Triplex Unit 2 Fresno County						979		n/a		1
INSULATION										
Construction Type		Cavity		Area (ft ²)		Special Features		Status		
Wall	Wood Framed	R 20		944				New		
Demising	Wood Framed	R 13		325				New		
Slab	Unheated Slab-on-Grade	- no insulation		979		Perim = 165'		New		
Roof	Wood Framed Attic	R 38		979		Add=R-19.0		New		
FENESTRATION										
Orientation		Area(ft ²)		U-Fac		SHGC		Overhang		Sidefins
										Exterior Shades
										Status
Front (W)	20.0	0.300		0.23		6.0		none		N/A
Front (W)	20.0	0.300		0.23		6.0		none		N/A
Front (W)	30.0	0.300		0.23		none		none		N/A
Rear (E)	18.0	0.300		0.23		none		none		N/A
Rear (E)	34.5	0.300		0.23		none		none		N/A
Left (N)	34.5	0.300		0.23		none		none		N/A
HVAC SYSTEMS										
Qty.		Heating		Min. Eff		Cooling		Min. Eff		Thermostat
1		Electric Heat Pump		9.00 HSPF		Split Heat Pump		16.9 SEER		Setback
										New
HVAC DISTRIBUTION										
Location		Heating		Cooling		Duct Location		Duct R-Value		Status
HVAC System		Ducted		Ducted		Attic		8.0		New
WATER HEATING										
Qty.		Type		Gallons		Min. Eff		Distribution		Status
1		Heat Pump		50		3.20		Standard		New
EnergyPro 9.1 by EnergySoft User Number: 3835 ID: 2023_13_1469 Page 18 of 24										

2022 Single-Family Residential Mandatory Requirements Summary									
§ 150.0(k)(1): Screw based luminaires. Screw based luminaires must contain lamps that comply with Reference Joint Appendix JA8. *									
§ 150.0(k)(1)H: Light Sources in Enclosed or Recessed Luminaires. Lamps and other separable light sources that are not compliant with the JA8 elevated temperature requirements, including marking requirements, must not be installed in enclosed or recessed luminaires.									
§ 150.0(k)(1): Light Sources in Drawers, Cabinets, and Linen Closets. Light sources internal to drawers, cabinetry or linen closets are not required to comply with Table 150.0-A or be controlled by vacancy sensors provided that they are rated to consume no more than 5 watts of power, emit no more than 150 lumens, and are equipped with controls that automatically turn the lighting off when the drawer, cabinet or linen closet is closed.									
§ 150.0(k)(2A): Interior Switches and Controls. All forward phase cut dimmers used with LED light sources must comply with NEMA SSL 7A.									
§ 150.0(k)(2B): Interior Switches and Controls. Exhaust fans must be controlled separately from lighting systems. *									
§ 150.0(k)(2A): Accessible Controls. Lighting must have readily accessible wall-mounted controls that allow the lighting to be manually turned on and off. *									
§ 150.0(k)(2B): Multiple Controls. Controls must not bypass a dimmer, occupant sensor, or vacancy sensor function if the dimmer or sensor is installed to comply with § 150.0(k).									
§ 150.0(k)(2C): Mandatory Requirements. Lighting controls must comply with the applicable requirements of § 110.9.									
§ 150.0(k)(2D): Energy Management Control Systems. An energy management control system (EMCS) may be used to comply with dimming, occupancy, and control requirements if it provides the functionality of the specified control per § 110.9 and the physical controls specified in § 150.0(k)(2A).									
§ 150.0(k)(2E): Automatic Shutoff Controls. In bathrooms, laundry rooms, utility rooms and walk-in closets, at least one installed luminaire must be controlled by an occupancy or vacancy sensor providing automatic-off functionality. Lighting inside drawers and cabinets with opaque fronts or doors must have controls that turn the light off when the drawer or door is closed.									
§ 150.0(k)(2F): Dimmers. Lighting in habitable spaces (e.g., living rooms, dining rooms, kitchens, and bedrooms) must have readily accessible wall-mounted dimming controls that allow the lighting to be manually adjusted up and down. Forward phase cut dimmers controlling LED light sources in these spaces must comply with NEMA SSL 7A.									
§ 150.0(k)(2G): Independent controls. Integrated lighting of exhaust fans shall be controlled independently from the fans. Lighting under cabinets or shelves, lighting in display cabinets, and switched outlets must be controlled separately from ceiling-installed lighting.									
§ 150.0(k)(3A): Residential Outdoor Lighting. For single-family residential buildings, outdoor lighting permanently mounted to a residential building, or to other buildings on the same lot, must have a manual on/off switch and either a photo cell and motion sensor or automatic time switch control) or an astronomical time clock. An energy management control system that provides the specified control functionality and meets all applicable requirements may be used to meet these requirements.									
§ 150.0(k)(4): Internally Illuminated address signs. Internally illuminated address signs must either comply with § 140.8 or consume no more than 5 watts of power.									
§ 150.0(k)(5): Residential Garages for Eight or More Vehicles. Lighting for residential parking garages for eight or more vehicles must comply with the applicable requirements for nonresidential garages in §§ 110.9, 130.0, 130.1, 130.4, 140.6, and 141.0.									
Solar Readiness:									
§ 110.10(a)(1): Single-Family Residences. Single-family residences located in subdivisions with 10 or more single-family residences and where the application for a tentative subdivision map for the residences has been deemed complete and approved by the enforcement agency, which do not have a photovoltaic system installed, must comply with the requirements of § 110.10(b)-(e).									
§ 110.10(b)(1A): Minimum Solar Zone Area. The solar zone must have a minimum total area as described below. The solar zone must comply with access, pathway, smoke ventilation, and spacing requirements as specified in Title 24, Part 9 or other parts of Title 24 or in any requirements adopted by a local jurisdiction. The solar zone total area must be comprised of areas that have no dimension less than 5 feet and are no less than 80 square feet each for buildings with roof areas less than or equal to 10,000 square feet or no less than 160 square feet each for buildings with roof areas greater than 10,000 square feet. For single-family residences, the solar zone must be located on the roof or overhang of the building and have a total area no less than 250 square feet. *									
§ 110.10(b)(2): Azimuth. All sections of the solar zone located on steep-sloped roofs must have an azimuth between 90-300° of true north.									
§ 110.10(b)(3A): Shading. The solar zone must not contain any obstructions, including but not limited to: vents, chimneys, architectural features, and roof mounted equipment.									
§ 110.10(b)(3B): Shading. Any obstruction located on the roof or any other part of the building that projects above a solar zone must be located at least twice the horizontal distance of the height difference between the highest point of the obstruction and the horizontal projection of the nearest point of the solar zone, measured in the vertical plane. *									
§ 110.10(b)(4): Structural Design Loads on Construction Documents. For areas of the roof designated as a solar zone, the structural design loads for roof dead load and roof live load must be clearly indicated on the construction documents.									
§ 110.10(c): Interconnection Pathways. The construction documents must indicate: a location reserved for inverters and metering equipment and a pathway reserved for routing of conduit from the solar zone to the point of interconnection with the electrical service; and for single-family residences and central water-heating systems, a pathway reserved for routing plumbing from the solar zone to the water-heating system.									
§ 110.10(d): Documentation. A copy of the construction documents or a comparable document indicating the information from § 110.10(b)-(c) must be provided to the occupant.									
§ 110.10(e)(1): Main Electrical Service Panel. The main electrical service panel must have a minimum busbar rating of 200 amps.									
§ 110.10(e)(2): Main Electrical Service Panel. The main electrical service panel must have a reserved space to allow for the installation of a double pole circuit breaker for a future solar electric installation. The reserved space must be permanently marked as "For Future Solar Electric."									
Electric and Energy Storage Ready:									

5/8/22

7/14/2023 10:38:07 AM
24" X 36"

2022 Single-Family Residential Mandatory Requirements Summary	
NOTE: Single-family residential buildings subject to the Energy Codes must comply with all applicable mandatory measures, regardless of the compliance approach used. Review the respective section for more information.	
(04/2022)	
Building Envelope:	
§ 110.6(a)(1):	Air Leakage. Manufactured fenestration, exterior doors, and exterior pet doors must limit air leakage to 0.3 CFM per square foot or less when tested per NFRC-400, ASTM E283, or AAMA/WDMA/CSA 1011.5.2-2440-2011. *
§ 110.6(a)(5):	Labeling. Fenestration products and exterior doors must have a label meeting the requirements of § 10-111(a).
§ 110.6(b):	Field fabricated exterior doors and fenestration products must use U-factors and solar heat gain coefficient (SHGC) values from Tables 110.6-A, 110.6-B, or JA 5 for exterior doors. They must be caulked and/or weatherstripped.
§ 110.7:	Air Leakage. All joints, penetrations, and other openings in the building envelope that are potential sources of air leakage must be caulked, gasketed, or weatherstripped.
§ 110.8(a):	Insulation Certification by Manufacturers. Insulation must be certified by the Department of Consumer Affairs, Bureau of Household Goods and Services (BHGS).
§ 110.8(g):	Insulation Requirements for Heated Slab Floors. Heated slab floors must be insulated per the requirements of § 110.8(g).
§ 110.8(i):	Roofing Products Solar Reflectance and Thermal Emittance. The thermal emittance and aged solar reflectance values of the roofing material must meet the requirements of § 110.8(i) and be labeled per §10-113 when the installation of a cool roof is specified on the CF-IR.
§ 110.8(j):	Radiant Barrier. When required, radiant barriers must have an emittance of 0.05 or less and be certified to the Department of Consumer Affairs.
§ 150.0(a):	Roof Deck, Ceiling and Rafter Roof Insulation. Roof decks in newly constructed attics in climate zones 4 and 8-16 area-weighted average U-Factor not exceeding U-0.184. Ceiling and rafter roofs minimum R-22 insulation in wood-frame ceiling, or area-weighted average U-Factor must not exceed 0.043. Rafter roof alterations minimum R-19 or area-weighted average U-Factor of 0.054 or less. Attic access doors must have permanently attached insulation using adhesive or mechanical fasteners. The attic access must be gasketed to prevent air leakage. Insulation must be installed in direct contact with a rafter or ceiling which is sealed to limit infiltration and exfiltration, as specified in § 110.7, including but not limited to placing insulation either above or below the roof deck or on top of a drywall ceiling.
§ 150.0(b):	Loose-fill Insulation. Loose fill insulation must meet the manufacturer's required density for the labeled R-value.
§ 150.0(c):	Wall Insulation. Minimum R-13 insulation in 2x4 inch wood framing wall or have a U-Factor of 0.102 or less, or R-20 in 2x6 inch wood framing or have a U-Factor of 0.071 or less. Opaque non-frame assemblies must have an overall assembly U-Factor not exceeding 0.102. Masonry walls must meet Tables 150.1-A or B. *
§ 150.0(d):	Raised-floor Insulation. Minimum R-19 insulation in raised wood framed floor or 0.037 maximum U-Factor. *
§ 150.0(f):	Slab Edge Insulation. Slab edge insulation must meet all of the following: have a water absorption rate, for the insulation material alone without facings, no greater than 0.3 percent; have a water vapor permeance no greater than 2.0 perm per inch; be protected from physical damage and UV light deterioration; and, when installed as part of a heated slab floor, meet the requirements of § 110.8(g).
§ 150.0(g)(1):	Vapor Retarder. In climate zones 1 through 16, the earth floor of unvented craw space must be covered with a Class I or Class II vapor retarder. This requirement also applies to controlled ventilation craw space for buildings complying with the exception to §150.0(g).
§ 150.0(g)(2):	Vapor Retarder. In climate zones 14 and 16, a Class I or Class II vapor retarder must be installed on the conditioned space side of all insulation in all exterior walls, vented attics, and unvented attics with air-permeable insulation.
§ 150.0(i):	Fenestration Products. Fenestration, including skylights, separating conditioned space from unconditioned space or outdoors must have a maximum U-Factor of 0.45, or area-weighted average U-Factor of all fenestration must not exceed 0.45.
Fireplaces, Decorative Gas Appliances, and Gas Log:	
§ 110.5(e):	Pilot Light. Continuously burning pilot lights are not allowed for indoor and outdoor fireplaces.
§ 150.0(e)(1):	Closable Doors. Masonry or factory-built fireplaces must have a closable metal or glass door covering the entire opening of the firebox.
§ 150.0(e)(2):	Combustion Intake. Masonry or factory-built fireplaces must have a combustion outside air intake, which is at least six square inches in area and is equipped with a readily accessible, operable, and light-fitting damper or combustion-air control device.
§ 150.0(e)(3):	Flue Damper. Masonry or factory-built fireplaces must have a flue damper with a readily accessible control. *
Space Conditioning, Water Heating, and Plumbing System:	
§ 110.9-§ 110.3:	Certification. Heating, ventilation, and air conditioning (HVAC) equipment, water heaters, showerheads, faucets, and all other regulated appliances must be certified by the manufacturer to the California Energy Commission. *
§ 110.2(a):	HVAC Efficiency. Equipment must meet the applicable efficiency requirements in Table 110.2-A through Table 110.2-N. *
§ 110.2(b):	Controls for Heat Pumps with Supplementary Electric Resistance Heaters. Heat pumps with supplementary electric resistance heaters must have controls that prevent supplementary heater operation when the heating load can be met by the heat pump alone; and in which the cut-on temperature for compression heating is higher than the cut-off temperature for supplementary heating, and the cut-off temperature for compression heating is higher than the cut-off temperature for supplementary heating.
§ 110.2(c):	Thermostats. All heating or cooling systems not controlled by a central energy management control system (EMCS) must have a setback thermostat. *
§ 110.3(c)(3):	Insulation. Unfired service water heater storage tanks and solar water-heating backup tanks must have adequate insulation, or tank surface heat loss rating.
§ 110.3(c)(6):	Isolation Valves. Instantaneous water heaters with an input rating below than 5.8 kBtu per hour (2.3kW) must have isolation valves with hose bibbs or other fittings on both cold and hot water lines to allow for flushing the water heater when the valves are closed.

RESIDENTIAL MEASURES SUMMARY										RMS-1
Project Name Option # 2 Triplex Unit 3		Building Type <input checked="" type="checkbox"/> Single Family <input type="checkbox"/> Multi Family <input type="checkbox"/> Existing+ Addition/Alteration			Date 24-06-2023			# of Units 1		
Project Address Option # 2 Triplex Unit 3 Fresno County		California Energy Climate Zone CA Climate Zone 13		Total Cond. Floor Area 979		Addition n/a				
INSULATION		Area		Special Features		Status				
Construction Type	Cavity	(ft ²)								
Wall	Wood Framed	R 20	717			New				
Demising	Wood Framed	R 13	152			New				
Slab	Unheated Slab-on-Grade	- no Insulation	979 Perim = 165'			New				
Roof	Wood Framed Attic	R 38	979 Add-R-19.0			New				